
	<b>Test Case Name</b>	Reinitiate Rejected Schedule Test
	<b>Test Case Number</b>	PSS-LIMS-011
	<b>Actual Result</b>	Pass

1.Enter the username, password, Select Module and click on login button


SSNo : PSS-LIMS-SS-001

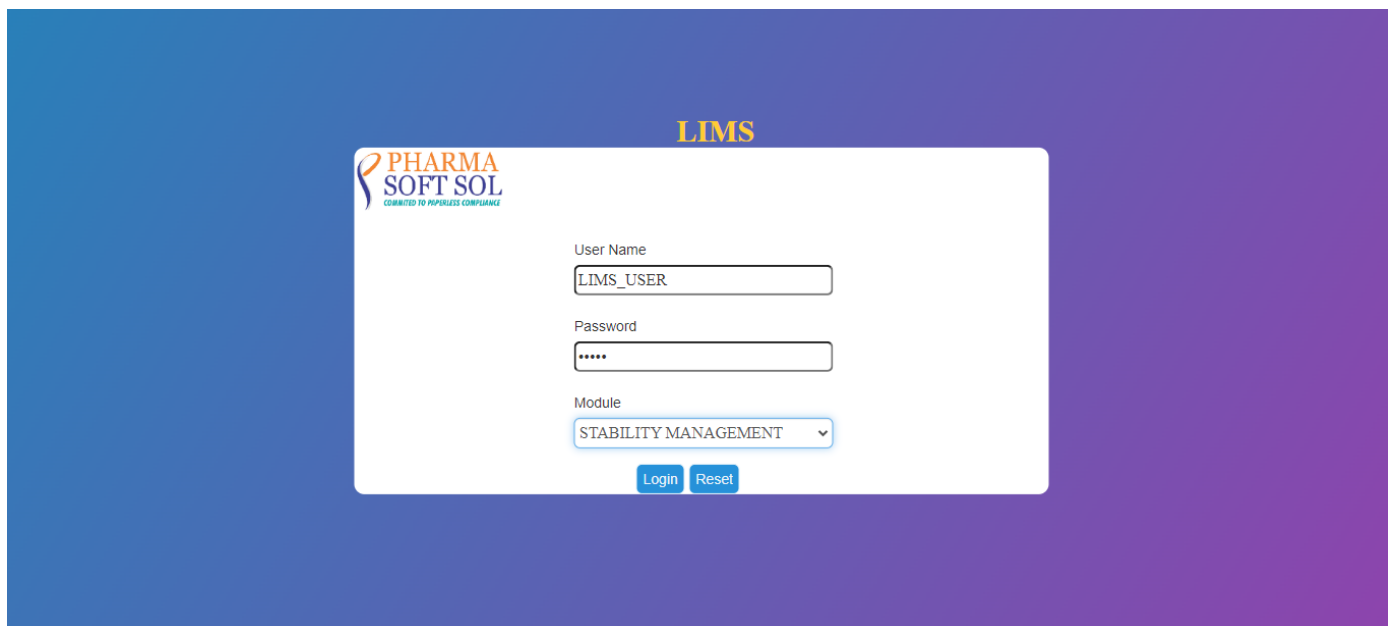

The screenshot shows the LIMS login interface. At the top, the 'LIMS' title is displayed in yellow. Below it, the PharmaSoftSol logo is visible. The login form contains three input fields: 'User Name' with the value 'LIMS\_USER', 'Password' with masked characters '\*\*\*\*\*', and 'Module' with a dropdown menu set to 'STABILITY MANAGEMENT'. At the bottom of the form are two buttons: 'Login' and 'Reset'.

2.Click on Schedule Test


SSNo : PSS-LIMS-SS-002

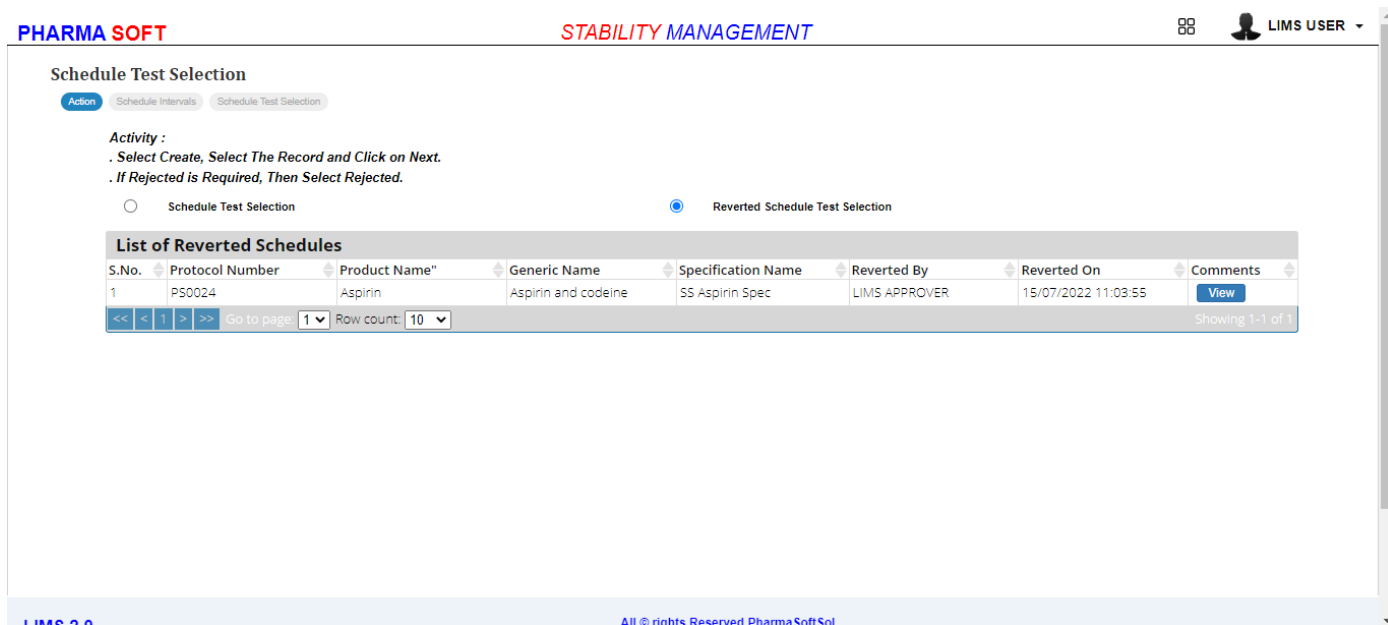

The screenshot displays the 'Schedule Test Selection' screen within the 'STABILITY MANAGEMENT' module. The page header includes the PharmaSoftSol logo, the module name, and a user profile for 'LIMS USER'. The main content area has three tabs: 'Action', 'Schedule Intervals', and 'Schedule Test Selection', with the third tab being active. Below the tabs, an 'Activity' section provides instructions: '. Select Create, Select The Record and Click on Next.' and '. If Rejected is Required, Then Select Rejected.' Two radio buttons are present: 'Schedule Test Selection' (unselected) and 'Reverted Schedule Test Selection' (selected). A table titled 'List of Reverted Schedules' contains one record with the following details:

S.No.	Protocol Number	Product Name"	Generic Name	Specification Name	Reverted By	Reverted On	Comments
1	PS0024	Aspirin	Aspirin and codeine	SS Aspirin Spec	LIMS APPROVER	15/07/2022 11:03:55	<a href="#">View</a>

Below the table, there are pagination controls: '<<' '<' '1' '>' '>>', 'Go to page: 1', 'Row count: 10', and 'Showing 1-1 of 1'. The footer of the application shows 'LIMS 2.0' and 'All © rights Reserved PharmaSoftSol'.

	<b>Test Case Name</b>	Reinitiate Rejected Schedule Test
	<b>Test Case Number</b>	PSS-LIMS-011
	<b>Actual Result</b>	Pass

### 3.Select a Record

SSNo : PSS-LIMS-SS-003

**PHARMA SOFT**
**STABILITY MANAGEMENT**
LIMS USER

#### Schedule Test Selection

Action
Schedule Intervals
Schedule Test Selection

Activity :

- . Select Create, Select The Record and Click on Next.
- . If Rejected is Required, Then Select Rejected.

☐ Schedule Test Selection
 ☒ Reverted Schedule Test Selection

##### List of Reverted Schedules

S.No.	Protocol Number	Product Name*	Generic Name	Specification Name	Reverted By	Reverted On	Comments
1	PS0024	Aspirin	Aspirin and codeine	SS Aspirin Spec	LIMS APPROVER	15/07/2022 11:03:55	<a href="#">View</a>

<<
<
1
>
>>
Go to page
1
Row count:
10
Showing 1-1 of 1

**IMS 2.0**
All © rights Reserved PharmaSoftSol

### 4.Click on Next

SSNo : PSS-LIMS-SS-004

**PHARMA SOFT**
**STABILITY MANAGEMENT**
LIMS USER

#### Schedule Test Selection

Action
Schedule Intervals
Schedule Test Selection

Reverted On

15/07/2022 11:03:55

Comments

[View](#)

Showing 1-1 of 1


. Select The Record and Click On Next.

. Select The Record and Click On Next.

##### Schedule Storage Conditions

<input type="checkbox"/>	S.No	Packing Type	Batch Number	Batch Size	Mfg.Date	Exp.Date	Storage Conditions	S
<input type="checkbox"/>	1		44	10	02-11-2020	02-11-2021		

**IMS 2.0**
All © rights Reserved PharmaSoftSol

 <b>PHARMA SOFT SOL</b> <small>COMMITTED TO PAPERLESS COMPLIANCE</small>	<b>Test Case Name</b>	Reinitiate Rejected Schedule Test
	<b>Test Case Number</b>	PSS-LIMS-011
	<b>Actual Result</b>	Pass

## 5.Select a Record

SSNo : PSS-LIMS-SS-005

**PHARMA SOFT**
**STABILITY MANAGEMENT**
LIMS USER

### Schedule Test Selection

Action
Schedule Intervals
Schedule Test Selection

. Select The Record and Click On Next.  
. Select The Record and Click On Next.

Schedule Storage Conditions									
<input type="checkbox"/>	S.No	Packing Type	Batch Number	Batch Size	Mfg.Date	Exp.Date	Storage Conditions	Stability Conditions	Schedule Interval Type
<input checked="" type="checkbox"/>	1	Box	44	10	02-11-2020	02-11-2021	40°C ± 2°C / 75%	ACCELERATED	MONTH

IMS 2.0
All © rights Reserved PharmaSoftSol

## 6.Click on Next

SSNo : PSS-LIMS-SS-006

**PHARMA SOFT**
**STABILITY MANAGEMENT**
LIMS USER

### Schedule Test Selection

Action
Schedule Intervals
Schedule Test Selection

. Select The Test, Select Approval Life Cycle and Click On Finish.  
. Enter E-Signature Password and Click On Submit.  
. Modify The Required Fields and Click On Finish.  
. Enter E-Signature Password and Click On Submit.

Set1

Packing Type: Box
Product Batch No: 44


Storage Conditions: 40°C ± 2°C / 75%RH ± 5%RH
Schedule Interval Type: MONTH

Stability Condition: ACCELERATED
Orientation: UP RIGHT

Interval and Test Details		
S.No	Test Name	1
1	Descriptive	<input checked="" type="checkbox"/>
2	Loss On Dry	<input checked="" type="checkbox"/>
S.No		1
1	Number of Syringes required at Each Point	50


Approval Life Cycle\*: Approval Life Cycle
View

IMS 2.0
All © rights Reserved PharmaSoftSol

 <b>PHARMA SOFT SOL</b> <small>COMMITTED TO PAPERLESS COMPLIANCE</small>	<b>Test Case Name</b>	Reinitiate Rejected Schedule Test
	<b>Test Case Number</b>	PSS-LIMS-011
	<b>Actual Result</b>	Pass

7. Click on Finish

SSNo : PSS-LIMS-SS-007

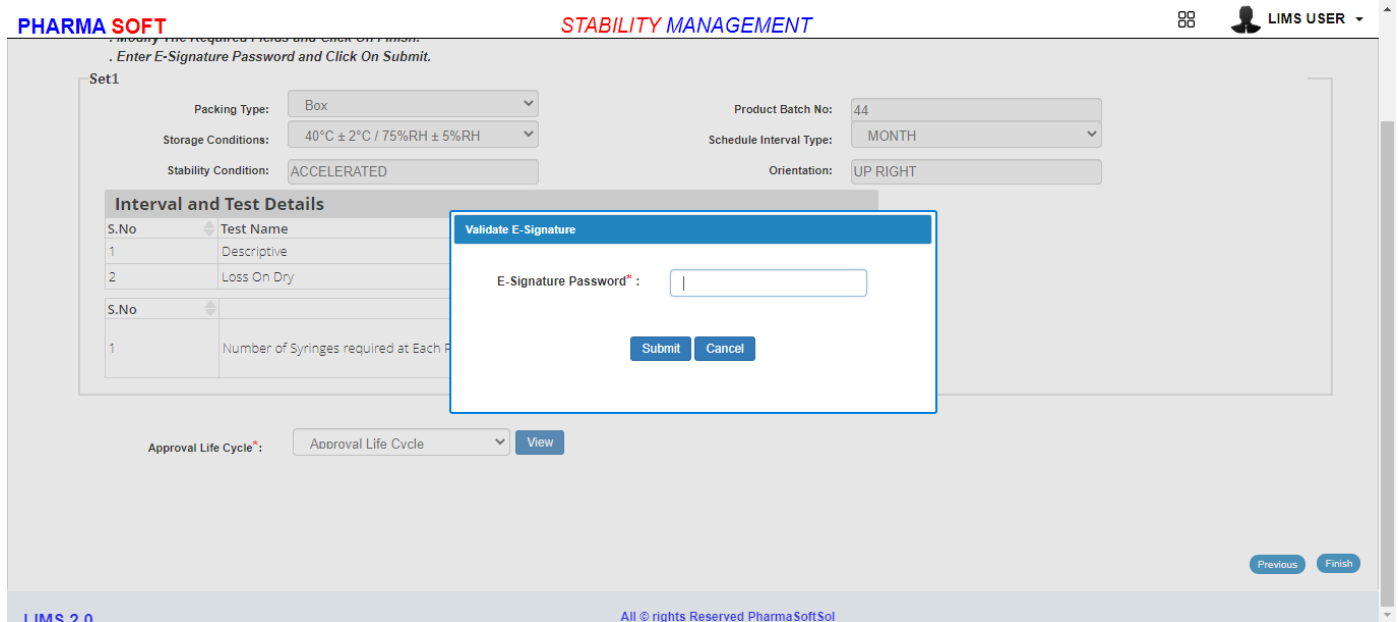

**PHARMA SOFT** **STABILITY MANAGEMENT** LIMS USER

Set1

Packing Type: Box

Storage Conditions: 40°C ± 2°C / 75%RH ± 5%RH

Stability Condition: ACCELERATED

Product Batch No: 44

Schedule Interval Type: MONTH

Orientation: UP RIGHT

**Interval and Test Details**

S.No	Test Name
1	Descriptive
2	Loss On Dry
S.No	
1	Number of Syringes required at Each P


Approval Life Cycle\*: Approval Life Cycle View

Previous Finish

LIMS 2.0 All © rights Reserved PharmaSoftSol

8. Enter E-Signature Password

SSNo : PSS-LIMS-SS-008

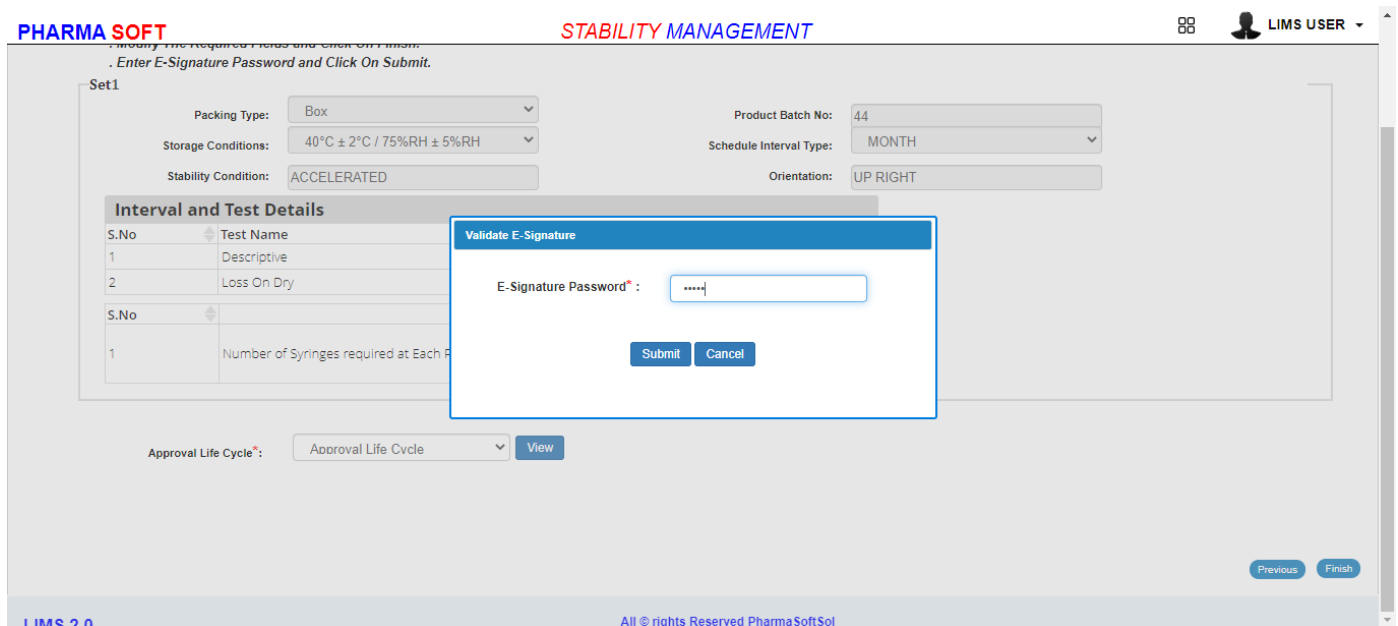

**PHARMA SOFT** **STABILITY MANAGEMENT** LIMS USER

Set1

Packing Type: Box

Storage Conditions: 40°C ± 2°C / 75%RH ± 5%RH

Stability Condition: ACCELERATED

Product Batch No: 44

Schedule Interval Type: MONTH

Orientation: UP RIGHT

**Interval and Test Details**


S.No	Test Name
1	Descriptive
2	Loss On Dry
S.No	
1	Number of Syringes required at Each P

Approval Life Cycle\*: Approval Life Cycle View

Previous Finish

LIMS 2.0 All © rights Reserved PharmaSoftSol



 <b>PHARMA SOFT SOL</b> <small>COMMITTED TO PAPERLESS COMPLIANCE</small>	<b>Test Case Name</b>	Reinitiate Rejected Schedule Test
	<b>Test Case Number</b>	PSS-LIMS-011
	<b>Actual Result</b>	Pass

9. Click on OK button

SSNo : PSS-LIMS-SS-009

**PHARMA SOFT**
**STABILITY MANAGEMENT**
LIMS USER

### Schedule Test Selection

[Action](#)
[Schedule Intervals](#)
[Schedule Test Selection](#)

*. Select The Test, Select Approval Life Cycle and Click On Finish.*  
*. Enter E-Signature Password and Click On Submit.*  
*. Modify The Required Fields and Click On Finish.*  
*. Enter E-Signature Password and Click On Submit.*

Set1

Packing Type: Box

Storage Conditions: 40°C ± 2°C / 75%RH ± 5%RH

Stability Condition: ACCELERATED

MONTH

RIGHT

**Success**  
Submitted successfully.  
OK

**Interval and Test Details**

S.No	Test Name
1	Descriptive
2	Loss On Dry

S.No 1

Number of Syringes required at Each Point 50

Approval Life Cycle: Approval Life Cycle View

IMS 2.0 All © rights Reserved PharmaSoftSol

10. Click on User Name

SSNo : PSS-LIMS-SS-010

**PHARMA SOFT**
**STABILITY MANAGEMENT**
LIMS USER

### Schedule Test Selection

[Action](#)
[Schedule Intervals](#)
[Schedule Test Selection](#)

**Activity :**  
*. Select Create, Select The Record and Click on Next.*  
*. If Rejected is Required, Then Select Rejected.*

☐ Schedule Test Selection
☒ Reverted Schedule Test Selection


Logout

**List of Reverted Schedules**

S.No.	Protocol Number	Product Name*	Generic Name	Specification Name	Reverted By	Reverted On	Comments
No data available!							

Row count: 10

IMS 2.0 All © rights Reserved PharmaSoftSol

	<b>Test Case Name</b>	Reinitiate Rejected Schedule Test
	<b>Test Case Number</b>	PSS-LIMS-011
	<b>Actual Result</b>	Pass

11.Click on Logout

SSNo : PSS-LIMS-SS-011

