




Logical Physical x 452, y: 2

[Root] 06.24.00

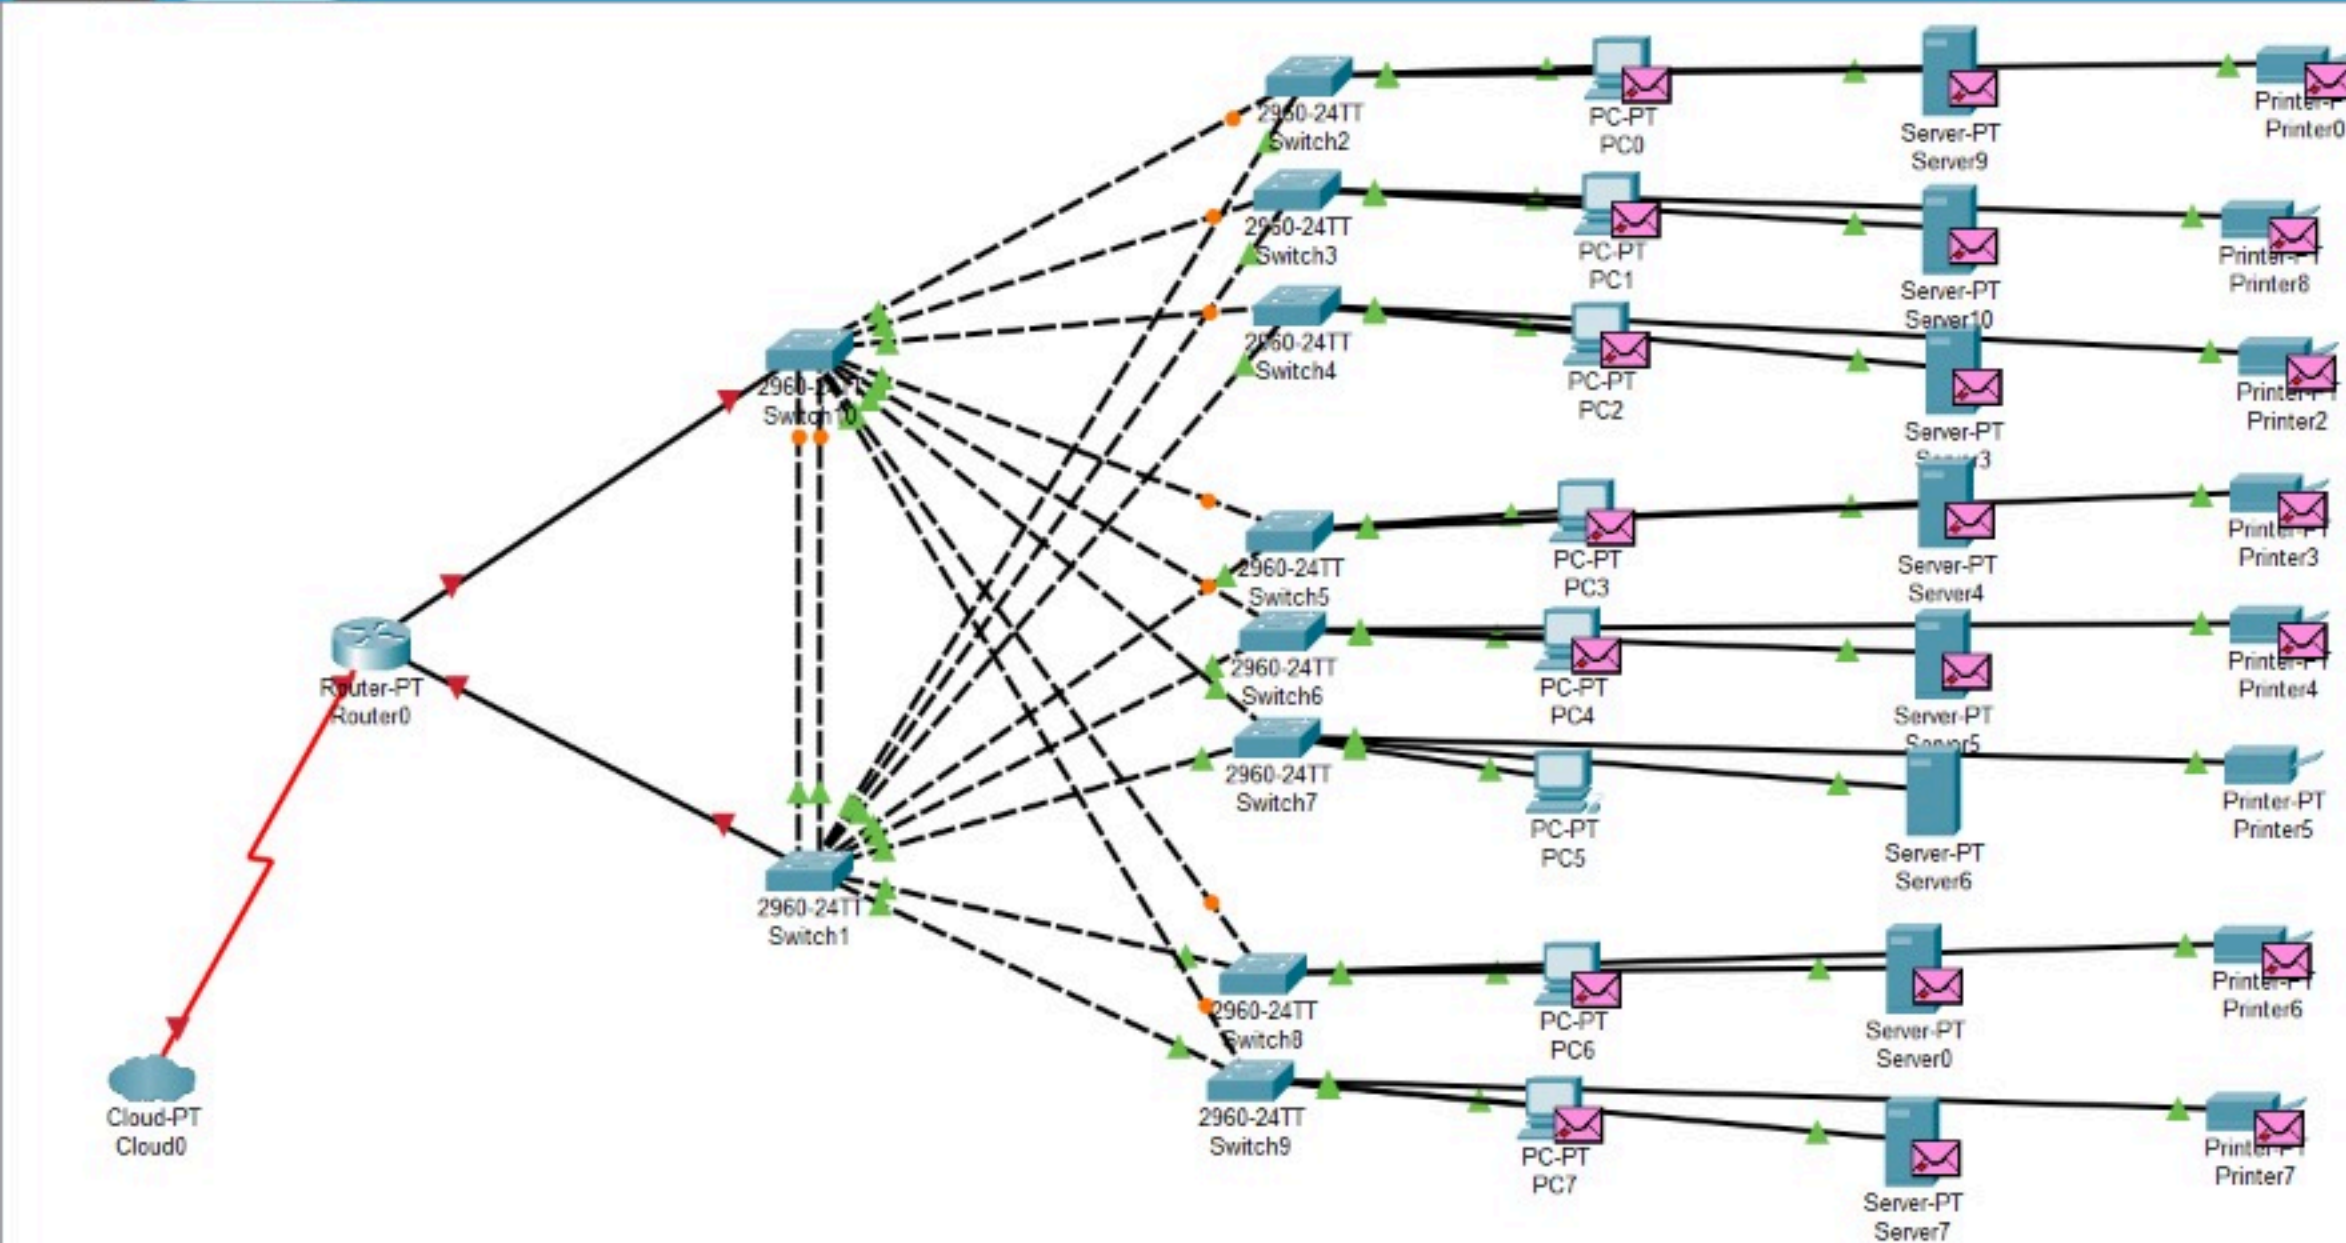

## Simulation Panel

## Event List

Vis.	Time(sec)	Last Device	At Device	Type
	2.013	Switch9	Printer7	STP
	2.013	Switch5	Server4	STP
	2.013	Switch5	PC3	STP
	2.013	Switch5	Printer3	STP
	2.013	Switch3	PC1	STP
	2.013	Switch3	Server10	STP
	2.013	Switch3	Printer8	STP
	2.013	Switch6	Server5	STP
	2.013	Switch6	PC4	STP
	2.013	Switch6	Printer4	STP
	2.013	Switch8	Printer6	STP
	2.013	Switch8	PC6	STP
	2.013	Switch8	Server0	STP
	2.013	Switch2	Printer0	STP
	2.013	Switch2	Server9	STP
	2.013	Switch2	PC0	STP

Reset Simulation

☒ Constant DelayCaptured to:  
2.013 s

## Play Controls



## Event List Filters - Visible Events

ACL Filter, ARP, BGP, Bluetooth, CAPWAP, CDP, DHCP, DHCPv6, DNS, DTP, EAPOL, EIGRP, EIGRPv6, FTP, H.323, HSRP, HSRPv6, HTTP, HTTPS, ICMP, ICMPv6, IPsec, ISAKMP, IoT, IoT TCP, LACP, LLDP, Meraki, NDP, NETFLOW, NTP, OSPF, OSPFv6, PAgP, POP3, PPP, PPPoE, PTP, RADIUS, REP, RIP, RIPng, RTP, SCCP, SMTP, SNMP, SSH, STP, SYSLOG, TACACS, TCP, TFTP, Telnet, UDP, USB, VTP

Edit Filters

Show All/None

Time: 07:11:31.935 PLAY CONTROLS:



Serial DTE



Scenario 0

New

Delete

Toggle PDU List Window

Fire	Last Status	Source	Destination	Type	Color	Time(sec)	Periodic	Num	Edit	Delete
	Successful	PC0	PC0	ICMP		0.000	N	0	(edit)	(delete)

