
SOLUTION / UPS AND SMALL DATA CENTRES

YELLOW PBAT-Gate

Web interface, 12-month history and data acquisition via PBAT600Pro.

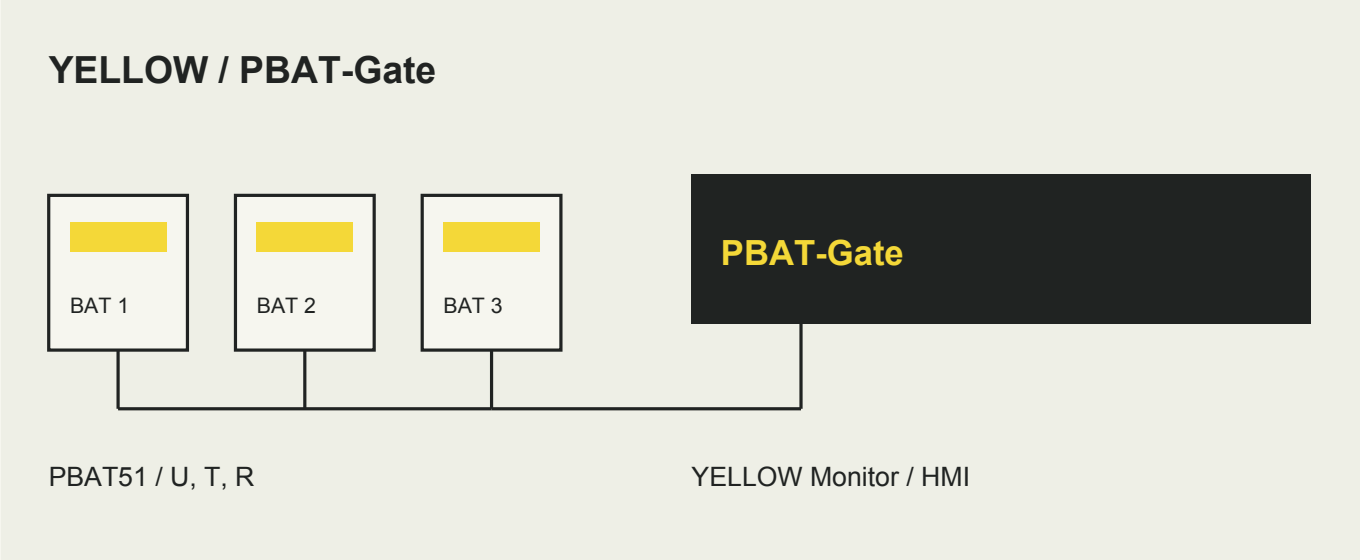

Functional data flow; not an installation drawing.

Batteries	Lead-acid batteries
Capacity	Up to 480 batteries
Strings	Up to 4 strings of 120 batteries
Integration	Modbus TCP, SNMP

Maximum battery counts apply to the specified version. Sensors, power supplies and interfaces are selected for the project.

COMPONENTS AND SPECIFICATIONS

YELLOW PBAT-Gate

Battery sensors	YELLOW PBAT51
String measurement	PBAT600Pro and Hall sensor per battery string
Display	HMI / YELLOW Monitor

Technical parameters

Controller power supply	18-36 V DC
Data history	12 months
String acquisition	PBAT600Pro

Configuration requirements

Confirm battery type and voltage, batteries per string, parallel string count, power supply, equipment layout and supervisory protocols.

Voltage, current and environmental sensors, cables, HMI and alert channels are specified separately. SOC/SOH estimates do not replace capacity testing.