
SOLUTION / TELECOM SITES

YELLOW PBMS2000

Telecom battery monitoring with automatic balancing.

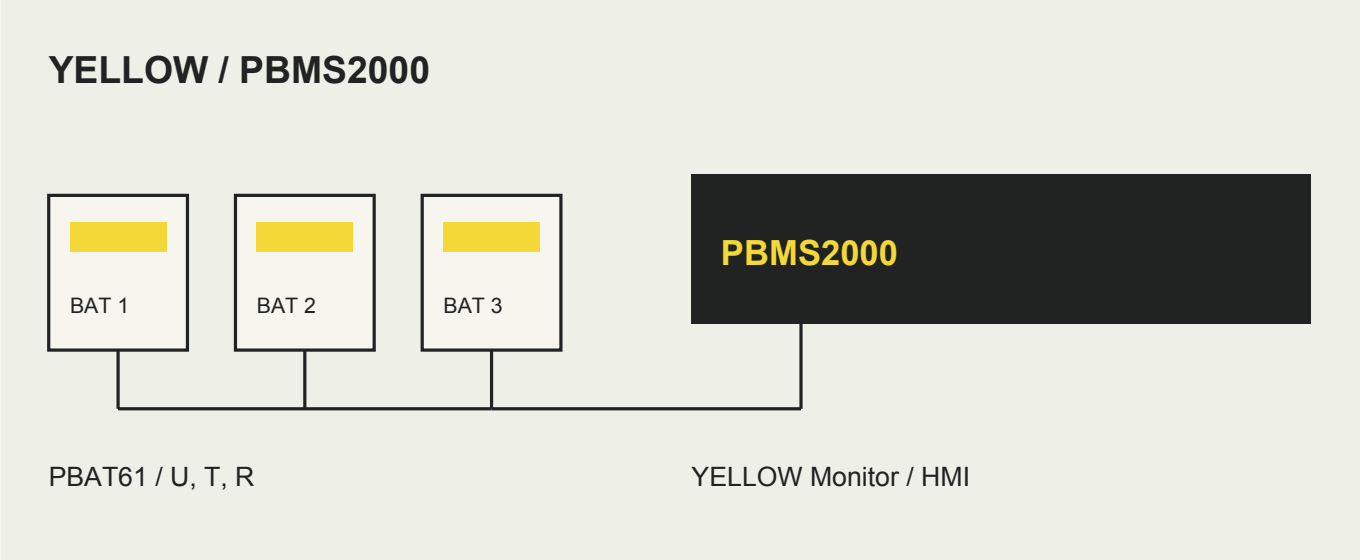

Functional data flow; not an installation drawing.

Batteries	VRLA · 24 / 48 V systems
Capacity	Up to 120 batteries
Strings	1 × 120 or 2 × 60 batteries
Integration	Modbus RTU / TCP, SNMP

Maximum battery counts apply to the specified version. Sensors, power supplies and interfaces are selected for the project.

COMPONENTS AND SPECIFICATIONS

YELLOW PBMS2000

Battery sensors	YELLOW PBAT61
String measurement	Hall sensor for string current measurement
Display	HMI / YELLOW Monitor

Technical parameters

Power supply	24 / 48 V DC; 20-60 V DC
Communication	Ethernet / RS485
Controller consumption	< 2 W

Configuration requirements

Confirm battery type and voltage, batteries per string, parallel string count, power supply, equipment layout and supervisory protocols.

Voltage, current and environmental sensors, cables, HMI and alert channels are specified separately. SOC/SOH estimates do not replace capacity testing.