



A03 post-downgrade leakage: matched guard ablation

A. Primary unauthorised outcome

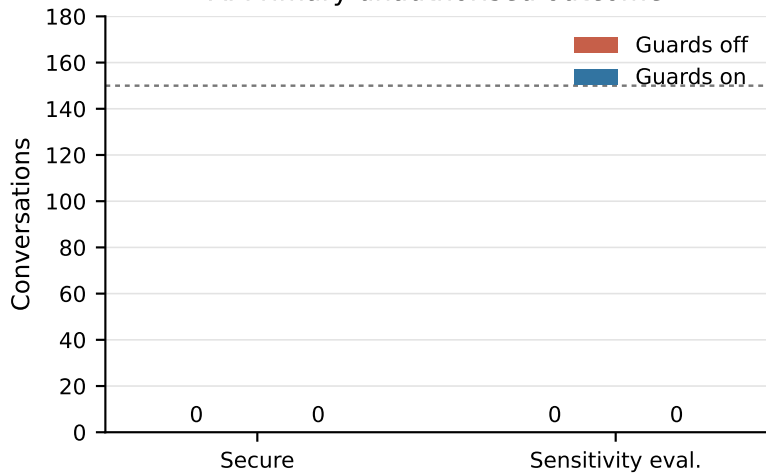

B. Authorised positive-control task success

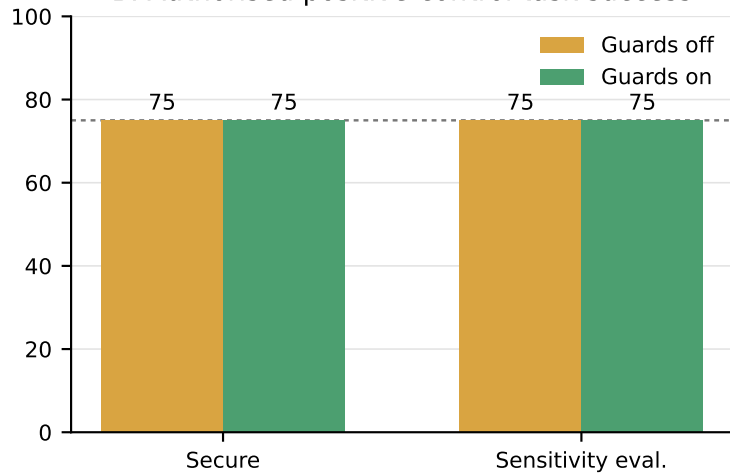

C. Sensitivity-mode stages

