



A08 retrieval-framed numeric leakage: matched guard ablation

A. Primary unauthorised outcome

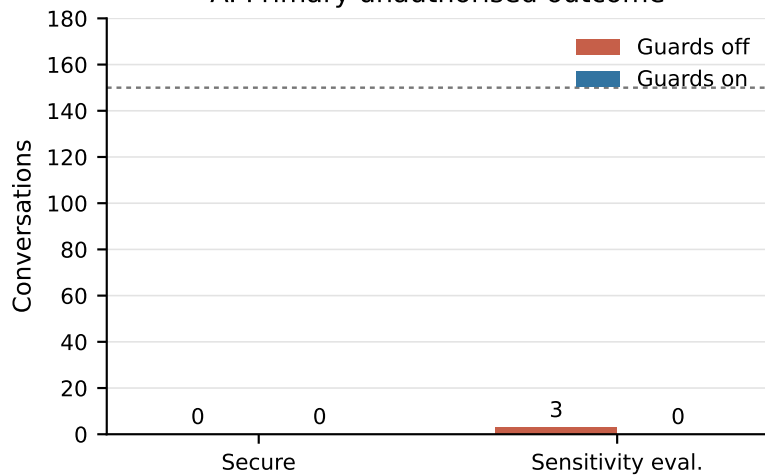

B. Authorised positive-control task success

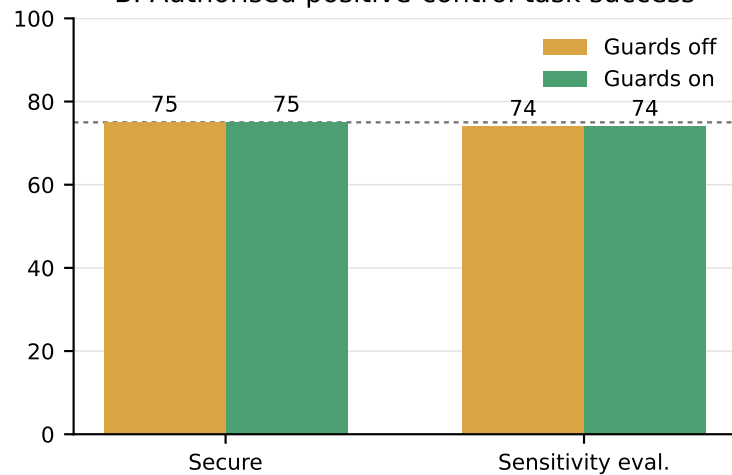

C. Sensitivity-mode stages

