1. THE CUSTOMER IS RESPONSIBLE FOR UPS (UNINTERUPTIBLE POWER SUPPLY) FOR NETWORK EQUIPMENT. GE VERNOVA SUGGESTS THAT THE CUSTOMER USE SEPARATE CIRCUITS TO POWER THE REDUNDANT EQUIPMENT (I.E. ETHERNET SWITCHES).

2. LENGTHS OF CAT-6 UTP AND FIBER OPTIC CABLE ARE TO BE DETERMINED AT INSTALLATION.

3. EACH HUMAN MACHINE INTERFACE (HMI, EWS, APPLICATION GATEWAY, SYSTEM CONFIGURATION SERVER, CONTROL SERVER, THIN CLIENT) AND ON-SITE MONITORING PC (OSM) COMES WITH A 50 FT PRE-FABRICATED CAT-6 UTP (1000 BASE-T) CABLE PER NETWORK INTERFACE CARD PORT. THE OPERATOR INTERFACE (OI) USER INTERFACE DOES NOT INCLUDE CONNECTING NETWORK CABLES. GE VERNOVA ALSO PROVIDES ONE ADDITIONAL 1000 FT SPOOL OF CAT-6 UTP (1000 BASE-T) AND FIVE BOXES OF 20 RJ-45 CONNECTORS, WHICH SHOULD BE USED TO SATISFY THE AS-INSTALLED CABLE LENGTH NEEDS.NETWORK TIME SERVER (NTP) (IF SUPPLIED BY GE VERNOVA) COMES WITH 150 FT LENGTH OF COAXIAL CABEL FOR CONNECTION TO GPS ANTENNA (IF SUPPLIED BY GE VERNOVA). HOWEVER, IF ADDITIONAL ANY CABLE, CONNECTORS OR REPEATORS ARE REQUIRED, CUSTOMER IS RESPONSIBLE FOR THE ADDITIONAL SUPPLY.

4. NETWORK HARDWARE THAT IS SUPPLIED BY GE VERNOVA IS SHIPPED LOOSE.THIS HARDWARE IS LOCATED AND INSTALLED BY THE CUSTOMER.

5. THE ON-SITE MONITOR (OSM), WHICH CONSISTS OF HARDWARE AND SOFTWARE, IS PROVIDED FOR THE LENGTH OF THE STANDARD WARRANTY PERIOD OR THE LENGTH OF ANY EXTENDED CONTRACT SERVICE AGREEMENT (CSA). THE OSM IS USED TO MONITOR SELECTED UNIT AND FLEET DATA. THE MONITORING SERVICE DOES NOT REQUIRE OPERATOR INTERACTION FROM THE SITE. GE VERNOVA REQUIRES THAT THE CUSTOMER PROVIDE A HIGH SPEED INTERNET CONNECTION (HSC) IN ORDER TO ENSURE CONTINUED MONITORING.GEK-120850 MAY BE REFERRED FOR REQUIREMENTS OF THE HSC.
THE HARDWARE INSTALLED FOR REMOTE MONITORING PURPOSES REMAINS THE PROPERTY OF CUSTOMER.
THE SOFTWARE REMAINS THE PROPERTY OF GE VERNOVA AND WILL BE DISABLED AT THE COMPLETION OF THE MONITORING PERIOD AT THE DISCRETION OF THE GAS POWER BUSINESS.

6. ALL OPERATOR INTERFACES INCLUDING THE HMI AND OSM ARE TO BE LOADED WITH HARDWARE AND SOFTWARE AUTHORIZED BY GE VERNOVA POWER ONLY. INSTALLATION OF ANY SOFTWARE OR HARDWARE NOT AUTHORIZED BY GE VERNOVA POWER WILL VOID GE VERNOVA WARRANTY AGREEMENTS AND ALSO MAY CAUSE NETWORK INTERFACE PROBLEMS.

7. THE CUSTOMER AGREES BY USE OF THE GE VERNOVA CONTROL SYSTEM THAT THE TOOLS, SOFTWARE, COPYRIGHTED OPERATOR STATION SCREENS, DRAWINGS, SCHEMATICS, LOGIC, AND OTHER INTELLECTUAL PROPERTY PROVIDED WITH GE VERNOVA'S CONTROL SYSTEMS, OPERATOR STATIONS, AND RELATED COMPONENTS ARE PROPRIETARY INFORMATION OWNED BY GE VERNOVA OR OTHER PARTIES, PROTECTED BY LAW, AND LICENSED TO THE CUSTOMER FOR THEIR USE ON THEIR SPECIFIC PROJECT APPLICATION ONLY. THE CUSTOMER IS EXPRESSLY FORBIDDEN FROM REVERSE ENGINEERING, DECOMPILING, OR OTHERWISE DERIVING THE SOURCE OF THE PROPRIETARY INFORMATION THROUGH ANY MEANS OR FROM REPRODUCING, DISTRIBUTING, DISCLOSING, OR ALLOWING ACCESS TO ANY GE VERNOVA PROPRIETARY INFORMATION, IN ANY FORM, TO ANY THIRD PARTY, WITHOUT GE VERNOVA'S PRIOR WRITTEN PERMISSION. SUCH AUTHORIZATION WILL LIKELY REQUIRE AN AGREEMENT BETWEEN GE VERNOVA AND THE THIRD PARTY.

8. ALL EXTERNAL DATALINK INTERFACES COMMUNICATING TO GE VERNOVA CONTROLS NETWORK THROUGH NETWORKST 4.0 EXTERNAL SWITCHES USING SINGLE MODE FIBER NEED TO COMMUNICATE USING 1 GBPS SPEED ONLY. IF ANY DATALINK INTERFACE IS NOT ABLE TO COMMUNICATE USING 1 GPBS SPEED THEN PARTNER OR CUSTOMER NEED TO PROVIDE FIBER TO COPPER CONVERTOR AT NETWORKST 4.0 (EXTERNAL SWITCHES) END AND NEED TO SHARE THIS INFORMATION IN EARLY STAGE OF TH E PROJECT SO GE VERNOVA CAN ORDER THE CORRECT HARDWARE NEEDED.

LEGEND	
SYMBOL	DESCRIPTION
△	DEFINES CUSTOMER'S SCOPE
●	DEFINES GAS TURBINE ORDER SCOPE
	DEFINES STEAM TURBINE ORDER SCOPE
	DEFINES GE-DCS ORDER SCOPE
	DEFINES PEECC
	DEFINES LCI & EXCITER COMPARTMENT(LEC)
	DEFINES EXCITER COMPARTMENT(EC)
	DEFINES UNIT MOTOR CONTROL CENTER(MCC)

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates. Thus, it is being provided with the explicit expectation of restricted use. All persons or legal entities receiving this information shall be deemed by the act of its receipt to have contractually agreed to make no duplications, reproductions of any nature by any means, modifications, disclosures, or use any portion of this material; except as is expressly authorized in writing by GE Vernova and/or its affiliates.

Revision History

REV	DESCRIPTION	DATE	APPROVALS
E	- External switch & UTM port tables sheet updated as per markup. - Central control room(osw4clt) monitor size has been updated to 85". - Switch port tables(SW4-1,SW4-2) updated as per markup. - Updated the location of Network cabinet4-BSC1CLT in server room to cybersecurity room - In Sheet-25, HRSGLMCLT,PMSSVR,uPMSSVR is removed in the portable. - In sheet-26 BSC1CLT location is updated from Server room to Cyber Security room.	2025-11-14	Created By: SAI NIKHIL REDDY Y.R Approved By: Janaki,Paramkusam

THIS DOCUMENT SHALL BE REVISED IN ITS ENTIRETY. ALL SHEETS OF THIS DOCUMENT ARE THE SAME REVISION LEVEL AS INDICATED IN THE REVISION BLOCK.

ASSY, REMOTE CONTROL SYS

DESIGN MEMO: 1511771
GT TURBINE SERIAL NUMBER: 899061
ST TURBINE SERIAL NUMBER: 370T080
MODEL LIST: 4108
CUSTOMER: OSTROLEKA

Similar To: NONE	Created By: PATNAIK, MANISH		MLI: 4108
First Made For: 1511771 MPL-	Approved By: GUDA, RAGHU		IEC61355 NO: -
GE VERNOVA	Document Type: TECHNICAL DOCUMENT		Sheet Size: B
	Document Title: **ASSY, REMOTE CONTROL SYS**		
Creation Date: 2021-10-28	Drawing Number: 302T0147	Revision: E	Sheet: 1 of 27

ID #	DESCRIPTION	IDENT.	SUPPLER
1	FIBER OPTIC CABLE (SINGLE MODE)	107T2279	ORLEN
2	FIBER OPTIC CABLE (MULTI MODE)	216A5771	NA
3	FIBER OPTIC CONNECTOR (TYPE LC)	107T2275	ORLEN
4	FIBER OPTIC CONN. ASM KIT (TYPE LC, ONE PER SITE)	-	ORLEN
5	CAT-6 UTP (1000 BASE-T) ETHERNET CABLE & RJ-45 CONNECTOR (SEE NOTE 3)	-	GE VERNOVA
6	PREFABRICATED 50' CAT- 6 (1000 BASE-T) ETHERNET PATCH CABLE	-	GE VERNOVA
7	CAT-6 UTP ETHERNET CABLE & RJ-45 CONNECTOR (PRE -INSTALLED & PRE – WIRED)	-	GE VERNOVA
8	ONSITE MONITORING SYSTEM (OSM)	-	GE VERNOVA
9	HIGH SPEED INTERNET CONNECTION (HSC)	GEK-120850	ORLEN
10	MONITOR (SEE NOTE 4)	-	GE VERNOVA
11	LOCK BOX (SEE NOTE 4)	-	GE VERNOVA
12	-	-	-
13	NTP TIME SERVER WITH GPS ANTENNA & COAXIAL CABLE (SEE NOTE 3,4)	-	GE VERNOVA
14	TIME SYNCHRONIZATION DISTRIBUTION PANEL (SEE NOTE 4)	-	GE VERNOVA
15	NTP TIME SERVER (IRIG-B INPUT BY OTHERS) (SEE NOTE 4)	-	GE VERNOVA
16	SITE ROUTER FOR OSM (SEE NOTE 4)	-	GE VERNOVA
17	UNIFIED THREAT MANAGER (SEE NOTE 4)	-	GE VERNOVA
18	NETWORKST 4.0 ROUTER (SEE NOTE 4)	-	GE VERNOVA
19	XDH SW (SEE NOTE 4)	-	GE VERNOVA
20	THIN CLIENT (SEE NOTE 4)	-	GE VERNOVA
21	THICK CLIENT HMI (SEE NOTE 4)	-	GE VERNOVA

ID #	DESCRIPTION	IDENT.	SUPPLER
22	CONTROL SERVER (SEE NOTE 4)	-	GE VERNOVA
23	A3 COLOR LASER PRINTER (SEE NOTE 4)	-	GE VERNOVA
24	A4 COLOR LASER PRINTER (SEE NOTE 4)	-	GE VERNOVA
25	HMI CABINET	-	GE VERNOVA
26	LEC RACK	305T4595	GE VERNOVA
27	NETWORK EQUIPMENT CABINET	305T4595	GE VERNOVA
28	CONTROL SERVER RACK	305T4595	GE VERNOVA
29	WALL MOUNT NETWORK CABINET	-	-
30	STACKING CABLE (SEE NOTE 4)	-	GE VERNOVA
31	POWER STACKING CABLE (SEE NOTE 4)	-	GE VERNOVA
32	SMF VLAN STACKED EDGE SW WITH 2SFP (SEE NOTE 4)	-	GE VERNOVA
33	SMF VLAN STACKED EDGE SW WITH 4SFP (SEE NOTE 4)	-	GE VERNOVA
34	MMF VLAN STACKED EDGE SW WITH 2SFP (SEE NOTE 4)	-	NA
35	SMF VLAN STACKED ROOT BRIDGE SW (SEE NOTE 4)	-	GE VERNOVA
36	MMF VLAN STACKED ROOT BRIDGE SW (SEE NOTE 4)	-	NA
37	SMF 10M CABLE WITH LC CONNECTOR (SEE NOTE 4)	-	GE VERNOVA
38	SMF VLAN STACKED EXTERNAL SW WITH 24SFP (SEE NOTE 4)	-	GE VERNOVA
39	MMF VLAN STACKED EXTERNAL SW WITH 24SFP (SEE NOTE 4)	-	NA
40	SMF 1M CABLE WITH LC CONNECTOR (SEE NOTE 4)	-	GE VERNOVA
41	SMF VLAN CISCO IE 2SFP SW (16 PORT)	-	GE VERNOVA

ID #	DESCRIPTION	IDENT.	SUPPLER
42	SMF VLAN CISCO IE 1SFP SW (8 PORT)	-	NA
43	SMF VLAN CISCO IE 2SFP SW (8 PORT)	-	NA
44	MMF VLAN CISCO IE 2SFP SW (16 PORT)	-	NA
45	MMF VLAN CISCO IE 1SFP SW (8 PORT)	-	NA
46	MMF VLAN CISCO IE 2SFP SW (8 PORT)	-	NA
47	HEAT AND POWER LOAD DRAWING	306T6738	GE VERNOVA
48	KVM EXTENDER	-	GE VERNOVA
49	NOZOMI (NSGL250)	-	GE VERNOVA
50	NAS SERVER	-	GE VERNOVA
51	NOZOMI	-	ORLEN
	-	-	-
	-	-	-
	-	-	-
	-	-	-
	-	-	-
	-	-	-
	-	-	-
	-	-	-
	-	-	-

GE VERNOVA

Document Type: TECHNICAL DOCUMENT

Sheet Size: B

Document Title: **ASSY, REMOTE CONTROL SYS**

Creation Date: 2021-10-28

Drawing Number: 302T0147

Revision: E

Sheet: 2 of 27

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

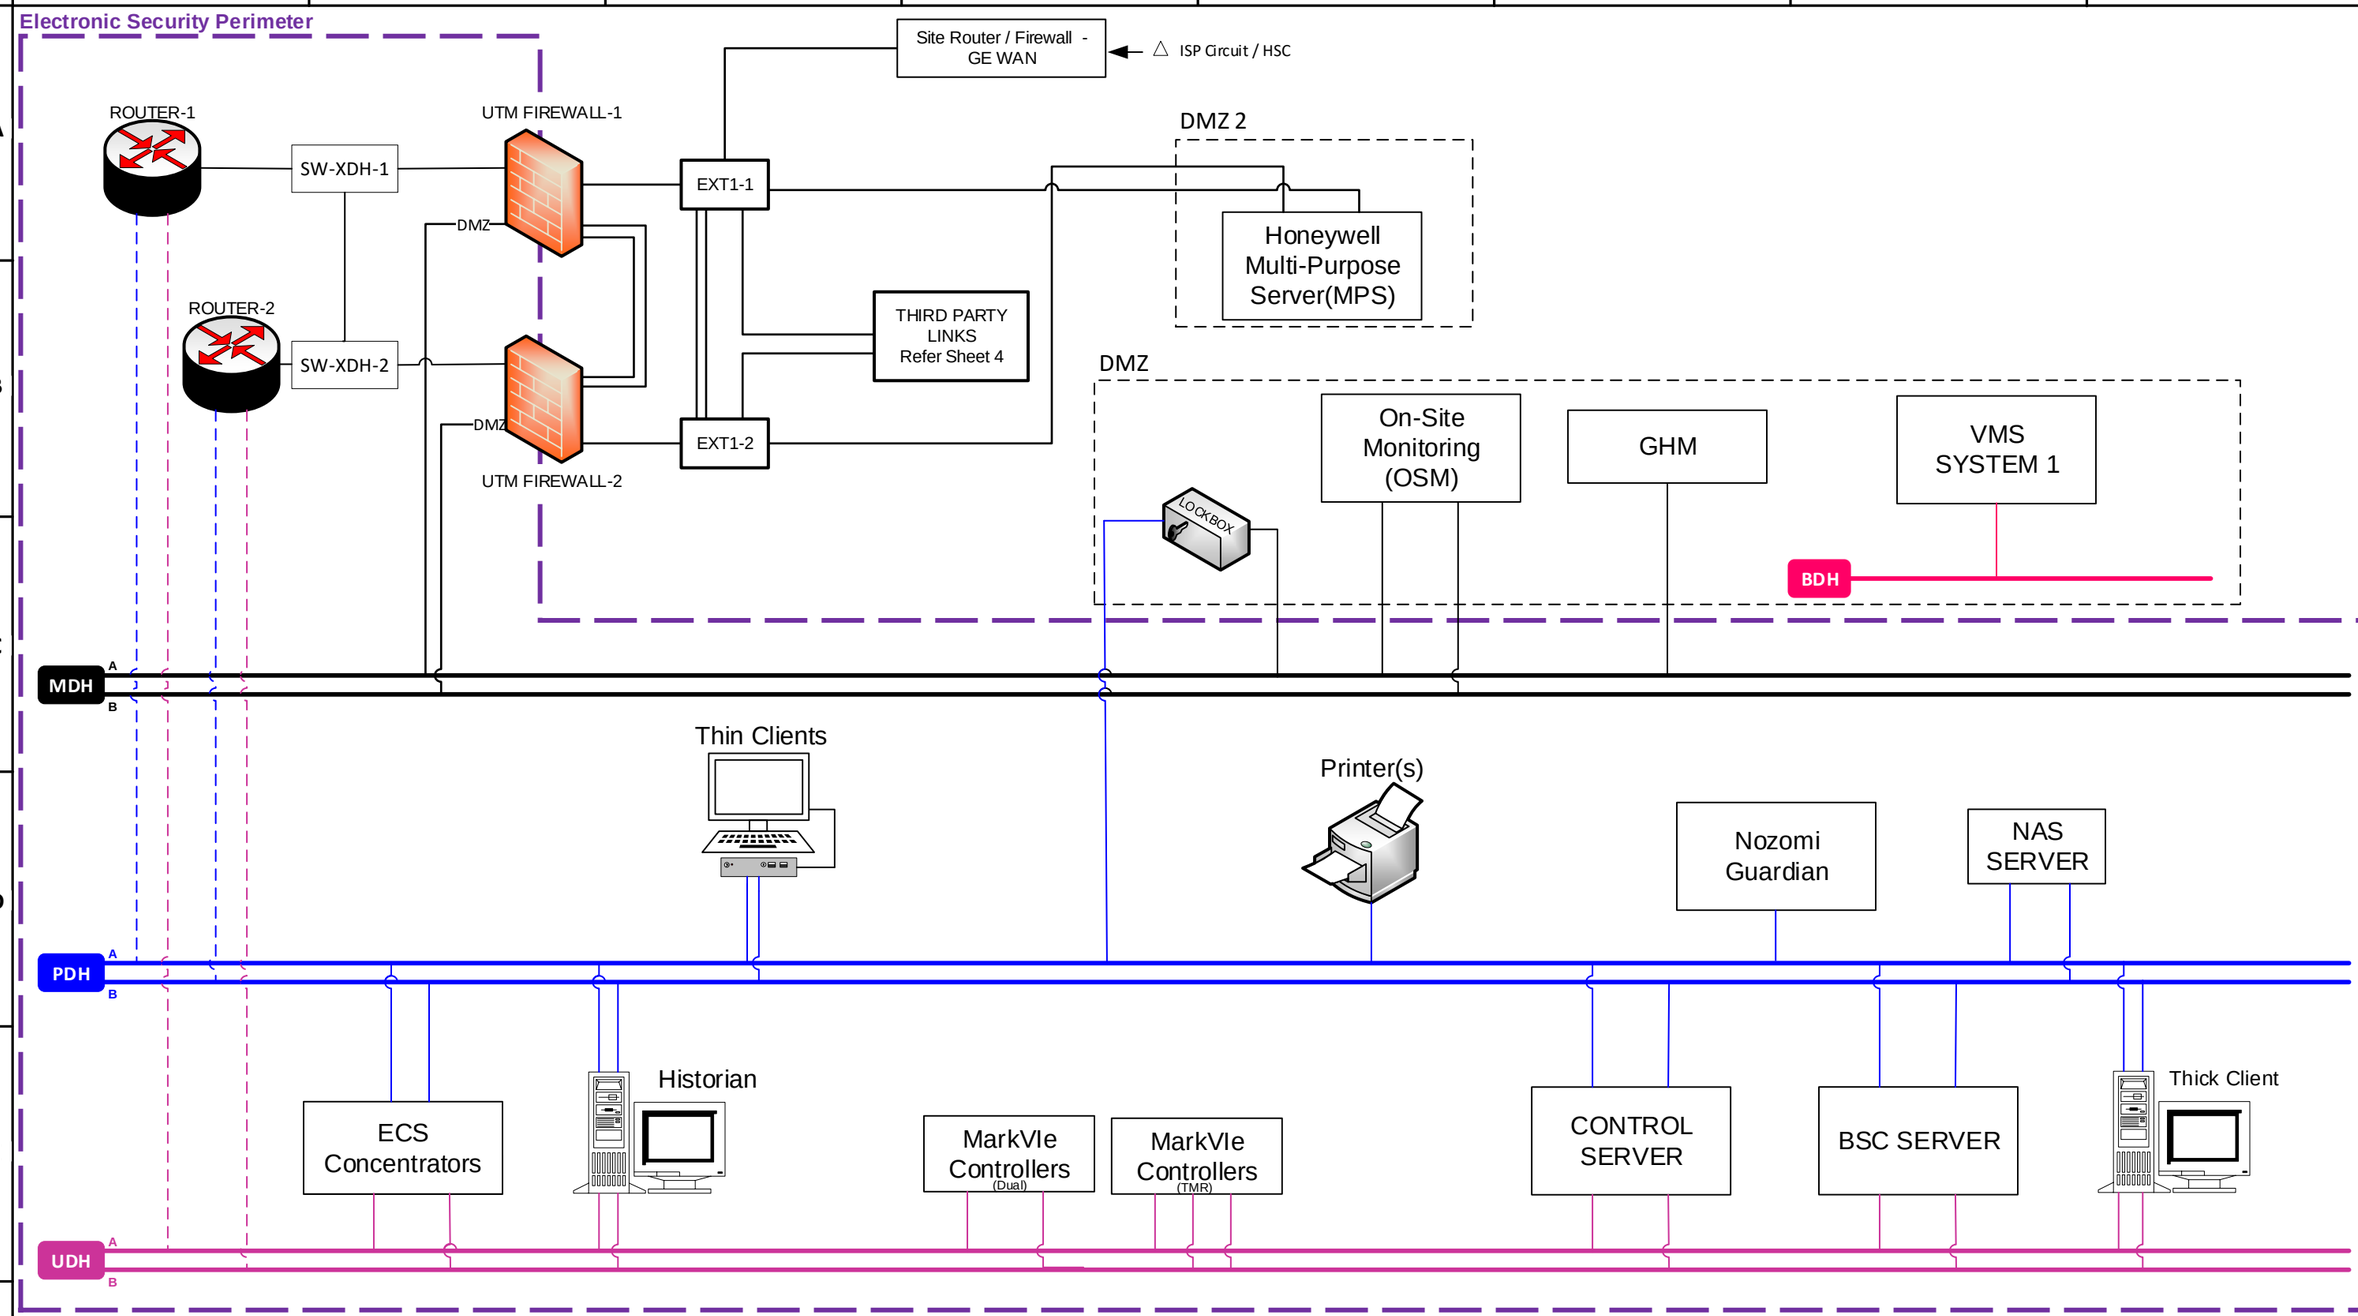

NETWORKST 4.0 – SINGLE LINE OVERVIEW

NOTE: SPEED ON DATA HIGHWAYS (UDH/PDH/MDH) IS 1 GBPS

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type:	Sheet Size:
TECHNICAL DOCUMENT	B

Document Title: **ASSY, REMOTE CONTROL SYS**

Creation Date:	Drawing Number:	Revision:	Sheet:
2021-10-28	302T0147	E	3 of 27

Switch:	EXT1-1 (11CSA02GH020)	ID#:	38	Location:	SERVER ROOM - NETWORK CABINET 2
Part No:	117T6409P54Y1AAA			IP Address:	
Type:	SMF VLAN STACKED EXTERNAL SW WITH 24SFP			Power Source:	UPS1

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
VLAN59	CAT6	5	1	UTM1-Port 16	UTM1-Port 16	172.16.172.1
VLAN50	CAT6	5	2	SITE ROUTER/FW	SITE ROUTER / FIREWALL Orlen Jump Host	TBD
VLAN50	CAT6	5	3	UTM-1 PORT 3	UTM-1 PORT 3	192.168.254.253
VLAN70	CAT6	5	4	UTM-1 PORT 15	UTM-1 PORT 15	172.16.145.129
VLAN52	CAT6	5	5	UTM-1 PORT 8	UTM-1 PORT 8	172.16.171.1
VLAN53	CAT6	5	6	UTM-1 PORT 14	UTM-1 PORT 14	10.151.198.101
VLAN58	CAT6	5	7	UTM-1 PORT 13	UTM-1 PORT 13	172.30.128.65
VLAN51	CAT6	5	8	UTM-1 PORT 9	UTM-1 PORT 9	172.16.160.1
VLAN55	CAT6	5	9	UTM-1 PORT 10	UTM-1 PORT 10	10.151.103.1
VLAN56	CAT6	5	10	UTM-1 PORT 11	UTM-1 PORT 11	172.16.180.1
VLAN57	CAT6	5	11	UTM-1 PORT 12	UTM-1 PORT 12	172.16.190.1
VLAN58	SMF	5	12	DATA LINK	TT SOWE\LFC (MODBUS)	See table 1P below
VLAN54	SMF	5	13	DATA LINK	DYSTER SCADA TO ECS PRIMARY IEC:60870-104	See table 3P below
VLAN59	SMF	5	14	DATA LINK	Orlen Connections (See table 4)-Pri.	172.16.172.12
VLAN55	SMF	5	15	DATA LINK	HONEYWELL MULTI PURPOSE SERVER (MPS)-PRI. DMZ2 INTERNAL	172.16.170.10
VLAN52	SMF	5	16	DATA LINK	Honeywell Multi Purpose Server (MPS)-Pri. DMZ2 Secure	172.16.171.10
VLAN52	SMF	-	17	SPARE	SPARE	-
VLAN56	CAT6	5	18	DATA LINK	RAW WATER PUMP STATION PRIMARY (MODBUS)	172.16.180.2
VLAN57	SMF	5	19	DATA LINK	GAS SUPPLIER SCADA PRIMARY (OPC UA)	172.16.145.130
VLAN70	CAT6	5	20	DATA LINK	System1 (OPC UA)	-
VLAN53	SMF	5	21	DATA LINK	GAS PIPELINE PLC1\2\3 PRIMARY-MODBUS	See table 2P below
VLAN53	SMF	-	22	SPARE	SPARE	-
VLAN53	SMF	-	23	SPARE	SPARE	-
VLAN53	SMF	-	24	SPARE	SPARE	-
STACK	STACKING	30	STACKING 1	EXT1-2:STACKING 2	EXTERNAL SWITCH 2	-
STACK	STACKING	30	STACKING 2	EXT1-2:STACKING 1	EXTERNAL SWITCH 2	-
Pwr Stack 9300	Pwr Stack 9300	31	STACKING 1	EXT1-2:Stack 2	Cisco 9300 24 Port External Switch Power Stacking	-
Pwr Stack 9300	Pwr Stack 9300	31	STACKING 2	EXT1-2:Stack 1	Cisco 9300 24 Port External Switch Power Stacking	-

Switch:	EXT1-2 (11CSA02GH021)	ID#:	38	Location:	SERVER ROOM - NETWORK CABINET 2
Part No:	117T6409P54Y1AAA			IP Address:	
Type:	SMF VLAN STACKED EXTERNAL SW WITH 24SFP			Power Source:	UPS2

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
VLAN59	CAT6	5	1	UTM2-Port 16	UTM2-Port 16	172.16.172.1
VLAN50	CAT6	-	2	SPARE	-	-
VLAN50	CAT6	5	3	UTM-2 PORT 3	UTM-2 PORT 3	192.168.254.253
VLAN70	CAT6	5	4	UTM2-PORT 15	UTM2-PORT 15	172.16.145.129
VLAN52	CAT6	5	5	UTM-2 PORT 8	UTM-2 PORT 8	172.16.171.1
VLAN53	CAT6	5	6	UTM-2 PORT 14	UTM-2 PORT 14	10.151.198.101
VLAN58	CAT6	5	7	UTM-2 PORT 13	UTM-2 PORT 13	172.30.128.65
VLAN51	CAT6	5	8	UTM-2 PORT 9	UTM-2 PORT 9	172.16.160.1
VLAN55	CAT6	5	9	UTM-2 PORT 10	UTM-2 PORT 10	10.151.103.1
VLAN56	CAT6	5	10	UTM-2 PORT 11	UTM-2 PORT 11	172.16.180.1
VLAN57	CAT6	5	11	UTM-2 PORT 12	UTM-2 PORT 12	172.16.190.1
VLAN58	SMF	5	12	DATA LINK	TT SOWE\LFC SECONDARY (MODBUS)	See table 1S below
VLAN54	SMF	5	13	DATA LINK	DYSTER SCADA TO ECS SECONDARY IEC:60870-104	See table 3P below
VLAN59	SMF	5	14	DATA LINK	Orlen Connections (See table 4)-Sec.	172.16.172.13
VLAN55	SMF	5	15	DATA LINK	HONEYWELL MULTI PURPOSE SERVER (MPS)-SEC. DMZ-2 INTERNAL	172.16.170.11
VLAN52	SMF	5	16	DATA LINK	Honeywell Multi Purpose Server (MPS)-Sec. DMZ-2 Secure	172.16.171.11
VLAN52	SMF	-	17	SPARE	SPARE	-
VLAN56	CAT6	5	18	DATA LINK	RAW WATER PUMP STATION SECONDARY (MODBUS)	172.16.180.3
VLAN57	SMF	5	19	DATA LINK	GAS SUPPLIER SCADA SECONDARY (OPC UA)	172.16.190.3
VLAN70	CAT6	-	20	SPARE	SPARE	-
VLAN53	SMF	5	21	DATA LINK	GAS PIPLINE PLC1\2\3 Secondary Modbus	See table 2S below
VLAN53	SMF	-	22	SPARE	SPARE	-
VLAN53	SMF	-	23	SPARE	SPARE	-
VLAN53	SMF	-	24	SPARE	-	-
STACK	STACKING	30	STACKING 1	EXT1-1:STACKING 2	EXTERNAL SWITCH 1	-
STACK	STACKING	30	STACKING 2	EXT1-1:STACKING 1	EXTERNAL SWITCH 1	-
Pwr Stack 9300	Pwr Stack 9300	31	STACKING 1	EXT1-1:Stack 2	Cisco 9300 24 Port External Switch Power Stacking	-
Pwr Stack 9300	Pwr Stack 9300	31	STACKING 2	EXT1-1:Stack 1	Cisco 9300 24 Port External Switch Power Stacking	-

NOTE:
1. DME IS INSTALLED IN EWS1SVR

Table-1P:TO TT SOWE\LFC\DYSTER

LINK	IP
SOWE-REAL	172.16.160.3
LFC-REAL	172.16.160.7
DYSTER\SCADA TSO	172.16.160.11

Table-1S:TO TT SOWE\LFC\DYSTER

LINK	IP
LFC-REAL	172.16.160.8
DYSTER\SCADA TSO	172.16.160.12

Table-2P:GAS PIPLINE

LINK	IP
PLC1:ZZU	10.151.198.118
PLC2:SOT	10.151.198.135
PLC3:SNT	10.151.198.103

Table-2S:GAS PIPLINE

LINK	IP
PLC1:ZZU	10.151.198.119
PLC2:SOT	10.151.198.136
PLC3:SNT	10.151.198.104

Table-4:Multi Purpose Server(MPS)	DMZ2 Internal IP	DMZ2 External IP
Hpervisor Management IP	10.151.103.2	
RDP VM	10.151.103.3	172.16.171.3
SFTP VM	10.151.103.4	172.16.171.4
Log Forwarder VM	10.151.103.5	172.16.171.5
OP CUA VM	10.151.103.6	172.16.171.6

CENTRAL CONTROL ROOM

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type:	Sheet Size:
TECHNICAL DOCUMENT	B

Document Title: **ASSY, REMOTE CONTROL SYS**

Creation Date:	Drawing Number:	Revision:	Sheet:
2021-10-28	302T0147	E	4 of 27

Switch:	RTR1 (11CSA02GH017)	**ID#:**	18	**Location:**	SERVER ROOM - NETWORK CABINET 2
Part No:	117T6409P060AAAF			**IP Address:**	10.10.11.2
Type:	NETWORKST 4.0 ROUTER			**Power Source:**	UPS1

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
NA	CAT6	5	GE 0/0	SW-XDH-01 PORT1	XDH SWITCH	10.10.11.5
NA	CAT6	5	GE 0/1	RB1-1 PORT 24	ROOT BRIDGE	172.16.205.247

Switch:	RTR2 (11CSA02GH018)	**ID#:**	18	**Location:**	SERVER ROOM - NETWORK CABINET 2
Part No:	117T6409P060AAAF			**IP Address:**	10.10.11.3
Type:	NETWORKST 4.0 ROUTER			**Power Source:**	UPS2

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
NA	CAT6	5	GE 0/0	SW-XDH-02 PORT1	XDH SWITCH	10.10.11.6
NA	CAT6	5	GE 0/1	RB1-2 PORT 24	ROOT BRIDGE	172.16.205.247

A

Switch:	SW-XDH-01 (11CSA02GH015)	**ID#:**	19	**Location:**	SERVER ROOM - NETWORK CABINET 2
Part No:	117T6409P060AAAB			**IP Address:**	10.10.11.5
Type:	XDH SW			**Power Source:**	UPS1

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
Trunk	CAT6	5	1	RTR1:GE 0/0	4331 ROUTER	10.10.11.2
Trunk	CAT6	5	2	UTM1:1	401E FIREWALL	10.10.11.4
Unavailable	Unavailable	-	3	RESERVED	-	-
Unavailable	Unavailable	-	4	RESERVED	-	-
Unavailable	Unavailable	-	5	RESERVED	-	-
Unavailable	Unavailable	-	6	RESERVED	-	-
Unavailable	Unavailable	-	7	RESERVED	-	-
Unavailable	Unavailable	-	8	RESERVED	-	-
Unavailable	Unavailable	-	9	RESERVED	-	-
Unavailable	Unavailable	-	10	RESERVED	-	-
Unavailable	Unavailable	-	11	RESERVED	-	-
Unavailable	Unavailable	-	12	RESERVED	-	-
Unavailable	Unavailable	-	13	RESERVED	-	-
Unavailable	Unavailable	-	14	RESERVED	-	-
Unavailable	Unavailable	-	15	RESERVED	-	-
Unavailable	Unavailable	-	16	RESERVED	-	-
Unavailable	Unavailable	-	17	RESERVED	-	-
Unavailable	Unavailable	-	18	RESERVED	-	-
Unavailable	Unavailable	-	19	RESERVED	-	-
Unavailable	Unavailable	-	20	RESERVED	-	-
Unavailable	Unavailable	-	21	RESERVED	-	-
Unavailable	Unavailable	-	22	RESERVED	-	-
Unavailable	Unavailable	-	23	RESERVED	-	-
Trunk	CAT6	5	24	SW-XDH-02:24	XDH SWITCH COPPER TRUNK PORTS	10.10.11.6
Unavailable	Unavailable	-	25	RESERVED	-	-
Unavailable	Unavailable	-	26	RESERVED	-	-
Unavailable	Unavailable	-	27	RESERVED	-	-
Unavailable	Unavailable	-	28	RESERVED	-	-

B

Switch:	SW-XDH-02 (11CSA02GH016)	**ID#:**	19	**Location:**	SERVER ROOM - NETWORK CABINET 2
Part No:	117T6409P060AAAB			**IP Address:**	10.10.11.6
Type:	XDH SW			**Power Source:**	UPS2

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
Trunk	CAT6	5	1	RTR2:GE 0/0	4331 ROUTER	10.10.11.3
Trunk	CAT6	5	2	UTM2:1	401E FIREWALL	10.10.11.4
Unavailable	Unavailable	-	3	RESERVED	-	-
Unavailable	Unavailable	-	4	RESERVED	-	-
Unavailable	Unavailable	-	5	RESERVED	-	-
Unavailable	Unavailable	-	6	RESERVED	-	-
Unavailable	Unavailable	-	7	RESERVED	-	-
Unavailable	Unavailable	-	8	RESERVED	-	-
Unavailable	Unavailable	-	9	RESERVED	-	-
Unavailable	Unavailable	-	10	RESERVED	-	-
Unavailable	Unavailable	-	11	RESERVED	-	-
Unavailable	Unavailable	-	12	RESERVED	-	-
Unavailable	Unavailable	-	13	RESERVED	-	-
Unavailable	Unavailable	-	14	RESERVED	-	-
Unavailable	Unavailable	-	15	RESERVED	-	-
Unavailable	Unavailable	-	16	RESERVED	-	-
Unavailable	Unavailable	-	17	RESERVED	-	-
Unavailable	Unavailable	-	18	RESERVED	-	-
Unavailable	Unavailable	-	19	RESERVED	-	-
Unavailable	Unavailable	-	20	RESERVED	-	-
Unavailable	Unavailable	-	21	RESERVED	-	-
Unavailable	Unavailable	-	22	RESERVED	-	-
Unavailable	Unavailable	-	23	RESERVED	-	-
Trunk	CAT6	5	24	SW-XDH-01:24	XDH SWITCH COPPER TRUNK PORTS	10.10.11.5
Unavailable	Unavailable	-	25	RESERVED	-	-
Unavailable	Unavailable	-	26	RESERVED	-	-
Unavailable	Unavailable	-	27	RESERVED	-	-
Unavailable	Unavailable	-	28	RESERVED	-	-

CENTRAL CONTROL ROOM

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type: TECHNICAL DOCUMENT			Sheet Size: B
Document Title: **ASSY, REMOTE CONTROL SYS**			
Creation Date: 2021-10-28	Drawing Number: 302T0147	Revision: E	Sheet: 5 of 27

A

Switch:	UTM1 (11CSA02GH013)	**ID#:**	17	**Location:**	SERVER ROOM - NETWORK CABINET 2
Part No:	117T6409PX10ABAB			**IP Address:**	
Type:	UNIFIED THREAT MANAGER			**Power Source:**	UPS1

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
NA	CAT6	5	1	SW-XDH-01 PORT2	SW-XDH-01 PORT2	10.10.11.4
NA	CAT6	5	2	SW2-1 PORT 24	GE DMZ (MDH)	172.16.16.1
VLAN50	CAT6	5	3	EXT1-1 PORT 3	GE WAN	192.168.254.253
NA	CAT6	-	4	AVAILABLE	-	-
NA	CAT6	-	5	AVAILABLE	-	-
NA	CAT6	-	6	AVAILABLE	-	-
NA	CAT6	5	7	GE MONITORING	INTERFACE SETUP FOR M&D	-
VLAN52	CAT6	5	8	EXT1-1 PORT 5	DMZ-2 MPS Secure	172.16.171.1
VLAN51	CAT6	5	9	EXT1-1 PORT 8	EXTERNAL COMMUNICATION	172.16.160.1
VLAN55	CAT6	5	10	EXT1-1 PORT 9	DMZ-2 MPS Internal	172.16.170.1
VLAN56	CAT6	5	11	EXT1-1 PORT 10	EXTERNAL COMMUNICATION	172.16.180.1
VLAN57	CAT6	5	12	EXT1-1 PORT 11	EXTERNAL COMMUNICATION	172.16.190.1
VLAN58	CAT6	5	13	EXT1-1 PORT 7	EXTERNAL COMMUNICATION	172.30.128.65
VLAN53	CAT6	5	14	EXT1-1 PORT 6	EXTERNAL COMMUNICATION	10.151.198.101
VLAN70	CAT6	5	15	EXT1-1 PORT 4	EXTERNAL COMMUNICATION	172.16.145.129
VLAN59	CAT6	5	16	Ext1-1 Port 1	EXTERNAL COMMUNICATION	172.16.172.1
NA	SFP	-	17	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	18	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	19	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	20	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	21	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	22	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	23	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	24	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	25	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	26	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	27	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	28	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	CAT6	5	HA	HA LINK 1	TO UTM2 PORT HA	-

E

B

Switch:	UTM2 (11CSA02GH014)	**ID#:**	17	**Location:**	SERVER ROOM - NETWORK CABINET 2
Part No:	117T6409PX11ABAB			**IP Address:**	
Type:	UNIFIED THREAT MANAGER – ID#17			**Power Source:**	UPS2

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
NA	CAT6	5	1	SW-XDH-02 PORT2	SW-XDH-02 PORT2	10.10.11.4
NA	CAT6	5	2	SW2-2 PORT 24	GE DMZ (MDH)	172.16.16.1
VLAN50	CAT6	5	3	EXT1-2 PORT 3	GE WAN	192.168.254.253
NA	CAT6	-	4	AVAILABLE	-	-
NA	CAT6	-	5	AVAILABLE	-	-
NA	CAT6	-	6	AVAILABLE	-	-
NA	CAT6	5	7	GE MONITORING	INTERFACE SETUP FOR M&D	-
VLAN52	CAT6	5	8	EXT1-2 PORT 5	DMZ-2 MPS Secure	172.16.171.1
VLAN51	CAT6	5	9	EXT1-2 PORT 8	EXTERNAL COMMUNICATION	172.16.160.1
VLAN55	CAT6	5	10	EXT1-2 PORT 9	DMZ-2 MPS Internal	172.16.170.1
VLAN56	CAT6	5	11	EXT1-2 PORT 10	EXTERNAL COMMUNICATION	172.16.180.1
VLAN57	CAT6	5	12	EXT1-2 PORT 11	EXTERNAL COMMUNICATION	172.16.190.1
VLAN58	CAT6	5	13	EXT1-2 PORT 7	EXTERNAL COMMUNICATION	172.30.128.65
VLAN53	CAT6	5	14	EXT1-2 PORT 6	EXTERNAL COMMUNICATION	10.151.198.101
VLAN70	CAT6	5	15	EXT1-2 PORT 4	EXTERNAL COMMUNICATION	172.16.145.129
VLAN59	CAT6	5	16	Ext1-2 Port 1	EXTERNAL COMMUNICATION	172.16.172.1
NA	SFP	-	17	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	18	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	19	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	20	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	21	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	22	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	23	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	24	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	25	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	26	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	27	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	SFP	-	28	AVAILABLE	SPARE INTERFACES FOR SFP's	-
NA	CAT6	5	HA	HA LINK 1	TO UTM1 PORT HA	-

E

CENTRAL CONTROL ROOM

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type: TECHNICAL DOCUMENT			Sheet Size: B
Document Title: **ASSY, REMOTE CONTROL SYS**			
Creation Date: 2021-10-28	Drawing Number: 302T0147	Revision: E	Sheet: 6 of 27

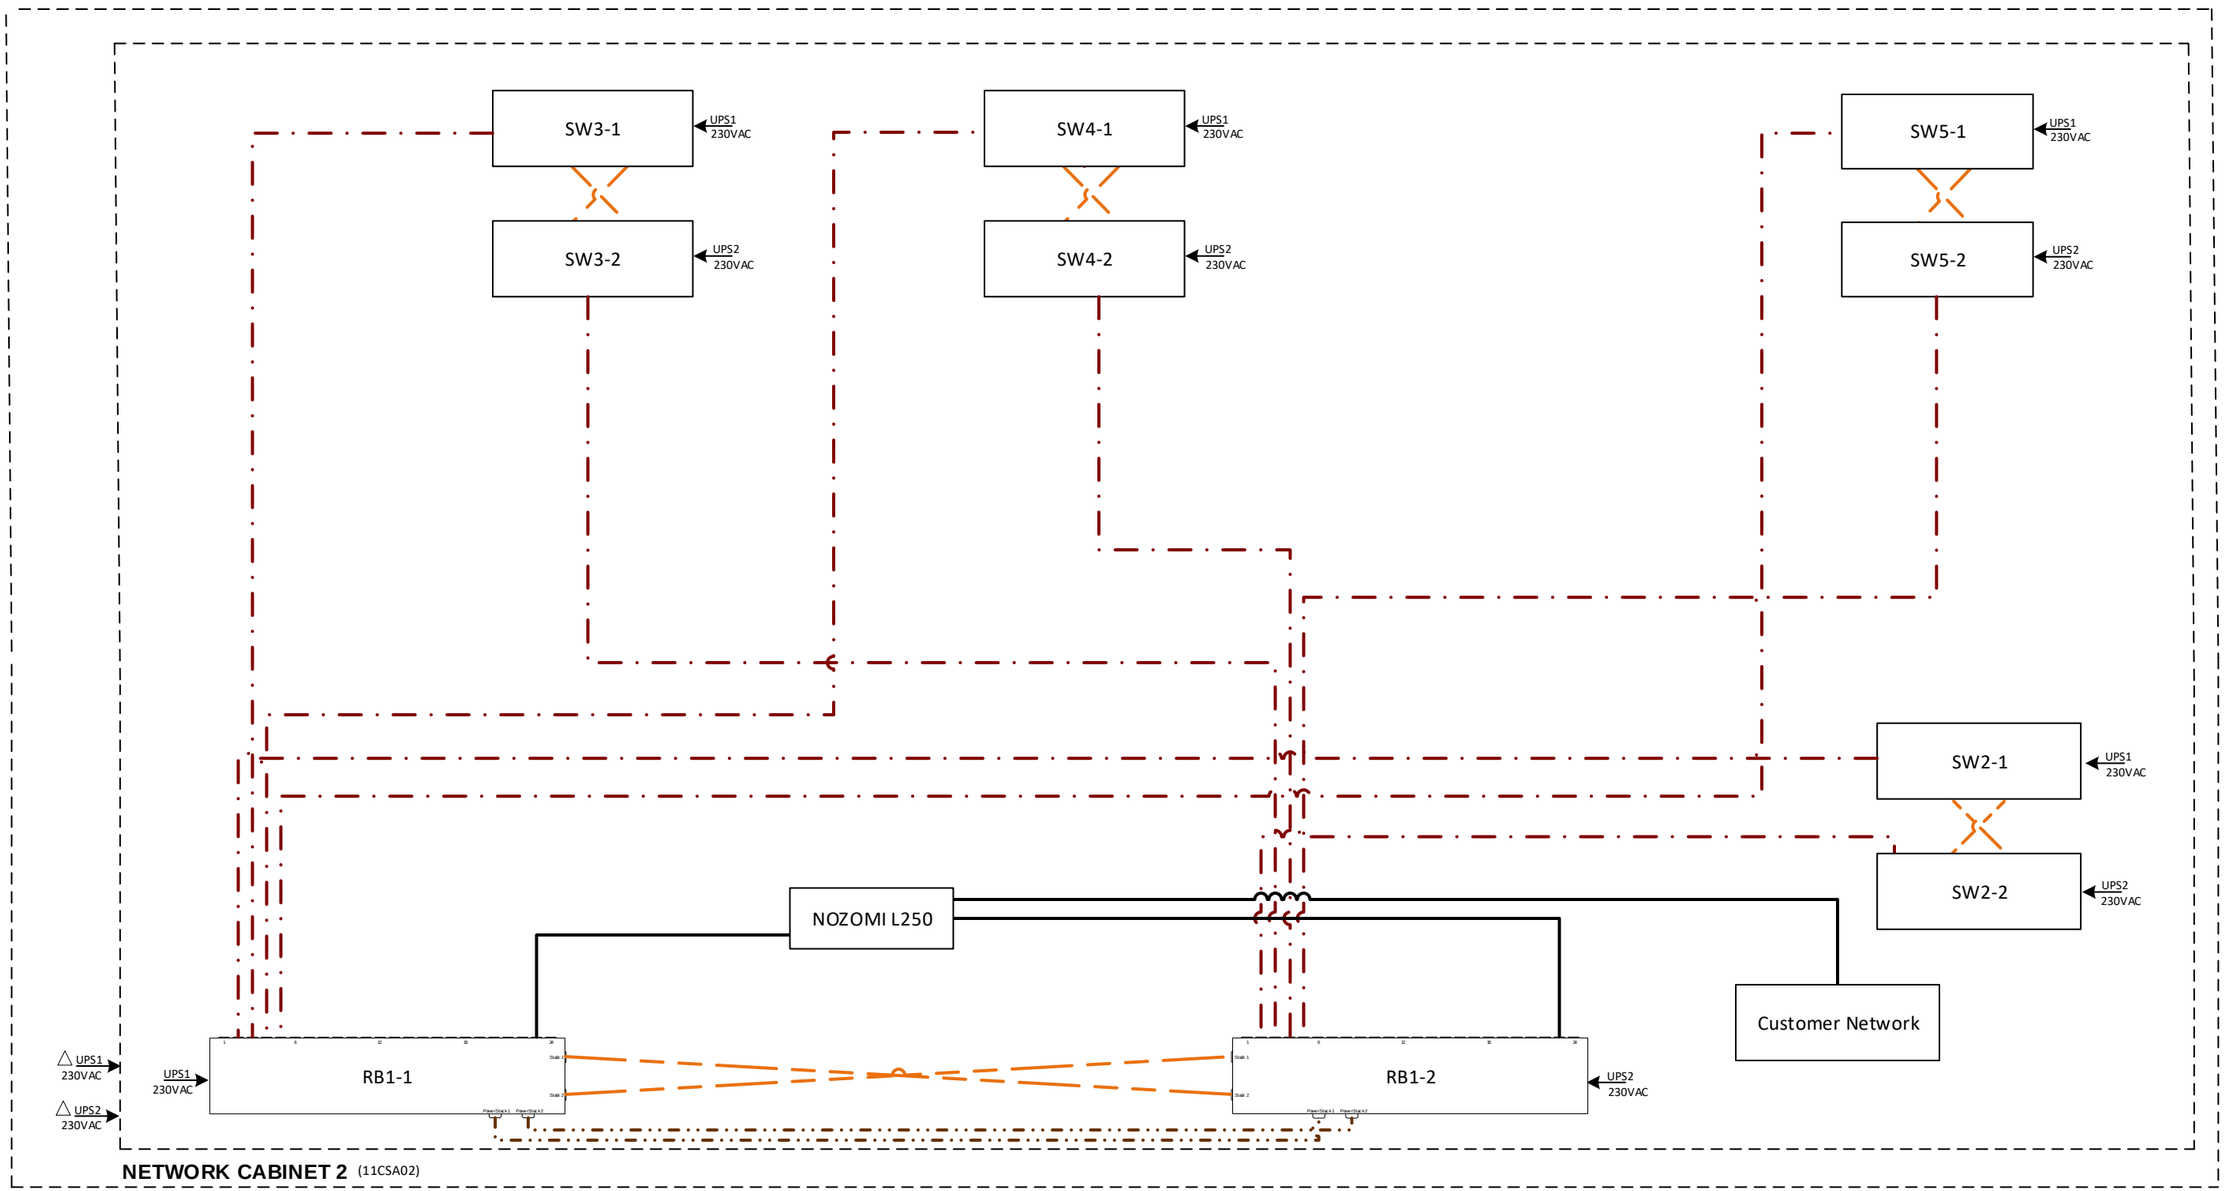

ID#7 - CAT-6 UTP ETHERNET CABLE: (BY GE VERNOVA) (CROSS OVER)

ID#1,#3 - FIBER OPTIC CABLE (SINGLE MODE): (BY CUSTOMER) (PRIMARY)

ID#1,#3 - FIBER OPTIC CABLE (SINGLE MODE): (BY CUSTOMER) (SECONDARY)

ID#31- (BY GE VERNOVA) POWER STACKING: (ROOT BRIDGE SWITCHES)

ID#30 - (BY GE VERNOVA) DATA STACKING: (ROOT/EDGE SWITCHES)

ID#37 – FIBER OPTIC CABLE(SINGLE MODE): (PRIMARY)(PROVIDED BY GE VERNOVA

ID#37 – FIBER OPTIC CABLE(SINGLE MODE): (SECONDARY)(PROVIDED BY GE VERNOVA)

NETWORK OVERVIEW – SH1

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type:	Sheet Size:
TECHNICAL DOCUMENT	B

Document Title: **ASSY, REMOTE CONTROL SYS**

Creation Date:	Drawing Number:	Revision:	Sheet:
2021-10-28	302T0147	E	7 of 27

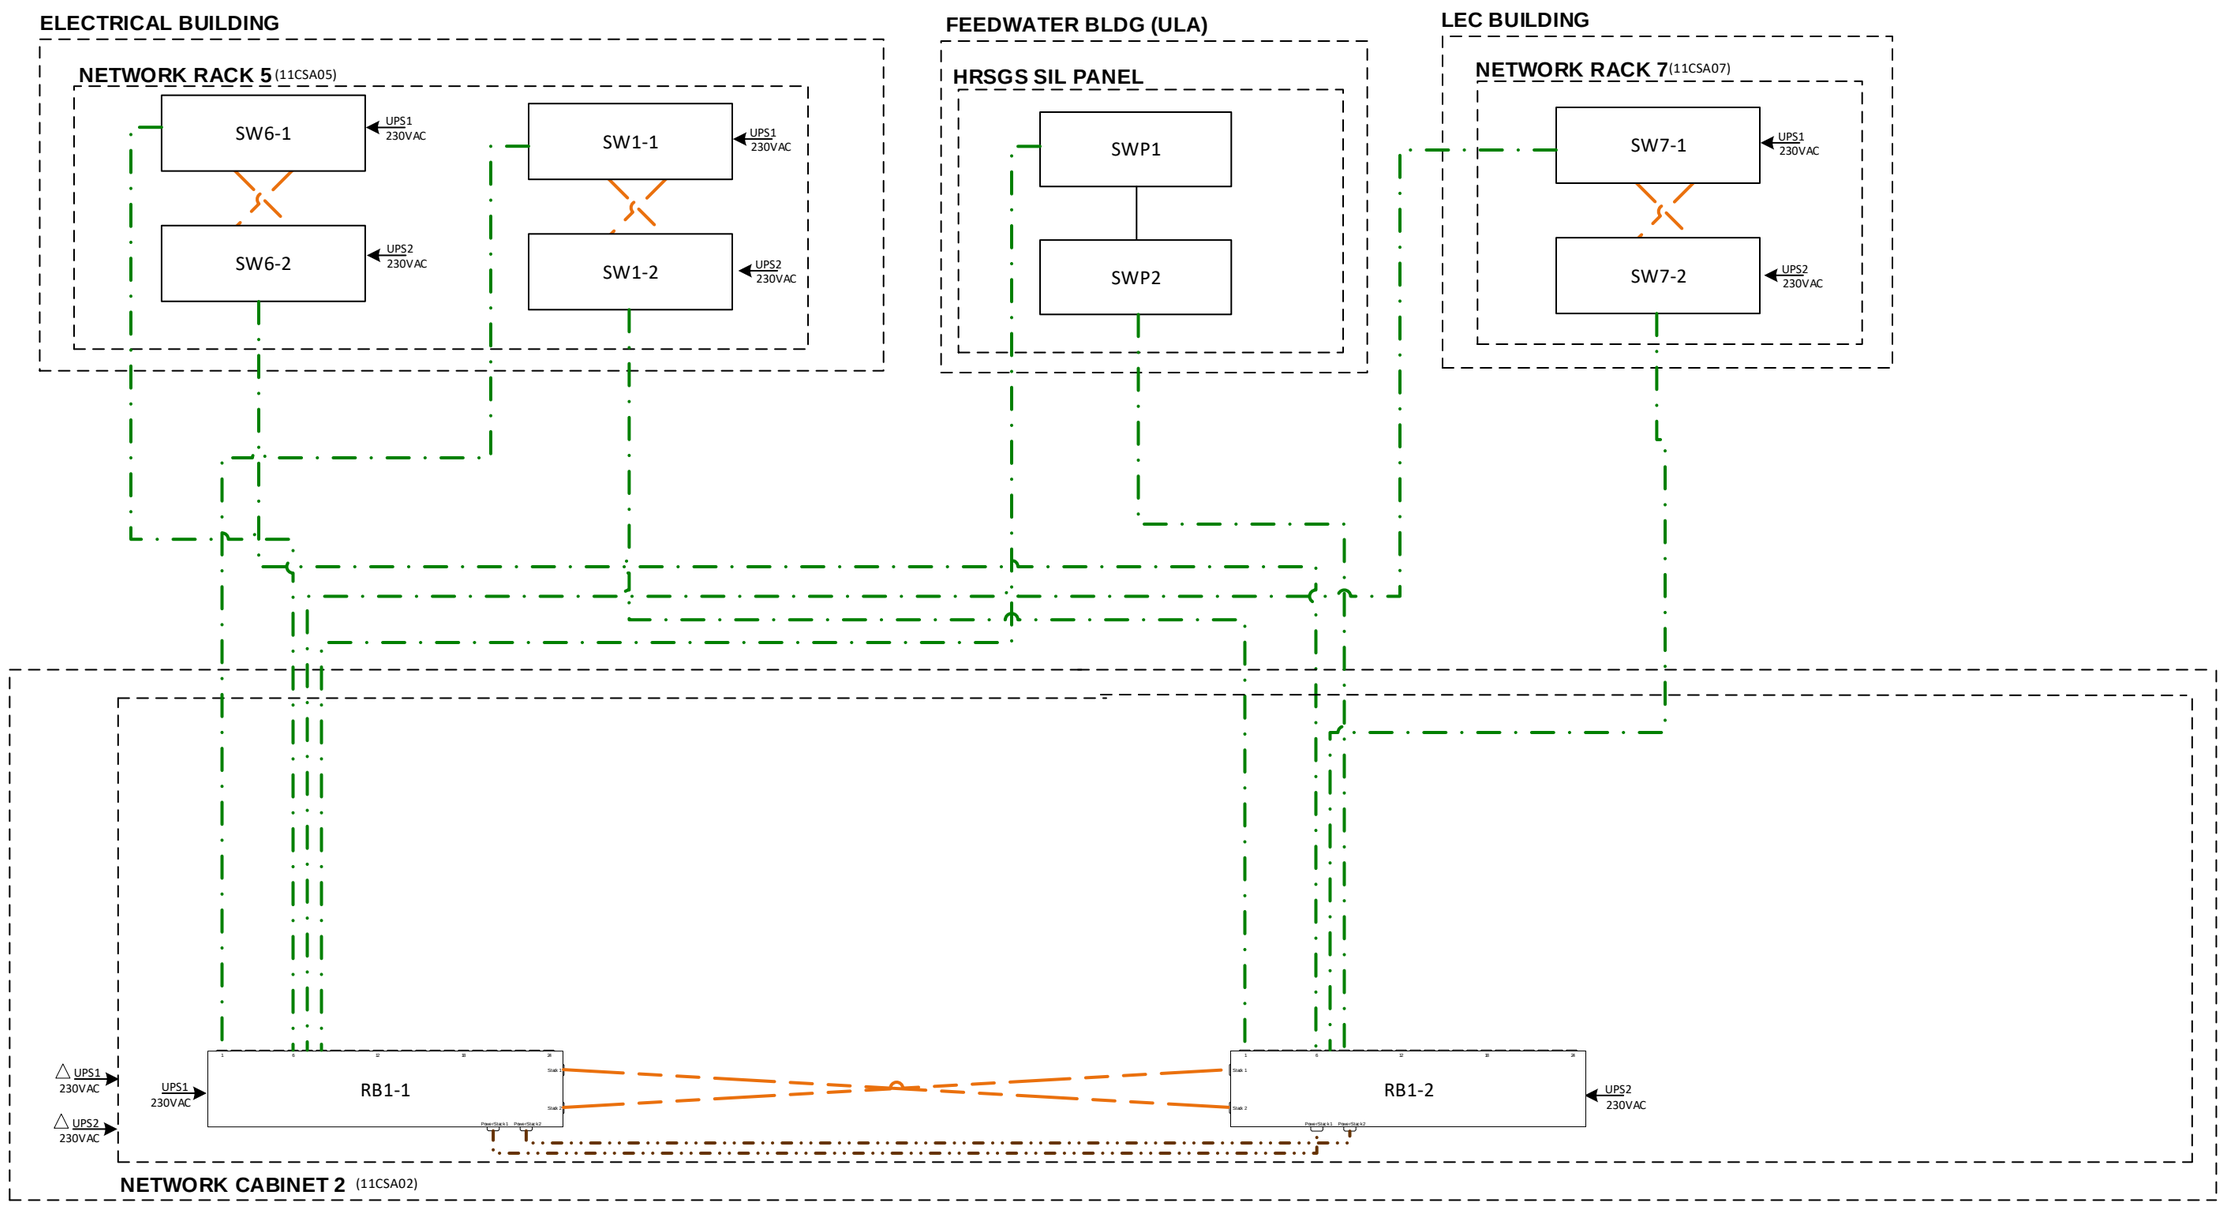

ID#7 - CAT-6 UTP ETHERNET CABLE: (BYGE VERNOVA) (CROSS OVER)

ID#1,#3 - FIBER OPTIC CABLE (SINGLE MODE): (BY CUSTOMER) (PRIMARY)

ID#1,#3 - FIBER OPTIC CABLE (SINGLE MODE): (BY CUSTOMER) (SECONDARY)

ID#31- (BY GE VERNOVA) POWER STACKING: (ROOT BRIDGE SWITCHES)

ID#30 - (BY GE VERNOVA) DATA STACKING: (ROOT/EDGE SWITCHES)

ID#37 – FIBER OPTIC CABLE(SINGLE MODE): (PRIMARY)(PROVIDED BY GE VERNOVA)

ID#37 – FIBER OPTIC CABLE(SINGLE MODE): (SECONDARY)(PROVIDED BY GE VERNOVA)

NETWORK OVERVIEW – SH2

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type: TECHNICAL DOCUMENT		Sheet Size: B
Document Title: **ASSY, REMOTE CONTROL SYS**		
Creation Date: 2021-10-28	Drawing Number: 302T0147	Revision: E / Sheet: 8 of 27

A

Switch:	RB1-1 (11CSA02GH001)	**ID#:**	35	**Location:**	SERVER ROOM - NETWORK CABINET 2
Part No:	117T6409P54RBAAA			**IP Address:**	172.16.205.247
Type:	SMF VLAN STACKED ROOT BRIDGE SW			**Power Source:**	UPS1

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
Trunk	SMF	1,3	1	SW1-1:Port G1	SMF VLAN STACKED EDGE SW WITH 4SFP (ELECTRICAL BUILDING)	172.16.202.1
Trunk	SMF	1,3	2	SW2-1:Port G1	SMF VLAN STACKED EDGE SW WITH 4SFP (CCR)	172.16.202.2
Trunk	SMF	1,3	3	SW3-1:Port G1	SMF VLAN STACKED EDGE SW WITH 4SFP (ENGINEERNG ROOM)	172.16.202.3
Trunk	SMF	1,3	4	SW4-1:Port G1	SMF VLAN STACKED EDGE SW WITH 4SFP (ENGINEERNG ROOM)	172.16.202.4
Trunk	SMF	1,3	5	SW5-1:Port G1	SMF VLAN STACKED EDGE SW WITH 4SFP (ENGINEERNG ROOM)	172.16.202.5
Trunk	SMF	1,3	6	SW6-1:Port G1	SMF VLAN STACKED EDGE SW WITH 4SFP (ELECTRICAL BUILDING)	172.16.202.6
Trunk	SMF	1,3	7	SW7-1:Port G1	SMF VLAN STACKED EDGE SW WITH 4SFP (ELECTRICAL BUILDING)	172.16.202.7
Trunk	SMF	1,3	8	SWP1:Port 1	SMF VLAN CISCO IE 1SFP SW (8 PORT)(FEED WATER BUILDING)	172.16.203.1
Trunk	SMF	-	9	SPARE	-	-
Trunk	SMF	-	10	SPARE	-	-
Trunk	SMF	-	11	SPARE	-	-
Trunk	SMF	-	12	SPARE	-	-
Trunk	SMF	-	13	SPARE	-	-
Trunk	SMF	-	14	SPARE	-	-
Trunk	SMF	-	15	SPARE	-	-
Trunk	SMF	-	16	SPARE	-	-
Trunk	SMF	-	17	SPARE	-	-
Trunk	SMF	-	18	SPARE	-	-
Trunk	SMF	-	19	SPARE	-	-
Trunk	SMF	-	20	SPARE	-	-
Trunk	SMF	-	21	SPARE	-	-
Trunk	SMF	-	22	SPARE	-	-
-	-	5	23*	NSG-L250-1:PORT 1	NOZOMI NSG-L250 IDS	-
Trunk	CAT6	5	24	RTR1:GE 0/0	4331 Router	10.10.11.2
Stack 9300	Flex Stack 9300	-	STACKING 1	RB1-2:Stack 2	Cisco 9300 24 Port Root Bridge Stackable	172.16.205.247
Stack 9300	Flex Stack 9300	-	STACKING 2	RB1-2:Stack 1	Cisco 9300 24 Port Root Bridge Stackable	172.16.205.247
Pwr Stack 9300	Pwr Stack 9300	31	STACKING 1	RB1-2:Stack 2	Cisco 9300 24 Port Root Bridge Power Stacking	-
Pwr Stack 9300	Pwr Stack 9300	31	STACKING 2	RB1-2:Stack 1	Cisco 9300 24 Port Root Bridge Power Stacking	-

B

Switch:	RB1-2 (11CSA02GH002)	**ID#:**	35	**Location:**	SERVER ROOM - NETWORK CABINET 2
Part No:	117T6409P54RBAAA			**IP Address:**	172.16.205.247
Type:	SMF VLAN STACKED ROOT BRIDGE SW			**Power Source:**	UPS2

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
Trunk	SMF	1,3	1	SW1-2:Port G1	SMF VLAN STACKED EDGE SW WITH 4SFP (ELECTRICAL BUILDING)	172.16.202.1
Trunk	SMF	1,3	2	SW2-2:Port G1	SMF VLAN STACKED EDGE SW WITH 4SFP (CCR)	172.16.202.2
Trunk	SMF	1,3	3	SW3-2:Port G1	SMF VLAN STACKED EDGE SW WITH 4SFP (ENGINEERNG ROOM)	172.16.202.3
Trunk	SMF	1,3	4	SW4-2:Port G1	SMF VLAN STACKED EDGE SW WITH 4SFP (ENGINEERNG ROOM)	172.16.202.4
Trunk	SMF	1,3	5	SW5-2:Port G1	SMF VLAN STACKED EDGE SW WITH 4SFP (ENGINEERNG ROOM)	172.16.202.5
Trunk	SMF	1,3	6	SW6-2:Port G1	SMF VLAN STACKED EDGE SW WITH 4SFP (ELECTRICAL BUILDING)	172.16.202.6
Trunk	SMF	1,3	7	SW7-2:Port G1	SMF VLAN STACKED EDGE SW WITH 4SFP (ELECTRICAL BUILDING)	172.16.202.7
Trunk	SMF	1,3	8	SWP2:Port 1	SMF VLAN CISCO IE 1SFP SW (8 PORT)(FEED WATER BUILDING)	172.16.203.2
Trunk	SMF	-	9	SPARE	-	-
Trunk	SMF	-	10	SPARE	-	-
Trunk	SMF	-	11	SPARE	-	-
Trunk	SMF	-	12	SPARE	-	-
Trunk	SMF	-	13	SPARE	-	-
Trunk	SMF	-	14	SPARE	-	-
Trunk	SMF	-	15	SPARE	-	-
Trunk	SMF	-	16	SPARE	-	-
Trunk	SMF	-	17	SPARE	-	-
Trunk	SMF	-	18	SPARE	-	-
Trunk	SMF	-	19	SPARE	-	-
Trunk	SMF	-	20	SPARE	-	-
Trunk	SMF	-	21	SPARE	-	-
Trunk	SMF	-	22	SPARE	-	-
-	-	5	23*	NSG-L250-1:PORT 2	NOZOMI NSG-L250 IDS	-
Trunk	CAT6	5	24	RTR2:GE 0/0	4331 Router	10.10.11.3
Stack 9300	Flex Stack 9300	-	STACKING 1	RB1-1:Stack 2	Cisco 9300 24 Port Root Bridge Stackable	172.16.205.247
Stack 9300	Flex Stack 9300	-	STACKING 2	RB1-1:Stack 1	Cisco 9300 24 Port Root Bridge Stackable	172.16.205.247
Pwr Stack 9300	Pwr Stack 9300	31	STACKING 1	RB1-1:Stack 2	Cisco 9300 24 Port Root Bridge Power Stacking	-
Pwr Stack 9300	Pwr Stack 9300	31	STACKING 2	RB1-1:Stack 1	Cisco 9300 24 Port Root Bridge Power Stacking	-

* Note - Port configured as SPAN Port

CENTRAL CONTROL ROOM

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type: TECHNICAL DOCUMENT			Sheet Size: B
Document Title: **ASSY, REMOTE CONTROL SYS**			
Creation Date: 2021-10-28	Drawing Number: 302T0147	Revision: E	Sheet: 9 of 27

A

Switch:	NSG-L250-1 (11CSA02GH019)	**ID#:**	49	**Location:**	SERVER ROOM - NETWORK CABINET 2
Part No:	138T9799G0001			**IP Address:**	172.16.204.10
Type:	NOZOMI NSG-L250 IDS			**Power Source:**	UPS1

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
-	-	5	1*	RB1-1:PORT 23	9300 SMF VLAN STACKED ROOT BRIDGE SW SPAN PORT	172.16.205.247
-	-	5	2*	RB1-2:PORT 23	9300 SMF VLAN STACKED ROOT BRIDGE SW SPAN PORT	172.16.205.247
-	CAT6	5	3	SW2-1:PORT 20	SMF VLAN STACKED EDGE SW WITH 4SFP	172.16.202.2
-	CAT6	5	4	SW2-2:PORT 20	SMF VLAN STACKED EDGE SW WITH 4SFP	172.16.202.2
-	CAT6	-	5	SPARE	-	-
CUST	CAT6	5	MGMT	-	-	172.16.202.2

B

Switch:	NSG-2 (11CSA02GH022)	**ID#:**	51	**Location:**	SERVER ROOM - NETWORK CABINET 2
Part No:	By Customer			**IP Address:**	TBD-Customer
Type:	-			**Power Source:**	UPS2

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
-	CAT6	5	1	SW1-1:PORT 20	SMF VLAN STACKED EDGE SW WITH 4SFP	172.16.202.1
-	CAT6	5	2	SW1-2:PORT 20	SMF VLAN STACKED EDGE SW WITH 4SFP	172.16.202.1
-	CAT6	-	3	SPARE	-	-
-	CAT6	-	4	SPARE	-	-
-	CAT6	5	5	SW3-1:PORT 20	SMF VLAN STACKED EDGE SW WITH 4SFP	172.16.202.3
-	CAT6	5	6	SW3-2:PORT 20	SMF VLAN STACKED EDGE SW WITH 4SFP	172.16.202.3
-	CAT6	5	7	SW4-1:PORT 20	SMF VLAN STACKED EDGE SW WITH 4SFP	172.16.202.4
-	CAT6	5	8	SW4-2:PORT 20	SMF VLAN STACKED EDGE SW WITH 4SFP	172.16.202.4
-	CAT6	5	9	SW5-1:PORT 20	SMF VLAN STACKED EDGE SW WITH 4SFP	172.16.202.5
-	CAT6	5	10	SW5-2:PORT 20	SMF VLAN STACKED EDGE SW WITH 4SFP	172.16.202.5
-	CAT6	5	11	SW6-1:PORT 20	SMF VLAN STACKED EDGE SW WITH 4SFP	172.16.202.6
-	CAT6	5	12	SW6-1:PORT 20	SMF VLAN STACKED EDGE SW WITH 4SFP	172.16.202.6
-	CAT6	5	13	SPARE	-	-
CUST	CAT6	5	MGMT	-	-	TBD

* Note - Port configured as SPAN Port

CENTRAL CONTROL ROOM

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type: TECHNICAL DOCUMENT			Sheet Size: B
Document Title: **ASSY, REMOTE CONTROL SYS**			
Creation Date: 2021-10-28	Drawing Number: 302T0147	Revision: E	Sheet: 10 of 27

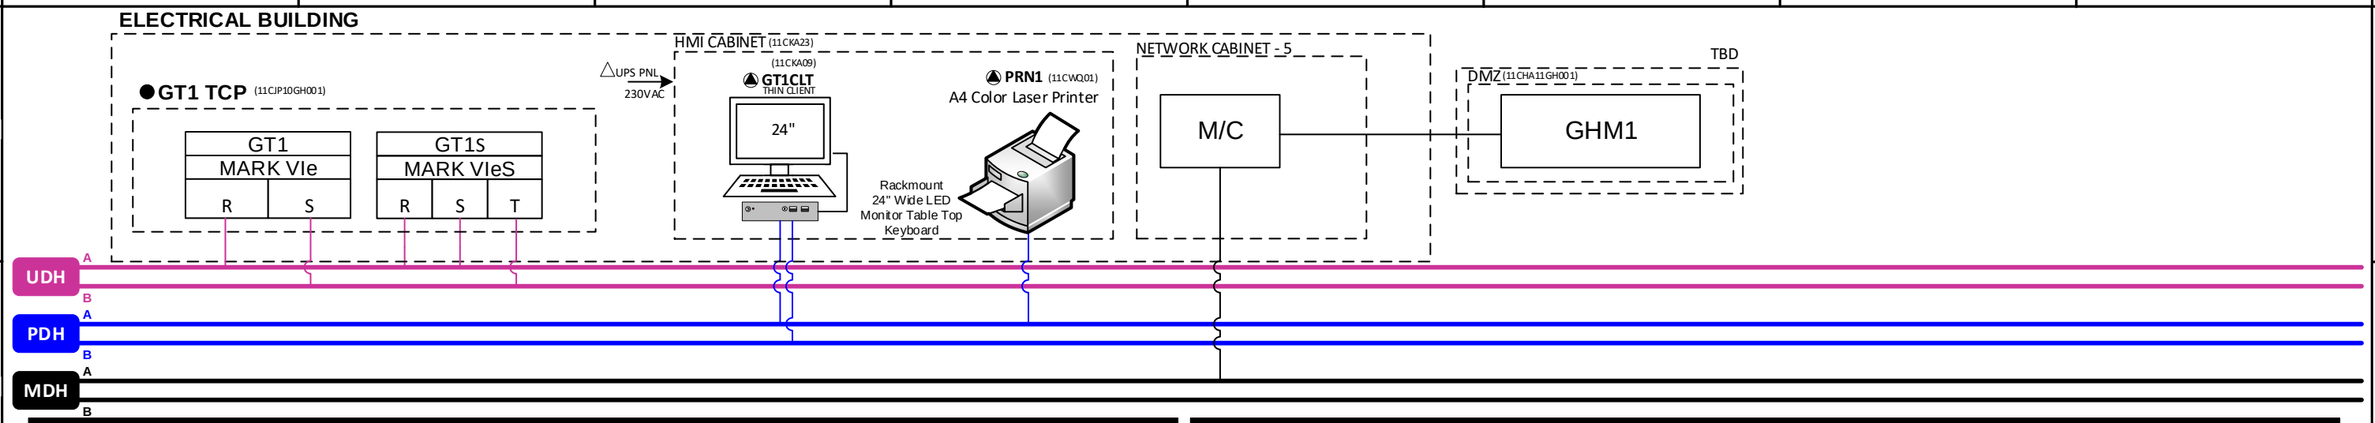

A

Switch:	SW6-1 (11CSA05GH003)	**ID#:**	33	**Location:**	ELECTRICAL BUILDING - NETWORK CABINET 5
Part No:	117T6409P36RCAAB			**IP Address:**	172.16.202.6
Type:	SMF VLAN STACKED EDGE SW WITH 4SFP			**Power Source:**	UPS1

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
PDH	CAT6	-	1	SPARE	-	-
PDH	CAT6	6	2	GT1CLT:1	THIN CLIENT - PRIMARY	172.16.200.1
PDH	CAT6	-	3	SPARE	-	-
PDH	CAT6	5	4	PRN1	A4 COLOR LASER PRINTER	172.16.205.40
PDH	CAT6	-	5	SPARE	-	-
PDH	CAT6	-	6	SPARE	-	-
PDH	CAT6	-	7	SPARE	-	-
PDH	CAT6	-	8	SPARE	-	-
PDH	CAT6	-	9	SPARE	-	-
PDH	CAT6	-	10	SPARE	-	-
UDH	CAT6	7	11	GT1:R	GT1 <R> CONTROLLER	172.16.101.111
UDH	CAT6	7	12	GT1S:R	GT1S <R> CONTROLLER	172.16.101.135
UDH	CAT6	-	13	SPARE	-	-
UDH	CAT6	-	14	SPARE	-	-
UDH	CAT6	-	15	SPARE	-	-
UDH	CAT6	-	16	SPARE	-	-
UDH	CAT6	-	17	SPARE	-	-
UDH	CAT6	-	18	SPARE	-	-
UDH	CAT6	-	19	SPARE	-	-
SPAN	CAT6	-	20	SPARE	-	-
UDH	CAT6	-	21	SPARE	-	-
UDH	CAT6	-	22	SPARE	-	-
MDH	CAT6	5	23	GHM	GHM	172.16.16.54
MDH	CAT6	-	24	SPARE	-	-
Trunk	SMF	37	G1	RB1-1:6	SMF VLAN STACKED ROOT BRIDGE SW (CCR)	172.16.205.247
Trunk	SMF	-	G2	SPARE	-	-
Trunk	SMF	-	G3	SPARE	-	-
Trunk	SMF	-	G4	SPARE	-	-
STACK	STACKING	30	STACKING 1	SW6-2: STACKING 2	9200L EDGE SWITCH	-
STACK	STACKING	30	STACKING 2	SW6-2: STACKING 1	9200L EDGE SWITCH	-

B

Switch:	SW6-2 (11CSA05GH004)	**ID#:**	33	**Location:**	ELECTRICAL BUILDING - NETWORK CABINET 5
Part No:	117T6409P36RCAAB			**IP Address:**	172.16.202.6
Type:	SMF VLAN STACKED EDGE SW WITH 4SFP			**Power Source:**	UPS2

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
PDH	CAT6	-	1	SPARE	-	-
PDH	CAT6	6	2	GT1CLT:2	THIN CLIENT - SECONDARY	172.16.200.1
PDH	CAT6	-	3	SPARE	-	-
PDH	CAT6	-	4	SPARE	-	-
PDH	CAT6	-	5	SPARE	-	-
PDH	CAT6	-	6	SPARE	-	-
PDH	CAT6	-	7	SPARE	-	-
PDH	CAT6	-	8	SPARE	-	-
PDH	CAT6	-	9	SPARE	-	-
PDH	CAT6	-	10	SPARE	-	-
UDH	CAT6	7	11	GT1:S	GT1 <S> CONTROLLER	172.16.101.112
UDH	CAT6	7	12	GT1S:S	GT1S <S> CONTROLLER	172.16.101.136
UDH	CAT6	7	13	GT1S:T	GT1S <T> CONTROLLER	172.16.101.137
UDH	CAT6	-	14	SPARE	-	-
UDH	CAT6	-	15	SPARE	-	-
UDH	CAT6	-	16	SPARE	-	-
UDH	CAT6	-	17	SPARE	-	-
UDH	CAT6	-	18	SPARE	-	-
UDH	CAT6	-	19	SPARE	-	-
SPAN	CAT6	-	20	SPARE	-	-
UDH	CAT6	-	21	SPARE	-	-
UDH	CAT6	-	22	SPARE	-	-
MDH	CAT6	-	23	SPARE	-	-
MDH	CAT6	-	24	SPARE	-	-
Trunk	SMF	37	G1	RB1-2:6	SMF VLAN STACKED ROOT BRIDGE SW (CCR)	172.16.205.247
Trunk	SMF	-	G2	SPARE	-	-
Trunk	SMF	-	G3	SPARE	-	-
Trunk	SMF	-	G4	SPARE	-	-
STACK	STACKING	30	STACKING 1	SW6-1: STACKING 2	9200L EDGE SWITCH	-
STACK	STACKING	30	STACKING 2	SW6-1: STACKING 1	9200L EDGE SWITCH	-

ELECTRICAL BUILDING

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type: TECHNICAL DOCUMENT

Sheet Size: B

Document Title: **ASSY, REMOTE CONTROL SYS**

Creation Date: 2021-10-28

Drawing Number: 302T0147

Revision: E

Sheet: 11 of 27

A

Switch:	SW7-1 (11CSA07GH001)	**ID#:**	33	**Location:**	LEC BUILDING – NETWORK RACK
Part No:	117T6409P36RCAAB			**IP Address:**	172.16.202.7
Type:	SMF VLAN STACKED EDGE SW WITH 4SFP			**Power Source:**	UPS1

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
PDH	CAT6	-	1	SPARE	-	-
PDH	CAT6	-	2	SPARE	-	-
PDH	CAT6	-	3	SPARE	-	-
PDH	CAT6	-	4	SPARE	-	-
PDH	CAT6	-	5	SPARE	-	-
PDH	CAT6	-	6	SPARE	-	-
PDH	CAT6	-	7	SPARE	-	-
PDH	CAT6	-	8	SPARE	-	-
PDH	CAT6	-	9	SPARE	-	-
PDH	CAT6	-	10	SPARE	-	-
UDH	CAT6	-	11	SPARE	-	-
UDH	CAT6	-	12	SPARE	-	-
UDH	CAT6	-	13	SPARE	-	-
UDH	CAT6	7	14	E1:KEYPAD	E1 - KEYPAD	172.16.101.119
UDH	CAT6	7	15	E1:M1	E1 - M1 - CONTROLLER	172.16.101.116
UDH	CAT6	-	16	SPARE	-	-
UDH	CAT6	7	17	L1	GT1 STATIC STARTER – LS2100e	172.16.101.110
UDH	CAT6	-	18	SPARE	-	-
UDH	CAT6	-	19	SPARE	-	-
UDH	CAT6	-	20	SPARE	-	-
UDH	CAT6	-	21	SPARE	-	-
UDH	CAT6	-	22	SPARE	-	-
MDH	CAT6	-	23	SPARE	-	-
MDH	CAT6	-	24	SPARE	-	172.16.16.1
Trunk	SMF	37	G1	RB1-1:7	SMF VLAN STACKED ROOT BRIDGE SW (CCR)	172.16.205.247
Trunk	SMF	-	G2	SPARE	-	-
Trunk	SMF	-	G3	SPARE	-	-
Trunk	SMF	-	G4	SPARE	-	-
STACK	STACKING	30	STACKING 1	SW7-2: STACKING 2	9200L EDGE SWITCH	-
STACK	STACKING	30	STACKING 2	SW7-2: STACKING 1	9200L EDGE SWITCH	-

B

Switch:	SW7-2 (11CSA07GH002)	**ID#:**	33	**Location:**	LEC BUILDING – NETWORK RACK
Part No:	117T6409P36RCAAB			**IP Address:**	172.16.202.7
Type:	SMF VLAN STACKED EDGE SW WITH 4SFP			**Power Source:**	UPS2

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
PDH	CAT6	-	1	SPARE	-	-
PDH	CAT6	-	2	SPARE	-	-
PDH	CAT6	-	3	SPARE	-	-
PDH	CAT6	-	4	SPARE	-	-
PDH	CAT6	-	5	SPARE	-	-
PDH	CAT6	-	6	SPARE	-	-
PDH	CAT6	-	7	SPARE	-	-
PDH	CAT6	-	8	SPARE	-	-
PDH	CAT6	-	9	SPARE	-	-
PDH	CAT6	-	10	SPARE	-	-
UDH	CAT6	-	11	SPARE	-	-
UDH	CAT6	-	12	SPARE	-	-
UDH	CAT6	-	13	SPARE	-	-
UDH	CAT6	-	14	SPARE	-	-
UDH	CAT6	7	15	E1:M2	E1 – M2 - CONTROLLER	172.16.101.117
UDH	CAT6	7	16	E1:C	E1 - C - CONTROLLER	172.16.101.118
UDH	CAT6	-	17	SPARE	-	-
UDH	CAT6	-	18	SPARE	-	-
UDH	CAT6	-	19	SPARE	-	-
UDH	CAT6	-	20	SPARE	-	-
UDH	CAT6	-	21	SPARE	-	-
UDH	CAT6	-	22	SPARE	-	-
MDH	CAT6	-	23	SPARE	-	-
MDH	CAT6	-	24	SPARE	-	-
Trunk	SMF	37	G1	RB1-2:7	SMF VLAN STACKED ROOT BRIDGE SW (CCR)	172.16.205.247
Trunk	SMF	-	G2	SPARE	-	-
Trunk	SMF	-	G3	SPARE	-	-
Trunk	SMF	-	G4	SPARE	-	-
STACK	STACKING	30	STACKING 1	SW7-1: STACKING 2	9200L EDGE SWITCH	-
STACK	STACKING	30	STACKING 2	SW7-1: STACKING 1	9200L EDGE SWITCH	-

LEC BUILDING

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type: TECHNICAL DOCUMENT		Sheet Size: B
Document Title: **ASSY, REMOTE CONTROL SYS**		
Creation Date: 2021-10-28	Drawing Number: 302T0147	Revision: E / Sheet: 12 of 27

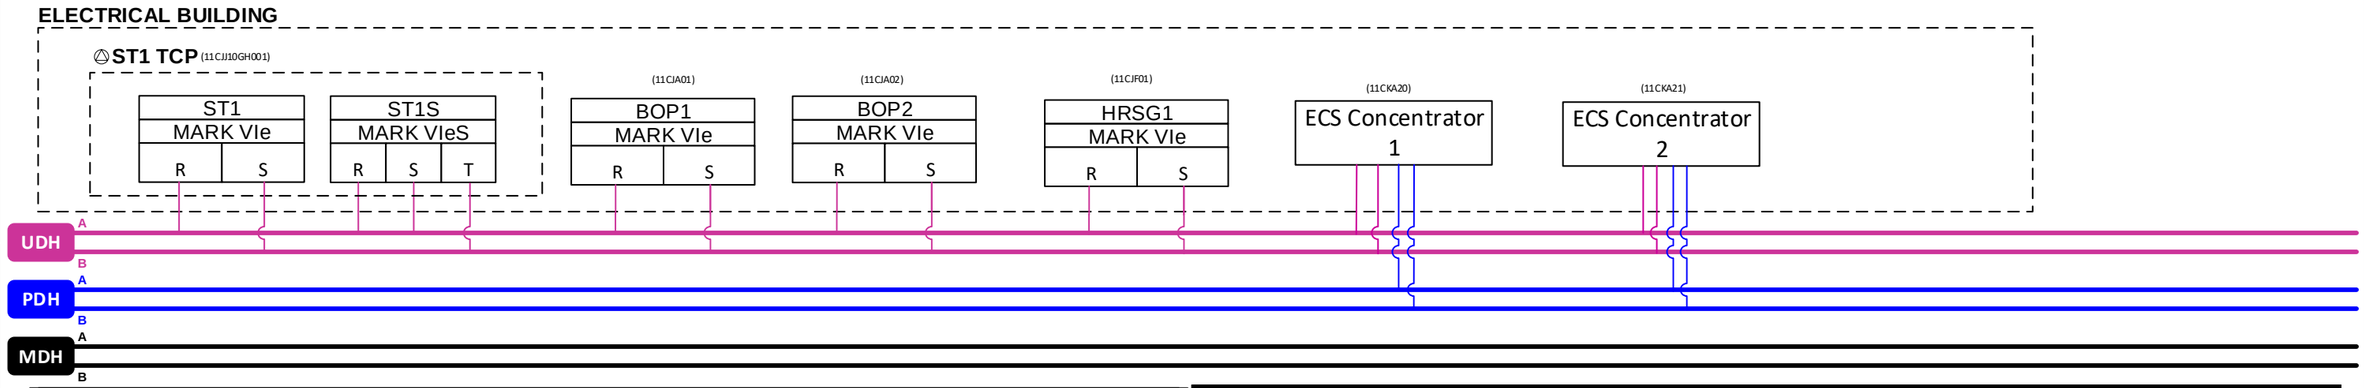

A

Switch:	SW1-1 (11CSA05GH001)	**ID#:**	33	**Location:**	ELECTRICAL BUILDING - NETWORK CABINET 5
Part No:	117T6409P36RCAAB			**IP Address:**	172.16.202.1
Type:	SMF VLAN STACKED EDGE SW WITH 4SFP			**Power Source:**	UPS1

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
PDH	CAT6	5	1	ECS 1 -PRI	ECS CONCENTRATOR 1 - PRIMARY	172.16.205.127
PDH	CAT6	5	2	ECS 2 -PRI	ECS CONCENTRATOR 2 - PRIMARY	172.16.205.128
PDH	CAT6	-	3	SPARE	-	-
PDH	CAT6	-	4	SPARE	-	-
PDH	CAT6	-	5	SPARE	-	-
PDH	CAT6	-	6	SPARE	-	-
PDH	CAT6	-	7	SPARE	-	-
PDH	CAT6	-	8	SPARE	-	-
PDH	CAT6	-	9	SPARE	-	-
PDH	CAT6	-	10	SPARE	-	-
UDH	CAT6	5	11	BOP1:R	BOP1 <R> CONTROLLER	172.16.101.40
UDH	CAT6	5	12	BOP2:R	BOP2 <R> CONTROLLER	172.16.101.73
UDH	CAT6	5	13	HRSG1:R	HRSG1 <R> CONTROLLER	172.16.101.30
UDH	CAT6	-	14	SPARE	-	-
UDH	CAT6	-	15	SPARE	-	-
UDH	CAT6	5	16	ECS 1 - PRI	ECS CONCENTRATOR 1 - PRIMARY	172.16.101.27
UDH	CAT6	5	17	ECS 2 - PRI	ECS CONCENTRATOR 2 - PRIMARY	172.16.101.28
UDH	CAT6	5	18	ST1:R	ST1 <R> CONTROLLER	172.16.101.211
UDH	CAT6	5	19	ST1S:R	ST1S <R> CONTROLLER	172.16.101.222
SPAN	CAT6	-	20	SPARE	-	-
UDH	CAT6	-	21	SPARE	-	-
UDH	CAT6	-	22	SPARE	-	-
MDH	CAT6	-	23	SPARE	-	-
MDH	CAT6	-	24	SPARE	-	-
Trunk	SMF	37	G1	RB1-1:1	SMF VLAN STACKED ROOT BRIDGE SW (CCR)	172.16.205.247
Trunk	SMF	-	G2	SPARE	-	-
Trunk	SMF	-	G3	SPARE	-	-
Trunk	SMF	-	G4	SPARE	-	-
STACK	STACKING	30	STACKING 1	SW1-2: STACKING 2	9200L EDGE SWITCH	-
STACK	STACKING	30	STACKING 2	SW1-2: STACKING 1	9200L EDGE SWITCH	-

B

Switch:	SW1-2 (11CSA05GH002)	**ID#:**	33	**Location:**	ELECTRICAL BUILDING - NETWORK CABINET 5
Part No:	117T6409P36RCAAB			**IP Address:**	172.16.202.1
Type:	SMF VLAN STACKED EDGE SW WITH 4SFP			**Power Source:**	UPS2

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
PDH	CAT6	5	1	ECS 1 -SEC	ECS CONCENTRATOR 1 - SECONDARY	172.16.205.127
PDH	CAT6	5	2	ECS 2 -SEC	ECS CONCENTRATOR 2 - SECONDARY	172.16.205.128
PDH	CAT6	-	3	SPARE	-	-
PDH	CAT6	-	4	SPARE	-	-
PDH	CAT6	-	5	SPARE	-	-
PDH	CAT6	-	6	SPARE	-	-
PDH	CAT6	-	7	SPARE	-	-
PDH	CAT6	-	8	SPARE	-	-
PDH	CAT6	-	9	SPARE	-	-
PDH	CAT6	-	10	SPARE	-	-
UDH	CAT6	5	11	BOP1:S	BOP1 <S> CONTROLLER	172.16.101.41
UDH	CAT6	5	12	BOP2:S	BOP2 <S> CONTROLLER	172.16.101.74
UDH	CAT6	5	13	HRSG1:S	HRSG1S <S> CONTROLLER	172.16.101.31
UDH	CAT6	-	14	SPARE	-	-
UDH	CAT6	-	15	SPARE	-	-
UDH	CAT6	5	16	ECS 1 - SEC	ECS CONCENTRATOR 1 - SECONDARY	172.16.101.27
UDH	CAT6	5	17	ECS 2 - SEC	ECS CONCENTRATOR 2 - SECONDARY	172.16.101.28
UDH	CAT6	5	18	ST1:S	ST1 <S> CONTROLLER	172.16.101.212
UDH	CAT6	5	19	ST1S:S	ST1S <S> CONTROLLER	172.16.101.223
SPAN	CAT6	5	20	ST1S:T	ST1S <T> CONTROLLER	172.16.101.224
UDH	CAT6	-	21	SPARE	-	-
UDH	CAT6	-	22	SPARE	-	-
MDH	CAT6	-	23	SPARE	-	-
MDH	CAT6	-	24	SPARE	-	-
Trunk	SMF	37	G1	RB1-2:1	SMF VLAN STACKED ROOT BRIDGE SW (CCR)	172.16.205.247
Trunk	SMF	-	G2	SPARE	-	-
Trunk	SMF	-	G3	SPARE	-	-
Trunk	SMF	-	G4	SPARE	-	-
STACK	STACKING	30	STACKING 1	SW1-1: STACKING 2	9200L EDGE SWITCH	-
STACK	STACKING	30	STACKING 2	SW1-1: STACKING 1	9200L EDGE SWITCH	-

ELECTRICAL BUILDING

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type: TECHNICAL DOCUMENT			Sheet Size: B
Document Title: **ASSY, REMOTE CONTROL SYS**			
Creation Date: 2021-10-28	Drawing Number: 302T0147	Revision: E	Sheet: 13 of 27

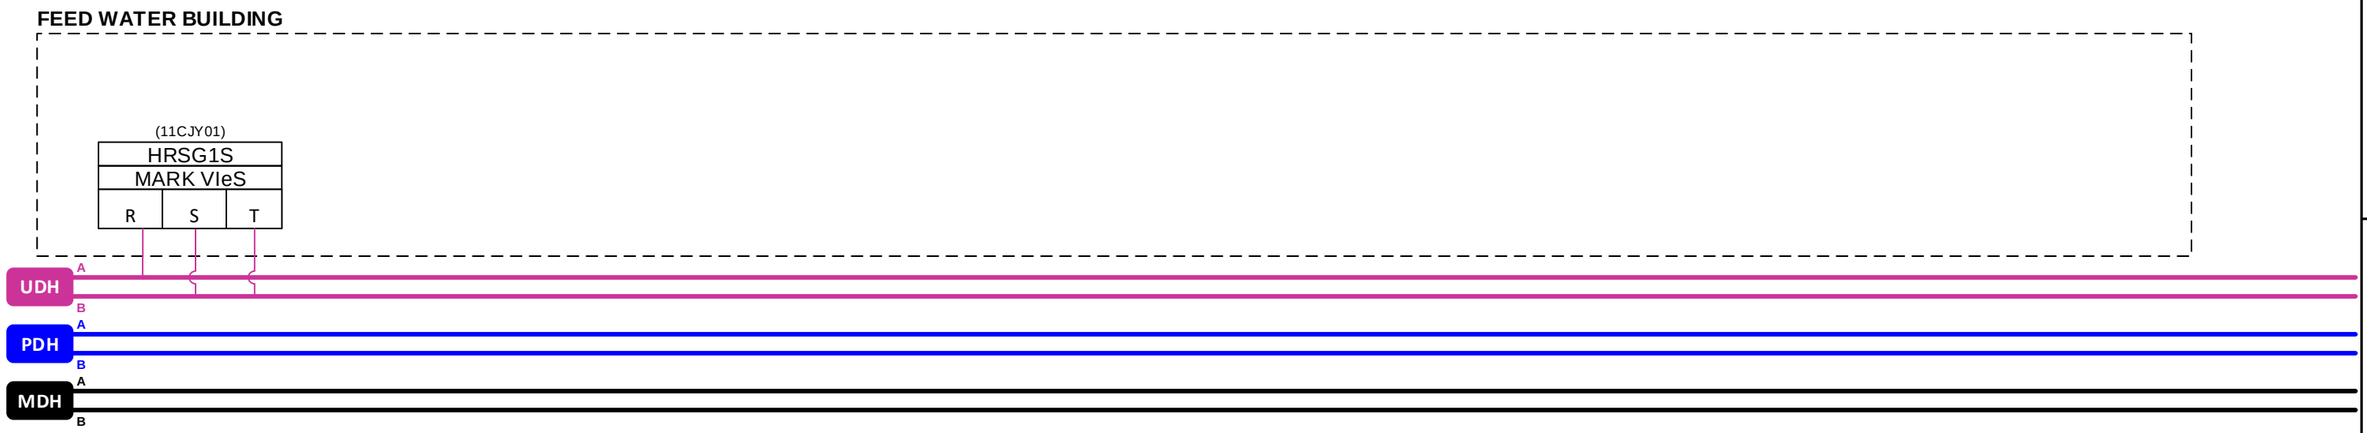

A					
Switch:	SWP1	**ID#:**	42	**Location:**	FEED WATER BUILDING
Part No:	117T6409P041ACAD			**IP Address:**	172.16.203.1
Type:	SMF VLAN CISCO IE 1SFP SW (8 PORT)			**Power Source:**	ST1 TCP PANEL

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
PDH	CAT6	-	1X	SPARE	-	-
PDH	CAT6	-	2X	SPARE	-	-
UDH	CAT6		3X	SPARE	-	-
UDH	CAT6		4X	SPARE	-	-
UDH	CAT6	5	5X	HRSG1S:R	HRSG1S <R> CONTROLLER	172.16.101.138
UDH	CAT6	-	6X	SPARE	-	-
UDH	CAT6	-	7X	SPARE	-	-
UDH	CAT6	-	8X	SPARE	-	-
Trunk	SMF	1,3	Port 1	RB1-1:8	SMF VLAN STACKED ROOT BRIDGE SW (HRSGS)	172.16.205.247
Trunk	SMF	-	Port 2	NA	DO NOT USE	-
Trunk	CAT6	-	Port 1	NA	DO NOT USE	-
Trunk	CAT6	7	Port 2	SWP2:PORT 2	SMF VLAN CISCO IE 1SFP SW (8 PORT)	172.16.203.2

Switch:	SWP2	**ID#:**	42	**Location:**	FEED WATER BUILDING
Part No:	117T6409P041ACAD			**IP Address:**	172.16.203.2
Type:	SMF VLAN CISCO IE 1SFP SW (8 PORT)			**Power Source:**	ST1 TCP PANEL

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
PDH	CAT6	-	1X	SPARE	-	-
PDH	CAT6	-	2X	SPARE	-	-
UDH	CAT6	-	3X	SPARE	-	-
UDH	CAT6	-	4X	SPARE	-	-
UDH	CAT6	5	5X	HRSG1S:S	HRSG1S <S> CONTROLLER	172.16.101.139
UDH	CAT6	5	6X	HRSG1S:T	HRSG1S <T> CONTROLLER	172.16.101.140
UDH	CAT6	-	7X	SPARE	-	-
UDH	CAT6	-	8X	SPARE	-	-
Trunk	SMF	1,3	Port 1	RB1-2:8	SMF VLAN STACKED ROOT BRIDGE SW (HRSGS)	172.16.205.247
Trunk	SMF	-	Port 2	NA	DO NOT USE	-
Trunk	CAT6	-	Port 1	NA	DO NOT USE	-
Trunk	CAT6	7	Port 2	SWP1:PORT 2	SMF VLAN CISCO IE 1SFP SW (8 PORT)	172.16.203.1

FEED WATER BUILDING

NLR
Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type:	Sheet Size:
TECHNICAL DOCUMENT	B

Document Title: **ASSY, REMOTE CONTROL SYS**

Creation Date:	Drawing Number:	Revision:	Sheet:
2021-10-28	302T0147	E	14 of 27

CENTRAL CONTROL ROOM

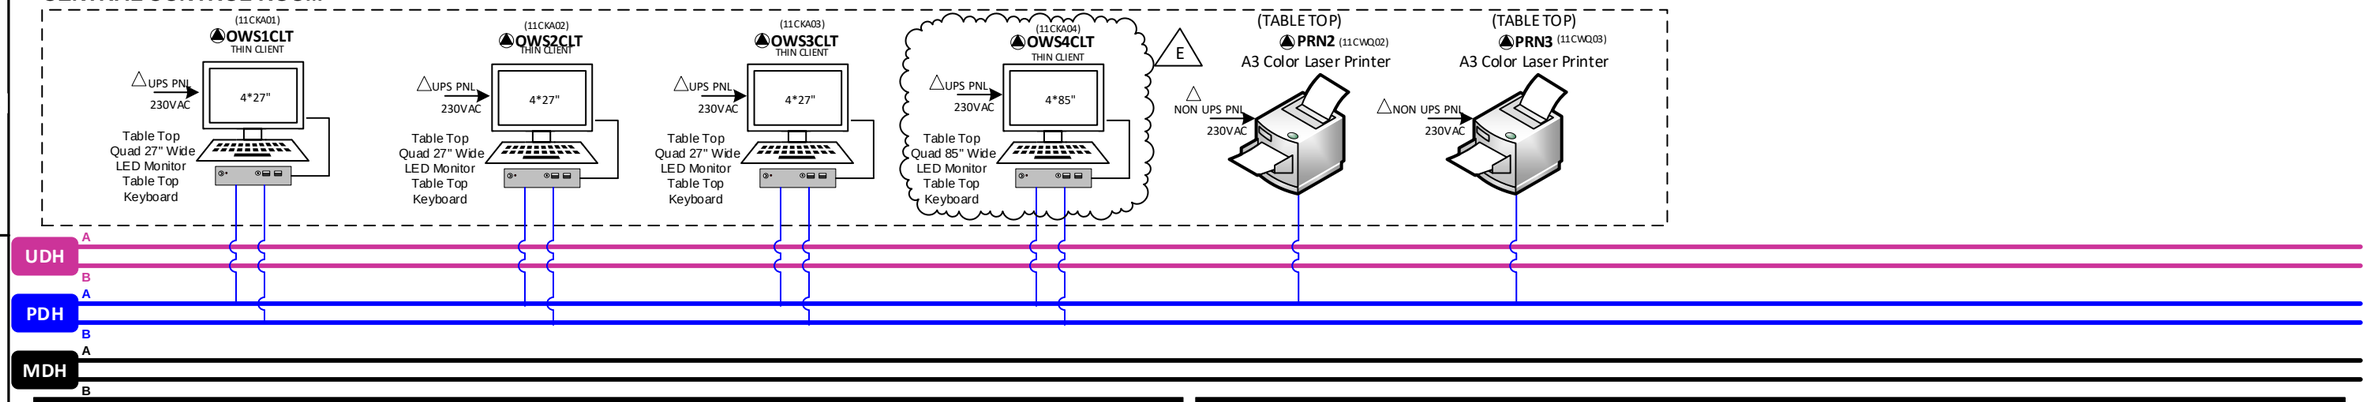

A

Switch:	SW2-1 (11CSA02GH003)	ID#:	33	Location:	SERVER ROOM – NETWORK CABINET 2
Part No:	117T6409P36RCAAB			IP Address:	172.16.202.2
Type:	SMF VLAN STACKED EDGE SW WITH 4SFP			Power Source:	UPS1

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
PDH	CAT6	6	1	OWS1CLT:1	THIN CLIENT - PRIMARY	172.16.200.5
PDH	CAT6	6	2	OWS2CLT:1	THIN CLIENT - PRIMARY	172.16.200.6
PDH	CAT6	6	3	OWS3CLT:1	THIN CLIENT - PRIMARY	172.16.200.7
PDH	CAT6	6	4	OWS4CLT:1	THIN CLIENT - PRIMARY	172.16.200.8
PDH	CAT6	-	5	SPARE	-	-
PDH	CAT6	-	6	SPARE	-	-
PDH	CAT6	-	7	SPARE	-	-
PDH	CAT6	-	8	SPARE	-	-
PDH	CAT6	-	9	SPARE	-	-
PDH	CAT6	5	10	PRN2	A3 COLOR LASER PRINTER	172.16.205.41
UDH	CAT6	-	11	SPARE	-	-
UDH	CAT6	-	12	SPARE	-	-
UDH	CAT6	-	13	SPARE	-	-
UDH	CAT6	-	14	SPARE	-	-
UDH	CAT6	-	15	SPARE	-	-
UDH	CAT6	-	16	SPARE	-	-
UDH	CAT6	-	17	SPARE	-	-
UDH	CAT6	-	18	SPARE	-	-
UDH	CAT6	-	19	SPARE	-	-
SPAN	CAT6	-	20	SPARE	-	-
UDH	CAT6	-	21	SPARE	-	-
UDH	CAT6	-	22	SPARE	-	-
MDH	CAT6	-	23	SPARE	-	-
MDH	CAT6	5	24	UTM1:2	UNIFIED THREAT MANAGER	172.16.16.1
Trunk	SMF	37	G1	RB1-1:2	SMF VLAN STACKED ROOT BRIDGE SW (CCR)	172.16.205.247
Trunk	SMF	-	G2	SPARE	-	-
Trunk	SMF	-	G3	SPARE	-	-
Trunk	SMF	-	G4	SPARE	-	-
STACK	STACKING	30	STACKING 1	SW2-2: STACKING 2	9200L EDGE SWITCH	-
STACK	STACKING	30	STACKING 2	SW2-2: STACKING 1	9200L EDGE SWITCH	-

B

Switch:	SW2-2 (11CSA02GH004)	ID#:	33	Location:	SERVER ROOM – NETWORK CABINET 2
Part No:	117T6409P36RCAAB			IP Address:	172.16.202.2
Type:	SMF VLAN STACKED EDGE SW WITH 4SFP			Power Source:	UPS2

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
PDH	CAT6	6	1	OWS1CLT:2	THIN CLIENT - SECONDARY	172.16.200.5
PDH	CAT6	6	2	OWS2CLT:2	THIN CLIENT - SECONDARY	172.16.200.6
PDH	CAT6	6	3	OWS3CLT:2	THIN CLIENT - SECONDARY	172.16.200.7
PDH	CAT6	6	4	OWS4CLT:2	THIN CLIENT - SECONDARY	172.16.200.8
PDH	CAT6	-	5	SPARE	-	-
PDH	CAT6	-	6	SPARE	-	-
PDH	CAT6	-	7	SPARE	-	-
PDH	CAT6	-	8	SPARE	-	-
PDH	CAT6	-	9	SPARE	-	-
PDH	CAT6	5	10	PRN3	A3 COLOR LASER PRINTER	172.16.205.42
UDH	CAT6	-	11	SPARE	-	-
UDH	CAT6	-	12	SPARE	-	-
UDH	CAT6	-	13	SPARE	-	-
UDH	CAT6	-	14	SPARE	-	-
UDH	CAT6	-	15	SPARE	-	-
UDH	CAT6	-	16	SPARE	-	-
UDH	CAT6	-	17	SPARE	-	-
UDH	CAT6	-	18	SPARE	-	-
UDH	CAT6	-	19	SPARE	-	-
SPAN	CAT6	-	20	SPARE	-	-
UDH	CAT6	-	21	SPARE	-	-
UDH	CAT6	-	22	SPARE	-	-
MDH	CAT6	-	23	SPARE	-	-
MDH	CAT6	5	24	UTM2:2	UNIFIED THREAT MANAGER	172.16.16.1
Trunk	SMF	37	G1	RB1-2:2	SMF VLAN STACKED ROOT BRIDGE SW (CCR)	172.16.205.247
Trunk	SMF	-	G2	SPARE	-	-
Trunk	SMF	-	G3	SPARE	-	-
Trunk	SMF	-	G4	SPARE	-	-
STACK	STACKING	30	STACKING 1	SW2-1: STACKING 2	9200L EDGE SWITCH	-
STACK	STACKING	30	STACKING 2	SW2-1: STACKING 1	9200L EDGE SWITCH	-

CENTRAL CONTROL ROOM

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type:	Sheet Size:
TECHNICAL DOCUMENT	B

Document Title: **ASSY, REMOTE CONTROL SYS**

Creation Date:	Drawing Number:	Revision:	Sheet:
2021-10-28	302T0147	E	15 of 27

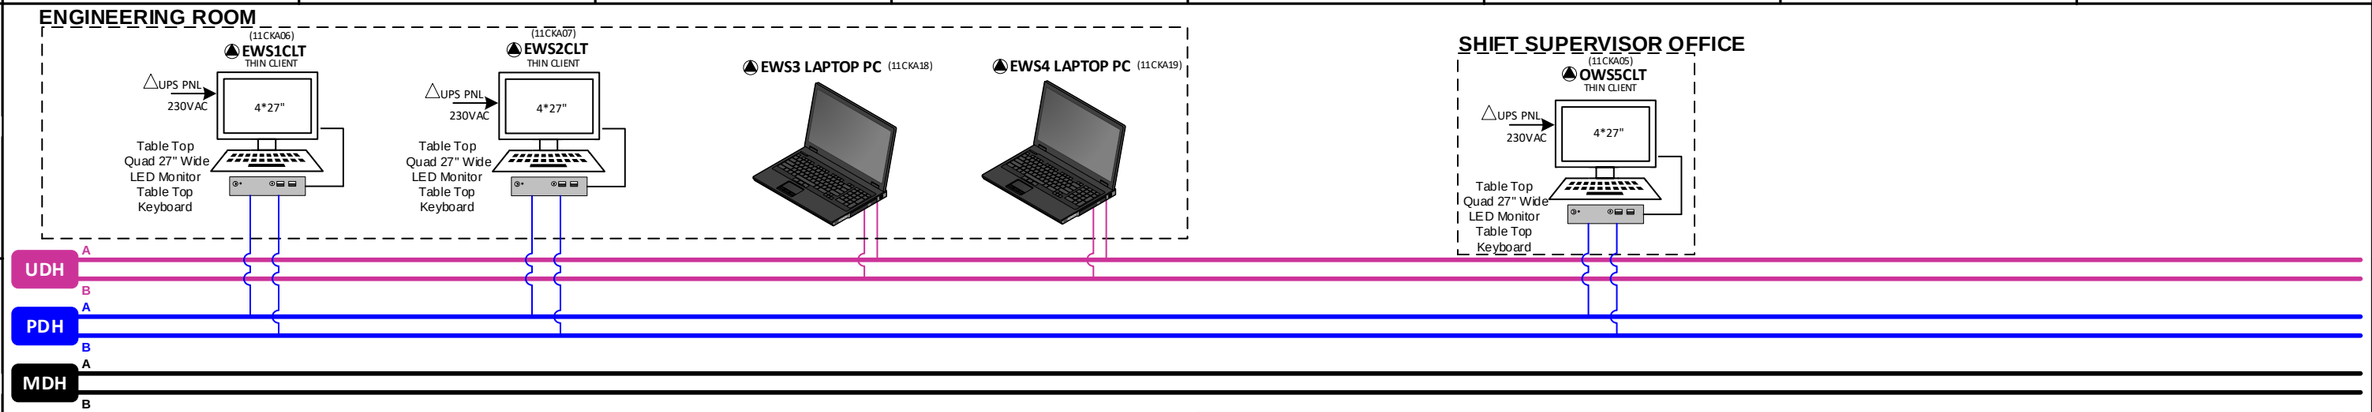

A

Switch:	SW3-1 (11CSA02GH005)	ID#:	33	Location:	SERVER ROOM – NETWORK CABINET 2
Part No:	117T6409P36RCAAB			IP Address:	172.16.202.3
Type:	SMF VLAN STACKED EDGE SW WITH 4SFP			Power Source:	UPS1

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
PDH	CAT6	6	1	EWS1CLT:1	THIN CLIENT - PRIMARY	172.16.200.3
PDH	CAT6	6	2	EWS2CLT:1	THIN CLIENT - PRIMARY	172.16.200.4
PDH	CAT6	6	3	OWS5CLT:1	THIN CLIENT - PRIMARY	172.16.200.9
PDH	CAT6	6	4	EWS3	ENGINEERING LAPTOP EWS3 - PRIMARY	172.16.205.122
PDH	CAT6	6	5	EWS4	ENGINEERING LAPTOP EWS4 - PRIMARY	172.16.205.123
PDH	CAT6	-	6	SPARE	-	-
PDH	CAT6	-	7	SPARE	-	-
PDH	CAT6	-	8	SPARE	-	-
PDH	CAT6	-	9	SPARE	-	-
PDH	CAT6	-	10	SPARE	-	-
UDH	CAT6	6	11	EWS3	ENGINEERING LAPTOP EWS3 - PRIMARY	172.16.101.22
UDH	CAT6	6	12	EWS4	ENGINEERING LAPTOP EWS4 - PRIMARY	172.16.101.23
UDH	CAT6	-	13	SPARE	-	-
UDH	CAT6	-	14	SPARE	-	-
UDH	CAT6	-	15	SPARE	-	-
UDH	CAT6	-	16	SPARE	-	-
UDH	CAT6	-	17	SPARE	-	-
UDH	CAT6	-	18	SPARE	-	-
UDH	CAT6	-	19	SPARE	-	-
SPAN	CAT6	-	20	SPARE	-	-
UDH	CAT6	-	21	SPARE	-	-
UDH	CAT6	-	22	SPARE	-	-
MDH	CAT6	-	23	SPARE	-	-
MDH	CAT6	-	24	SPARE	-	-
Trunk	SMF	37	G1	RB1-1:3	SMF VLAN STACKED ROOT BRIDGE SW (CCR)	172.16.205.247
Trunk	SMF	-	G2	SPARE	-	-
Trunk	SMF	-	G3	SPARE	-	-
Trunk	SMF	-	G4	SPARE	-	-
STACK	STACKING	30	STACKING 1	SW3-2: STACKING 2	9200L EDGE SWITCH	-
STACK	STACKING	30	STACKING 2	SW3-2: STACKING 1	9200L EDGE SWITCH	-

B

Switch:	SW3-2 (11CSA02GH006)	ID#:	33	Location:	SERVER ROOM – NETWORK CABINET 2
Part No:	117T6409P36RCAAB			IP Address:	172.16.202.3
Type:	SMF VLAN STACKED EDGE SW WITH 4SFP			Power Source:	UPS2

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
PDH	CAT6	6	1	EWS1CLT:2	THIN CLIENT - SECONDARY	172.16.200.3
PDH	CAT6	6	2	EWS2CLT:2	THIN CLIENT - SECONDARY	172.16.200.4
PDH	CAT6	6	3	OWS5CLT:2	THIN CLIENT - SECONDARY	172.16.200.9
PDH	CAT6	6	4	EWS3	ENGINEERING LAPTOP EWS3 - SECONDARY	172.16.205.122
PDH	CAT6	6	5	EWS4	ENGINEERING LAPTOP EWS4 - SECONDARY	172.16.205.123
PDH	CAT6	-	6	SPARE	-	-
PDH	CAT6	-	7	SPARE	-	-
PDH	CAT6	-	8	SPARE	-	-
PDH	CAT6	-	9	SPARE	-	-
PDH	CAT6	-	10	SPARE	-	-
UDH	CAT6	6	11	EWS3	ENGINEERING LAPTOP EWS3 - SECONDARY	172.16.101.22
UDH	CAT6	6	12	EWS4	ENGINEERING LAPTOP EWS4 - SECONDARY	172.16.101.23
UDH	CAT6	-	13	SPARE	-	-
UDH	CAT6	-	14	SPARE	-	-
UDH	CAT6	-	15	SPARE	-	-
UDH	CAT6	-	16	SPARE	-	-
UDH	CAT6	-	17	SPARE	-	-
UDH	CAT6	-	18	SPARE	-	-
UDH	CAT6	-	19	SPARE	-	-
SPAN	CAT6	-	20	SPARE	-	-
UDH	CAT6	-	21	SPARE	-	-
UDH	CAT6	-	22	SPARE	-	-
MDH	CAT6	-	23	SPARE	-	-
MDH	CAT6	-	24	SPARE	-	-
Trunk	SMF	37	G1	RB1-2:3	SMF VLAN STACKED ROOT BRIDGE SW (CCR)	172.16.205.247
Trunk	SMF	-	G2	SPARE	-	-
Trunk	SMF	-	G3	SPARE	-	-
Trunk	SMF	-	G4	SPARE	-	-
STACK	STACKING	30	STACKING 1	SW3-1: STACKING 2	9200L EDGE SWITCH	-
STACK	STACKING	30	STACKING 2	SW3-1: STACKING 1	9200L EDGE SWITCH	-

ENGINEERING ROOM

NLR
Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type:	Sheet Size:
TECHNICAL DOCUMENT	B

Document Title: **ASSY, REMOTE CONTROL SYS**

Creation Date:	Drawing Number:	Revision:	Sheet:
2021-10-28	302T0147	E	16 of 27

ENGINEERING ROOM

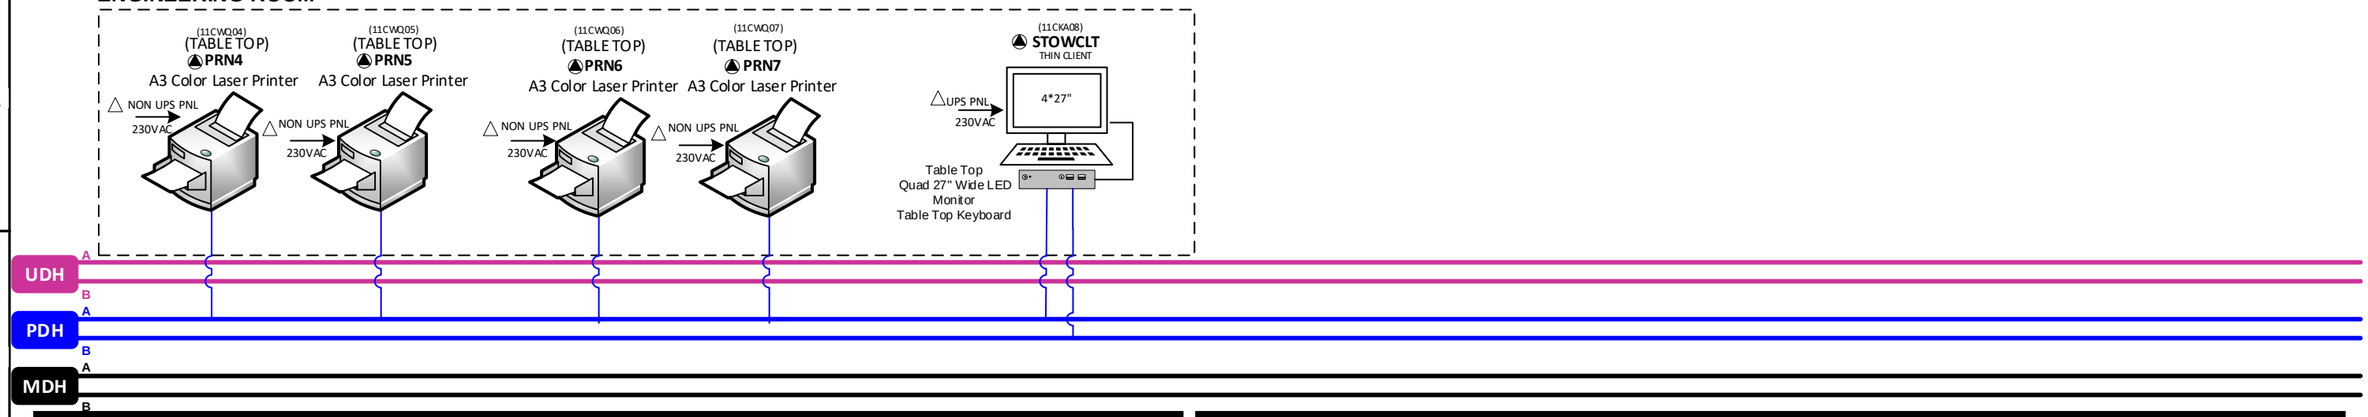

A

Switch:	SW4-1 (11CSA02GH007)	ID#:	33	Location:	SERVER ROOM – NETWORK CABINET 2
Part No:	117T6409P36RCAAB			IP Address:	172.16.202.4
Type:	SMF VLAN STACKED EDGE SW WITH 4SFP			Power Source:	UPS1

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
PDH	CAT6	6	1	SPARE	-	-
PDH	CAT6	6	2	HST2SVR	HST2SVR – HISTORIAN PRIMARY	172.16.205.39
PDH	CAT6	6	3	GTWY1SVR	DATA GATEWAY 1 - PRIMARY	172.16.205.124
PDH	CAT6	6	4	GTWY2SVR	DATA GATEWAY 2 - PRIMARY	172.16.205.125
PDH	CAT6	6	5	STOWSCLT:1	THIN CLIENT - PRIMARY	172.16.200.10
PDH	CAT6	6	6	HST1SVR	HST1SVR – HISTORIAN PRIMARY	172.16.205.38
PDH	CAT6	5	7	PRN4	A3 COLOR LASER PRINTER	172.16.205.43
PDH	CAT6	6	8	SPARE	-	-
PDH	CAT6	-	9	SPARE	-	-
PDH	CAT6	5	10	PRN6	A3 COLOR LASER PRINTER	172.16.205.45
UDH	CAT6	6	11	GTWY1SVR	DATA GATEWAY 1 - PRIMARY	172.16.101.124
UDH	CAT6	6	12	GTWY2SVR	DATA GATEWAY 2 - PRIMARY	172.16.101.125
UDH	CAT6	6	13	HST2SVR	HST2SVR – HISTORIAN PRIMARY	172.16.101.21
UDH	CAT6	6	14	SPARE	-	-
UDH	CAT6	6	15	HST1SVR	HST1SVR – HISTORIAN PRIMARY	172.16.101.20
UDH	CAT6	-	16	SPARE	-	-
UDH	CAT6	-	17	SPARE	-	-
UDH	CAT6	-	18	SPARE	-	-
UDH	CAT6	-	19	SPARE	-	-
SPAN	CAT6	-	20	SPARE	-	-
UDH	CAT6	-	21	SPARE	-	-
UDH	CAT6	-	22	SPARE	-	-
MDH	CAT6	6	23	SYSTEM ONE	SYSTEM ONE	-
MDH	CAT6	-	24	SPARE	-	-
Trunk	SMF	37	G1	RB1-1:4	SMF VLAN STACKED ROOT BRIDGE SW (CCR)	172.16.205.247
Trunk	SMF	-	G2	SPARE	-	-
Trunk	SMF	-	G3	SPARE	-	-
Trunk	SMF	-	G4	SPARE	-	-
STACK	STACKING	30	STACKING 1	SW4-2: STACKING 2	9200L EDGE SWITCH	-
STACK	STACKING	30	STACKING 2	SW4-2: STACKING 1	9200L EDGE SWITCH	-

B

Switch:	SW4-2 (11CSA02GH008)	ID#:	33	Location:	SERVER ROOM – NETWORK CABINET 2
Part No:	117T6409P36RCAAB			IP Address:	172.16.202.4
Type:	SMF VLAN STACKED EDGE SW WITH 4SFP			Power Source:	UPS2

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
PDH	CAT6	6	1	SPARE	-	-
PDH	CAT6	6	2	HST2SVR	HST2SVR – HISTORIAN SECONDARY	172.16.205.39
PDH	CAT6	6	3	GTWY1SVR	DATA GATEWAY 1 - SECONDARY	172.16.205.124
PDH	CAT6	6	4	GTWY2SVR	DATA GATEWAY 2 - SECONDARY	172.16.205.125
PDH	CAT6	6	5	STOWSCLT:2	THIN CLIENT - SECONDARY	172.16.200.10
PDH	CAT6	6	6	HST1SVR	HST1SVR – HISTORIAN SECONDARY	172.16.205.38
PDH	CAT6	5	7	PRN5	A3 COLOR LASER PRINTER	172.16.205.44
PDH	CAT6	6	8	SPARE	-	-
PDH	CAT6	-	9	SPARE	-	-
PDH	CAT6	5	10	PRN7	A3 COLOR LASER PRINTER	172.16.205.46
UDH	CAT6	6	11	GTWY1SVR	DATA GATEWAY 1 - SECONDARY	172.16.101.124
UDH	CAT6	6	12	GTWY2SVR	DATA GATEWAY 2 - SECONDARY	172.16.101.125
UDH	CAT6	6	13	HST2SVR	HST2SVR – HISTORIAN SECONDARY	172.16.101.21
UDH	CAT6	6	14	SPARE	-	-
UDH	CAT6	6	15	HST1SVR	HST1SVR – HISTORIAN SECONDARY	172.16.101.20
UDH	CAT6	-	16	SPARE	-	-
UDH	CAT6	-	17	SPARE	-	-
UDH	CAT6	-	18	SPARE	-	-
UDH	CAT6	-	19	SPARE	-	-
SPAN	CAT6	-	20	SPARE	-	-
UDH	CAT6	-	21	SPARE	-	-
UDH	CAT6	-	22	SPARE	-	-
MDH	CAT6	6	23	SYSTEM ONE	SYSTEM ONE	-
MDH	CAT6	-	24	-	-	-
Trunk	SMF	37	G1	RB1-2:4	SMF VLAN STACKED ROOT BRIDGE SW (CCR)	172.16.205.247
Trunk	SMF	-	G2	SPARE	-	-
Trunk	SMF	-	G3	SPARE	-	-
Trunk	SMF	-	G4	SPARE	-	-
STACK	STACKING	30	STACKING 1	SW4-1: STACKING 2	9200L EDGE SWITCH	-
STACK	STACKING	30	STACKING 2	SW4-1: STACKING 1	9200L EDGE SWITCH	-

SERVER ROOM

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type:	Sheet Size:
TECHNICAL DOCUMENT	B

Document Title: **ASSY, REMOTE CONTROL SYS**

Creation Date:	Drawing Number:	Revision:	Sheet:
2021-10-28	302T0147	E	17 of 27

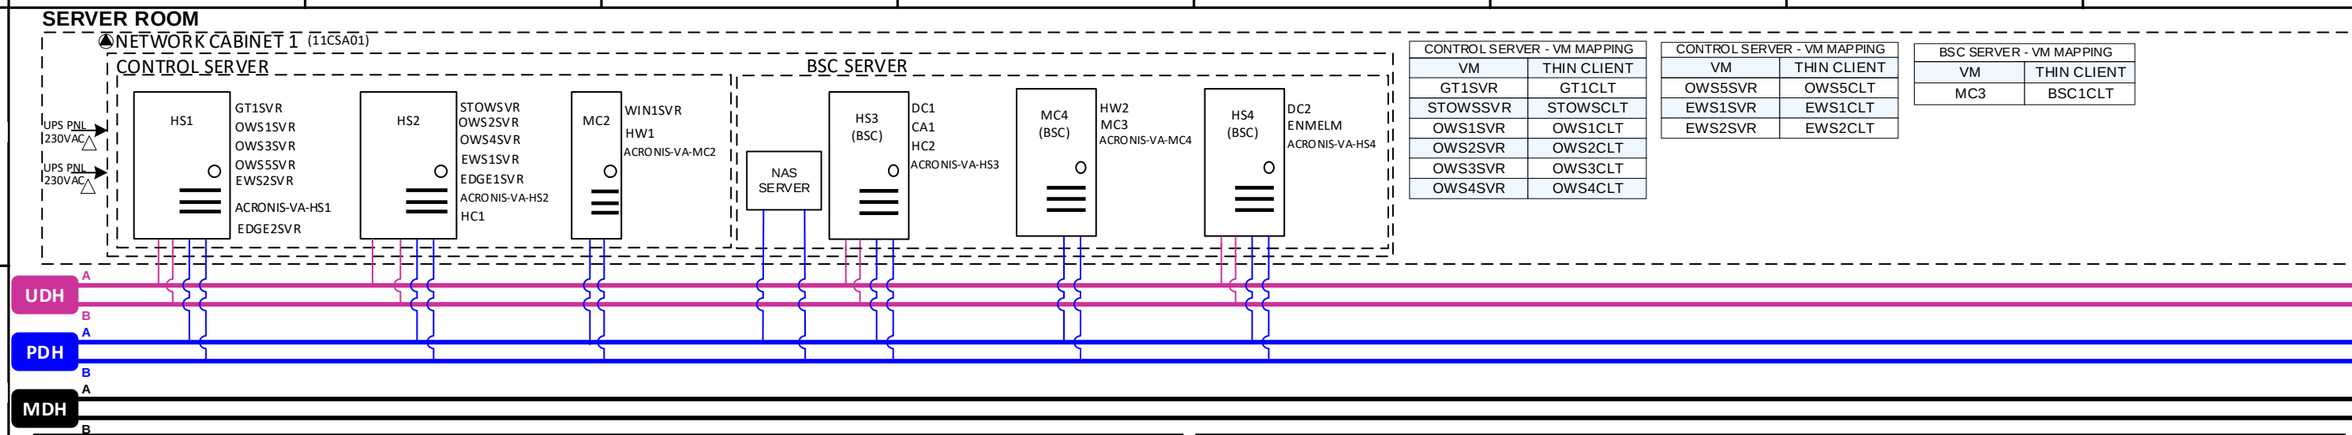

CONTROL SERVER - VM MAPPING	
VM	THIN CLIENT
GT1SVR	GT1CLT
STOWSSVR	STOWSCLT
OWS1SVR	OWS1CLT
OWS2SVR	OWS2CLT
OWS3SVR	OWS3CLT
OWS4SVR	OWS4CLT

CONTROL SERVER - VM MAPPING	
VM	THIN CLIENT
OWS5SVR	OWS5CLT
EWS1SVR	EWS1CLT
EWS2SVR	EWS2CLT

BSC SERVER - VM MAPPING	
VM	THIN CLIENT
MC3	BSC1CLT

A

Switch:	SW5-1 (11CSA02GH011)	ID#:	33	Location:	SERVER ROOM – NETWORK CABINET 1
Part No:	117T6409P36RCAAB	E		IP Address:	172.16.202.5
Type:	SMF VLAN STACKED EDGE SW WITH 4SFP			Power Source:	UPS1

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
PDH	CAT6	5	1	HS1	CONTROL SERVER – HS1 - PRIMARY	172.16.199.8
PDH	CAT6	5	2	HS2	CONTROL SERVER – HS2 - PRIMARY	172.16.199.9
PDH	CAT6	5	3	MC2	CONTROL SERVER – MC2 - PRIMARY	172.16.199.11
PDH	CAT6	5	4	HS3	BSC SERVER – HS3 - PRIMARY	172.16.198.8
PDH	CAT6	5	5	HS4	BSC SERVER – HS4 - PRIMARY	172.16.198.9
PDH	CAT6	5	6	MC4	BSC SERVER – MC4 - PRIMARY	172.16.199.14
PDH	CAT6	5	7	BSC1CLT:1	BSC THIN CLIENT - PRIMARY	172.16.200.11
PDH	CAT6	5	8	LOCKBOX:PDH	LOCKBOX:PDH	HIDDEN **
PDH	CAT6	5	9	NAS	NAS SERVER – PRIMARY	172.16.199.220
PDH	CAT6	5	10	NTP-1:4	NTP TIME SYNCH1	172.16.205.250
UDH	CAT6	5	11	HS1	CONTROL SERVER – HS1 - PRIMARY	-
UDH	CAT6	5	12	HS2	CONTROL SERVER – HS2 - PRIMARY	-
UDH	CAT6	-	13	SPARE	-	-
UDH	CAT6	5	14	HS3	BSC SERVER – HS3 - PRIMARY	-
UDH	CAT6	5	15	HS4	BSC SERVER – HS4 - PRIMARY	-
UDH	CAT6	-	16	SPARE	-	-
UDH	CAT6	-	17	SPARE	-	-
UDH	CAT6	-	18	SPARE	-	-
UDH	CAT6	-	19	SPARE	-	-
SPAN	CAT6	-	20	SPARE	-	-
UDH	CAT6	-	21	SPARE	-	-
UDH	CAT6	5	22	NTP-1:3	NTP TIME SYNCH1	172.16.101.250
MDH	CAT6	5	23	LOCKBOX:MDH	LOCKBOX:MDH	HIDDEN **
MDH	CAT6	5	24	OSM:MDH	ONSITE MONITORING - MDH	-
Trunk	SMF	37	G1	RB1-1:5	SMF VLAN STACKED ROOT BRIDGE SW (CCR)	172.16.205.247
Trunk	SMF	-	G2	SPARE	-	-
Trunk	SMF	-	G3	SPARE	-	-
Trunk	SMF	-	G4	SPARE	-	-
STACK	STACKING	30	STACKING 1	SW5-2: STACKING 2	9200L EDGE SWITCH	-
STACK	STACKING	30	STACKING 2	SW5-2: STACKING 1	9200L EDGE SWITCH	-

B

Switch:	SW5-2 (11CSA02GH012)	ID#:	33	Location:	SERVER ROOM – NETWORK CABINET 1
Part No:	117T6409P36RCAAB	E		IP Address:	172.16.202.5
Type:	SMF VLAN STACKED EDGE SW WITH 4SFP			Power Source:	UPS2

VLAN	MEDIA	ID#	PORT	DEVICE	DEVICE DESCRIPTION	IP ADDRESS
PDH	CAT6	5	1	HS1	CONTROL SERVER – HS1 - SECONDARY	172.16.199.8
PDH	CAT6	5	2	HS2	CONTROL SERVER – HS2 - SECONDARY	172.16.199.9
PDH	CAT6	5	3	MC2	CONTROL SERVER – MC2 - SECONDARY	172.16.199.11
PDH	CAT6	5	4	HS3	BSC SERVER – HS3 - SECONDARY	172.16.198.8
PDH	CAT6	5	5	HS4	BSC SERVER – HS4 - SECONDARY	172.16.198.9
PDH	CAT6	5	6	MC4	BSC SERVER – MC4 - SECONDARY	172.16.199.14
PDH	CAT6	5	7	BSC1CLT:2	BSC THIN CLIENT - SECONDARY	172.16.200.11
PDH	CAT6	-	8	SPARE	-	-
PDH	CAT6	5	9	NAS	NAS SERVER - SECONDARY	172.16.199.220
PDH	CAT6	-	10	SPARE	-	-
UDH	CAT6	5	11	HS1	CONTROL SERVER – HS1 - SECONDARY	-
UDH	CAT6	5	12	HS2	CONTROL SERVER – HS2 - SECONDARY	-
UDH	CAT6	-	13	SPARE	-	-
UDH	CAT6	5	14	HS3	BSC SERVER – HS3 - SECONDARY	-
UDH	CAT6	5	15	HS4	BSC SERVER – HS4 - SECONDARY	-
UDH	CAT6	-	16	SPARE	-	-
UDH	CAT6	-	17	SPARE	-	-
UDH	CAT6	-	18	SPARE	-	-
UDH	CAT6	-	19	SPARE	-	-
SPAN	CAT6	-	20	SPARE	-	-
UDH	CAT6	-	21	SPARE	-	-
UDH	CAT6	-	22	SPARE	-	-
MDH	CAT6	-	23	SPARE	-	-
MDH	CAT6	5	24	OSM:MDH	ONSITE MONITORING - MDH	-
Trunk	SMF	37	G1	RB1-2:5	SMF VLAN STACKED ROOT BRIDGE SW (CCR)	172.16.205.247
Trunk	SMF	-	G2	SPARE	-	-
Trunk	SMF	-	G3	SPARE	-	-
Trunk	SMF	-	G4	SPARE	-	-
STACK	STACKING	30	STACKING 1	SW5-1: STACKING 2	9200L EDGE SWITCH	-
STACK	STACKING	30	STACKING 2	SW5-1: STACKING 1	9200L EDGE SWITCH	-

** Note - IP Address for Lockbox is Hidden For Security Purpose.

SERVER ROOM

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type:	Sheet Size:
TECHNICAL DOCUMENT	B

Document Title: **ASSY, REMOTE CONTROL SYS**

Creation Date:	Drawing Number:	Revision:	Sheet:
2021-10-28	302T0147	E	18 of 27

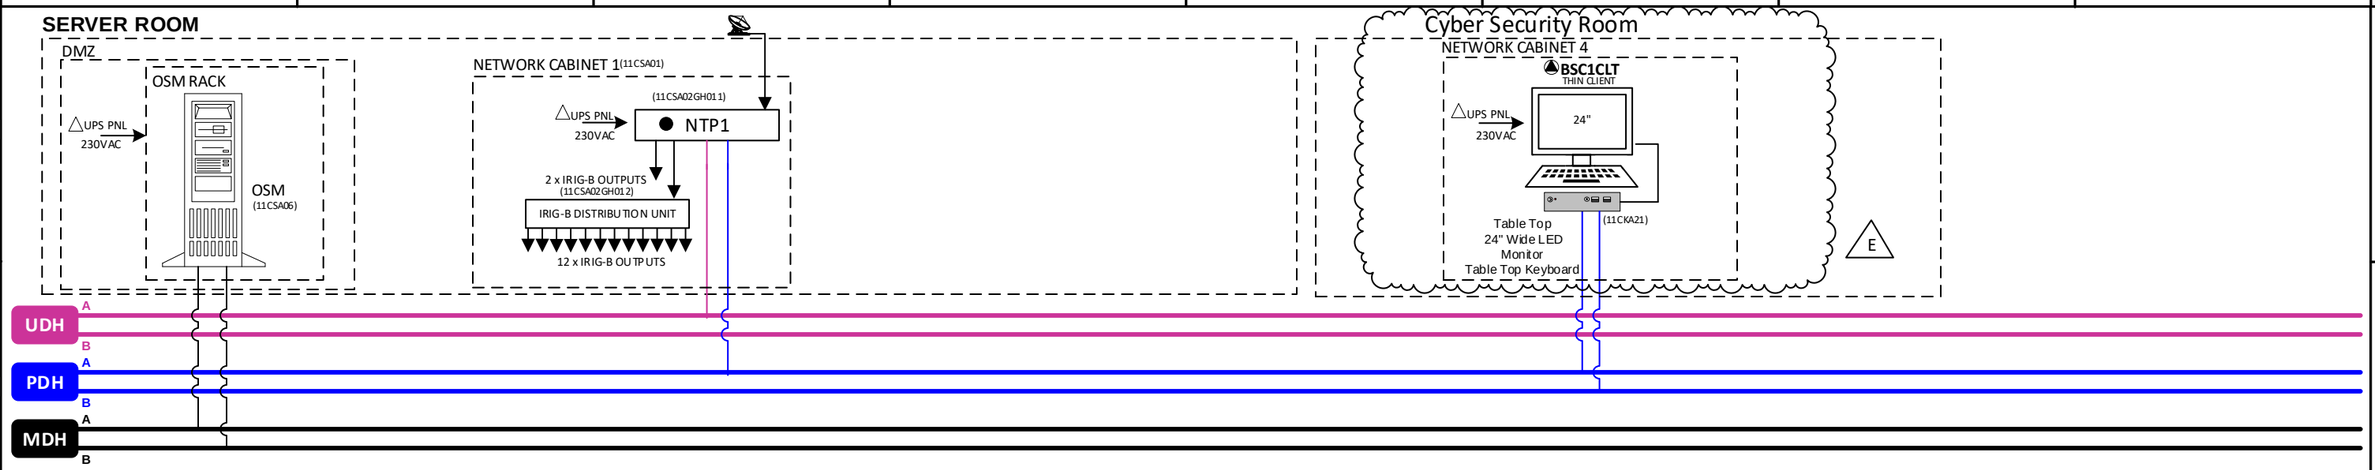

SERVER ROOM

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA	Document Type: TECHNICAL DOCUMENT		Sheet Size: B
	Document Title: **ASSY, REMOTE CONTROL SYS**		
Creation Date: 2021-10-28	Drawing Number: 302T0147	Revision: E	Sheet: 19 of 27

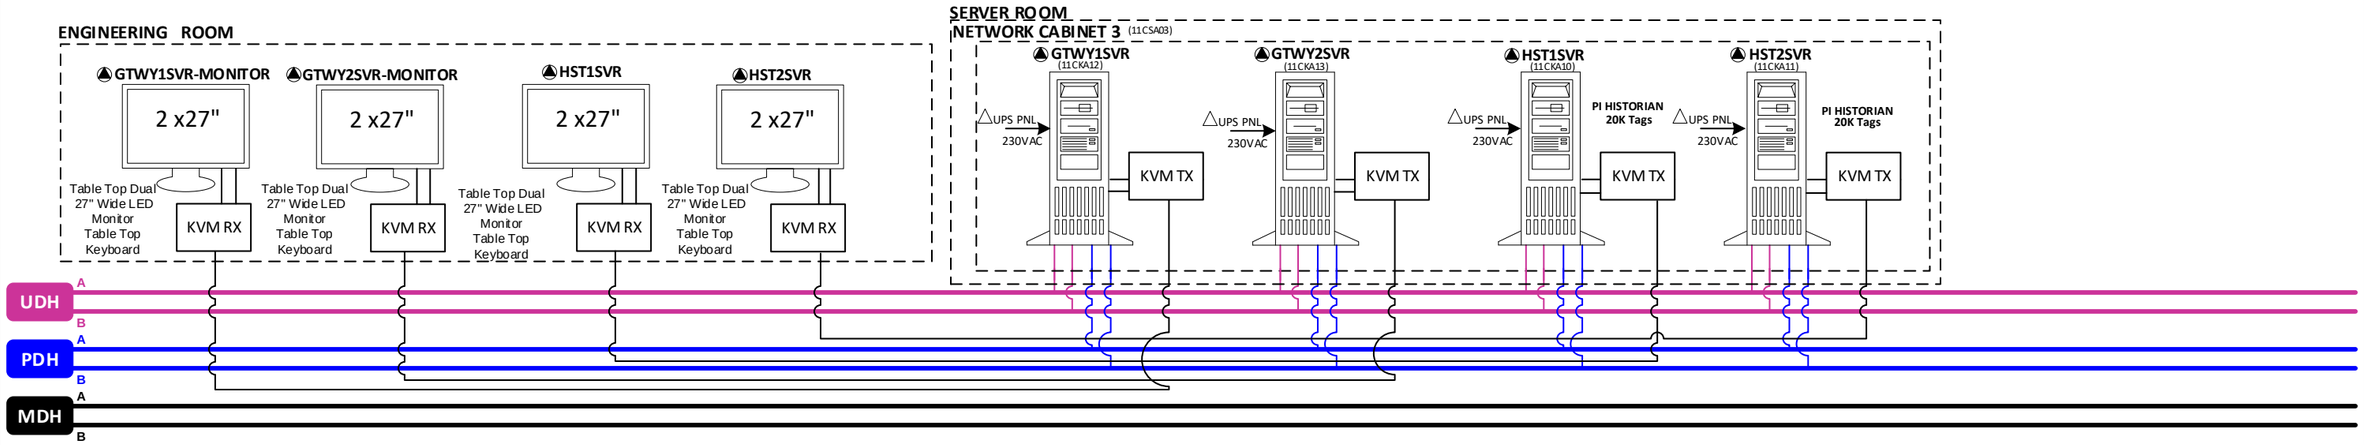

SERVER ROOM

NLR
Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA	Document Type: TECHNICAL DOCUMENT		Sheet Size: B
	Document Title: **ASSY, REMOTE CONTROL SYS**		
Creation Date: 2021-10-28	Drawing Number: 302T0147	Revision: E	Sheet: 20 of 27

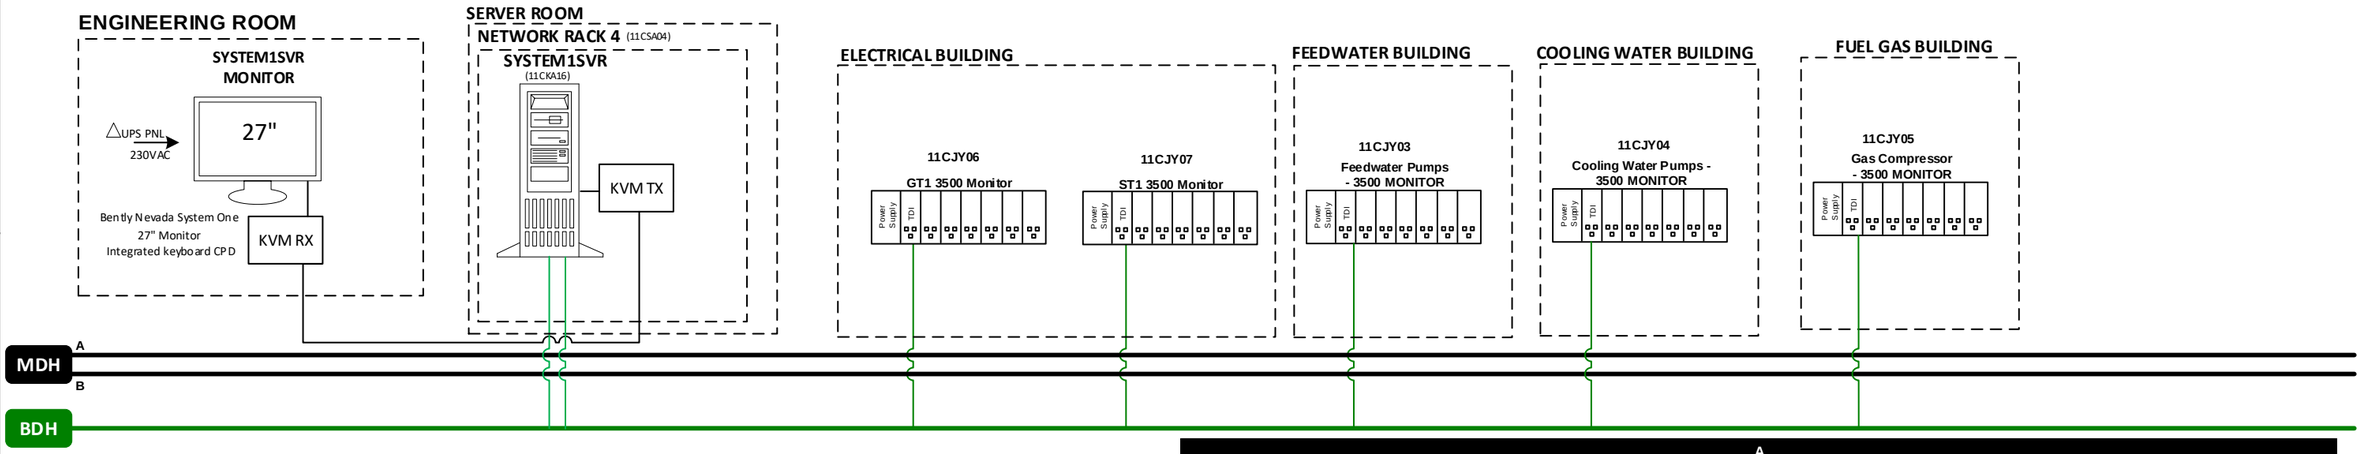

A					
Switch:	BNSW1		**Location:**	SERVER ROOM - NETWORK RACK 4: 11CSA04	
Part No:	IE-4010-16S12P		**IP Address:**	172.16.145.180	
Type:	Industrial Ethernet 4010 Series Switches: 10/100/1000		**Power Source:**	Yes	
VLAN	**MEDIA**	**PORT**	**DEVICE**	**DEVICE DESCRIPTION**	**IP ADDRESS**
BDH	CAT6	1	External	Plant Cyber Security System NIDS PORT	172.16.145.170
BDH	CAT6	2	External	Plant Cyber Security System-App. Managment -P	172.16.145.171
BDH	CAT6	3	External	Plant Cyber Security System-App. Managment -S	172.16.145.122
BDH	CAT6	4	SPARE	-	-
BDH	CAT6	5	SPARE	-	-
BDH	CAT6	6	SPARE	-	-
BDH	CAT6	7	SPARE	-	-
BDH	CAT6	8	EXT 1-1 Port 20	External Switch 1-1 Port 20	172.16.145.129
BDH	CAT6	9	VMS:NIC1	System1	172.16.145.130
BDH	CAT6	10	VMS:NIC2	System 1 Cyber Security Managment NIC	172.16.145.140
BDH	CAT6	11	SPARE	-	-
BDH	CAT6	12	SPARE	-	-
BDH	SMF(ID#1,3)	13	-KFE2:P5	ELECTRICAL BUILDING: 11CJY06	-
BDH	SMF(ID#1,3)	14	-KFE2:P5	FEEDWATER BUILDING: 11CJY03	-
BDH	SMF(ID#1,3)	15	-KFE2:P5	COOLING WATER BUILDING: 11CJY04	-
BDH	SMF(ID#1,3)	16	-KFE2:P5	GAS COMPRESSOR BUILDING: 11CJY05	-
BDH	SMF	17	SPARE	-	-
BDH	SMF	18	SPARE	-	-
BDH	SMF	19	SPARE	-	-
BDH	SMF	20	SPARE	-	-
BDH	SMF	21	SPARE	-	-
BDH	SMF	22	SPARE	-	-
BDH	SMF	23	SPARE	-	-
BDH	SMF(ID#1,3)	24	SPARE	-	-

E

A					
Switch:	-KFE2 (BY BENTLY NEVADA)			**Location:**	FEEDWATER BUILDING
Part No:	SLX-5EG-2SFP			**IP Address:**	172.16.145.181
Type:	Industrial Ethernet Switch: 10/100/100MB			**Power Source:**	Yes
VLAN	**MEDIA**	**PORT**	**DEVICE**	**DEVICE DESCRIPTION**	**IP ADDRESS**
BDH	CAT6	1	FWP 3500 MONITOR:TDI	Bently 3500 Monitor	172.16.145.131
BDH	CAT6	2	SPARE	-	-
BDH	CAT6	3	SPARE	-	-
BDH	SFP	4	SPARE	-	-
BDH	SMF(ID#1,3)	5	BNSW1:14	Industrial Ethernet Switch: 10/100/100MB - (ELECTRICAL BUILDING)	-

A					
Switch:	-KFE2 (BY BENTLY NEVADA)			**Location:**	COOLING WATER BUILDING
Part No:	SLX-5EG-2SFP			**IP Address:**	172.16.145.182
Type:	Industrial Ethernet Switch: 10/100/100MB			**Power Source:**	Yes
VLAN	**MEDIA**	**PORT**	**DEVICE**	**DEVICE DESCRIPTION**	**IP ADDRESS**
BDH	CAT6	1	CWP 3500 MONITOR:TDI	Bently 3500 Monitor	172.16.145.132
BDH	CAT6	2	SPARE	-	-
BDH	CAT6	3	SPARE	-	-
BDH	SFP	4	SPARE	-	-
BDH	SMF(ID#1,3)	5	BNSW1:15	Industrial Ethernet Switch: 10/100/100MB - (ELECTRICAL BUILDING)	-

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

MACHINE MONITORING – SH1

GE VERNOVA

Document Type: TECHNICAL DOCUMENT			Sheet Size: B
Document Title: **ASSY, REMOTE CONTROL SYS**			
Creation Date: 2021-10-28	Drawing Number: 302T0147	Revision: E	Sheet: 21 of 27

A					
Switch:	-KFE2 (BY BENTLY NEVADA)			**Location:**	ELECTRICAL BUILDING
Part No:	SLX-5EG-2SFP			**IP Address:**	172.16.145.183
Type:	Industrial Ethernet Switch: 10/100/100MB			**Power Source:**	Yes
VLAN	**MEDIA**	**PORT**	**DEVICE**	**DEVICE DESCRIPTION**	**IP ADDRESS**
BDH	CAT6	1	GT1 3500 MONITOR:TDI	Bently 3500 Monitor	172.16.145.133
BDH	CAT6	2	ST1 3500 MONITOR:TDI	Bently 3500 Monitor	172.16.145.134
BDH	CAT6	3	SPARE	-	-
BDH	SFP	4	SPARE	-	-
BDH	SMF(ID#1,3)	5	BNSW1:13	Industrial Ethernet Switch: 10/100/100MB - (ELECTRICAL BUILDING)	-

A					
Switch:	-KFE2 (BY BENTLY NEVADA)			**Location:**	FUEL GAS BUILDING
Part No:	SLX-5EG-2SFP			**IP Address:**	172.16.145.184
Type:	Industrial Ethernet Switch: 10/100/100MB			**Power Source:**	Yes
VLAN	**MEDIA**	**PORT**	**DEVICE**	**DEVICE DESCRIPTION**	**IP ADDRESS**
BDH	CAT6	1	GC 3500 MONITOR:TDI	Bently 3500 Monitor	172.16.145.135
BDH	CAT6	2	SPARE	-	-
BDH	CAT6	3	SPARE	-	-
BDH	SFP	4	SPARE	-	-
BDH	SMF(ID#1,3)	5	BNSW1:16	Industrial Ethernet Switch: 10/100/100MB - (ELECTRICAL BUILDING)	-

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

MACHINE MONITORING – SH2

GE VERNOVA

Document Type: TECHNICAL DOCUMENT			Sheet Size: B
Document Title: **ASSY, REMOTE CONTROL SYS**			
Creation Date: 2021-10-28	Drawing Number: 302T0147	Revision: E	Sheet: 22 of 27

	Modbus Links										
Controller	**MKVIe Cabinet Location**	**PLC Name**	**PLC Location**	**Connection Type**	**PSCA Location**	**Modbus Switch**	**Port**	**Mode**	**Mode**	**Master IP**	**Slave IP**
BOP1	FW Pump Bldg.(ULA)	CEMS	CEMS Bldg (UHT)	SMF	LU004	MSW1R	SFP1	100MB	DUPLEX	192.16.201.21	192.16.201.23
BOP1	FW Pump Bldg.(ULA)	CEMS	CEMS Bldg (UHT)	SMF	LU004	MSW1S	SFP1	100MB		192.16.201.22	192.16.201.24
BOP1	FW Pump Bldg.(ULA)	AUXILIARY BOILER	Aux Boiler Bldg (UTX10)	SMF	LU004	MSW1R	SFP2	100MB	DUPLEX	192.16.201.21	192.16.201.41
BOP1	FW Pump Bldg.(ULA)	AUXILIARY BOILER	Aux Boiler Bldg (UTX10)	SMF	LU004	MSW1S	SFP2	100MB		192.16.201.22	192.16.201.42
BOP1	WTP Building (UGK)	WATER TREATMENT\EFFLUENT PLANT	WATER TREAT. BLDG	CU	LU003	MSW1R	Port 8	100MB	DUPLEX	192.16.201.121	192.16.201.131
BOP1	WTP Building (UGK)	WATER TREATMENT\EFFLUENT PLANT	WATER TREAT. BLDG	CU	LU003	MSW1S	Port 8	100MB		192.16.201.122	192.16.201.132
BOP1	WTP Building (UGK)	AIR COMPRESSOR	Turbine Hall Annex (UMC10)	SMF	LU003	MSW1R	SFP2	100MB	DUPLEX	192.16.201.70	192.16.201.72
BOP1	WTP Building (UGK)	AIR COMPRESSOR	Turbine Hall Annex (UMC10)	SMF	LU003	MSW1S	SFP2	100MB		192.16.201.71	192.16.201.73
BOP1	Main Elec. Bldg (UBA)	WEATHER STATION	Main Elec. Bldg (UBA)	CU	CA006	MSW1R	Port 6	100MB	SIMPLEX	192.16.201.151	192.16.201.153
BOP1	Main Elec. Bldg (UBA)	HVAC SYSTEM	Main Elec. Bldg (UBA)	CU	CA006	MSW1R	Port 7	100MB	DUPLEX	192.16.201.151	192.16.201.161
BOP1	Main Elec. Bldg (UBA)	HVAC SYSTEM	Main Elec. Bldg (UBA)	CU	CA006	MSW1S	Port 7	100MB		192.16.201.152	192.16.201.162
BOP1	Main Elec. Bldg (UBA)	FIRE FIGHTING SYSTEM RED	Main Elec. Bldg (UBA)	CU	CA006	MSW1R	Port 8	100MB	DUPLEX	192.16.201.151	192.16.201.171
BOP1	Main Elec. Bldg (UBA)	FIRE FIGHTING SYSTEM RED	Main Elec. Bldg (UBA)	CU	CA006	MSW1S	Port 8	100MB		192.16.201.152	192.16.201.172
BOP2	Main Elec. Bldg (UBA)	RMS	Fuel Gas Bldg (UEN)	SMF	LU006	MSW1R	SFP1	100MB	DUPLEX	192.16.201.91	192.16.201.101
BOP2	Main Elec. Bldg (UBA)	RMS	Fuel Gas Bldg (UEN)	SMF	LU006	MSW1S	SFP1	100MB		192.16.201.92	192.16.201.102
BOP2	Main Elec. Bldg (UBA)	GAS COMP.SYSTEM 1	FG Compressor Bldg (UER)	SMF	LU006	MSW1R	SFP2	100MB	DUPLEX	192.16.201.91	192.16.201.111
BOP2	Main Elec. Bldg (UBA)	GAS COMP.SYSTEM 1	FG Compressor Bldg (UER)	SMF	LU006	MSW1S	SFP2	100MB		192.16.201.92	192.16.201.112
BOP2	Main Elec. Bldg (UBA)	GAS COMP.SYSTEM 2	FG Compressor Bldg (UER)	SMF	LU006	MSW1R	SFP2	100MB	DUPLEX	192.16.201.91	192.16.201.113
BOP2	Main Elec. Bldg (UBA)	GAS COMP.SYSTEM 2	FG Compressor Bldg (UER)	SMF	LU006	MSW1S	SFP2	100MB		192.16.201.92	192.16.201.114

E

PSCA

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type: TECHNICAL DOCUMENT

Sheet Size: B

Document Title: **ASSY, REMOTE CONTROL SYS**

Creation Date: 2021-10-28

Drawing Number: 302T0147

Revision: E

Sheet: 23 of 27

Remote IO Connections

From Location	System	Cabinet	Switch	Port	Connector	To Location	System	Cabinet	Switch	Port
UBA (Main Electrical building)	HRSG1	LU001	ESW1R/S	SFP1	LC*	ULA (FW Pump Building)	HRSG1	CA003	ESW1R/S	SFP1
UBA (Main Electrical building)	HRSG1	LU001	ESW1R/S	SFP2	LC*	ULA (FW Pump Building)	HRSG1	LU002	ESW1R/S	SFP1
UBA (Main Electrical building)	BOP1	CA006	ESW1R/S	SFP1	LC*	UGK (WTP Building)	BOP1	LU003	ESW1R/S	SFP1
UBA (Main Electrical building)	BOP1	CA006	ESW1R/S	SFP2	LC*	ULA (FW Pump Building)	BOP1	LU004	ESW1R/S	SFP1
UBA (Main Electrical building)	BOP1	CA006	ESW2R/S	SFP1	LC*	ULA (FW Pump Building)	BOP1	CA011	ESW1R/S	SFP1
UBA (Main Electrical building)	BOP2	LU005	ESW1R/S	Port 16	RJ45	UBA (Main Electrical building)	BOP2	LU006	ESW1R/S	Port 16
UBA (Main Electrical building)	BOP2	LU005	ESW1R/S	SFP1	LC*	UBA15 (Cooling Water Electrical Building)	BOP2	LU007	ESW1R/S	SFP1

IO - NET

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type: TECHNICAL DOCUMENT

Sheet Size: B

Document Title: **ASSY, REMOTE CONTROL SYS**

Creation Date: 2021-10-28

Drawing Number: 302T0147

Revision: E

Sheet: 24 of 27

Non-Public Class II (Non Critical) - NLR

ADDRESS	VLAN	DEVICE	DESCRIPTION	LOCATION
172.16.101.111	UDH	GT1:R	GT1 <R> CONTROLLER	ELECTRICAL BUILDING
172.16.101.112	UDH	GT1:S	GT1 <S> CONTROLLER	ELECTRICAL BUILDING
172.16.101.135	UDH	GT1S:R	GT1S <R> CONTROLLER	ELECTRICAL BUILDING
172.16.101.136	UDH	GT1S:S	GT1S <S> CONTROLLER	ELECTRICAL BUILDING
172.16.101.137	UDH	GT1S:T	GT1S <T> CONTROLLER	ELECTRICAL BUILDING
172.16.101.116	UDH	E1:M1	E1 - M1 - CONTROLLER	ELECTRICAL BUILDING
172.16.101.117	UDH	E1:M2	E1 – M2 - CONTROLLER	ELECTRICAL BUILDING
172.16.101.118	UDH	E1:C	E1 - C - CONTROLLER	ELECTRICAL BUILDING
172.16.101.119	UDH	E1:KEYPAD	E1 - KEYPAD	ELECTRICAL BUILDING
172.16.101.110	UDH	L1	GT1 STATIC STARTER – LS2100e	ELECTRICAL BUILDING
172.16.101.211	UDH	ST1:R	ST1 <R> CONTROLLER	ELECTRICAL BUILDING
172.16.101.212	UDH	ST1:S	ST1 <S> CONTROLLER	ELECTRICAL BUILDING
172.16.101.222	UDH	ST1S:R	ST1S <R> CONTROLLER	ELECTRICAL BUILDING
172.16.101.223	UDH	ST1S:S	ST1S <S> CONTROLLER	ELECTRICAL BUILDING
172.16.101.224	UDH	ST1S:T	ST1S <T> CONTROLLER	ELECTRICAL BUILDING
172.16.101.40	UDH	BOP1:R	BOP1 <R> CONTROLLER	ELECTRICAL BUILDING
172.16.101.41	UDH	BOP1:S	BOP1 <S> CONTROLLER	ELECTRICAL BUILDING
172.16.101.73	UDH	BOP2:R	BOP2 <R> CONTROLLER	ELECTRICAL BUILDING
172.16.101.74	UDH	BOP2:S	BOP2 <S> CONTROLLER	ELECTRICAL BUILDING
172.16.101.30	UDH	HRSG1:R	HRSG1 <R> CONTROLLER	ELECTRICAL BUILDING
172.16.101.31	UDH	HRSG1:S	HRSG1 <S> CONTROLLER	ELECTRICAL BUILDING
172.16.101.138	UDH	HRSG1S:R	HRSG1S <R> CONTROLLER	FEED WATER BUILDING
172.16.101.139	UDH	HRSG1S:S	HRSG1S <S> CONTROLLER	FEED WATER BUILDING
172.16.101.140	UDH	HRSG1S:T	HRSG1S <T> CONTROLLER	FED WATER BUILDING
172.16.205.40	PDH	PRN1	A4 COLOR LASER PRINTER	ELECTRICAL BUILDING
172.16.205.41	PDH	PRN2	A3 COLOR LASER PRINTER	CENTRAL CONTROL ROOM
172.16.205.42	PDH	PRN3	A3 COLOR LASER PRINTER	CENTRAL CONTROL ROOM
172.16.205.43	PDH	PRN4	A3 COLOR LASER PRINTER	ENGINEERING ROOM
172.16.205.44	PDH	PRN5	A3 COLOR LASER PRINTER	ENGINEERING ROOM
172.16.205.45	PDH	PRN6	A3 COLOR LASER PRINTER	ENGINEERING ROOM
172.16.205.46	PDH	PRN7	A3 COLOR LASER PRINTER	ENGINEERING ROOM
172.16.205.38	PDH	HST1SVR	HISTORIAN	SERVER ROOM
172.16.101.20	UDH	uHST1SVR	HISTORIAN	SERVER ROOM
172.16.205.39	PDH	HST2SVR	HISTORIAN	SERVER ROOM
172.16.101.21	UDH	uHST2SVR	HISTORIAN	SERVER ROOM
172.16.101.250	UDH	NTP	NTP TIME SYNCH1	SERVER ROOM
172.16.205.250	PDH	uNTP	NTP TIME SYNCH1	SERVER ROOM
172.16.16.71	MDH	SYSTEM1	BENTLY SYSTEM ONE	ENGINEERING ROOM
172.16.200.1	PDH	GT1CLT	THIN CLIENT	ELECTRICAL BUILDING
172.16.200.3	PDH	EWS1CLT	THIN CLIENT	ENGINEERING ROOM
172.16.200.4	PDH	EWS2CLT	THIN CLIENT	ENGINEERING ROOM
172.16.200.5	PDH	OWS1CLT	THIN CLIENT	CENTRAL CONTROL ROOM
172.16.200.6	PDH	OWS2CLT	THIN CLIENT	CENTRAL CONTROL ROOM
172.16.200.7	PDH	OWS3CLT	THIN CLIENT	CENTRAL CONTROL ROOM
172.16.200.8	PDH	OWS4CLT	THIN CLIENT	CENTRAL CONTROL ROOM
172.16.200.9	PDH	OWS5CLT	THIN CLIENT	SHIFT SUPERVISORS OFFICE
172.16.200.10	PDH	STOWCLT	THIN CLIENT	ENGINEERING ROOM

ADDRESS	VLAN	DEVICE	DESCRIPTION	LOCATION
172.16.205.122	PDH	EWS3	EWS3 LAPTOP PC	ENGINEERING ROOM
172.16.101.22	UDH	EWS3	EWS3 LAPTOP PC	ENGINEERING ROOM
172.16.205.123	PDH	EWS4	EWS LAPTOP PC	ENGINEERING ROOM
172.16.101.23	UDH	EWS4	EWS4 LAPTOP PC	ENGINEERING ROOM
172.16.205.101	PDH	DC1	DOMAIN CONTROLLER 1	SERVER ROOM
172.16.205.102	PDH	DC2	DOMAIN CONTROLLER 2	SERVER ROOM
172.16.205.105	PDH	CA1	CERTIFICATE AUTHORITY SERVER	SERVER ROOM
172.16.199.7	PDH	HC1	vCENTER SERVER	SERVER ROOM
172.16.199.8	PDH	HS1	VIRTUAL HOST SERVER 1	SERVER ROOM
172.16.199.9	PDH	HS2	VIRTUAL HOST SERVER 1	SERVER ROOM
172.16.199.10	PDH	HW1	WITNESS/ ADMINISTRATIVE CONSOLE	SERVER ROOM
172.16.199.11	PDH	MC2	WITNESS HOST SERVER	SERVER ROOM
172.16.199.5	PDH	MC3	MANAGEMENT SERVER	SERVER ROOM
172.16.204.10	PDH	NSG-L250-1	NOZOMI NSG-L250 IDS MGMT PORT	SERVER ROOM
172.16.205.124	PDH	GTWY1SVR	THICK CLIENT	SERVER ROOM
172.16.101.124	UDH	uGTWY1SVR	THICK CLIENT	SERVER ROOM
172.16.205.125	PDH	GTWY2SVR	THICK CLIENT	SERVER ROOM
172.16.101.125	UDH	uGTWY2SVR	THICK CLIENT	SERVER ROOM
172.16.205.127	PDH	ECS 1	THICK CLIENT	ELECTRICAL BUILDING
172.16.101.27	UDH	uECS 1	THICK CLIENT	ELECTRICAL BUILDING
172.16.205.128	PDH	ECS 2	THICK CLIENT	ELECTRICAL BUILDING
172.16.101.28	UDH	uECS 2	THICK CLIENT	ELECTRICAL BUILDING
172.16.205.2	PDH	GT1SVR	Control Server VM	SERVER ROOM
172.16.101.2	UDH	uGT1SVR	Control Server VM	SERVER ROOM
172.16.205.10	PDH	STOWSSVR	Control Server VM	SERVER ROOM
172.16.101.3	UDH	uSTOWSSVR	Control Server VM	SERVER ROOM
172.16.205.22	PDH	EWS1SVR	Control Server VM	SERVER ROOM
172.16.101.24	UDH	uEWS1SVR	Control Server VM	SERVER ROOM
172.16.205.30	PDH	EWS2SVR	Control Server VM	SERVER ROOM
172.16.101.25	UDH	uEWS2SVR	Control Server VM	SERVER ROOM
172.16.205.14	PDH	OWS1SVR	Control Server VM	SERVER ROOM
172.16.101.14	UDH	uOWS1SVR	Control Server VM	SERVER ROOM
172.16.205.15	PDH	OWS2SVR	Control Server VM	SERVER ROOM
172.16.101.15	UDH	uOWS2SVR	Control Server VM	SERVER ROOM
172.16.205.16	PDH	OWS3SVR	Control Server VM	SERVER ROOM
172.16.101.16	UDH	uOWS3SVR	Control Server VM	SERVER ROOM
172.16.205.17	PDH	OWS4SVR	Control Server VM	SERVER ROOM
172.16.101.17	UDH	uOWS4SVR	Control Server VM	SERVER ROOM
172.16.205.18	PDH	OWS5SVR	Control Server VM	SERVER ROOM
172.16.101.18	UDH	uOWS5SVR	Control Server VM	SERVER ROOM

IP ADDRESS-1

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type:	Sheet Size:
TECHNICAL DOCUMENT	B

Document Title: **ASSY, REMOTE CONTROL SYS**

Creation Date:	Drawing Number:	Revision:	Sheet:
2021-10-28	302T0147	E	25 of 27

ADDRESS	VLAN	DEVICE	DESCRIPTION	LOCATION
172.16.205.150	PDH	EDGE1SVR	VIRTUAL FIELD AGENT	SERVER ROOM
172.16.101.150	UDH	uEDGE1SVR	VIRTUAL FIELD AGENT	SERVER ROOM
172.16.198.8	PDH	HS3	VIRTUAL HOST SERVER 3	SERVER ROOM
172.16.198.9	PDH	HS4	VIRTUAL HOST SERVER 4	SERVER ROOM
172.16.198.10	PDH	HW2	WITNESS/ ADMINISTRATIVE CONSOLE	SERVER ROOM
172.16.198.16	PDH	ACRONIS-VA-HS1	ACRONIS VIRTUAL APPLIANCE HS1	SERVER ROOM
172.16.198.17	PDH	ACRONIS-VA-HS2	ACRONIS VIRTUAL APPLIANCE HS2	SERVER ROOM
172.16.198.18	PDH	ACRONIS-VA-HS3	ACRONIS VIRTUAL APPLIANCE HS3	SERVER ROOM
172.16.198.19	PDH	ACRONIS-VA-HS4	ACRONIS VIRTUAL APPLIANCE HS4	SERVER ROOM
172.16.198.15	PDH	ACRONIS-VA-MC2	ACRONIS VIRTUAL APPLIANCE MC2	SERVER ROOM
172.16.198.20	PDH	ACRONIS-VA-MC4	ACRONIS VIRTUAL APPLIANCE MC4	SERVER ROOM
172.16.199.14	PDH	MC4	WITNESS HOST SERVER	SERVER ROOM
172.16.205.109	PDH	WIN1SVR	WINDOWS SERVER VM	SERVER ROOM
172.16.205.110	PDH	ENMELM	BSC LOGGING & SIEM APPLIANCE	SERVER ROOM
172.16.200.11	PDH	BSC1CLT	HYPER VISOR SERVER	CYBER SECURITY ROOM
172.16.198.7	PDH	HC2	vCENTER SERVER	SERVER ROOM
172.16.101.105	UDH	uCA1	CERTIFICATE AUTHORITY SERVER	SERVER ROOM
172.16.199.220	PDH	NAS	NAS SERVER	SERVER ROOM
172.16.202.1	PDH	SW1-1	EDGE SWITCH	ELECTRICAL BUILDING
172.16.202.1	PDH	SW1-2	EDGE SWITCH	ELECTRICAL BUILDING
172.16.202.2	PDH	SW2-1	EDGE SWITCH	SERVER ROOM
172.16.202.2	PDH	SW2-2	EDGE SWITCH	SERVER ROOM
172.16.202.3	PDH	SW3-1	EDGE SWITCH	SERVER ROOM
172.16.202.3	PDH	SW3-2	EDGE SWITCH	SERVER ROOM
172.16.202.4	PDH	SW4-1	EDGE SWITCH	SERVER ROOM
172.16.202.4	PDH	SW4-2	EDGE SWITCH	SERVER ROOM
172.16.202.5	PDH	SW5-1	EDGE SWITCH	SERVER ROOM
172.16.202.5	PDH	SW5-2	EDGE SWITCH	SERVER ROOM
172.16.202.6	PDH	SW6-1	EDGE SWITCH	ELECTRICAL BUILDING
172.16.202.6	PDH	SW6-2	EDGE SWITCH	ELECTRICAL BUILDING
172.16.202.7	PDH	SW7-1	EDGE SWITCH	LEC BUILDING
172.16.202.7	PDH	SW7-2	EDGE SWITCH	LEC BUILDING
172.16.205.247	PDH	RB1-1	ROOT BRIDGE SWITCH	SERVER ROOM
172.16.205.247	PDH	RB1-2	ROOT BRIDGE SWITCH	SERVER ROOM
172.16.203.1	PDH	SWP1	IE2K SWITCH	FEED WATER BUILDING
172.16.203.2	PDH	SWP2	IE2K SWITCH	FEED WATER BUILDING
172.16.205.151	PDH	EDGE2SVR	VIRTUAL FIELD AGENT	SERVER ROOM
172.16.101.151	UDH	uEDGE2SVR	VIRTUAL FIELD AGENT	SERVER ROOM

E

ADDRESS	VLAN	DEVICE	DESCRIPTION	LOCATION
172.16.150.10	RTU	RTU - PRI	IEC LINK TO RTU SWITCHYARD - PRIMARY	TBD
172.16.150.11	RTU	RTU - SEC	IEC LINK TO RTU SWITCHYARD- SECONDARY	TBD
172.16.150.38	PC	OPC LINK TO OFFICE PCs - PRI	OPC LINK TO OFFICE PCs - PRIMARY	TBD
172.16.150.39	PC	OPC LINK TO OFFICE PCs - SEC	OPC LINK TO OFFICE PCs - SECONDARY	TBD
192.16.201.23	PLC	CEMS SHELTER - PRI	CEMS SHELTER - PRIMARY	TBD
192.16.201.24	PLC	CEMS SHELTER - SEC	CEMS SHELTER - SECONDARY	TBD
192.16.201.41	PLC	AUXILIARY BOILER 1 - PRI	AUXILIARY BOILER 1 - PRIMARY	TBD
192.16.201.42	PLC	AUXILIARY BOILER 1 - SEC	AUXILIARY BOILER 1- SECONDARY	TBD
192.16.201.43	PLC	AUXILIARY BOILER 2 - PRI	AUXILIARY BOILER 2- PRIMARY	TBD
192.16.201.44	PLC	AUXILIARY BOILER 2 - SEC	AUXILIARY BOILER 2- SECONDARY	TBD
192.16.201.45	PLC	AUXILIARY BOILER 3 - PRI	AUXILIARY BOILER 3- PRIMARY	TBD
192.16.201.46	PLC	AUXILIARY BOILER 3 - SEC	AUXILIARY BOILER 3- SECONDARY	TBD
192.16.201.61	PLC	STEAL SEAL SYSTEM - PRI	STEAL SEAL SYSTEM - PRIMARY	TBD
192.16.201.62	PLC	STEAL SEAL SYSTEM - SEC	STEAL SEAL SYSTEM - SECONDARY	TBD
192.16.201.111	PLC	GAS COMP. SYSTEM 1 - PRI	GAS COMP. SYSTEM 1 - PRIMARY	TBD
192.16.201.112	PLC	GAS COMP. SYSTEM 1 – SEC	GAS COMP. SYSTEM 1 – SECONDARY	TBD
192.16.201.113	PLC	GAS COMP. SYSTEM 2 - PRI	GAS COMP. SYSTEM 2 - PRIMARY	TBD
192.16.201.114	PLC	GAS COMP. SYSTEM 2 – SEC	GAS COMP. SYSTEM 2 – SECONDARY	TBD
192.16.201.161	PLC	HVAC – PRI	HVAC – PRIMARY	TBD
192.16.201.162	PLC	HVAC – SEC	HVAC – SECONDARY	TBD
192.16.201.101	PLC	FUEL GAS SYSTEM - PRI	FUEL GAS SYSTEM - PRIMARY	TBD
192.16.201.102	PLC	FUEL GAS SYSTEM - SEC	FUEL GAS SYSTEM - SECONDARY	TBD
192.16.201.131	PLC	WATER TREATMENT / EFFLUENT PLANT - PRI	WATER TREATMENT / EFFLUENT PLANT - PRIMARY	WATER TREAT. BUILDING
192.16.201.132	PLC	WATER TREATMENT / EFFLUENT PLANT - SEC	WATER TREATMENT / EFFLUENT PLANT - SECONDARY	WATER TREAT. BUILDING
192.16.201.171	PLC	FIRE FIGHTING SYSTEM RED - PRI	FIRE FIGHTING SYSTEM RED	TBD
192.16.201.172	PLC	FIRE FIGHTING SYSTEM RED - SEC	FIRE FIGHTING SYSTEM RED	TBD
192.16.201.63	PLC	TUBE CLEANING SYS. SIMPLEX - PRI	TUBE CLEANING SYS. SIMPLEX	TBD

IP ADDRESS-2

NLR

Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type: TECHNICAL DOCUMENT			Sheet Size: B
Document Title: **ASSY, REMOTE CONTROL SYS**			
Creation Date: 2021-10-28	Drawing Number: 302T0147	Revision: E	Sheet: 26 of 27

TERM	DESCRIPTION
NA	Not Applicable
BDH	Bently Data Highway
BN	Bently Nevada
BSC	Baseline Security Center
CPD	Cursor Positioning Device
CRM	Control Remote
DCS	Distributed Control System
DMZ	Demilitarized Zone
E(x)	Exciter(x) Controller
EC	Exciter Compartment
ECS	Electrical Control System
EMAP	Performance Monitoring System
ESP	Electronic Security Paramater
ETH.CH	Ether Channel
EWS	Engineering Work Station
G(x)	Gas Turbine(x) Controller
GAMP	Gas Auxiliary Monitoring Panel
GHM	Generator Health Monitor
GP(x)	Generator Protection Panel(x)
GPP	Generator Protection Panel
GSM	GE Standard Messaging
GT	Gas Turbine
GTG	Gas Turbine Generator
HA	High Availability

TERM	DESCRIPTION
HST	Historian
HMI	Human Machine Interface
HSC	High Speed Internet Connection
ISP	Internet Service Provider
L(x)	LCI(x) Controller
LCI	Load Commutative Inverter
LEC	LCI and Exciter Compartment
MDH	Monitoring Data Highway
NTP	Network Time Protocol
OSM	On Site Monitoring
PDH	Plant Data Highway Network
PEECC	Package Electronic and Electrical Control Cabinet
PRN	Printer
RB	Root Bridge Switch
S(x)	Steam Turbine Controller(x)
ST	Steam Turbine
STG	Steam Turbine Generator
STMS	Shorted Turns Monitoring System for Generator Rotor
SVR	Server
SW	Ethernet Switch
TCP	Turbine Control Panel
IE	Industrial Ethernet
CLT	Client

TERM	DESCRIPTION
UDH	Unit Data Highway Network
UPS	Uninterrupted Power Supply
UTP	Unshielded Twisted Pair
VLAN	Virtual Local Area Network
UTM	Unified Threat Manager
CCR	Central / Customer Control Room
KVM	Keyboard, Video, Mouse
NAS	Network Attached Storage
OWS	Operator Workstation
RTR	Router
EXT	External
XDH	External Data Highway
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-
-	-

Acronyms

NLR
Copyright © GE Vernova and/or its affiliates 2021-2025
All rights reserved. The information herein is proprietary information of GE Vernova and/or its affiliates.

GE VERNOVA

Document Type:	Sheet Size:
TECHNICAL DOCUMENT	B

Document Title: **ASSY, REMOTE CONTROL SYS**

Creation Date:	Drawing Number:	Revision:	Sheet:
2021-10-28	302T0147	E	27 of 27