

SUBMITTAL PACKAGE

Complete door package

Exterior and interior door assemblies | Types A through D



SUB-08-1000-001

REV 0 | SEPTEMBER 2, 2026

PROJECT

Virginia Farmhouse

PREPARED FOR

Ridgeway Residential Builders

PACKAGE

08 10 00 - Doors and Frames

Drawing references: A1.2 First Floor Plan | A1.3 Second Floor Plan | A4.3 Doors & Windows

Prepared by Blue Ridge Doorworks | Asheville, North Carolina

PACKAGE OVERVIEW

Submittal transmittal

SUBMITTAL ID	REVISION	ISSUE DATE
SUB-08-1000-001	0 - Initial review	September 2, 2026
SUBMITTED BY	SUPPLIER	SUBMITTED UNITS
Ridgeway Residential Builders	Blue Ridge Doorworks	11 door leaves

Submitted door schedule

Verify rough openings before release to fabrication

MARK	QTY	SIZE	MATERIAL	LITE / STYLE	FINISH	MODEL / REMARKS
A	1	36" x 84"	Composite	3/3 clear lites	Warm white	Summit E-3684-A Front
B	1	36" x 84"	Composite	2 x 1 clear lites	Warm white	Summit E-3684-B Back
C	5	24" x 80"	Solid wood	1-panel	Aged clear	Heritage W-2480-P1 Interior
D	4	30" x 80"	Solid wood	5-panel	Aged clear	Heritage W-3080-P5 Interior

Package includes

Submitted door schedule; product data for Summit exterior doors and Heritage interior doors; frame, glazing, finish, storage, installation, and warranty information.

Contractor review

☐ Reviewed

☐ Reviewed as noted

☐ Revise and resubmit

Reviewer / date


Revision log

REV	DATE	DESCRIPTION	PREPARED BY
0	09/02/2026	Initial coordinated door package	M. Carter

TYPES A AND B


Summit exterior door series

Factory-finished composite entry assemblies with insulated glazing and integral weather seals

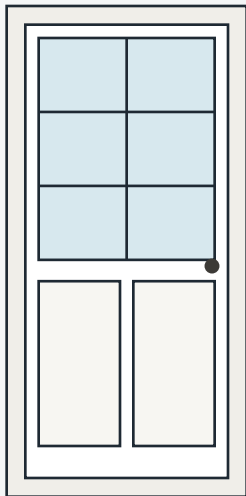

TYPE A

FRONT ENTRY

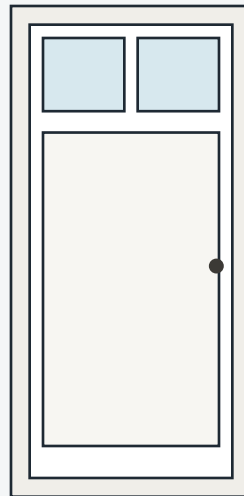

TYPE B

BACK ENTRY

Series data

LEAF	1-3/4" composite skin
CORE	High-density insulated core
FRAME	Composite, rot-resistant
GLAZING	Tempered insulated glass
TYPE A LITES	3/3 clear SDL
TYPE B LITES	2 x 1 clear
U-FACTOR	0.27 whole assembly
FINISH	BRD-01 Warm White
HARDWARE	Dark bronze prep
SWING	As shown on floor plans

Submitted configurations

TYPE A

36" x 84" | Model E-3684-A | Qty 1

TYPE B

36" x 84" | Model E-3684-B | Qty 1

Glazing and weathering

Insulated glazing uses clear tempered safety glass with exterior-applied simulated divided-lite bars. Factory weatherstrip includes compression jamb seals, adjustable sweep, and thermally broken aluminum sill. Seal perimeter joints with compatible exterior-grade sealant.

Finish and care

Warm White is a low-sheen factory coating. Touch up exposed fasteners and minor handling damage with BRD repair finish. Do not clean glazing or coated surfaces with abrasive pads, solvents, or alkaline masonry wash.


FABRICATION HOLD POINT

Field verify rough opening, handing, sill condition, exterior trim depth, and hardware preparation before release. Supplier dimensions are nominal leaf sizes. Coordinate final unit dimensions with approved shop drawings.

TYPES C AND D

Heritage interior door series

Salvaged-look birch doors with solid engineered wood cores and aged clear finish

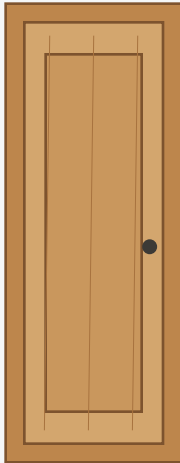**TYPE C**

ONE PANEL

**TYPE D**

FIVE PANEL

Series data

THICKNESS 1-3/8"

CORE Solid engineered stave

FACES Plain-sliced birch veneer

RAILS Solid wood, bonded

STILES 1-3/8" before trim

ADHESIVE Type I moisture-resistant

RATING Non-rated interior

FINISH BRD-AC1 aged clear

HARDWARE Dark bronze prep

WARRANTY One year limited

Submitted configurations

TYPE C

24" x 80" | Model W-2480-P1 | Qty 5

TYPE D

30" x 80" | Model W-3080-P5 | Qty 4

Aged finish

Select birch veneer for compatible tone within each room group. The aged clear finish retains small dents, softened edges, and natural color variation associated with salvaged millwork. Seal both faces and every edge.

Machining limits

Factory machine for specified hardware where final handing is available. Maximum field trim is 1/8 inch at each stile, 1/4 inch at top rail, and 1/2 inch at bottom rail. Reseal every cut edge before installation.

STORAGE REQUIREMENT

Store doors flat on level supports in a dry, ventilated interior space. Keep doors wrapped until the building is enclosed and wet work has dried. Do not install when relative humidity or temperature differs materially from expected occupied conditions.

FRAMES AND HARDWARE

Opening coordination

Exterior frame assembly

Composite frame with matching head and jambs, integral compression weatherstrip, adjustable dark bronze threshold, corner seals, and applied exterior casing prepared for field flashing.

JAMB DEPTH	4-9/16" nominal
CASING	2-1/4" composite
THRESHOLD	ADA profile, dark bronze
FASTENERS	Corrosion-resistant

Interior frame coordination

Interior leaves are supplied without frames. Coordinate jamb species, casing profile, stop, clearances, and finish with project millwork. Confirm hinge locations before factory machining.

HEAD CLEARANCE	1/8" typical
JAMB CLEARANCE	1/8" each side
FLOOR CLEARANCE	3/4" maximum
BEVEL	1/8" in 2" at lock edge


Hardware preparation schedule

TYPES	HINGES	LOCKSET	CLOSER	NOTES
A, B	3 at 4-1/2"	Cylindrical	Not included	Weatherstrip and sweep included
C, D	3 at 3-1/2"	Cylindrical	None	Coordinate privacy and passage sets

Required field verification

Before fabrication, verify every rough opening, wall thickness, swing, handing, finished floor elevation, threshold support, exterior exposure, and hardware function. Report conflicts in writing. Do not scale this product data for construction dimensions.

Finish samples



BRD-01 Warm White



BRD-CL1 Clear Birch



BRD-DB Dark Bronze

EXECUTION AND CLOSEOUT

Installation requirements

1

Delivery and storage

Deliver units in unopened protective wrapping. Inspect for transit damage on arrival. Store flat, level, dry, and out of direct sunlight. Keep exterior assemblies upright only when supported at head and sill.

2

Opening verification

Confirm opening size, plumb, level, square, wall thickness, sill support, and finish clearances. Do not install into an opening that exceeds manufacturer tolerance or contains active moisture.

3

Exterior installation

Set frames plumb and square. Shim at hinges, strike, sill, and fastener locations. Flash sill and perimeter in sequence with the wall weather barrier. Seal interior and exterior perimeter joints.

4

Interior installation

Allow doors to acclimate in occupied-range conditions. Fit leaves for uniform clearances without binding. Reseal field cuts, install hardware without splitting, and adjust operation before acceptance.

5

Protection and cleaning

Protect faces, edges, glazing, and finish from impact, moisture, paint, plaster, and masonry wash. Remove labels with manufacturer-approved cleaner. Replace damaged units that cannot be repaired invisibly.

Limited warranty

One year from substantial completion against manufacturing defects in materials and workmanship. Warranty excludes improper storage, field alteration beyond published limits, and uncontrolled moisture exposure.

Closeout deliverables

Provide approved schedule, finish touch-up material, care instructions, warranty certificate, and final model list. Record approved substitutions and field changes in the closeout package.

Technical values and product identities in this sample package are fictional and provided only for demonstration.