


FIRE COMPARTMENTATION PLAN — LEVEL 01

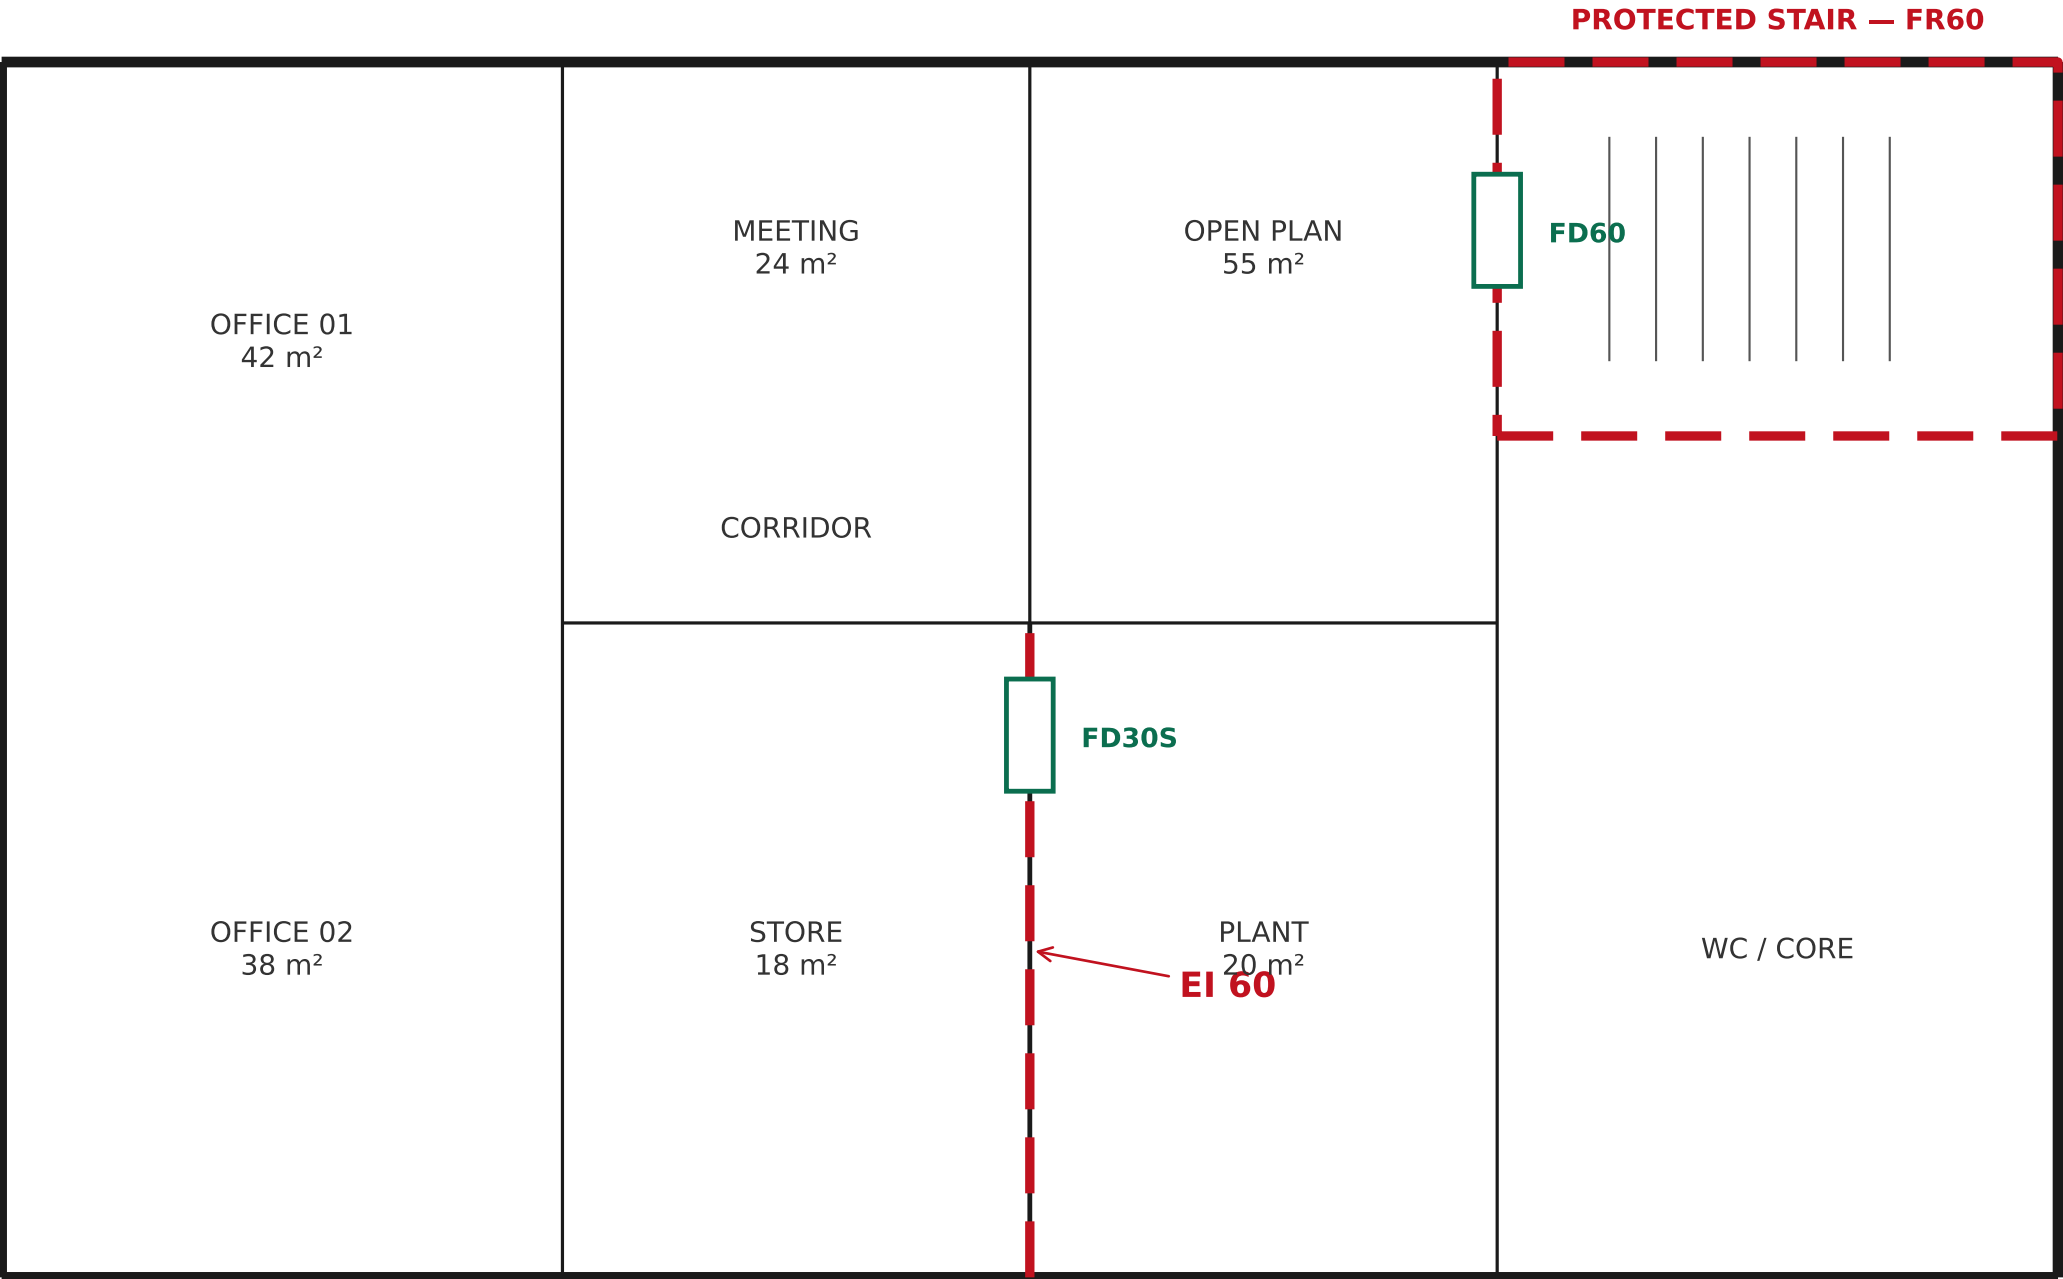

LEGEND

Compartment wall
60 min (EI 60)

External wall

Partition (non-rated)

Fire door (FD30S / FD60)

NOTES:

1. Compartment walls to achieve 60 min fire resistance (EI 60) to BS EN 13501-2, in accordance with Approved Document B (Vol. 2), England.
2. Fire doors to BS EN 1634-1. 'S' denotes smoke seal (FD30S).
3. Penetrations through compartment walls to be fire-stopped. Refer to spec K10/P10.
4. SAMPLE DRAWING FOR AI-WORKFLOW TRAINING ONLY — NOT FOR CONSTRUCTION.

SAMPLE PROJECT — TRAINING USE

LEVEL 01 — FIRE COMPARTMENTATION PLAN

Dwg No: SMP-XX-01-DR-A-7001

Scale: 1:100 @ A3 Rev: P01

Status: S2 — For Information