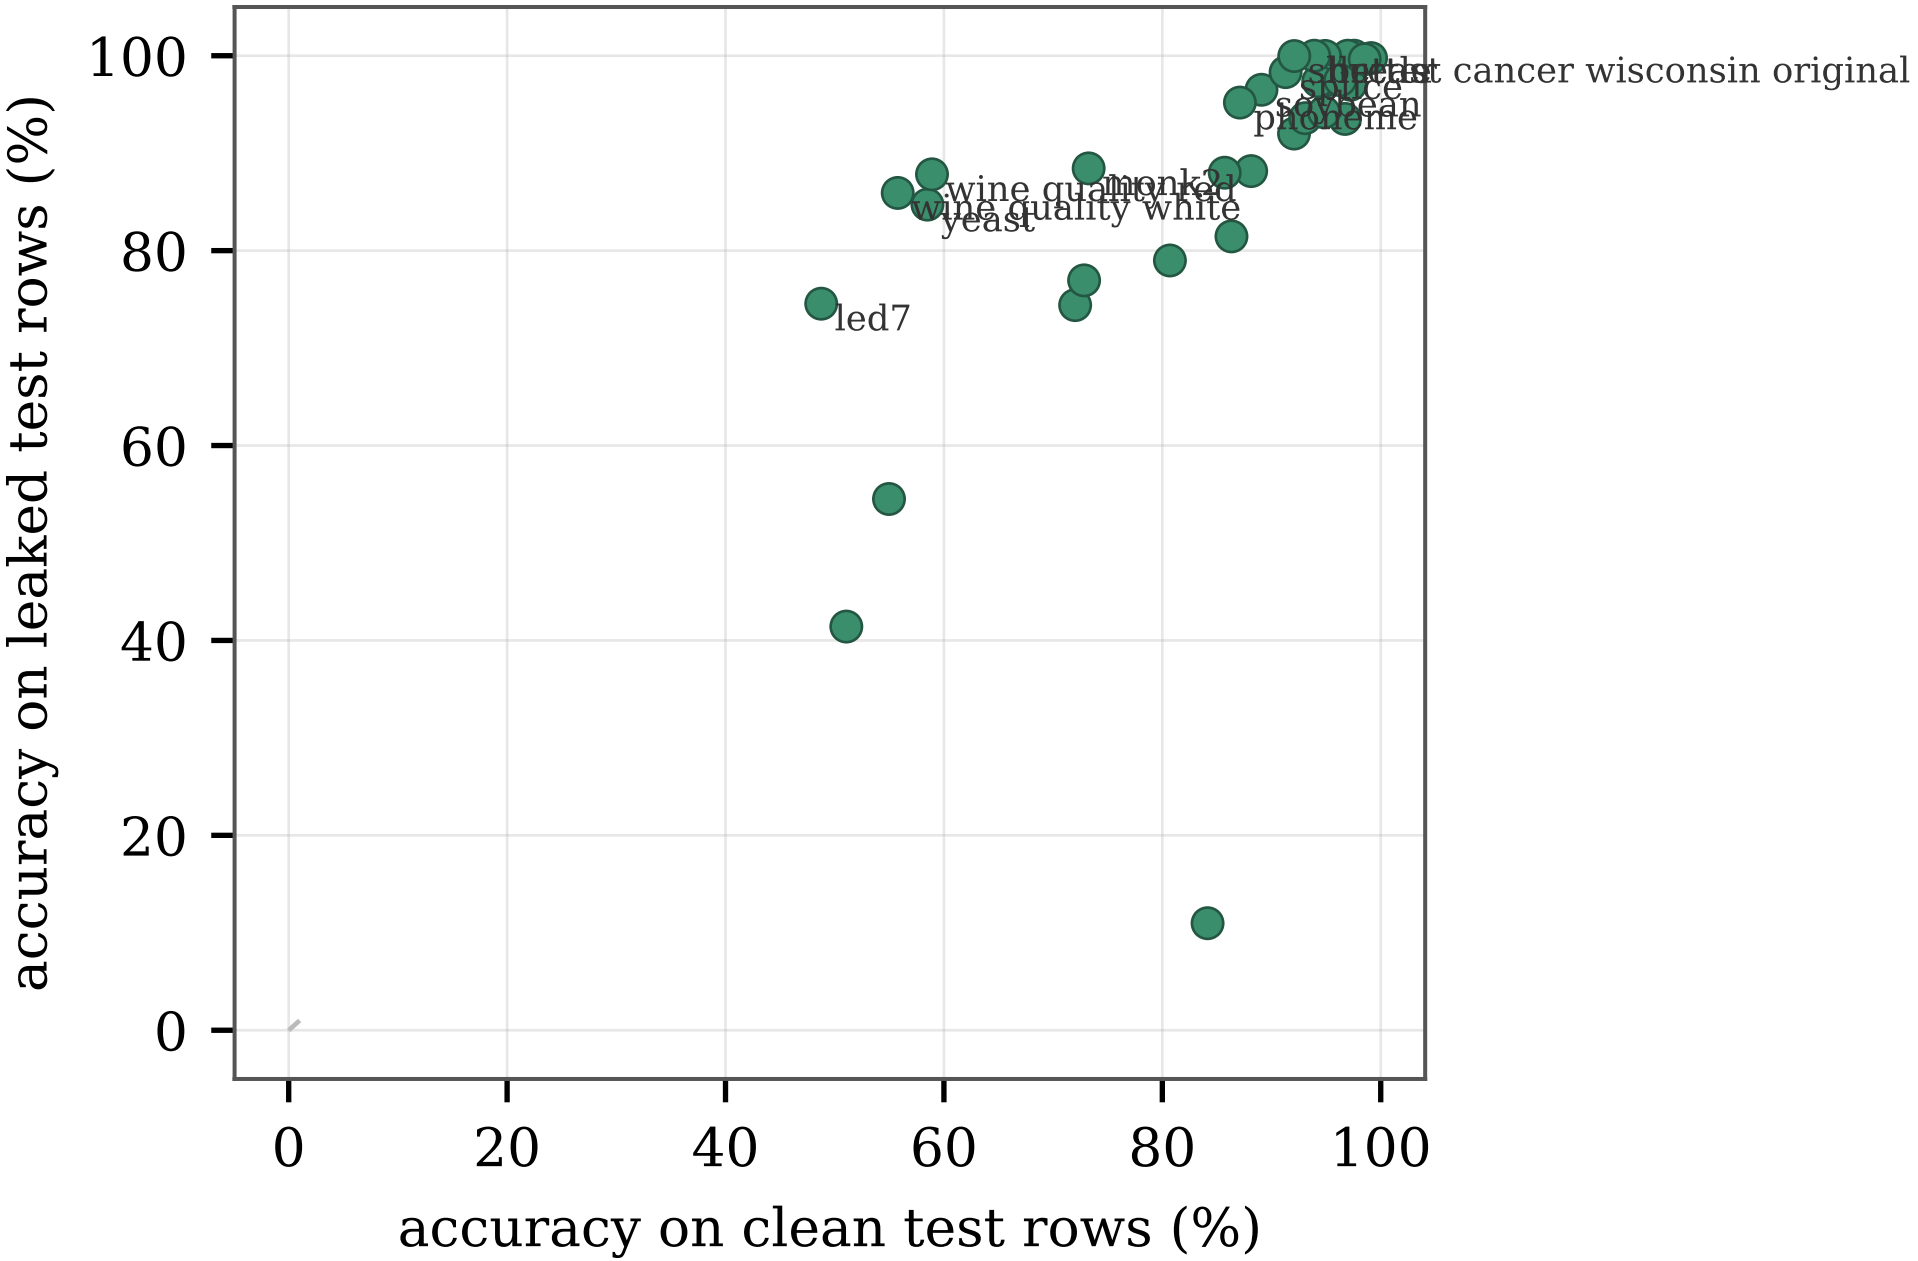
accuracy on leaked test rows (%)
accuracy on clean test rows (%)
0
20
40
60
80
100
breast cancer wisconsin original
splice
phoneme
wine quality red
wine quality white
yeast
led7