DALMATIAN FIRE SAFETY

Fire Risk Assessment

Client Interview Sheet

Quick prompts for the on-site walk-round conversation with the client/RP. Jot short answers on the lines. Expand in the full report afterwards.

Premises / building name and address:

Date of visit: _____ Assessor: _____

Type of assessment (Type 1 / Type 3 / Commercial): _____

1. Responsible Person (RP)

Who is the Responsible Person for this building under the Fire Safety Order?

2. Competent Person

Is a competent person appointed for day-to-day fire safety checks (e.g. alarm testing, fire extinguisher checks)? Who?

3. History of Building / Construction

Approximate age of the building and any known construction type (e.g. traditional brick, timber frame, converted house, purpose-built):

Any history of conversion, extension, or change of use? When, and what changed?

Any known fire-related incidents, near-misses, or enforcement notices at this building?

Any major refurbishment, recladding, or compartmentation works carried out? Any certificates/documentation available?

4. Occupancy: Staff and Visitors

How many people normally occupy the building (residents/staff/tenants), and roughly how many visitors at peak times?

Are there any known vulnerable occupants (mobility issues, sensory impairment, cognitive impairment, very young/elderly)?

Are there sleeping risks on-site (residential/overnight stays)? If so, where and how many?

5. How the Building Is Used

What is the building actually used for day-to-day (confirm matches assumed use: residential, office, mixed, storage, etc.)?

Are there any special activities or processes with added fire risk (e.g. commercial kitchen, workshop, storage of flammables, e-bike/e-scooter charging, out-of-hours hire)?

Any part of the building not in normal use, vacant, or under works at the moment?

Any recent or planned changes to how the building is used?

6. Evacuation Plans

What is the building's evacuation strategy (Stay Put / Simultaneous evacuation / other)? Confirm this matches what's actually displayed/installed.

Is there a written fire evacuation/emergency plan? When was it last reviewed?

Has a fire drill or evacuation exercise been carried out? When, and were there any issues?

Who is responsible for calling the fire brigade / coordinating evacuation on the day?

Assembly point: is one specified, and is it known to occupants?

How many exits are there from the building, and which are normally used? Where are the final exits?

How many staircases are in the building?

7. PEEPs (Personal Emergency Evacuation Plans)

Are there any occupants who would need a PEEP (residents, staff, or regular visitors with a disability or condition affecting escape)?


Are PEEPs currently in place for anyone? Who holds them, and are they up to date?

8. Training (staff) / Engagement (residents, visitors, students)

What fire safety training have staff had (a training matrix, fire awareness, warden or marshal certificates), and how are residents or visitors told what to do in a fire?

9. Floor plan

Floor / level: _____ 1 square = _____ m Plan attached ☐

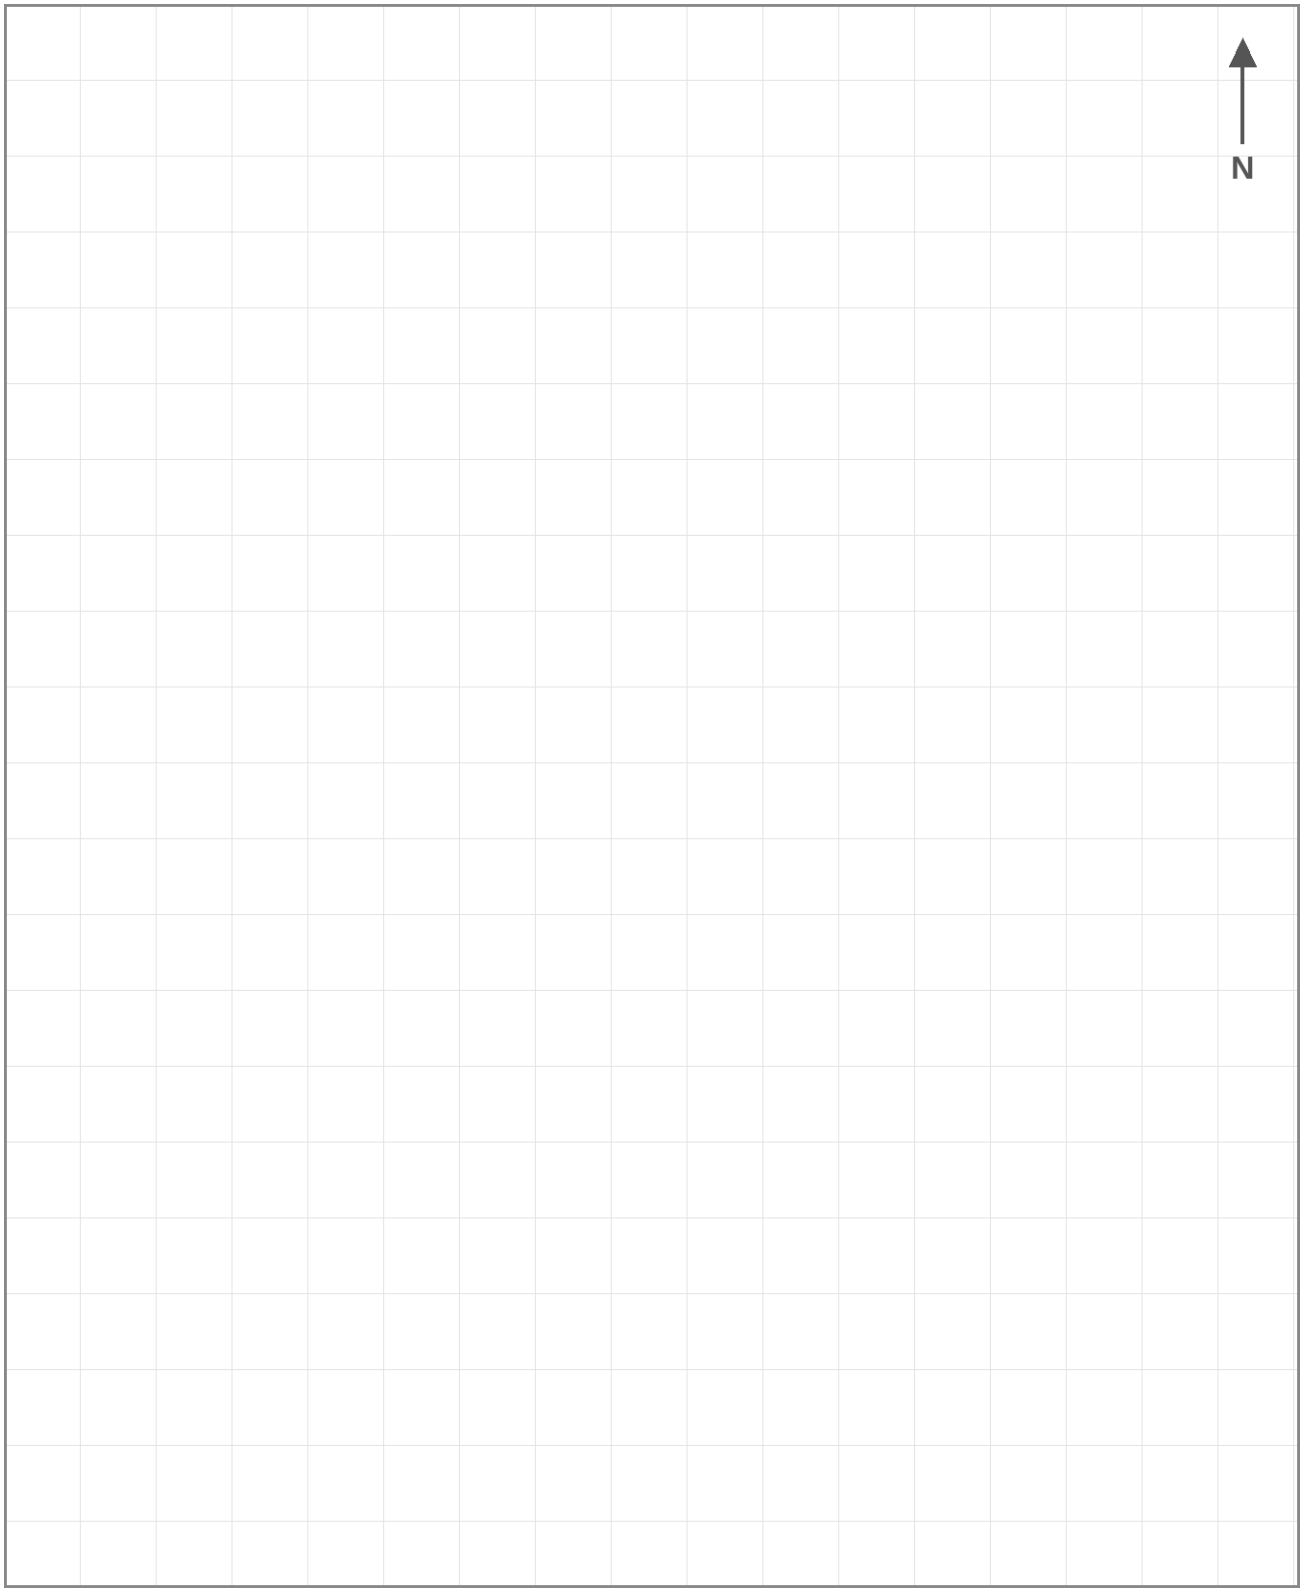

Key

	Fire door: draw it bold. Write the rating beside it (FD30, FD30S, FD60).		Staircase: arrow points up.
E1 850 →	Exit: number it E1, E2 and so on, write the clear width in mm beside it (for example E1 - 850). Arrow shows which way the door opens.	S1	Fire door sample: tag it S1, S2, S3 to match the boxes on the next page.

10. Fire door samples

Tick = no problem found. Write anything else in the notes. Match the sample number (S1 to S3) to the tag on the plan.

Sample S1	Location / door ref: _____	Rating: ☐ FD30 ☐ FD30S ☐ FD60 ☐ Unknown
☐ Door is fire-resisting, not replaced ☐ No damage or alterations to door or frame ☐ Glazing intact, still fire-resisting ☐ Hinges and ironmongery sound, no missing screws		☐ Gaps no more than 4 mm (bottom: as small as practicable) ☐ Self-closer fully closes the door (also from about 15 degrees) ☐ Seals and intumescent strips present, undamaged, not painted over ☐ Letterbox closed and suitable, grilles ok
Notes:		Result: ☐ Satisfactory ☐ Action needed

Sample S2	Location / door ref: _____	Rating: ☐ FD30 ☐ FD30S ☐ FD60 ☐ Unknown
☐ Door is fire-resisting, not replaced ☐ No damage or alterations to door or frame ☐ Glazing intact, still fire-resisting ☐ Hinges and ironmongery sound, no missing screws		☐ Gaps no more than 4 mm (bottom: as small as practicable) ☐ Self-closer fully closes the door (also from about 15 degrees) ☐ Seals and intumescent strips present, undamaged, not painted over ☐ Letterbox closed and suitable, grilles ok
Notes:		Result: ☐ Satisfactory ☐ Action needed

Sample S3	Location / door ref: _____	Rating: ☐ FD30 ☐ FD30S ☐ FD60 ☐ Unknown
☐ Door is fire-resisting, not replaced ☐ No damage or alterations to door or frame ☐ Glazing intact, still fire-resisting ☐ Hinges and ironmongery sound, no missing screws		☐ Gaps no more than 4 mm (bottom: as small as practicable) ☐ Self-closer fully closes the door (also from about 15 degrees) ☐ Seals and intumescent strips present, undamaged, not painted over ☐ Letterbox closed and suitable, grilles ok
Notes:		Result: ☐ Satisfactory ☐ Action needed

11. Occupancy working

Occupancy is the lower of the floor space figure and the exit figure. Floor space factors: Approved Document B Vol. 2 Table D1. Exit widths: HM Government guide. Tables are on the next page.

Area (public floor, net of stairs, toilets, servery)	**Area (m2)**	**m2 per person**	**People (area / factor)**
Floor space total			

Exit tag	**Clear width (mm)**	**Opens out? (Y/N)**	**Counted? (widest: discounted)**	**People allowed (guide table)**
E1				
E2				
E3				
E4				
E5				
Exit total (widest discounted)				

Floor space: _____	Exits: _____	**Occupancy (the lower):** _____
Limited by: ☐ floor space ☐ exits		Licence / known figure: _____
Risk level used: ☐ Higher ☐ Normal ☐ Lower		Travel distance checked: ☐ yes

12. Quick reference

Floor space factors (m2 per person): Approved Document B Vol. 2, Appendix D, Table D1

Bar area within 2 m of the servery; standing spectators	**0.3**
Assembly hall, club, dance floor, bar without fixed seating	**0.5**
Concourse or queuing area	**0.7**
Dining, restaurant, lounge or other bar, meeting or waiting room, staff room	**1.0**
Exhibition hall or studio	**1.5**
Shop sales area (general), skating rink	**2.0**
Gallery, museum, dormitory, workshop, factory floor	**5.0**
Office	**6.0**

Kitchen, library; shop sales area for bulky goods	**7.0**
Bedroom or study-bedroom	**8.0**
Bed-sitting room, snooker or billiards room	**10.0**
Storage and warehousing	**30.0**
Car park	**2 per space**

Leave out stairs, lifts, toilets and fixed structure. Mixed use: apply the most onerous factor to each part. Where people would normally be seated, the number of fixed seats can be used. If the use is not listed, choose a reasonable similar use.

Exit capacity: people allowed through a given clear width (HM Government fire safety risk assessment guides)

Clear width	Higher risk	Normal risk	Lower risk
750 mm or more	80	100	120
1050 mm or more	160	200	240
Each extra 75 mm (or part of)	+15	+15	+15

- Discount the widest exit (it may be blocked by the fire). If two exits are close together, consider whether one fire could stop both.
- The guides give only the 750 mm and 1050 mm figures. For a width in between, use the lower figure.
- Doors should open in the direction of escape where more than 60 people are expected. Count an inward-opening exit as 60 unless trained staff hold it open as part of fire safety management.
- Residential care and healthcare guides have no persons-per-width table, and open air venues use flow rates: see the guide. Approved Document B Table 2.3 gives different figures (110 for 850 mm, 220 for 1050 mm), so say in the report which source you used.

Travel distance: maximum, higher / normal / lower risk (HM Government guides)

Premises	More than one route	Single route only
Assembly, educational, theatres and cinemas, transport: seating in rows	20 / 32 / 45 m	10 / 15 / 18 m
The same: other areas	25 / 45 / 60 m	12 / 18 / 25 m
Offices and shops	25 / 45 / 60 m	12 / 18 / 25 m
Factories and warehouses	25 / 45 / 60 m	12 / 25 / 45 m
Sleeping accommodation (first figure also for bedrooms)	18 / 35 / 45 m	9 / 18 / 25 m
Residential care	10 / 18 / 25 m	6 / 9 / 15 m
Healthcare	30 m (dependent), 45 m (independent)	15 m (dependent), 18 m (independent)

- Measure from any point to the nearest place of reasonable safety: a protected stairway, a separate fire compartment with a final exit, or a final exit.
- Normal risk is the usual starting point. Higher risk is for small higher-risk areas. Lower risk is for exceptional cases only. If the first part of the route is one direction only, apply the single route figure to that part; the total must not exceed the more-than-one-route figure.
- Healthcare: total travel within a compartment should not exceed 60 m. In sleeping accommodation the distance inside the bedroom counts toward the total.

Quick reference only. Check the figure in the current guide before relying on it, and say in the report which source you used.