



- Nuclear Power Plant
- Concentrated Solar-Thermal Power
- Wind Turbines / Photovoltaic Solar Panels
- Hydroelectric Dams
- Geothermal Power Plant

#### Nuclear Energy

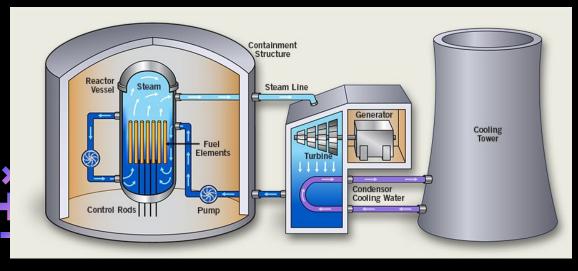

Atoms are split in nuclear fission, generating energy in the form of heat. This heat is then used to create steam, which spins a turbine to generate energy.


## Concentrated Solar-Thermal Power

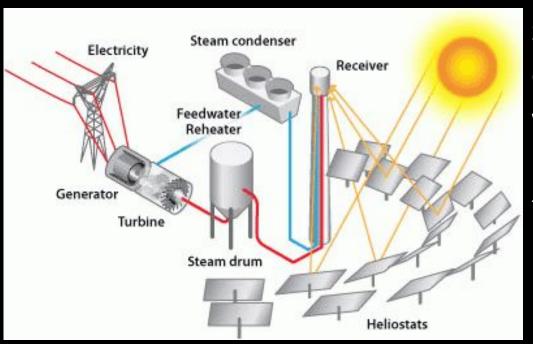

Sunlight is concentrated into a central tower that is filled with water. This water then turns into steam which turns a turbine to generate energy.





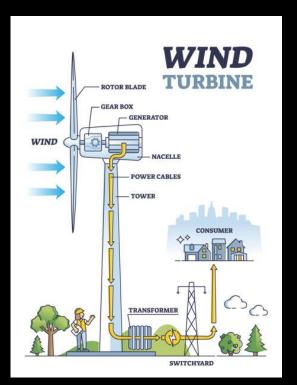


Turbine is in the name.

Transform the kinetic energy of the wind into electrical energy using turbines




#### Photovoltaic Solar Panels

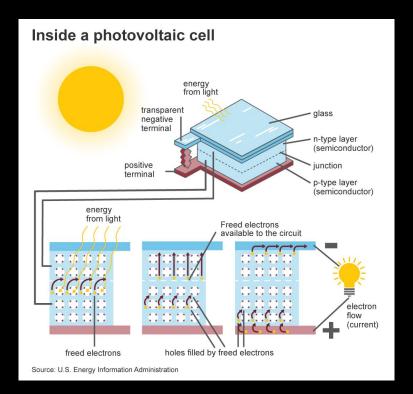

Photovoltaic solar panels convert sunlight directly into electricity using semiconductors. When sunlight hits the solar panels, it creates an electric current by causing electrons in the material to move.

## Hydroelectric Dams

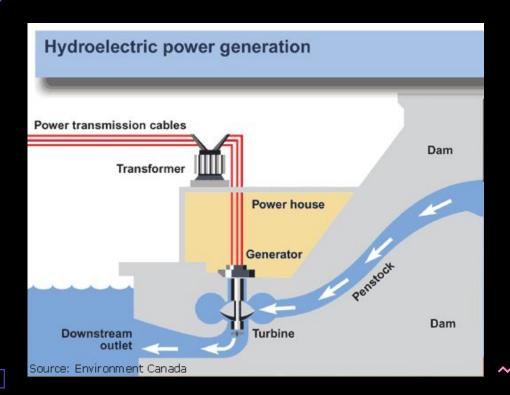


Hydroelectric power uses the potential energy of flowing water to make turbines spin, generating electricity.








### Geothermal Energy

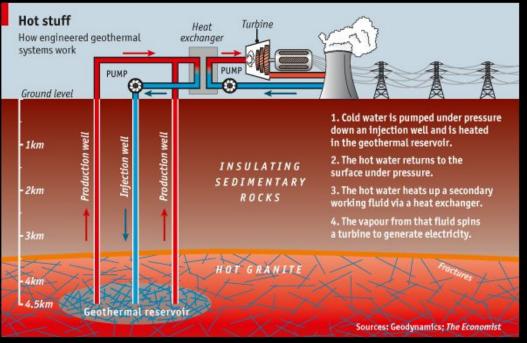

Geothermal power harnesses the heat from the Earth's core. This heat is used to produce electricity, making it a renewable energy source.



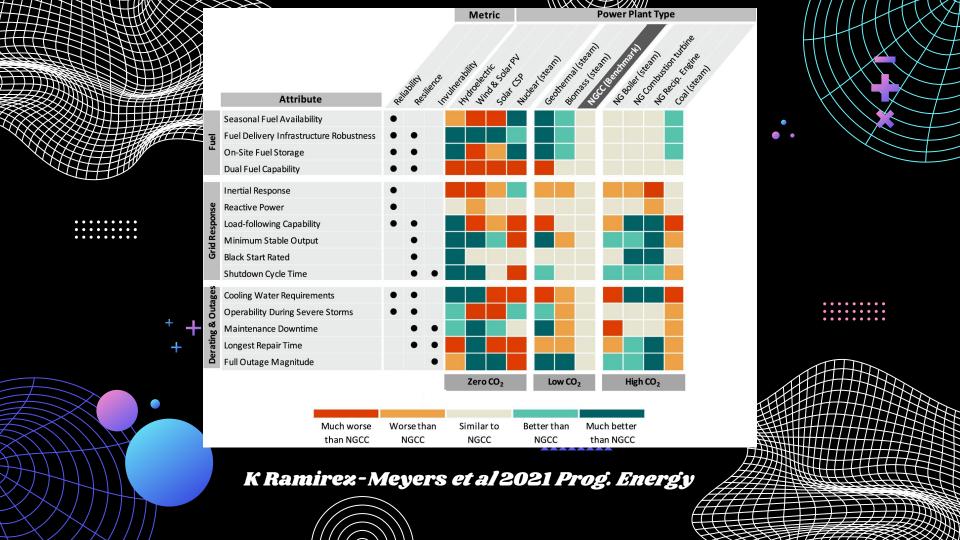

# What is being optimized

01

02

03

#### Reliability

- Seasonal Fuel availability
- Load-following Capability
- Operationality during
   Severe Storms

#### Resilience

- Load-following Capability
- Minimum Stable output
- Operationality duringSevere Storms
- Maintenance Downtime
- Shutdown Cycle Time

#### Invulnerability

- Shutdown Cycle Time
- Maintenance Downtime
- Full Outage Magnitude








# Reliability

~~~~

How few disruptions a grid experience



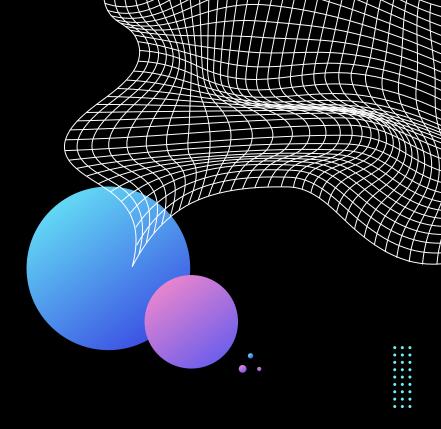

### Optimization of Reliability

$$SFA = H_0 n_{H0} + W_0 n_{W0} + S_0 n_{S0} + N_0 n_{N0} + G_0 n_{G0}$$

$$LFC = H_1 n_{H1} + W_1 n_{W1} + S_1 n_{S1} + N_1 n_{N1} + G_1 n_{G1}$$

$$ODSS = H_2 n_{H2} + W_2 n_{W2} + S_2 n_{S2} + N_2 n_{N2} + G_2 n_{G2}$$

Reliability = SFA + LFC + ODSS

#### Optimization of Reliability

$$SFA = 0.52n_{H0} + 0.62n_{W0} + 0.35n_{S0} + 1n_{N0} + 1n_{G0}$$

$$LFC = 1n_{H1} + 0.1n_{W1} + 0.25n_{S1} + 0.1n_{N1} + 0.1n_{G1}$$


$$ODSS = 0.75n_{H2} + 0.1n_{W2} + 0.1n_{S2} + 0.75n_{N2} + 0.75n_{G2}$$






**~~~~** 

How quickly a grid can recover after disruptions



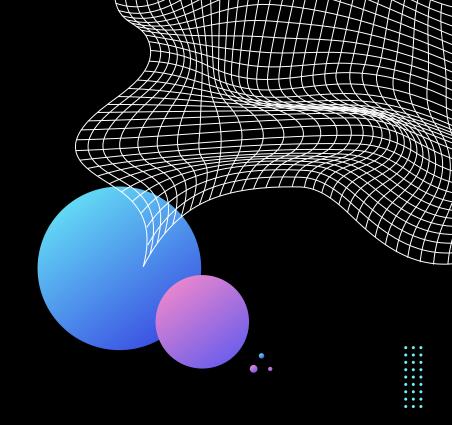

## Optimization of Resilience

$$SFA = H_0 n_{H0} + W_0 n_{W0} + S_0 n_{S0} + N_0 n_{N0} + G_0 n_{G0}$$

$$ODSS = H_{2}n_{H2} + W_{2}n_{W2} + S_{2}n_{S2} + N_{2}n_{N2} + G_{2}n_{G2}$$

$$MSO = H_{3}n_{H3} + W_{3}n_{W3} + S_{3}n_{S3} + N_{3}n_{N3} + G_{3}n_{G3}$$

$$MD \ = \ H_{_{4}}n_{_{H4}} + W_{_{4}}n_{_{W4}} + S_{_{4}}n_{_{S4}} + N_{_{4}}n_{_{N4}} + G_{_{4}}n_{_{G4}}$$

$$SCT = H_6 n_{H6} + W_6 n_{W6} + S_6 n_{S6} + N_6 n_{N6} + G_6 n_{G6}$$

Resilience = SFA + ODSS + MSO + MD + SCT

## Optimization of Resilience

$$LFC = 1n_{H1} + 0.1n_{W1} + 0.25n_{S1} + 0.1n_{N1} + 0.1n_{G1}$$

$$ODSS = 0.75n_{H2} + 0.1n_{W2} + 0.1n_{S2} + 0.75n_{N2} + 0.75n_{G2}$$

$$MSO = 0.9n_{H3} + 0.9n_{W3} + 0.8n_{S3} + 0.1n_{N3} + 0.9n_{G3}$$

$$MD = 0.75n_{H4} + 0.1n_{W4} + 0.1n_{S4} + 0.75n_{N4} + 0.75n_{G4}$$

$$SCT = 1n_{H6} + 1n_{W6} + 0.5n_{S6} + 0.25n_{N6} + 0.75n_{G6}$$







### Optimization of Invulnerability

$$MD = H_4 n_{H4} + W_4 n_{W4} + S_4 n_{S4} + N_4 n_{N4} + G_4 n_{G4}$$

$$SCT = H_6 n_{H6} + W_6 n_{W6} + S_6 n_{S6} + N_6 n_{N6} + G_6 n_{G6}$$

$$FOM = H_5 n_{H5} + W_5 n_{W5} + S_5 n_{S5} + N_5 n_{N5} + G_5 n_{G5} + M_5 n_{N5} + G_5 n_{N5}$$

Invulnerability = SCT + MD + FOM

#### Optimization of Invulnerability

$$MD = 0.75n_{H4} + 0.1n_{W4} + 0.1n_{S4} + 0.75n_{N4} + 0.75n_{G4}$$

$$SCT = 1n_{H6} + 1n_{W6} + 0.5n_{S6} + 0.25n_{N6} + 0.75n_{G6}$$

$$FOM = 0.27n_{H5} + 0.99n_{W5} + 0.99n_{S5} + 0.1n_{N5} + 0.99n_{G5}$$



## constraints

## **Objective Function**

 $SFA = H_0 n_H + W_0 n_W + S_0 n_S + N_0 n_N + G_0 n_G > 0.67684 \quad OPG = Reliability \cdot Resilience \cdot Invulnerability$ 

 $LFC = H_1 n_H + W_1 n_W + S_1 n_S + N_1 n_N + G_1 n_G > 0.394$ 

 $ODSS = H_2 n_H + W_2 n_W + S_2 n_S + N_2 n_N + G_2 n_G > 0.4431$ 

 $MSO = H_3 n_H + W_3 n_W + S_3 n_S + N_3 n_N + G_3 n_G > 0.6162$ 

 $MD = H_4 n_H + W_4 n_W + S_4 n_S + N_4 n_N + G_4 n_G > 0.64767$ 

 $FOM = H_5 n_H + W_5 n_W + S_5 n_S + N_5 n_N + G_5 n_G > 0.64767$ 

 $SCT = H_6 n_H + W_6 n_W + S_6 n_S + N_6 n_N + G_6 n_G > 0.59725$ 

Reliability = SFA + LFC + ODSS

Resilience = SFA + ODSS + MSO + MD + SCT

Invulnerability = SCT + MD + FOM



#### Results

#### Starting from zero:

• Hydro < 15% (y = 11.3686)

No upper bounds (y = 15.6514)

#### Starting from current grid:

• Hydro < 15% (y = 10.0881)

• No upper bounds (y = 15.6512) +

#### Possible Errors

- Reflects a theoretical power grid
- $^{\dagger}_{\perp}$   $^{+}$   $^{\circ}$  Doesn't consider political, social, or economical factors
  - Doesn't consider logistical challenges
- Assumes that the relationship between the factors are linear

^^^^

- A simplification of the grid rather than slower fluctuations
- There are likely other factors



- Ramirez-Meyers, K., Neal Mann, W., Deetjen, T. A., Johnson, S. C., Rhodes, J. D., & Webber, M. E. (2021). How
  different power plant types contribute to electric grid reliability, resilience, and vulnerability: A
  comparative analytical framework. Progress in Energy, 3(3), 033001.
- Drought effects on hydroelectricity generation in western U.S. differed by region in 2021. U.S. Energy
  Information Administration (EIA). (2021). Retrieved April 29, 2023, from
  https://www.eia.gov/todayinenergy/detail.php?id=51839
- How many homes can an average wind turbine power? How many homes can an average wind turbine power? | U.S. Geological Survey. (n.d.).
  - https://www.usgs.gov/faqs/how-many-homes-can-average-wind-turbine-power#:~:text=At%20a%204 2%25%20capacity%20factor,than%20940%20average%20U.S.%20homes.





## Thank you



Special Thanks

Foundation Instructor: Alex Wong

Honors Instructor: Joshua Rhodes