

Preliminary screening report

Puglia PV Authority Register

65.3

OUT OF 100

TECHNOLOGY

SOLAR

PROJECT STATUS

screening

COUNTRY / MARKET

Italy

GROSS SITE AREA

92.40 ha

SITE CENTROID

40.09720, 17.42230

ANALYSIS GENERATED

07 Aug 2026, 18:00 UTC

SNAPSHOT ID

snapshot-v12-sample

METHODOLOGY

v1.2

Further review

100% data coverage | high confidence

Screening result

This immutable run produced a score of 65.3 out of 100, classified as further review, with 100% source coverage and high confidence. The result reflects only the evidence and source responses recorded at 07 Aug 2026, 18:00 UTC.

Recommended next actions

1. Verify natura 2000 with the competent authority or a qualified specialist: 0.62% of the site overlaps 2 Natura 2000 designations.
2. Verify national designations with the competent authority or a qualified specialist: 0.42% of the site overlaps 1 national designation.
3. Verify flood risk reporting areas with the competent authority or a qualified specialist: 1 Floods Directive reporting-area feature intersects the site.
4. Verify surface water and wetlands with the competent authority or a qualified specialist: Nearest mapped watercourse is 640 m from the boundary.
5. Verify transmission-line proximity with the competent authority or a qualified specialist: Transmission line is 1,740 m from the boundary.
6. Verify substation proximity with the competent authority or a qualified specialist: Substation is 6,800 m from the boundary.
7. Confirm land control, planning policy, grid capacity, access rights, geotechnical conditions and current authority datasets before making a development or investment decision.

Saved site boundary

Exhibit date: 07 Aug 2026, 18:00 UTC | Analysis date: 07 Aug 2026, 18:00 UTC | CRS: WGS 84 geographic coordinates (EPSG:4326).

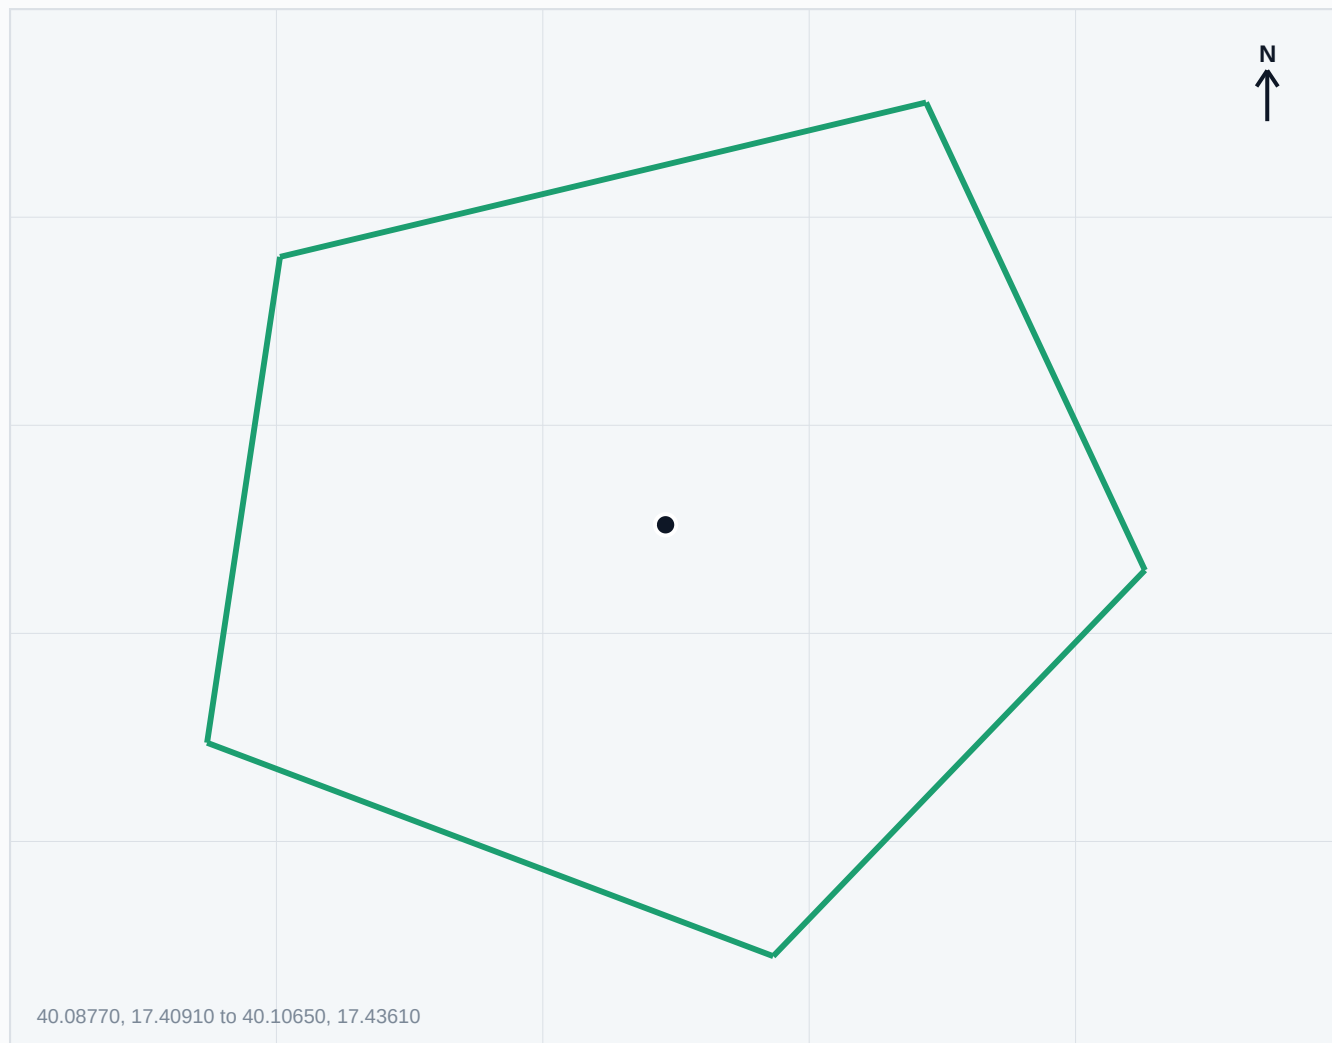


Exhibit particulars

SITE CENTROID

40.09720, 17.42230

GROSS BOUNDARY AREA

92.40 ha

This vector exhibit records the saved candidate-site boundary used for the selected analysis snapshot. It is not a cadastral, topographic or legal-title plan; boundary position and area require survey and land-record verification.

Snapshot constraint register

This register preserves the spatial finding, screening status and source retrieval date for each criterion in the selected immutable run.

Natura 2000

ENVIRONMENT | CONSTRAINT | 40/100

0.62% of the site overlaps 2 Natura 2000 designations.

European Environment Agency | retrieved 07 Aug 2026, 18:00 UTC

National designations

ENVIRONMENT | CAUTION | 50/100

0.42% of the site overlaps 1 national designation.

European Environment Agency | retrieved 07 Aug 2026, 18:00 UTC

Flood risk reporting areas

WATER | CONSTRAINT | 25/100

1 Floods Directive reporting-area feature intersects the site.

European Environment Agency | retrieved 07 Aug 2026, 18:00 UTC

Surface water and wetlands

WATER | CAUTION | 75/100

Nearest mapped watercourse is 640 m from the boundary.

OpenStreetMap contributors via Overpass API | retrieved 07 Aug 2026, 18:00 UTC

Main-road proximity

INFRASTRUCTURE | FAVOURABLE | 100/100

Main road is 820 m from the boundary.

OpenStreetMap contributors via Overpass API | retrieved 07 Aug 2026, 18:00 UTC

Transmission-line proximity

INFRASTRUCTURE | CAUTION | 75/100

Transmission line is 1,740 m from the boundary.

OpenStreetMap contributors via Overpass API | retrieved 07 Aug 2026, 18:00 UTC

Substation proximity

INFRASTRUCTURE | CAUTION | 50/100

Substation is 6,800 m from the boundary.

OpenStreetMap contributors via Overpass API | retrieved 07 Aug 2026, 18:00 UTC

Terrain slope

TERRAIN | FAVOURABLE | 100/100

3.80 deg average and 7.20 deg 90th-percentile sampled slope.

Open-Meteo Elevation API | retrieved 07 Aug 2026, 18:00 UTC

Feature-level source identifiers

Identifiers below are preserved from the source response used by the selected analysis run. Use them to locate the mapped record in current competent-authority data; an identifier is not confirmation that the feature remains current or legally applicable.

Natura 2000

- IT9150003 | Aquatina di Frigole | jurisdiction IT | Habitats and Birds
- IT9150025 | Torre Veneri | jurisdiction IT | Habitats

National designations

- EUAP0123 | Regional protected landscape | jurisdiction IT | Regional reserve

Flood risk reporting areas

- IT-RP-160 | Potential significant flood-risk area | jurisdiction IT | polygon | fluvial

Surface water and wetlands

- OSM:way/12345678 | Canale locale | watercourse

Main-road proximity

- OSM:way/23456789 | SP 96 | secondary

Transmission-line proximity

- OSM:way/34567890 | 132 kV line | 132000 V

Substation proximity

- OSM:node/45678901 | Primary substation | 132000 V

Weighted screening criteria

The table below preserves the score, weight, status and evidence statement returned for every criterion in this run.

Natura 2000 0.62% of the site overlaps 2 Natura 2000 designations.	40/100 weight 15% constraint
National designations 0.42% of the site overlaps 1 national designation.	50/100 weight 15% caution
Flood risk reporting areas 1 Floods Directive reporting-area feature intersects the site.	25/100 weight 10% constraint
Surface water and wetlands Nearest mapped watercourse is 640 m from the boundary.	75/100 weight 15% caution
Main-road proximity Main road is 820 m from the boundary.	100/100 weight 10% favourable
Transmission-line proximity Transmission line is 1,740 m from the boundary.	75/100 weight 10% caution
Substation proximity Substation is 6,800 m from the boundary.	50/100 weight 10% caution
Terrain slope 3.80 deg average and 7.20 deg 90th-percentile sampled slope.	100/100 weight 15% favourable

Source register

Natura 2000

European Environment Agency | Natura 2000 dataset | 2026 sample | retrieved 07 Aug 2026, 18:00 UTC | Source-specific reuse terms apply

Service: <https://example.com/service>

Metadata: <https://example.com/metadata>

- Verify against current competent-authority records.

Nationally designated areas

European Environment Agency | Nationally designated areas dataset | 2026 sample | retrieved 07 Aug 2026, 18:00 UTC | Source-specific reuse terms apply

Service: <https://example.com/service>

Metadata: <https://example.com/metadata>

- Verify against current competent-authority records.

Floods Directive reporting areas

European Environment Agency | Floods Directive reporting areas dataset | 2026 sample | retrieved 07 Aug 2026, 18:00 UTC | Source-specific reuse terms apply

Service: <https://example.com/service>

Metadata: <https://example.com/metadata>

- Verify against current competent-authority records.

Surface water and wetlands

OpenStreetMap contributors via Overpass API | Surface water and wetlands dataset | 2026 sample | retrieved 07 Aug 2026, 18:00 UTC | Source-specific reuse terms apply

Service: <https://example.com/service>

Metadata: <https://example.com/metadata>

- Verify against current competent-authority records.

Road, grid and substation proximity

OpenStreetMap contributors via Overpass API | Road, grid and substation proximity dataset | 2026 sample | retrieved 07 Aug 2026, 18:00 UTC | Source-specific reuse terms apply

Service: <https://example.com/service>

Metadata: <https://example.com/metadata>

- Verify against current competent-authority records.

Terrain elevation and slope

Open-Meteo Elevation API | Terrain elevation and slope dataset | 2026 sample | retrieved 07 Aug 2026, 18:00 UTC | Source-specific reuse terms apply

Service: <https://example.com/service>

Metadata: <https://example.com/metadata>

- Verify against current competent-authority records.

Methodology v1.2

Eight deterministic criteria total 100 weight points. Each available criterion receives a 0-100 score and contributes its weighted deduction. Where a source is unavailable, available-weight normalized is used; unavailable criteria reduce coverage and confidence and are never assigned a favourable default.

Reliance and professional review

This preliminary screening score is a deterministic prioritisation aid and requires professional review.

Mapped datasets can be incomplete, generalized, delayed, or unsuitable for parcel-level design. This report does not establish title, planning consent, environmental acceptability, grid capacity, access rights, flood safety, constructability, yield, valuation, or financing suitability. Use current competent-authority data and appropriately qualified advisers before relying on any finding.

Audit record

Project ID: project-v12-sample

Snapshot ID: snapshot-v12-sample

Snapshot created: 07 Aug 2026, 18:00 UTC

Analysis generated: 07 Aug 2026, 18:00 UTC

Methodology version: 1.2

The report is generated from the selected immutable snapshot. Generating the PDF does not rerun or refresh any source.