

Preliminary screening report

Puglia PV Screening Site

73.8

OUT OF 100

TECHNOLOGY

SOLAR

PROJECT STATUS

screening

COUNTRY / MARKET

Italy

GROSS SITE AREA

92.40 ha

SITE CENTROID

40.09720, 17.42230

ANALYSIS GENERATED

07 Aug 2026, 16:30 UTC

SNAPSHOT ID

snapshot-report-sample

METHODOLOGY

v1.1

Further review

100% data coverage | high confidence

Screening result

This immutable run produced a score of 73.8 out of 100, classified as further review, with 100% source coverage and high confidence. The result reflects only the evidence and source responses recorded at 07 Aug 2026, 16:30 UTC.

Recommended next actions

1. Verify national designations with the competent authority or a qualified specialist: 0.42% of the site overlaps 1 national designation.
2. Verify flood risk reporting areas with the competent authority or a qualified specialist: 1 Floods Directive reporting-area feature intersects the site.
3. Verify surface water and wetlands with the competent authority or a qualified specialist: Nearest mapped watercourse is 640 m from the boundary.
4. Verify transmission-line proximity with the competent authority or a qualified specialist: Transmission line is 1,740 m from the boundary.
5. Verify substation proximity with the competent authority or a qualified specialist: Substation is 6,800 m from the boundary.
6. Confirm land control, planning policy, grid capacity, access rights, geotechnical conditions and current authority datasets before making a development or investment decision.

Saved site boundary

Exhibit date: 07 Aug 2026, 16:30 UTC | Analysis date: 07 Aug 2026, 16:30 UTC | CRS: WGS 84 geographic coordinates (EPSG:4326).

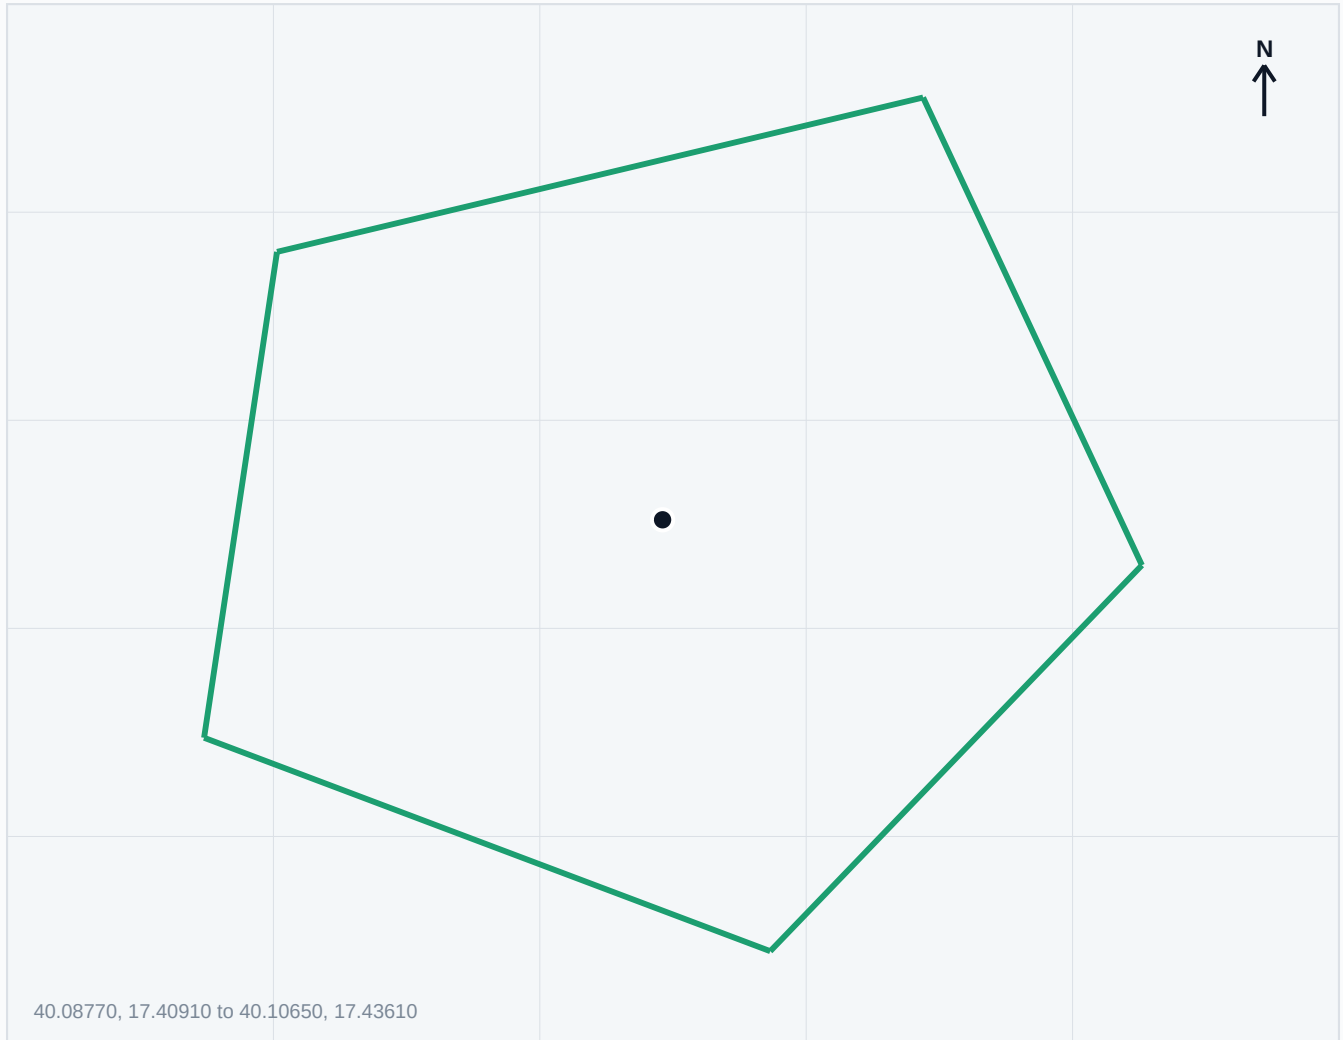


Exhibit particulars

SITE CENTROID

40.09720, 17.42230

GROSS BOUNDARY AREA

92.40 ha

This vector exhibit records the saved candidate-site boundary used for the selected analysis snapshot. It is not a cadastral, topographic or legal-title plan; boundary position and area require survey and land-record verification.

Snapshot constraint register

This register preserves the spatial finding, screening status and source retrieval date for each criterion in the selected immutable run.

Natura 2000

ENVIRONMENT | FAVOURABLE | 100/100

No mapped Natura 2000 intersection was returned.

European Environment Agency | retrieved 07 Aug 2026, 16:30 UTC

National designations

ENVIRONMENT | CAUTION | 50/100

0.42% of the site overlaps 1 national designation.

European Environment Agency | retrieved 07 Aug 2026, 16:30 UTC

Flood risk reporting areas

WATER | CONSTRAINT | 25/100

1 Floods Directive reporting-area feature intersects the site.

European Environment Agency | retrieved 07 Aug 2026, 16:30 UTC

Surface water and wetlands

WATER | CAUTION | 75/100

Nearest mapped watercourse is 640 m from the boundary.

OpenStreetMap contributors via Overpass API | retrieved 07 Aug 2026, 16:30 UTC

Main-road proximity

INFRASTRUCTURE | FAVOURABLE | 100/100

Main road is 820 m from the boundary.

OpenStreetMap contributors via Overpass API | retrieved 07 Aug 2026, 16:30 UTC

Transmission-line proximity

INFRASTRUCTURE | CAUTION | 75/100

Transmission line is 1,740 m from the boundary.

OpenStreetMap contributors via Overpass API | retrieved 07 Aug 2026, 16:30 UTC

Substation proximity

INFRASTRUCTURE | CAUTION | 50/100

Substation is 6,800 m from the boundary.

OpenStreetMap contributors via Overpass API | retrieved 07 Aug 2026, 16:30 UTC

Terrain slope

TERRAIN | FAVOURABLE | 100/100

3.80 deg average and 7.20 deg 90th-percentile sampled slope.

Open-Meteo Elevation API | retrieved 07 Aug 2026, 16:30 UTC

Weighted screening criteria

The table below preserves the score, weight, status and evidence statement returned for every criterion in this run.

Natura 2000	100/100 weight 15% favourable
No mapped Natura 2000 intersection was returned.	
National designations	50/100 weight 15% caution
0.42% of the site overlaps 1 national designation.	
Flood risk reporting areas	25/100 weight 10% constraint
1 Floods Directive reporting-area feature intersects the site.	
Surface water and wetlands	75/100 weight 15% caution
Nearest mapped watercourse is 640 m from the boundary.	
Main-road proximity	100/100 weight 10% favourable
Main road is 820 m from the boundary.	
Transmission-line proximity	75/100 weight 10% caution
Transmission line is 1,740 m from the boundary.	
Substation proximity	50/100 weight 10% caution
Substation is 6,800 m from the boundary.	
Terrain slope	100/100 weight 15% favourable
3.80 deg average and 7.20 deg 90th-percentile sampled slope.	

Source register

Natura 2000

European Environment Agency | Natura 2000 spatial dataset | 2024 | retrieved 07 Aug 2026, 16:30 UTC | Source-specific reuse terms apply

Service: <https://example.com/service>

Metadata: <https://example.com/metadata>

- Preliminary screening data; verify against current competent-authority records.

Nationally designated areas

European Environment Agency | Nationally designated areas | 23 | retrieved 07 Aug 2026, 16:30 UTC | Source-specific reuse terms apply

Service: <https://example.com/service>

Metadata: <https://example.com/metadata>

- Preliminary screening data; verify against current competent-authority records.

Floods Directive reporting areas

European Environment Agency | 2019 reporting service | 3.0 | retrieved 07 Aug 2026, 16:30 UTC | Source-specific reuse terms apply

Service: <https://example.com/service>

Metadata: <https://example.com/metadata>

- Preliminary screening data; verify against current competent-authority records.

Surface water and wetlands

OpenStreetMap contributors via Overpass API | Live OpenStreetMap extract | 2026-08-07 | retrieved 07 Aug 2026, 16:30 UTC | Source-specific reuse terms apply

Service: <https://example.com/service>

Metadata: <https://example.com/metadata>

- Preliminary screening data; verify against current competent-authority records.

Road, grid and substation proximity

OpenStreetMap contributors via Overpass API | Live OpenStreetMap infrastructure extract | 2026-08-07 | retrieved 07 Aug 2026, 16:30 UTC | Source-specific reuse terms apply

Service: <https://example.com/service>

Metadata: <https://example.com/metadata>

- Preliminary screening data; verify against current competent-authority records.

Terrain elevation and slope

Open-Meteo Elevation API | Copernicus DEM (90 m) | 10.5270/ESA-c5d3d65 | retrieved 07 Aug 2026, 16:30 UTC | Source-specific reuse terms apply

Service: <https://example.com/service>

Metadata: <https://example.com/metadata>

- Preliminary screening data; verify against current competent-authority records.

Methodology v1.1

Eight deterministic criteria total 100 weight points. Each available criterion receives a 0-100 score and contributes its weighted deduction. Where a source is unavailable, available-weight normalized is used; unavailable criteria reduce coverage and confidence and are never assigned a favourable default.

Reliance and professional review

This preliminary screening score is a deterministic prioritisation aid and requires professional review.

Mapped datasets can be incomplete, generalized, delayed, or unsuitable for parcel-level design. This report does not establish title, planning consent, environmental acceptability, grid capacity, access rights, flood safety, constructability, yield, valuation, or financing suitability. Use current competent-authority data and appropriately qualified advisers before relying on any finding.

Audit record

Project ID: project-report-sample

Snapshot ID: snapshot-report-sample

Snapshot created: 07 Aug 2026, 16:30 UTC

Analysis generated: 07 Aug 2026, 16:30 UTC

Methodology version: 1.1

The report is generated from the selected immutable snapshot. Generating the PDF does not rerun or refresh any source.