
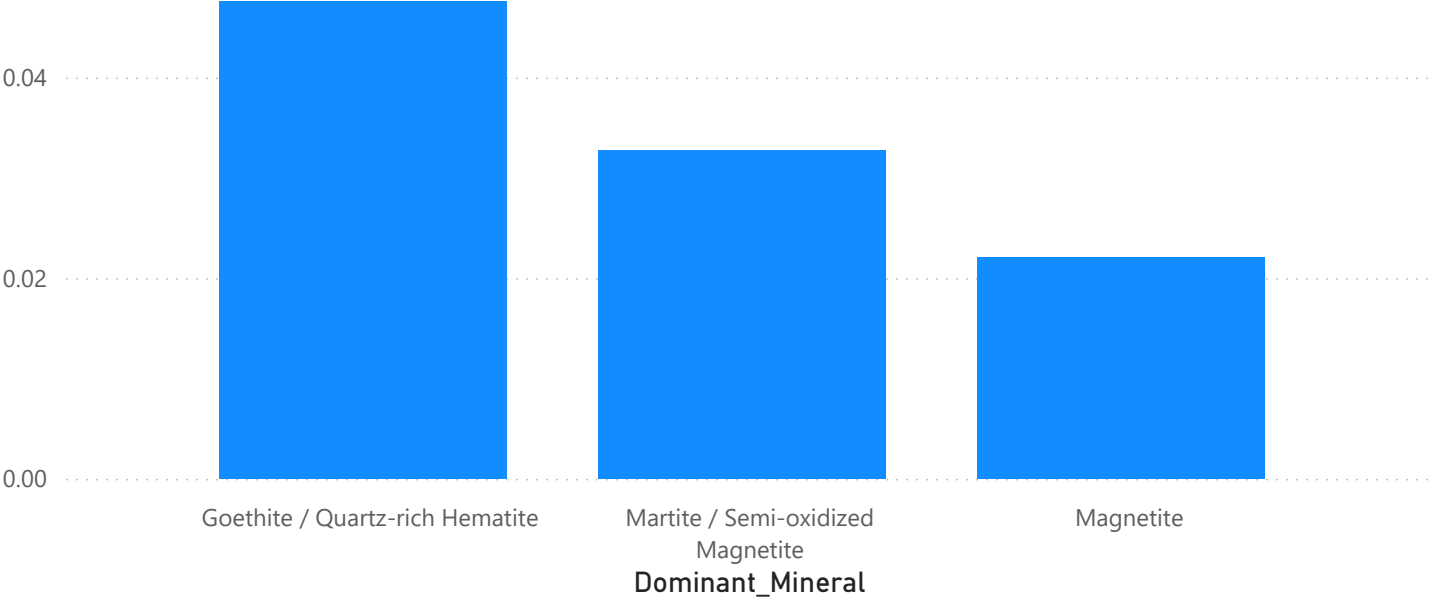


بررسی تغییرات فسفر

تعداد نمونه‌های دارای فسفر بالاتر از حد مجاز

نمایش میانگین فاکتور مغناطیسی

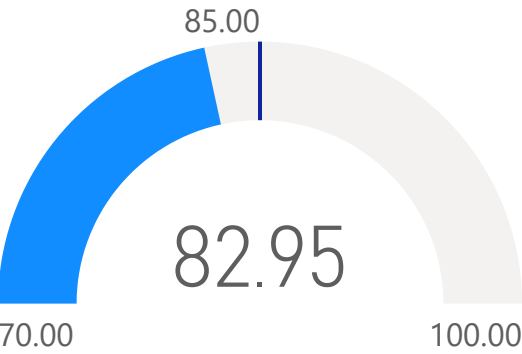

Sample_ID	Fe_Tot_pct	FeO_pct	Al2O3_pct	Average of CaO_pct	Alkalis_Na2O_K2O_pct	LOI_pct	MgO_pct	P_pct	S_pct	SiO2_pct	Basicity_B2
SMP-CH01-1016	65.44	20.94	1.63	0.63	0.05	1.41	0.58	0.02	0.08	3.59	0.23
SMP-CH01-1017	67.35	28.69	0.53	0.53	0.03	0.51	0.81	0.02	0.03	2.87	0.39
SMP-CH01-1018	65.94	19.23	0.66	0.59	0.04	0.92	0.86	0.04	0.09	3.85	0.32
SMP-CH01-1019	66.26	21.60	1.31	0.55	0.05	0.85	1.02	0.04	0.07	4.01	0.30
SMP-CH01-1020	65.70	24.62	0.32	0.52	0.04	0.24	0.41	0.02	0.06	3.66	0.23
SMP-CH01-1021	66.62	17.87	1.55	0.77	0.06	1.51	1.02	0.04	0.07	2.78	0.41
SMP-CH01-1022	66.75	24.83	0.73	0.33	0.05	0.46	0.60	0.02	0.04	2.75	0.27
SMP-CH01-1023	66.37	20.42	0.77	0.40	0.04	0.81	0.70	0.05	0.06	5.12	0.19
SMP-CH01-1024	67.37	26.43	0.62	0.59	0.03	0.47	0.43	0.03	0.05	2.28	0.35
SMP-CH01-1025	67.26	27.69	0.32	0.58	0.04	0.47	0.56	0.03	0.06	2.53	0.40
SMP-CH01-1026	61.28	2.81	1.55	0.66	0.08	4.44	0.78	0.04	0.13	6.14	0.19
SMP-CH01-1027	66.34	20.59	1.09	0.46	0.07	1.67	0.39	0.02	0.05	4.27	0.16
SMP-CH01-1028	65.14	19.79	0.96	0.63	0.05	1.38	0.69	0.03	0.06	4.84	0.23
SMP-CH01-1029	63.11	19.27	1.14	0.63	0.07	1.11	0.61	0.03	0.01	3.44	0.27
SMP-CH01-1030	63.16	26.66	0.61	0.47	0.03	0.18	0.57	0.03	0.05	3.66	0.23
Total	66.04	21.37	0.88	0.53	0.05	1.30	0.72	0.03	0.06	3.30	0.32

نمودار همبستگی

