



Laboratory Management — Overall Swimlane

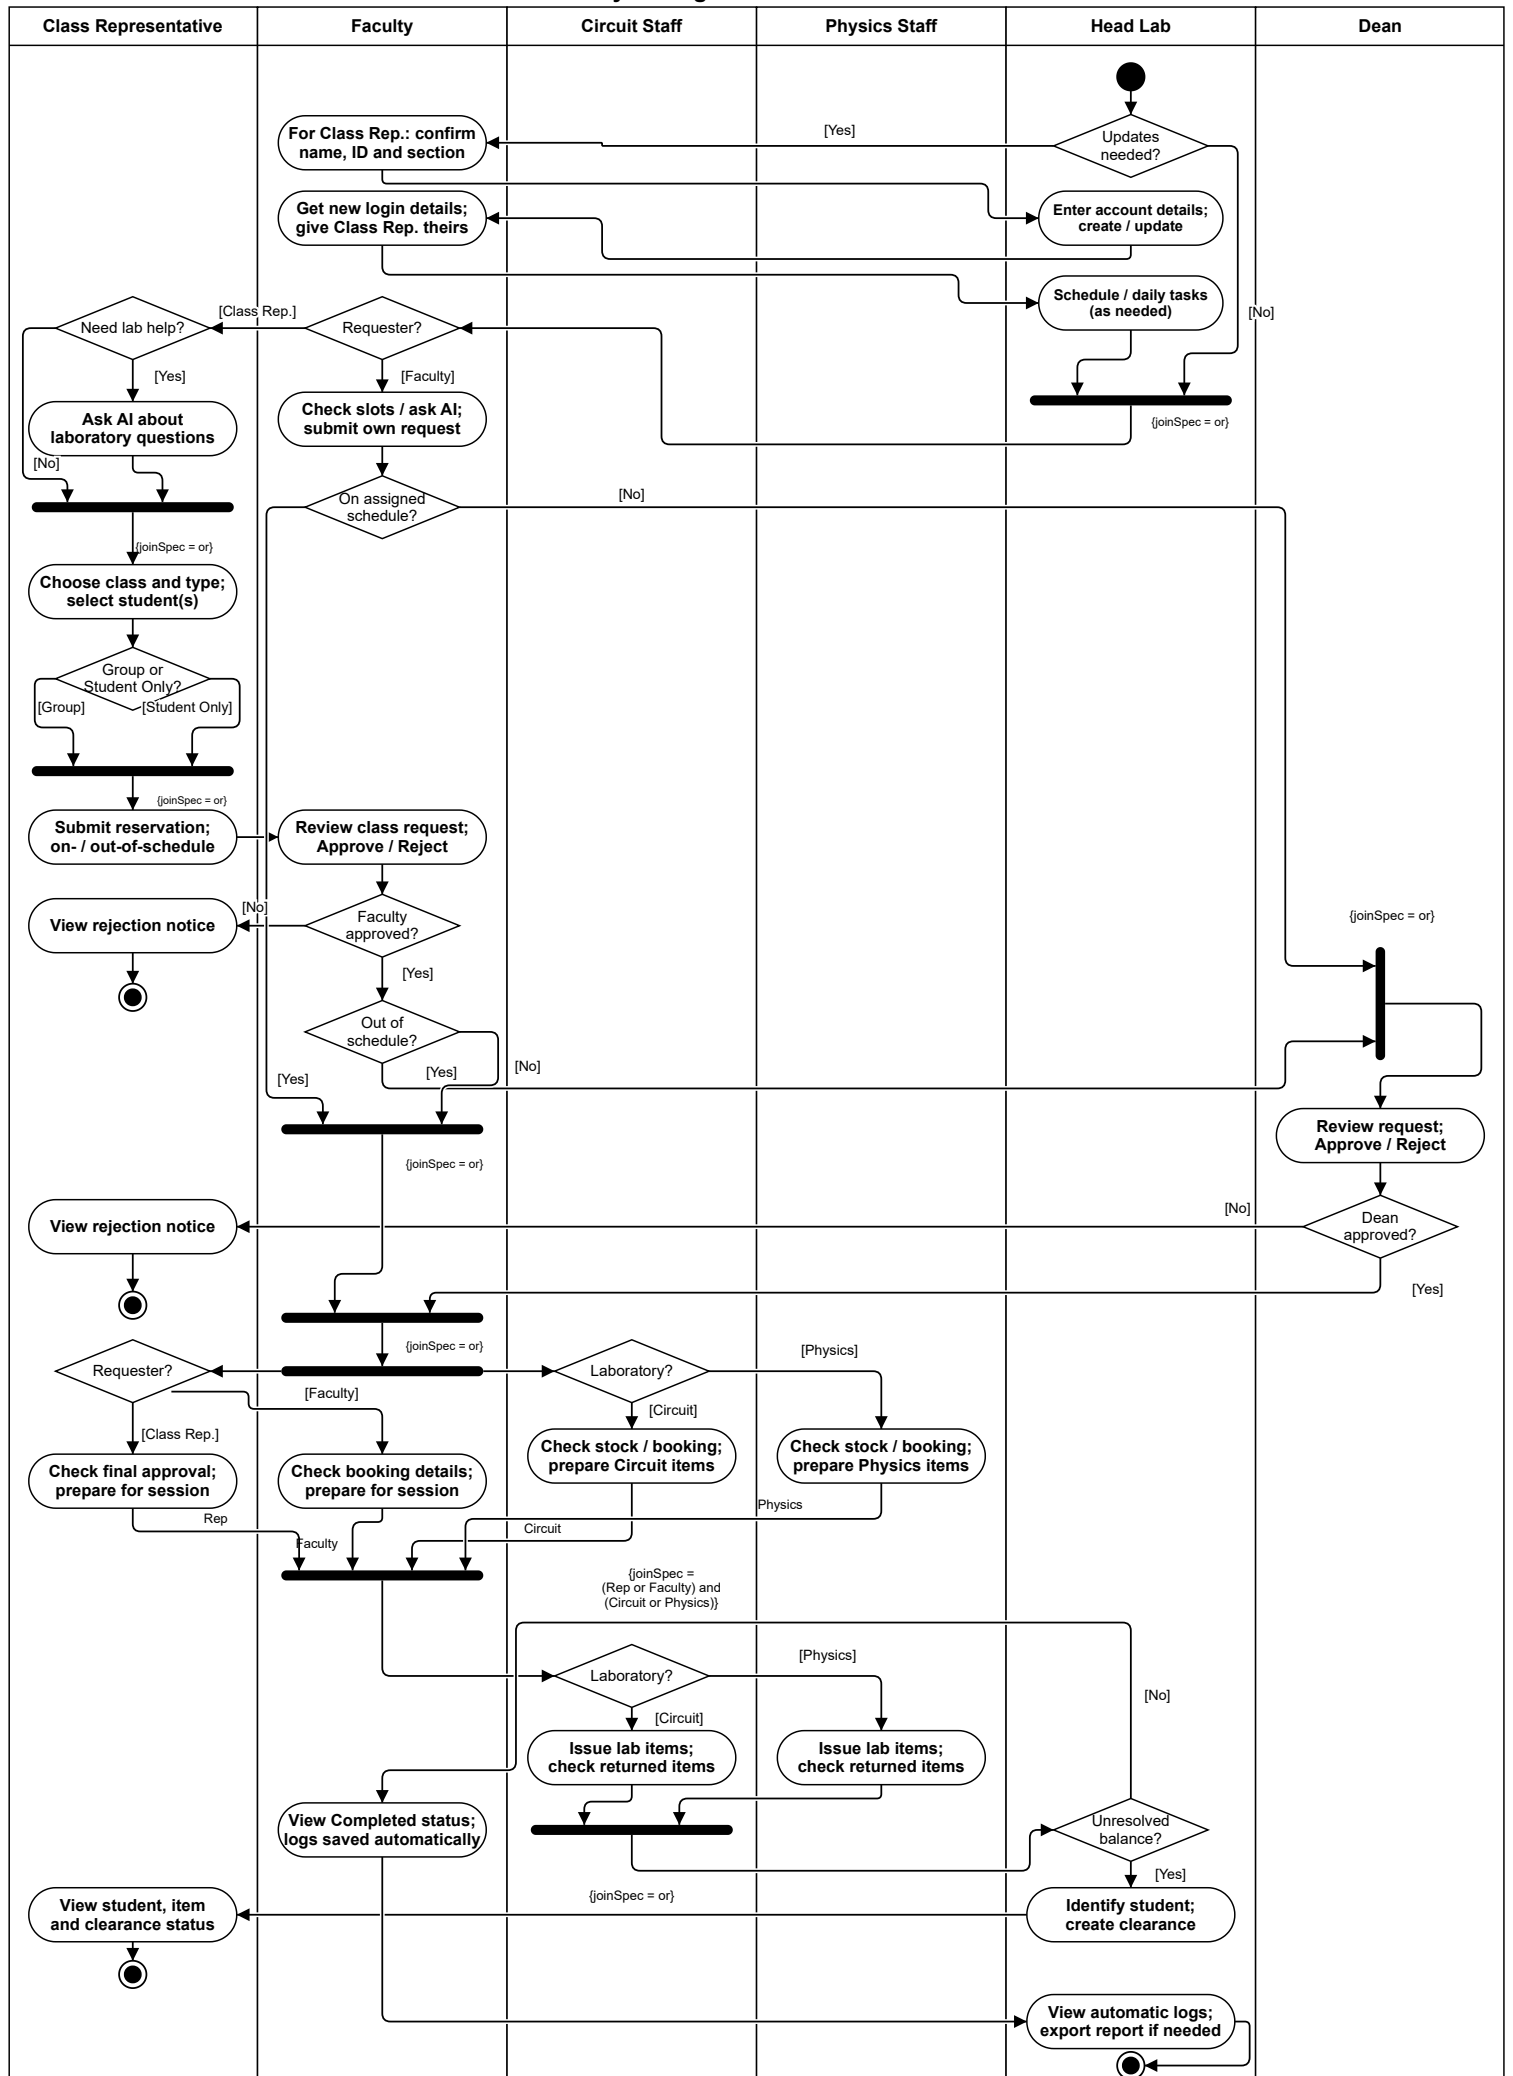


User Access & Accounts — Activity Diagram

Login: any role. Create / update Faculty or Class Rep. accounts: signed-in Head Laboratory only.

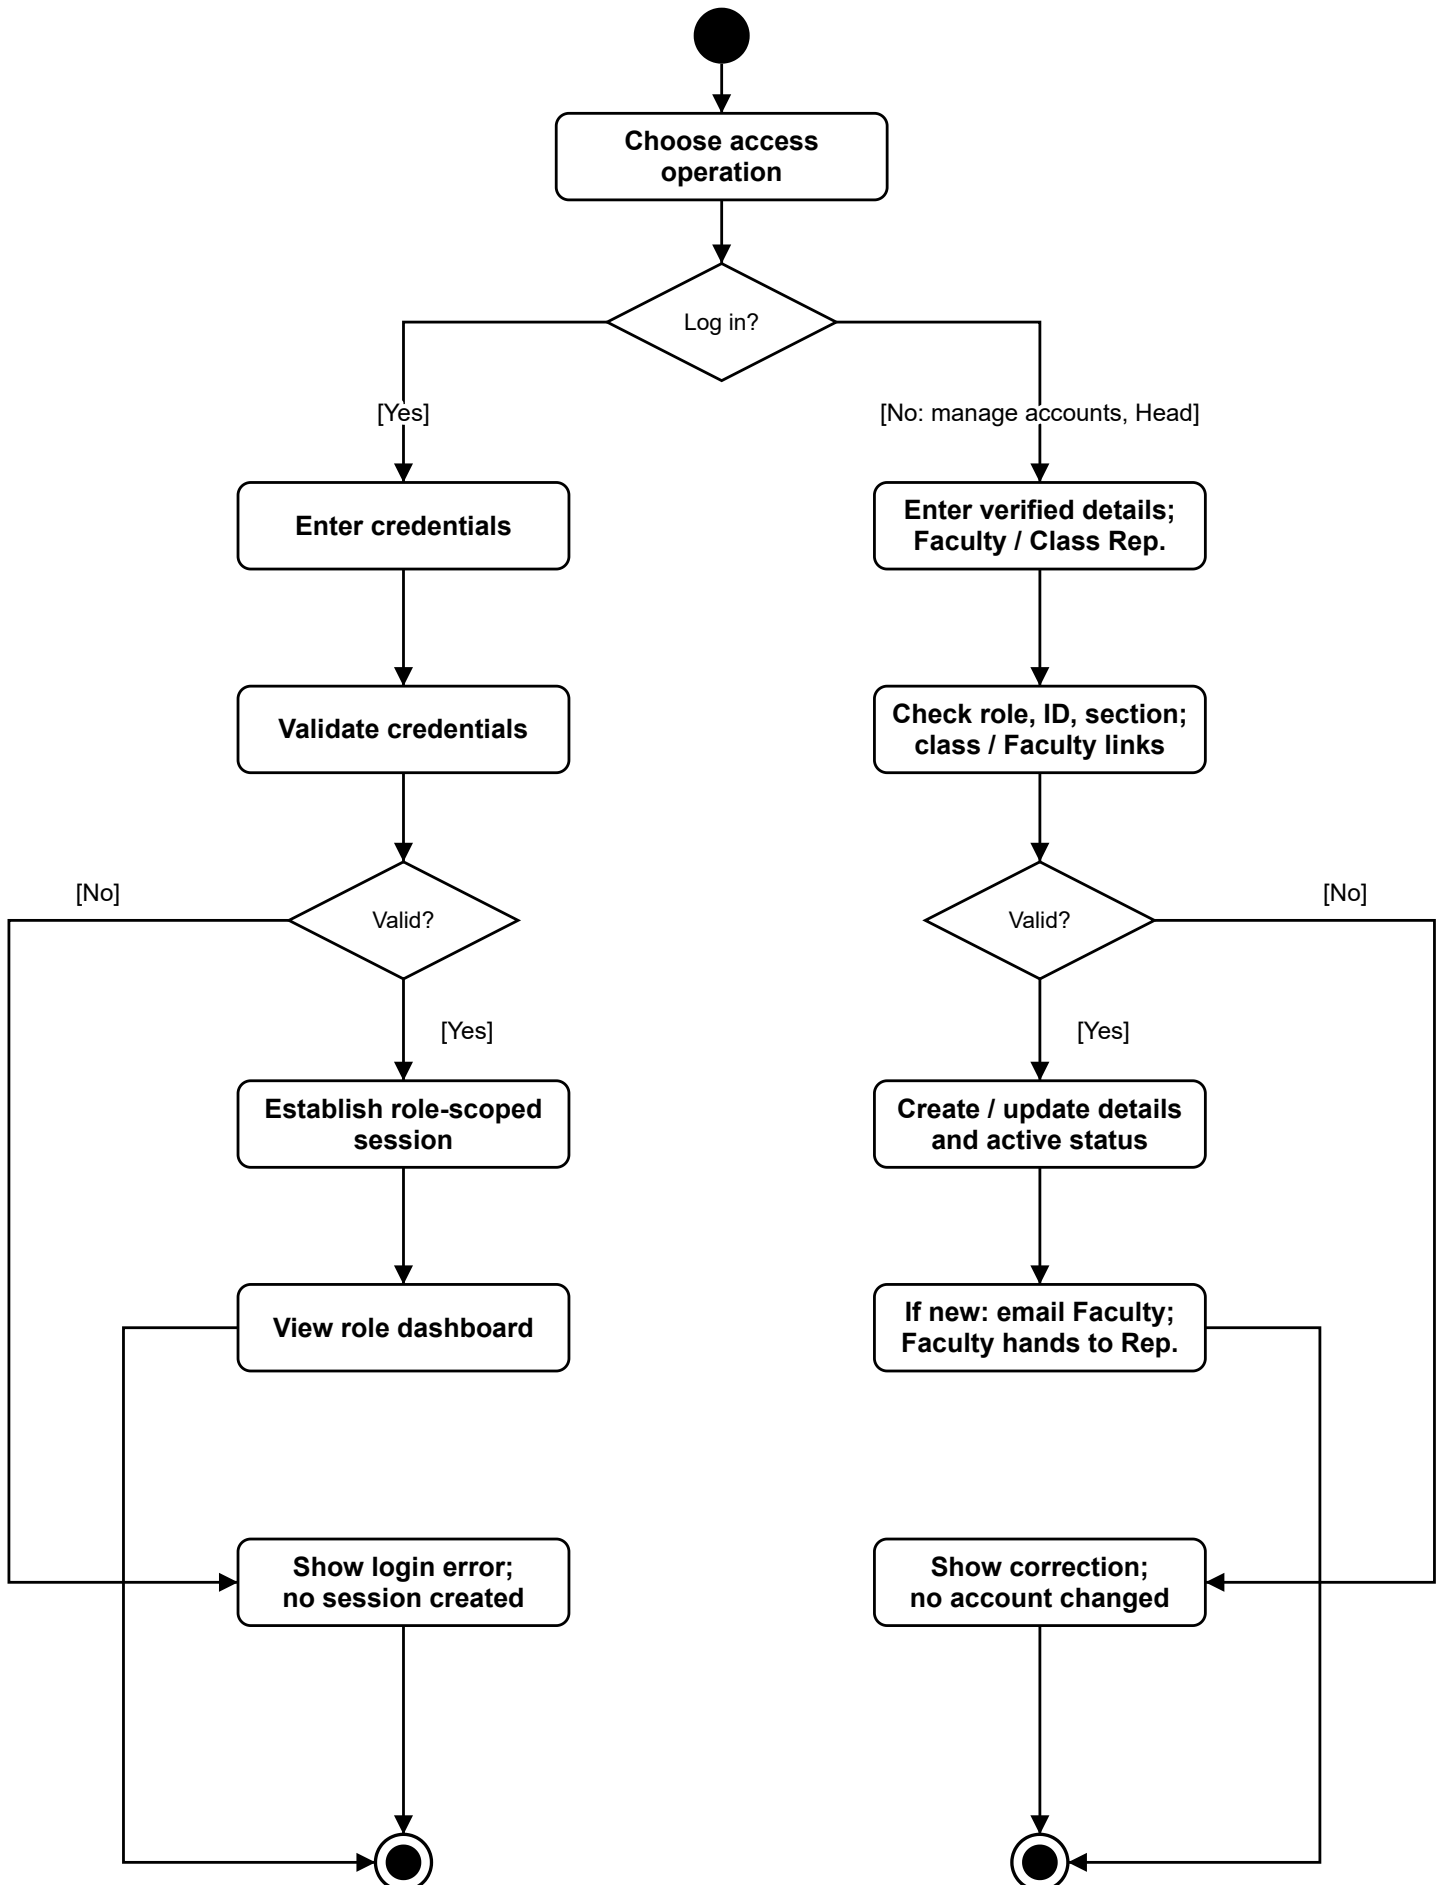


Reservations, Availability & Approvals — Activity Diagram

Class Rep.: choose Group or Student Only for BOTH schedule variants. Student Only = one selected class student.
On-schedule → Faculty; out-of-schedule → Faculty, then Dean. Faculty request rules remain unchanged.

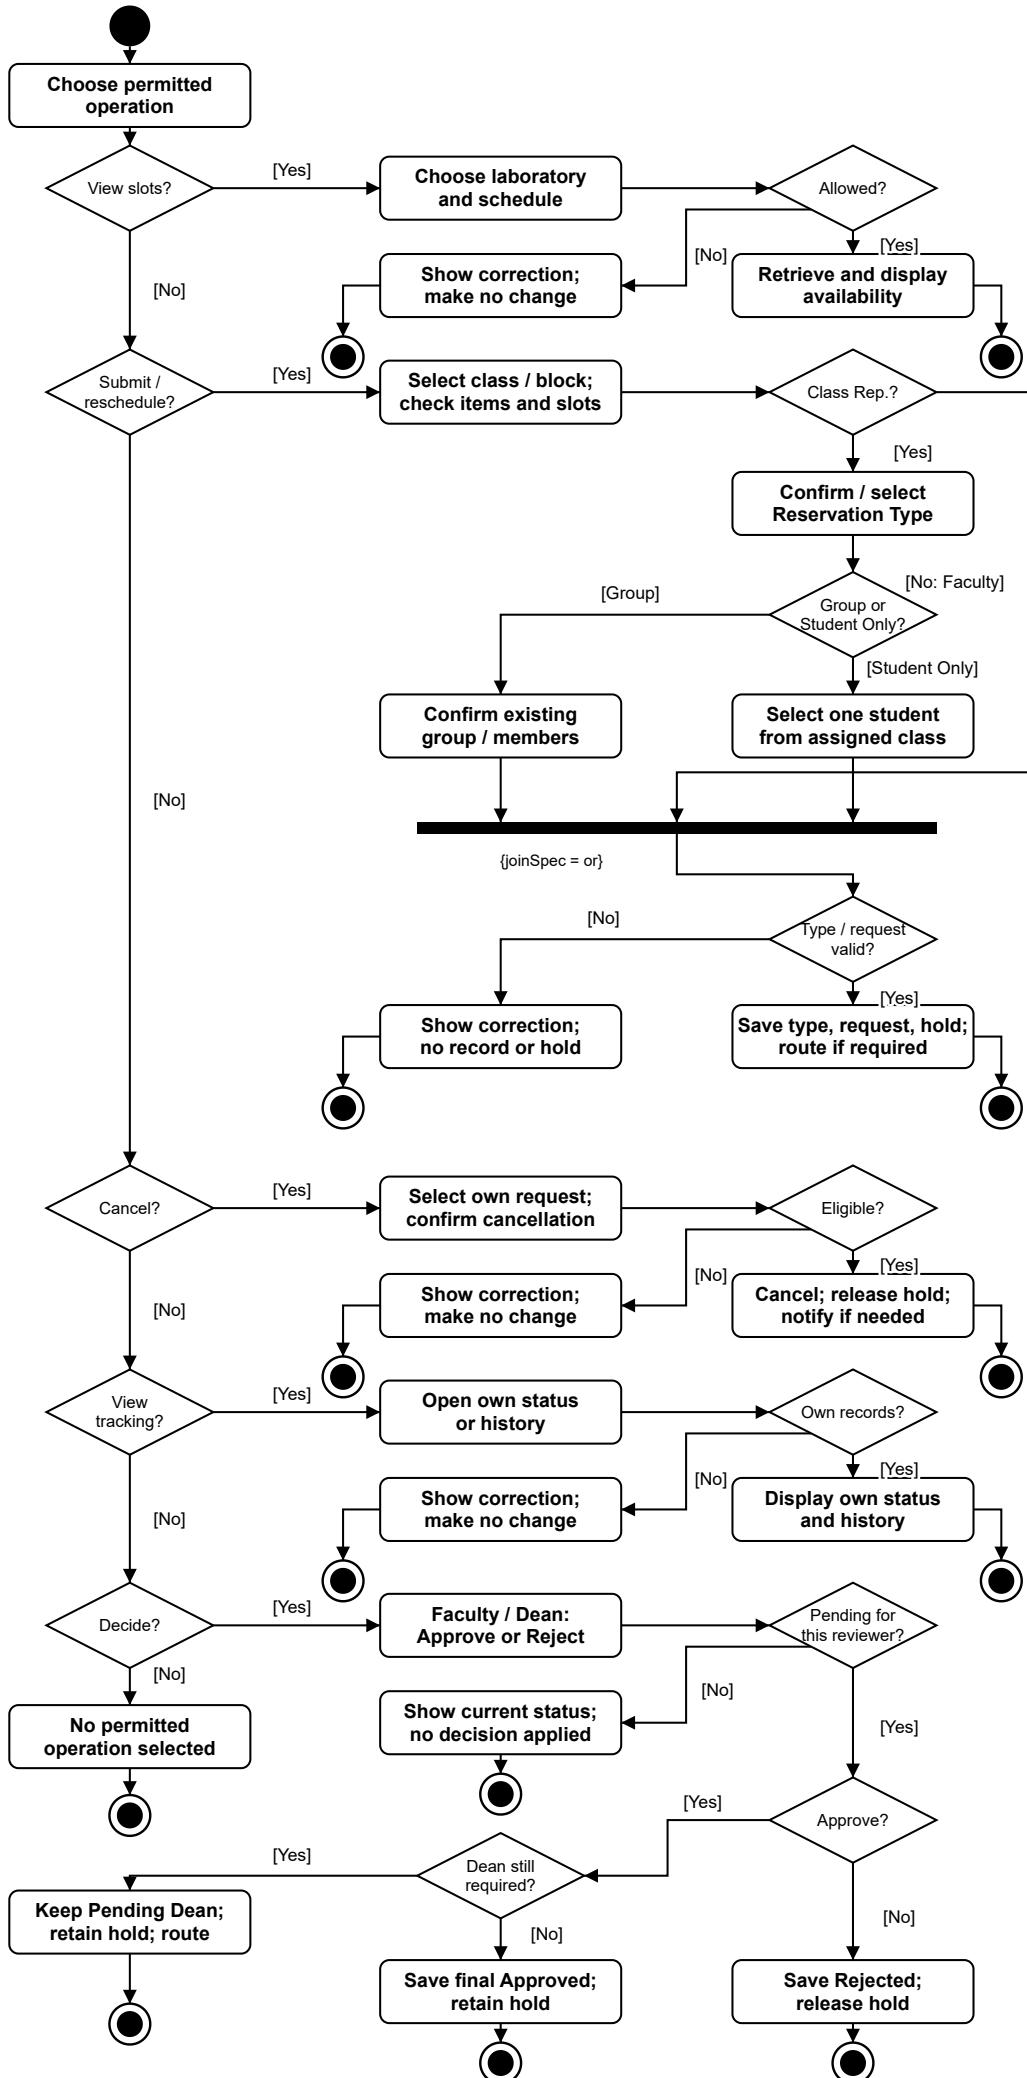


Laboratory Questions — Activity Diagram

Precondition: signed-in Class Representative or Faculty; informational Q&A only.

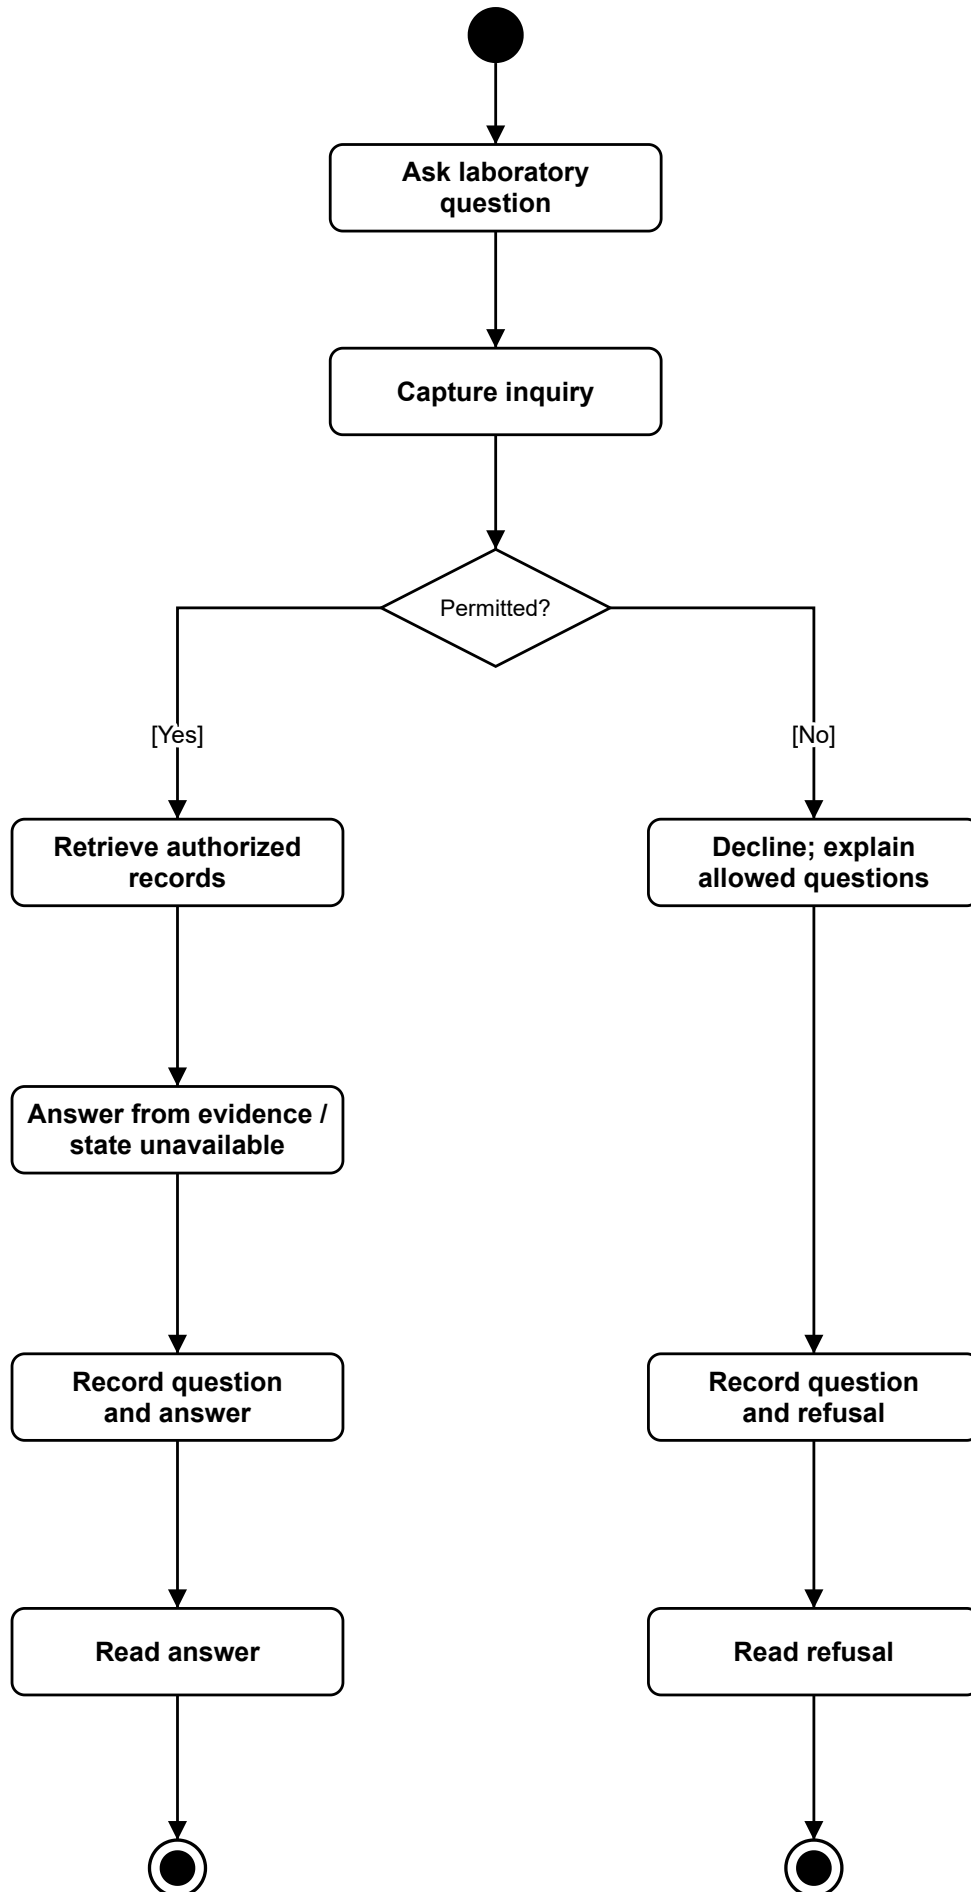


Equipment & Borrowing — Activity Diagram

Precondition: signed-in Head Laboratory or Staff within the assigned laboratory.

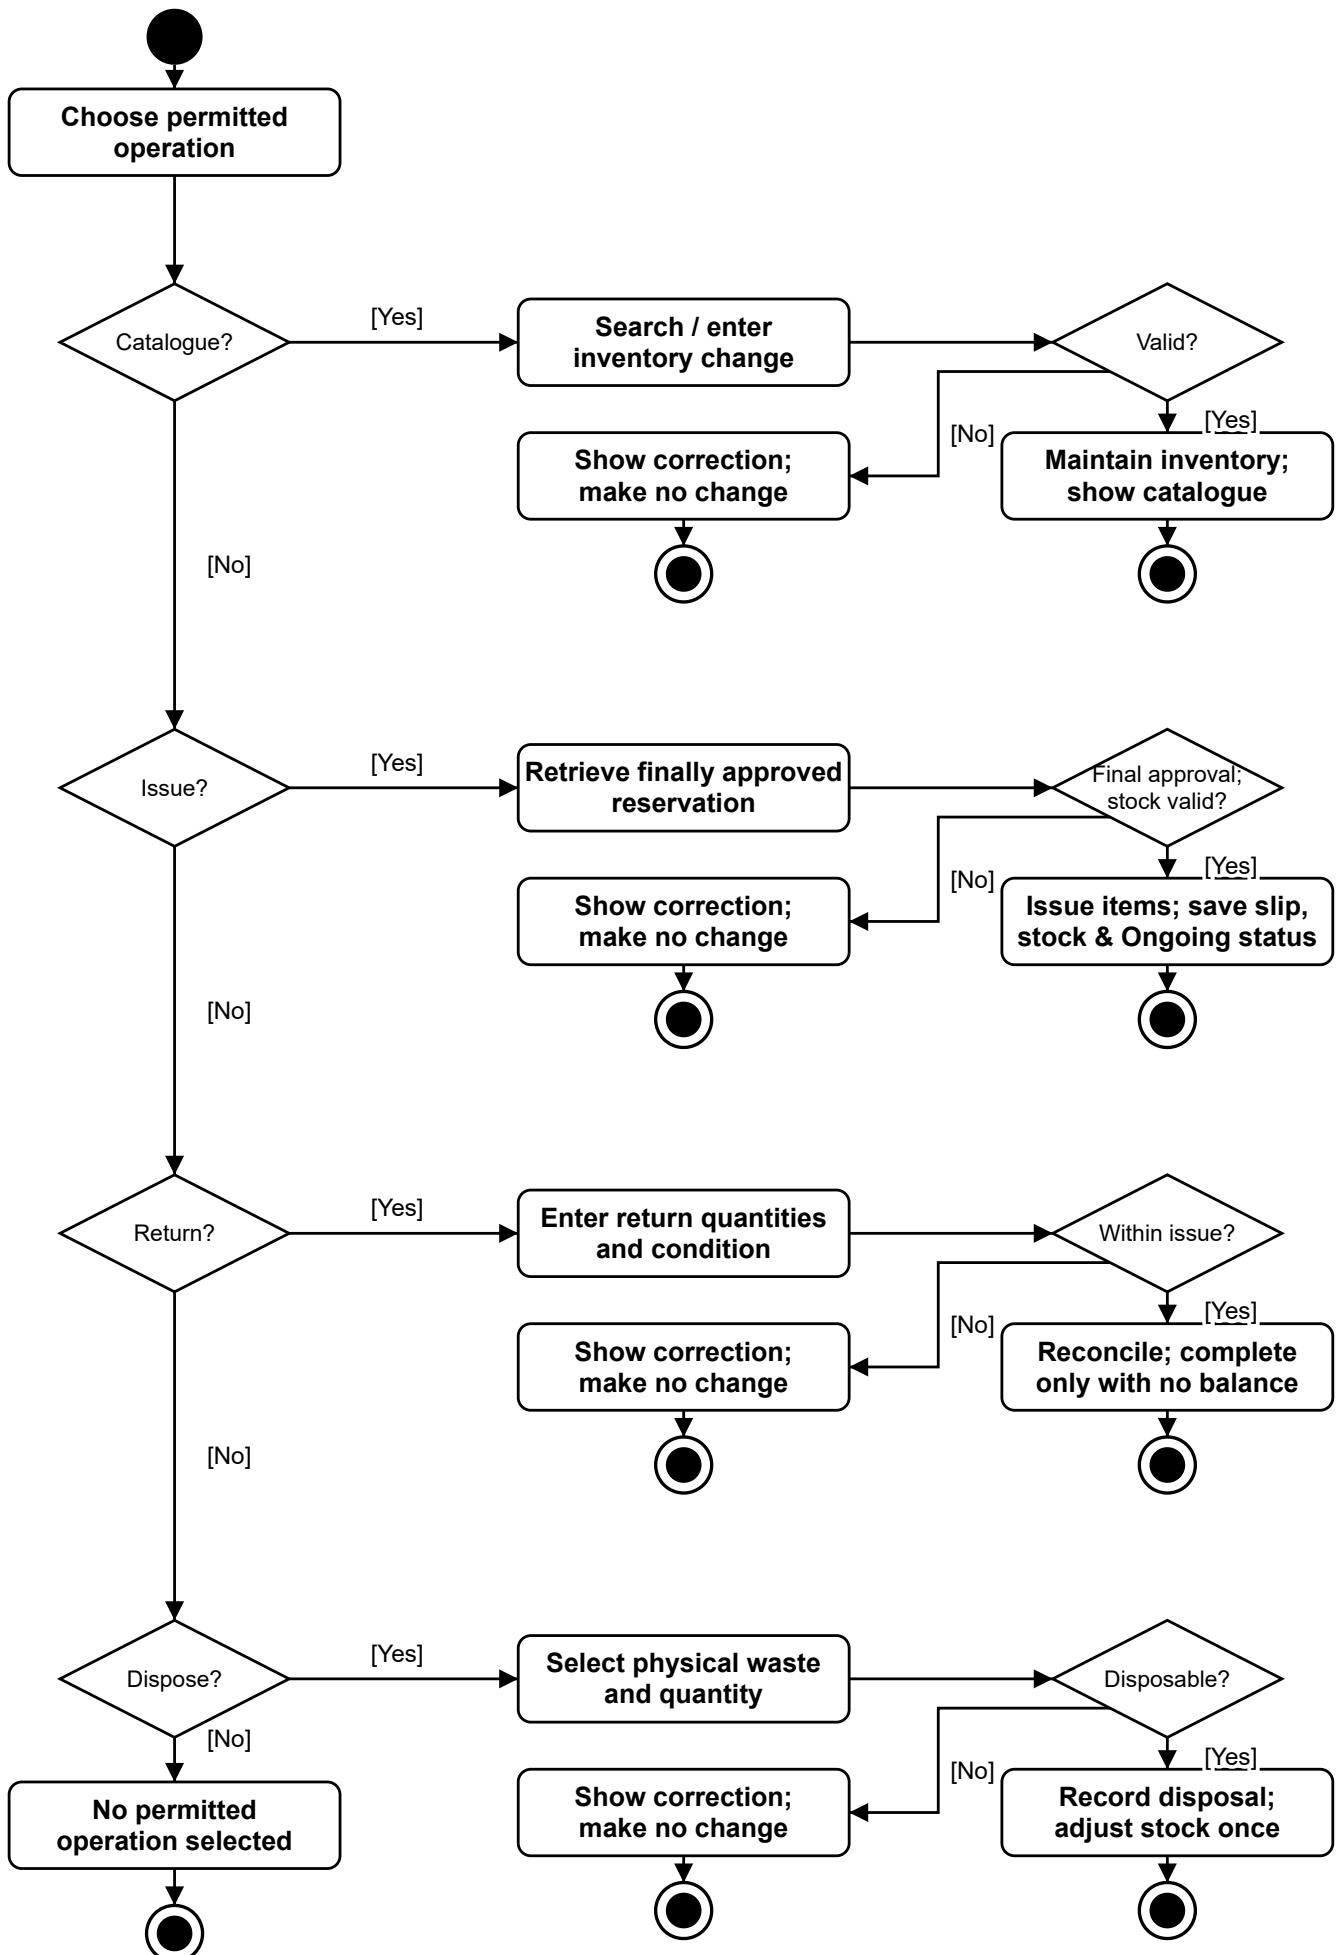


Laboratory Administration & Reporting — Activity Diagram

Precondition: signed-in Head Laboratory; Class Representative: assigned-class student clearance only.

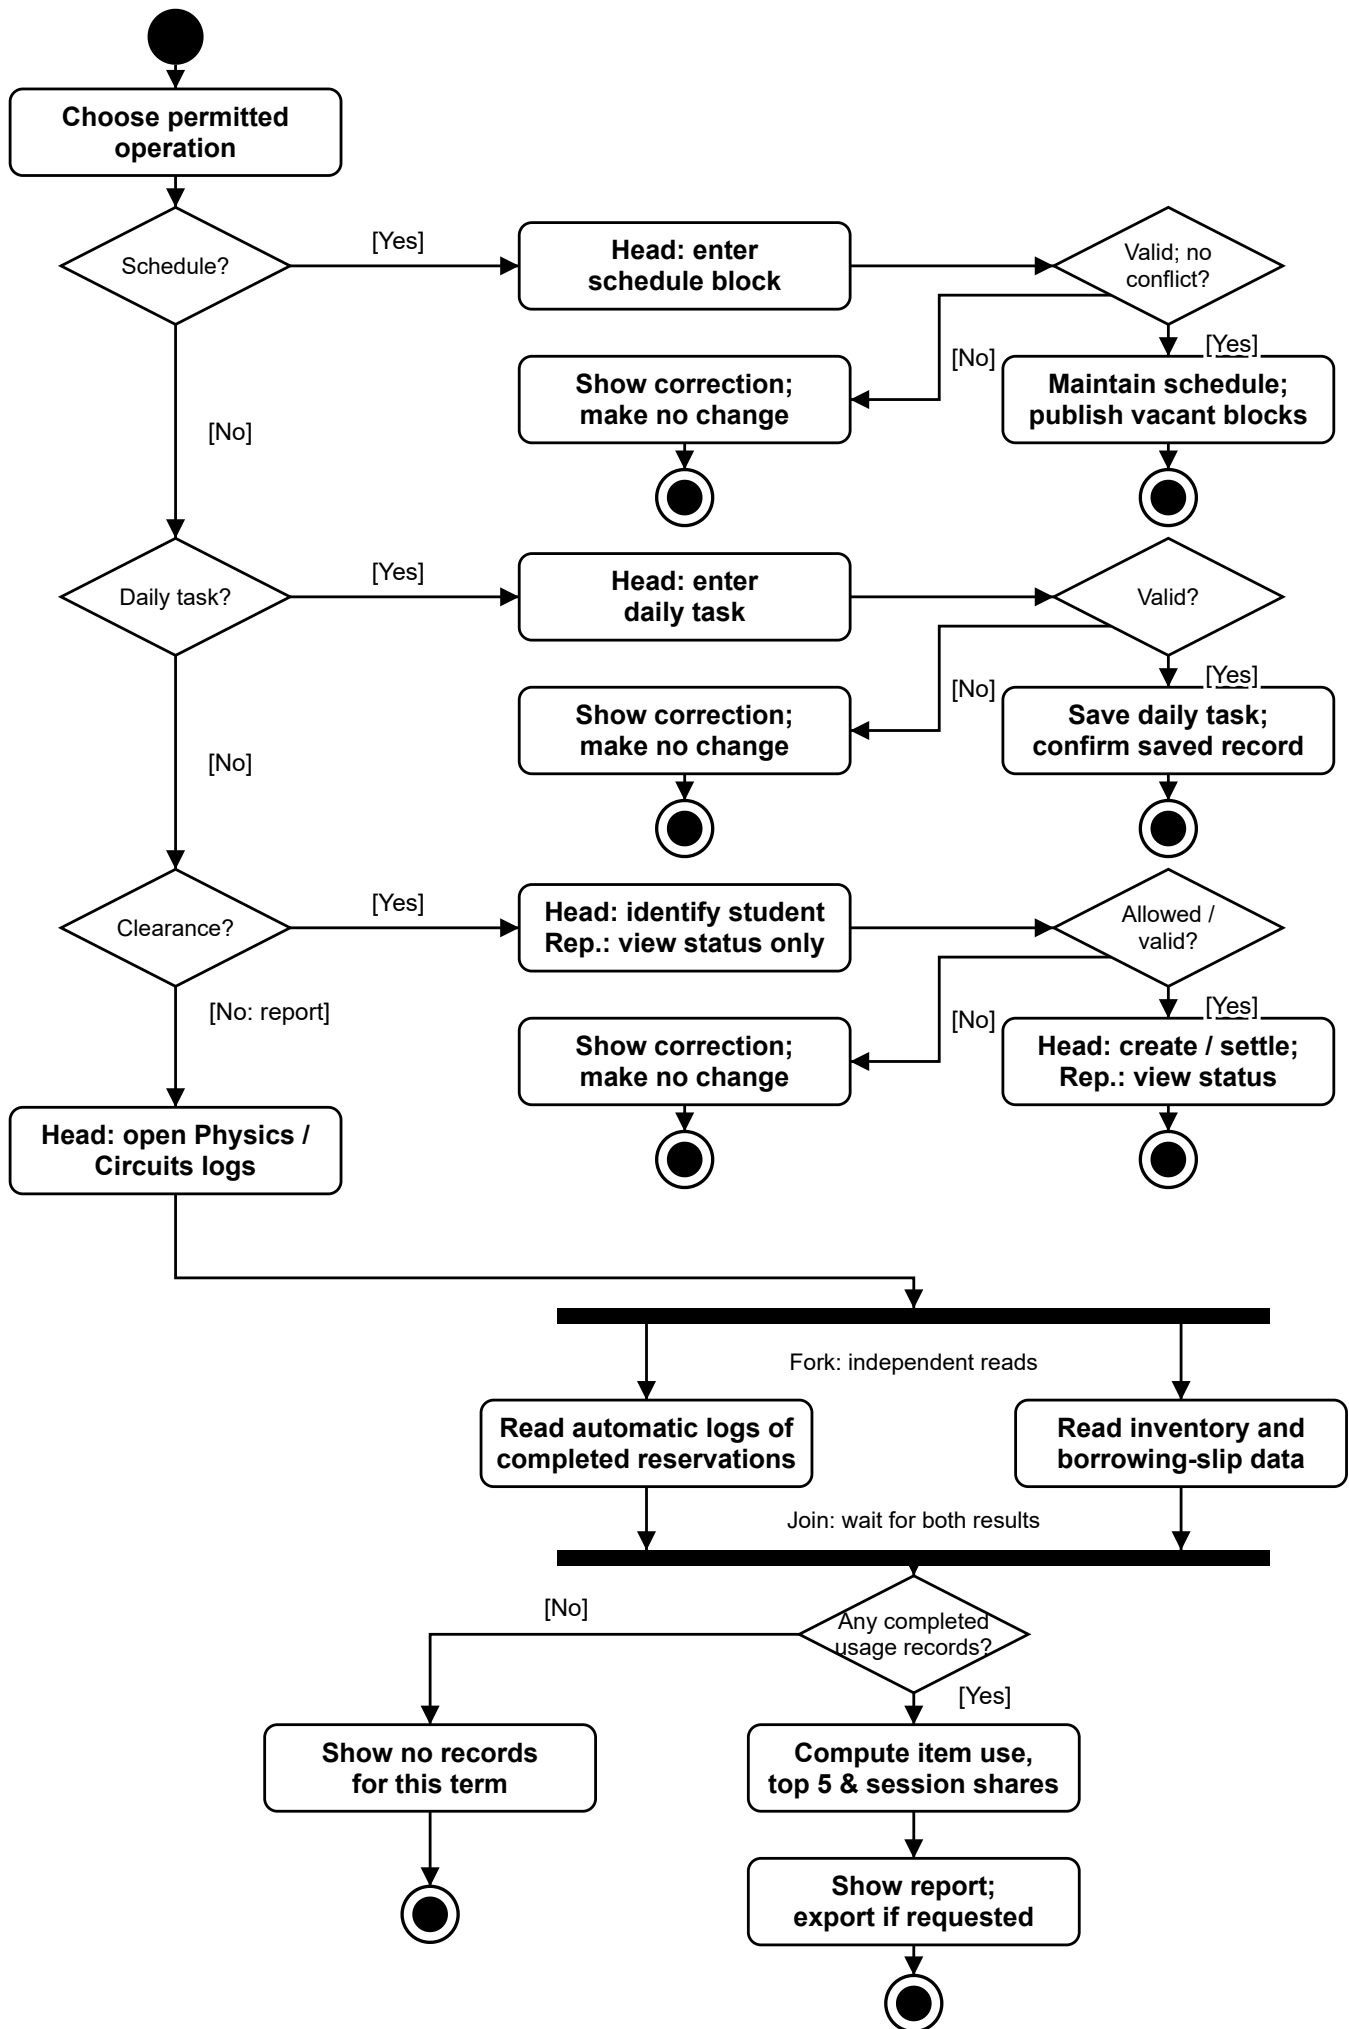


SEQ-01 · User Access and Account Management

Login uses an issued account. Head creates Faculty first; Faculty manually verifies Class Rep. name, Student ID and section.

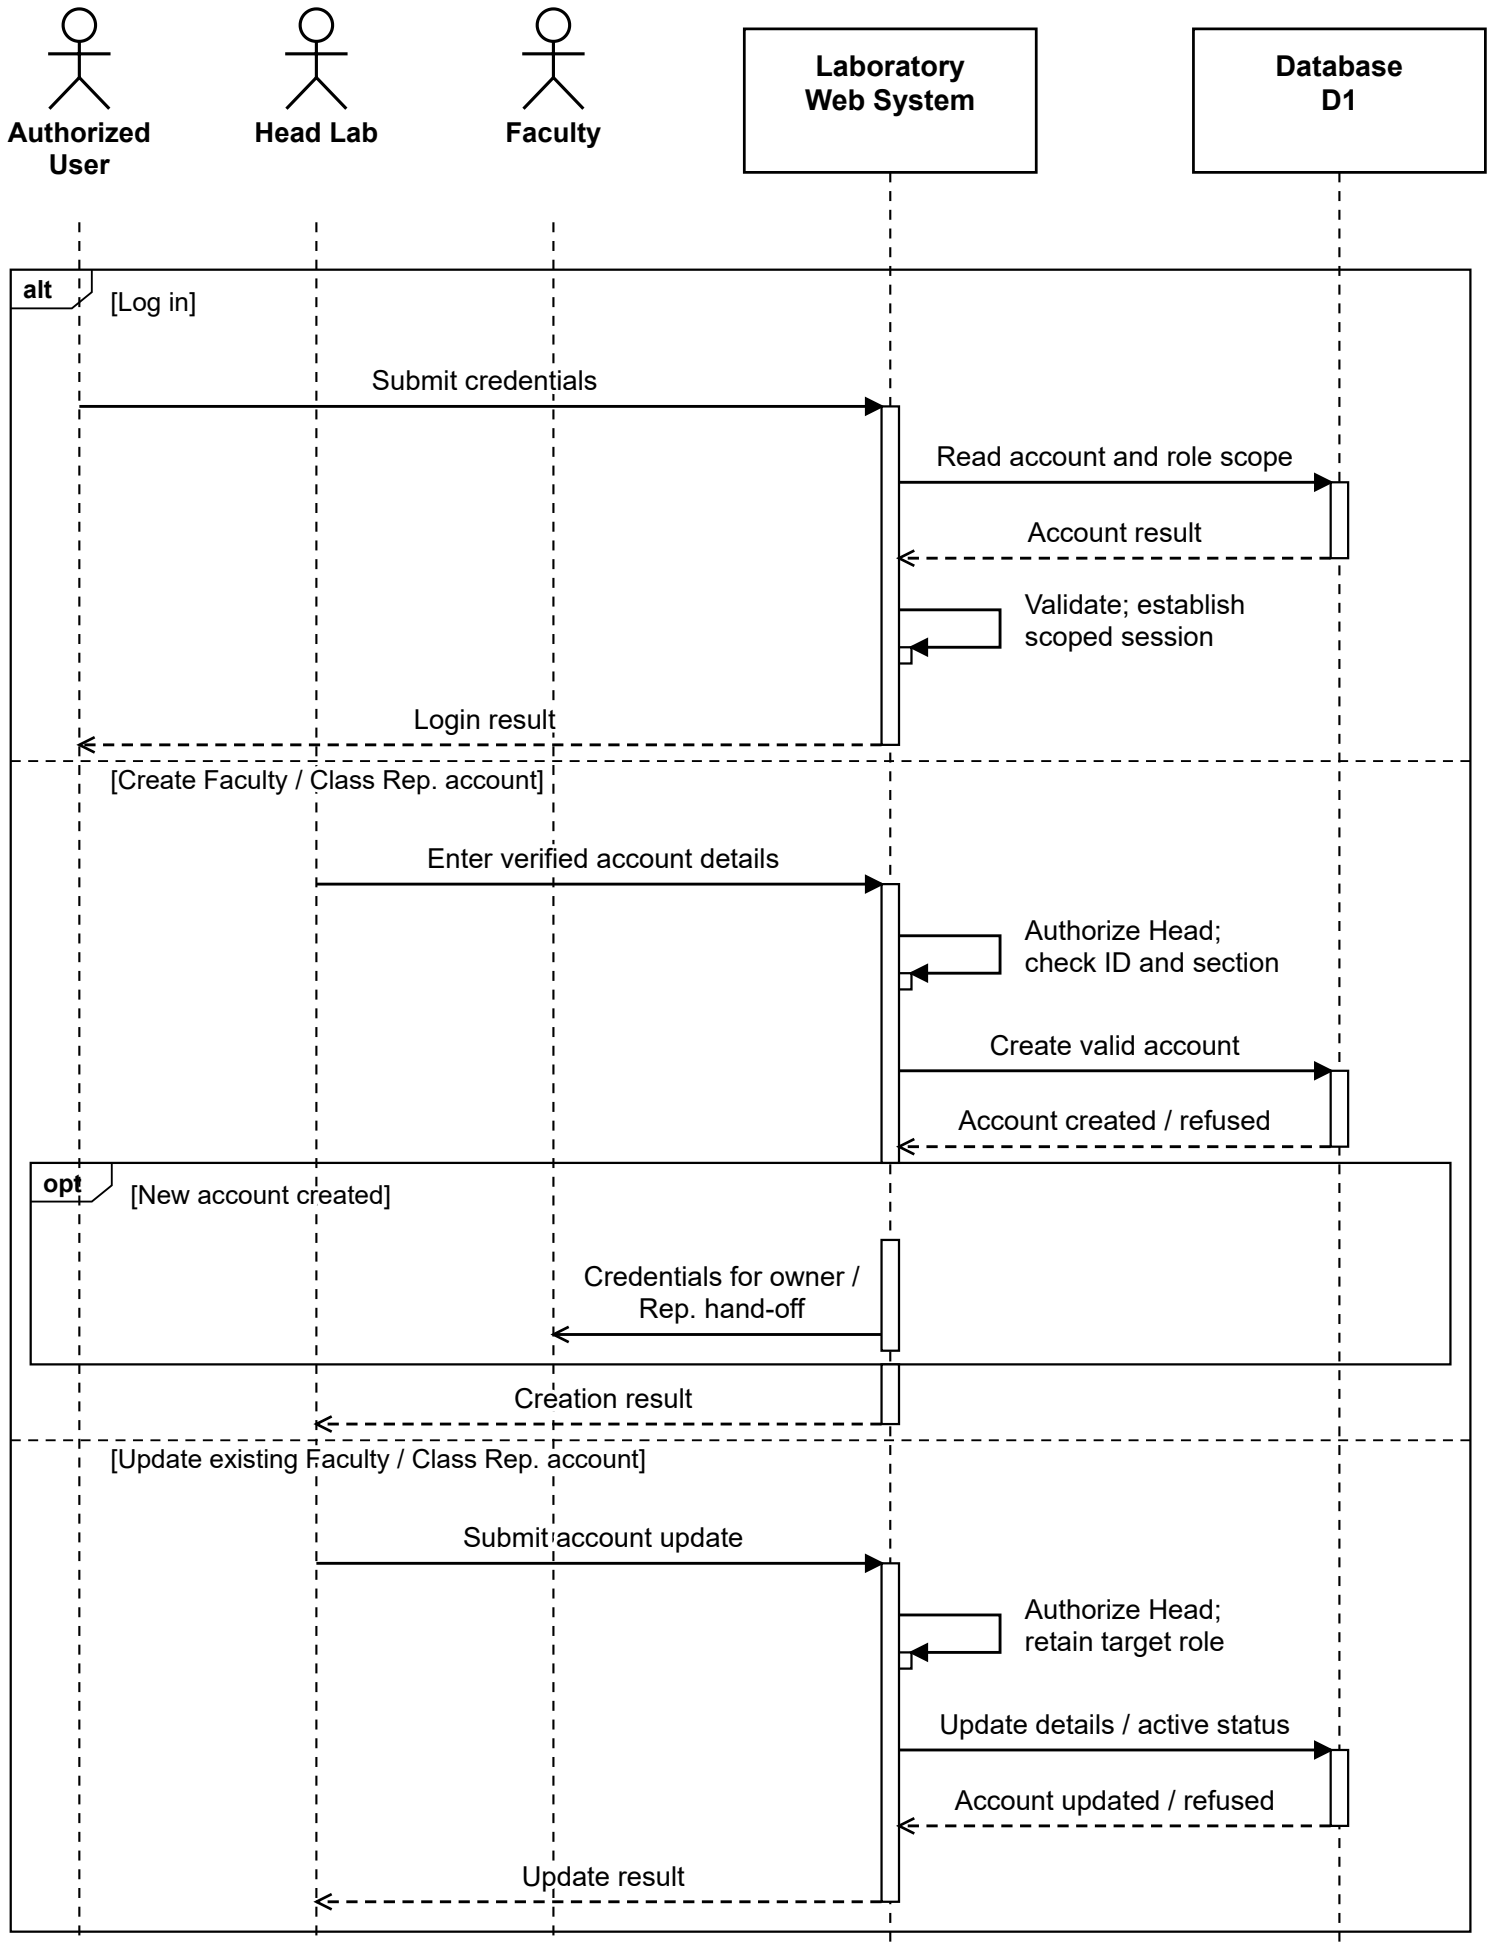


SEQ-02 · Reservations, Availability and Approvals

Class Rep.: Group = selected class members; Student Only = one selected class student.
Choice required for both schedule variants; Faculty requests do not require this choice.

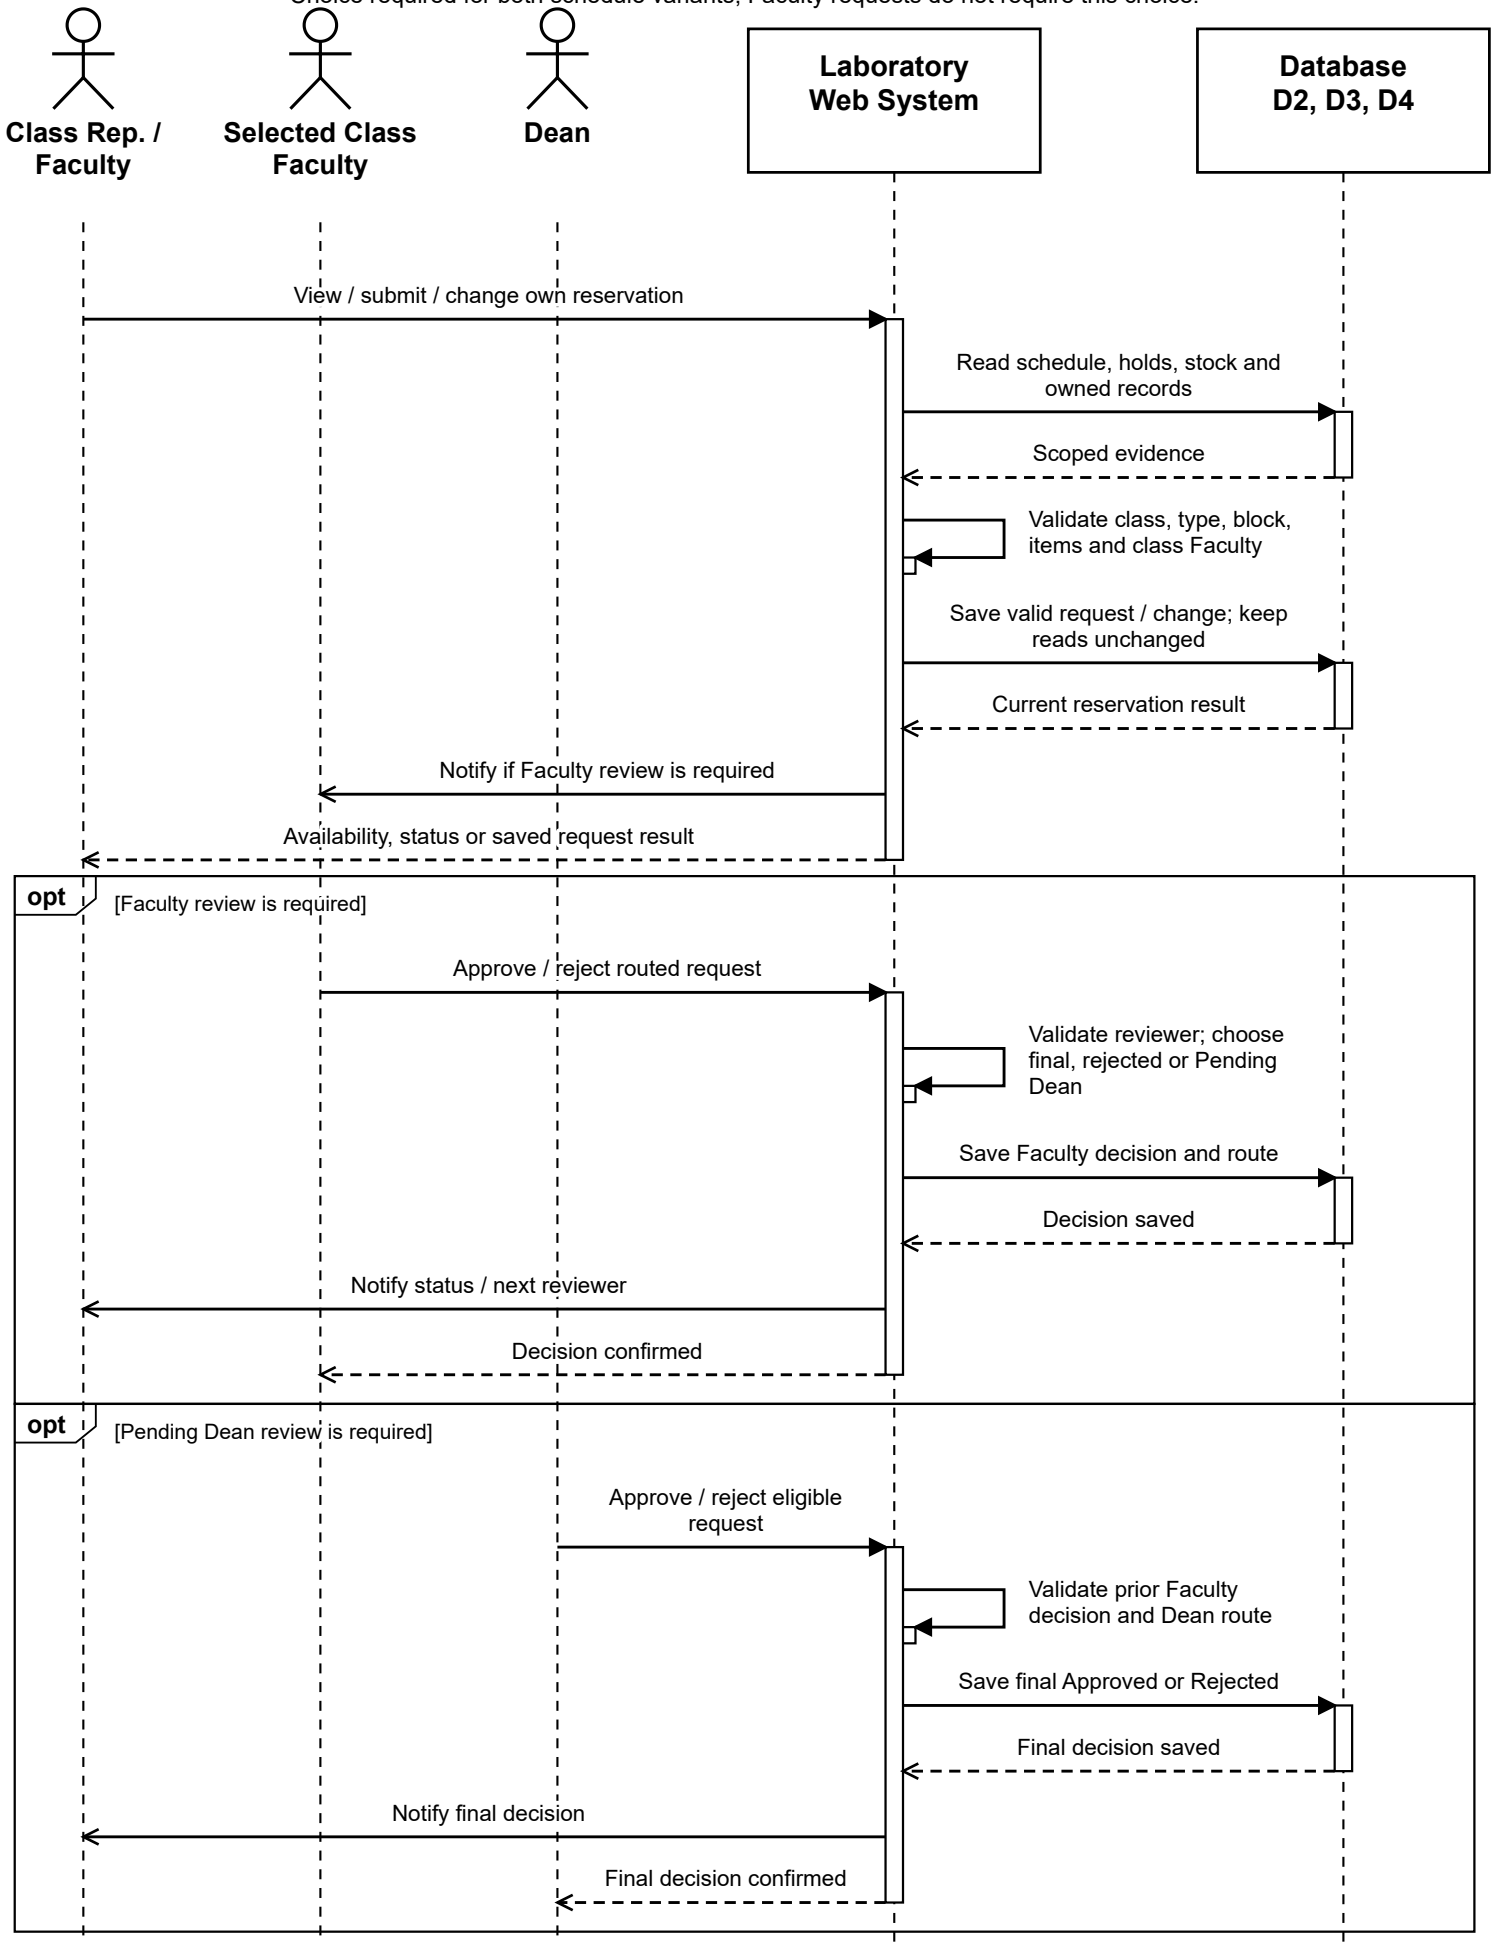


SEQ-03 · Laboratory Questions

Signed in Class Representative or Faculty; Q&A is informational and scope-limited.

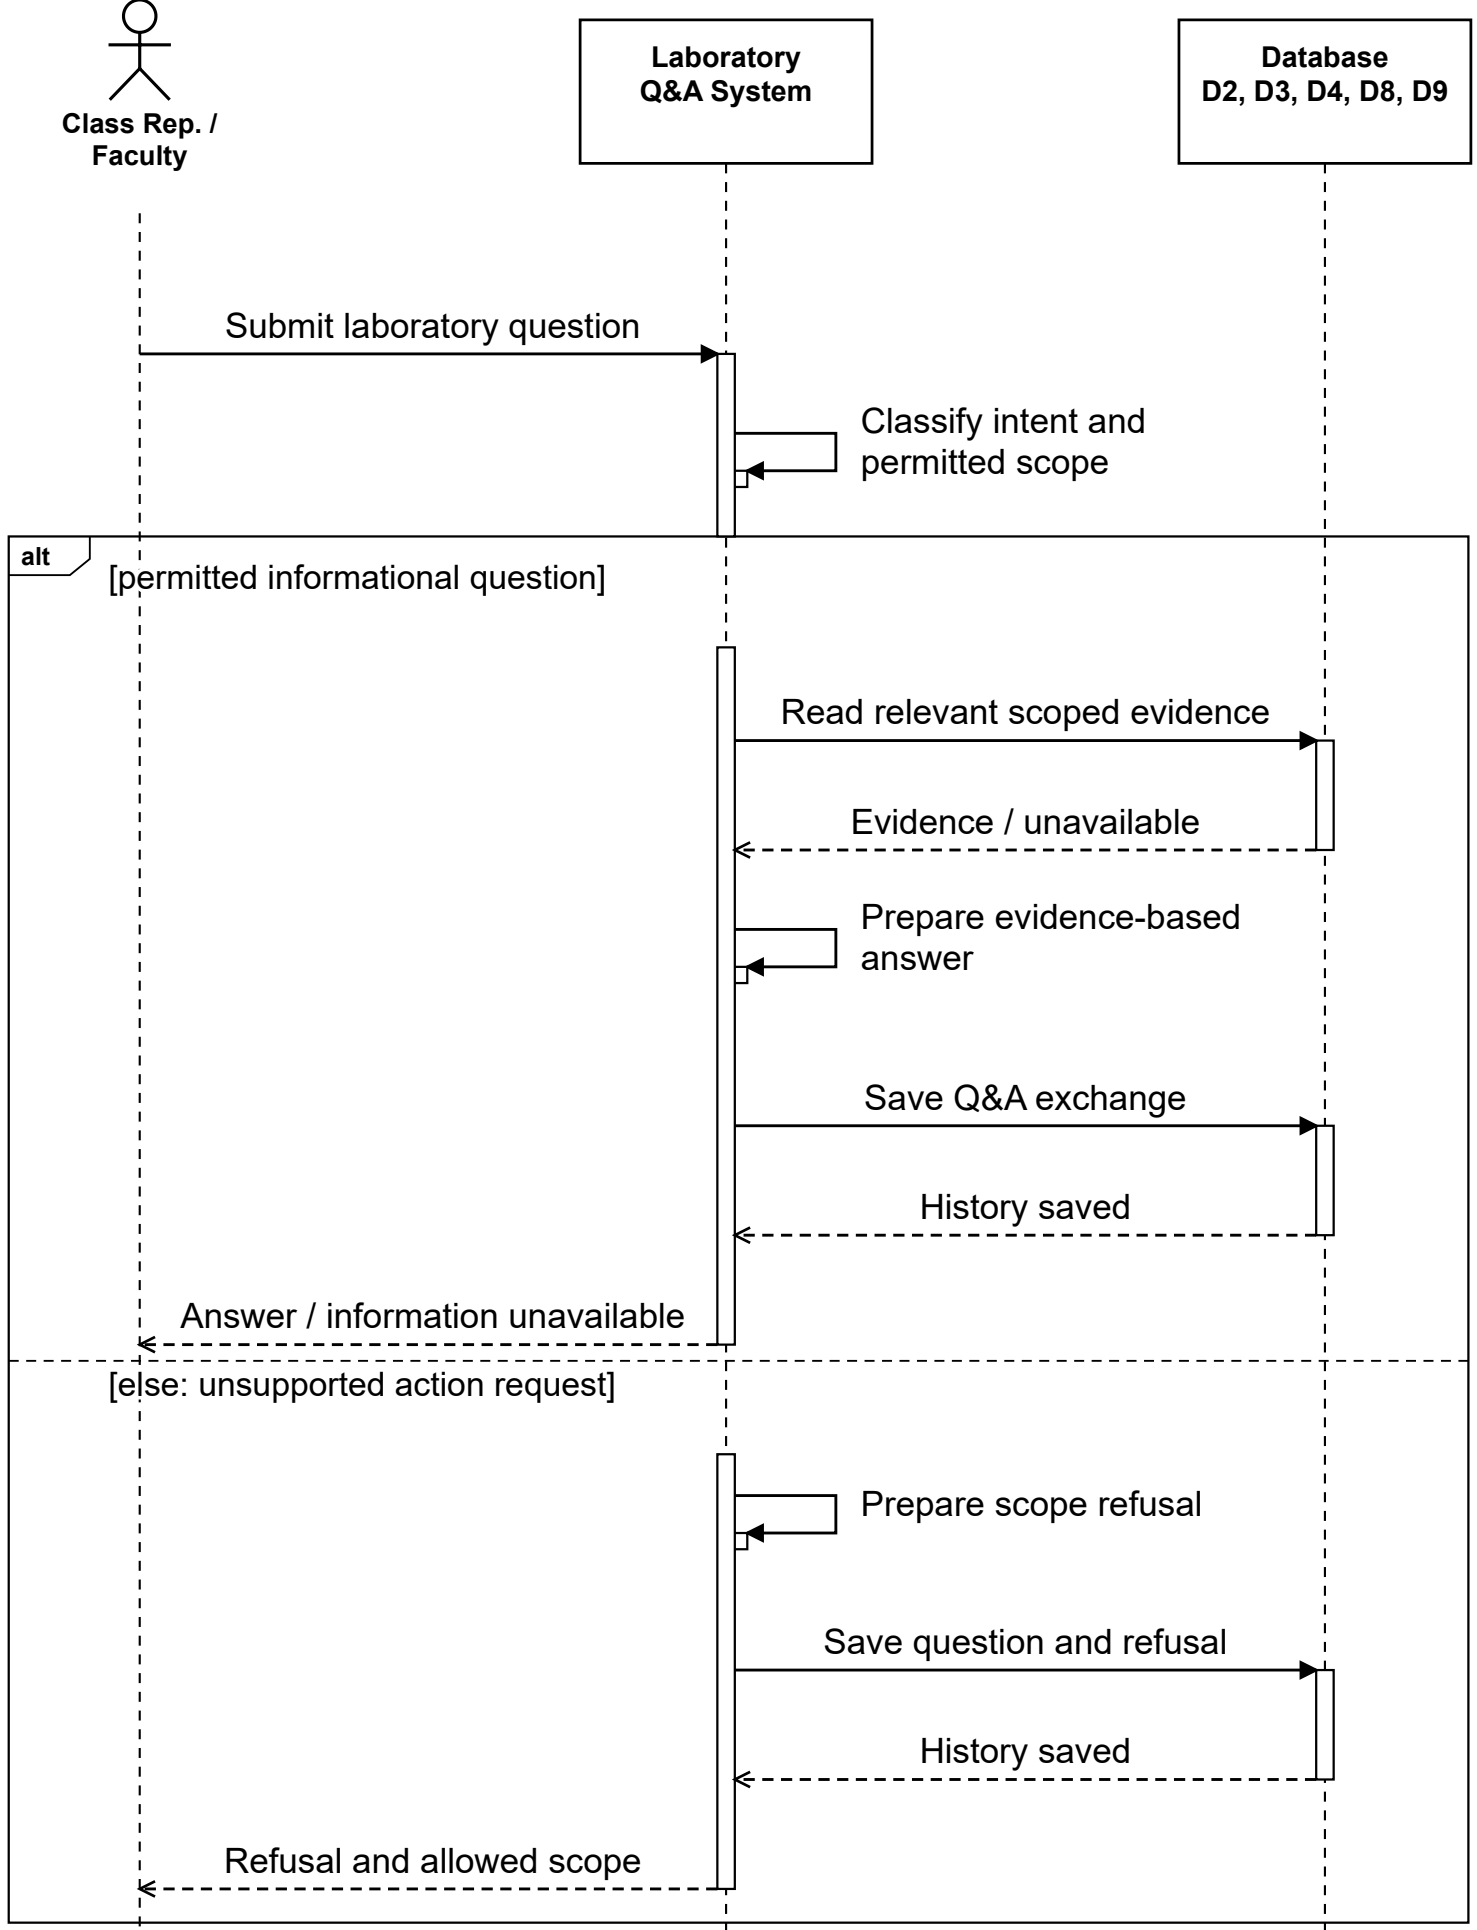


SEQ-04 · Equipment and Borrowing Management

Signed in Head Laboratory or assigned laboratory Staff; laboratory scope is enforced.

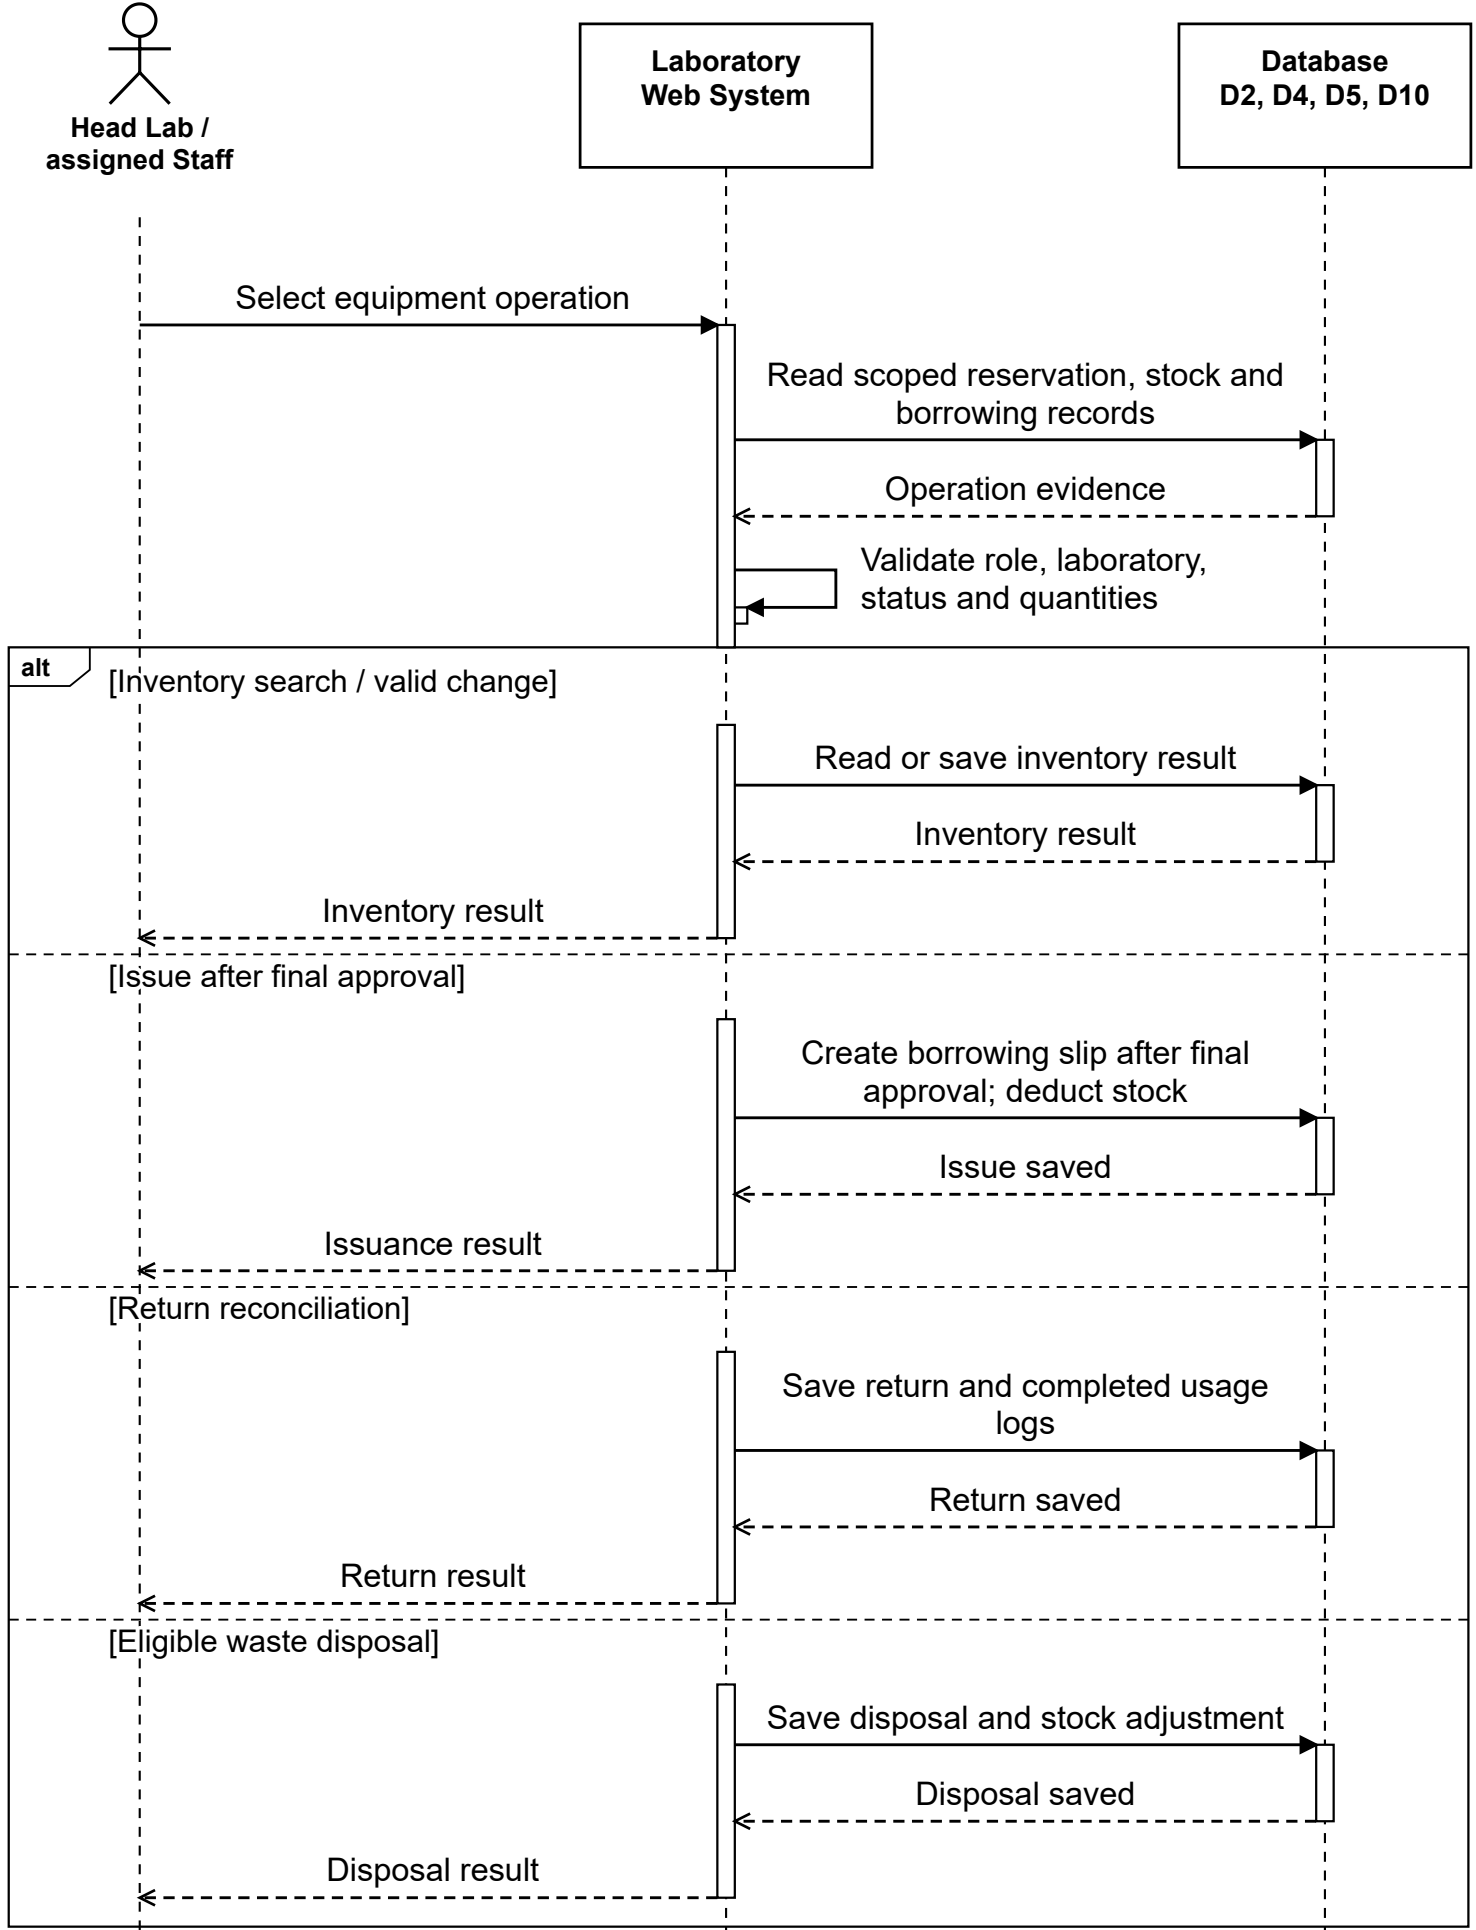


SEQ-05 · Laboratory Administration and Reporting

Head identifies the responsible student before creating clearance. Class Rep only views own-class clearance status.

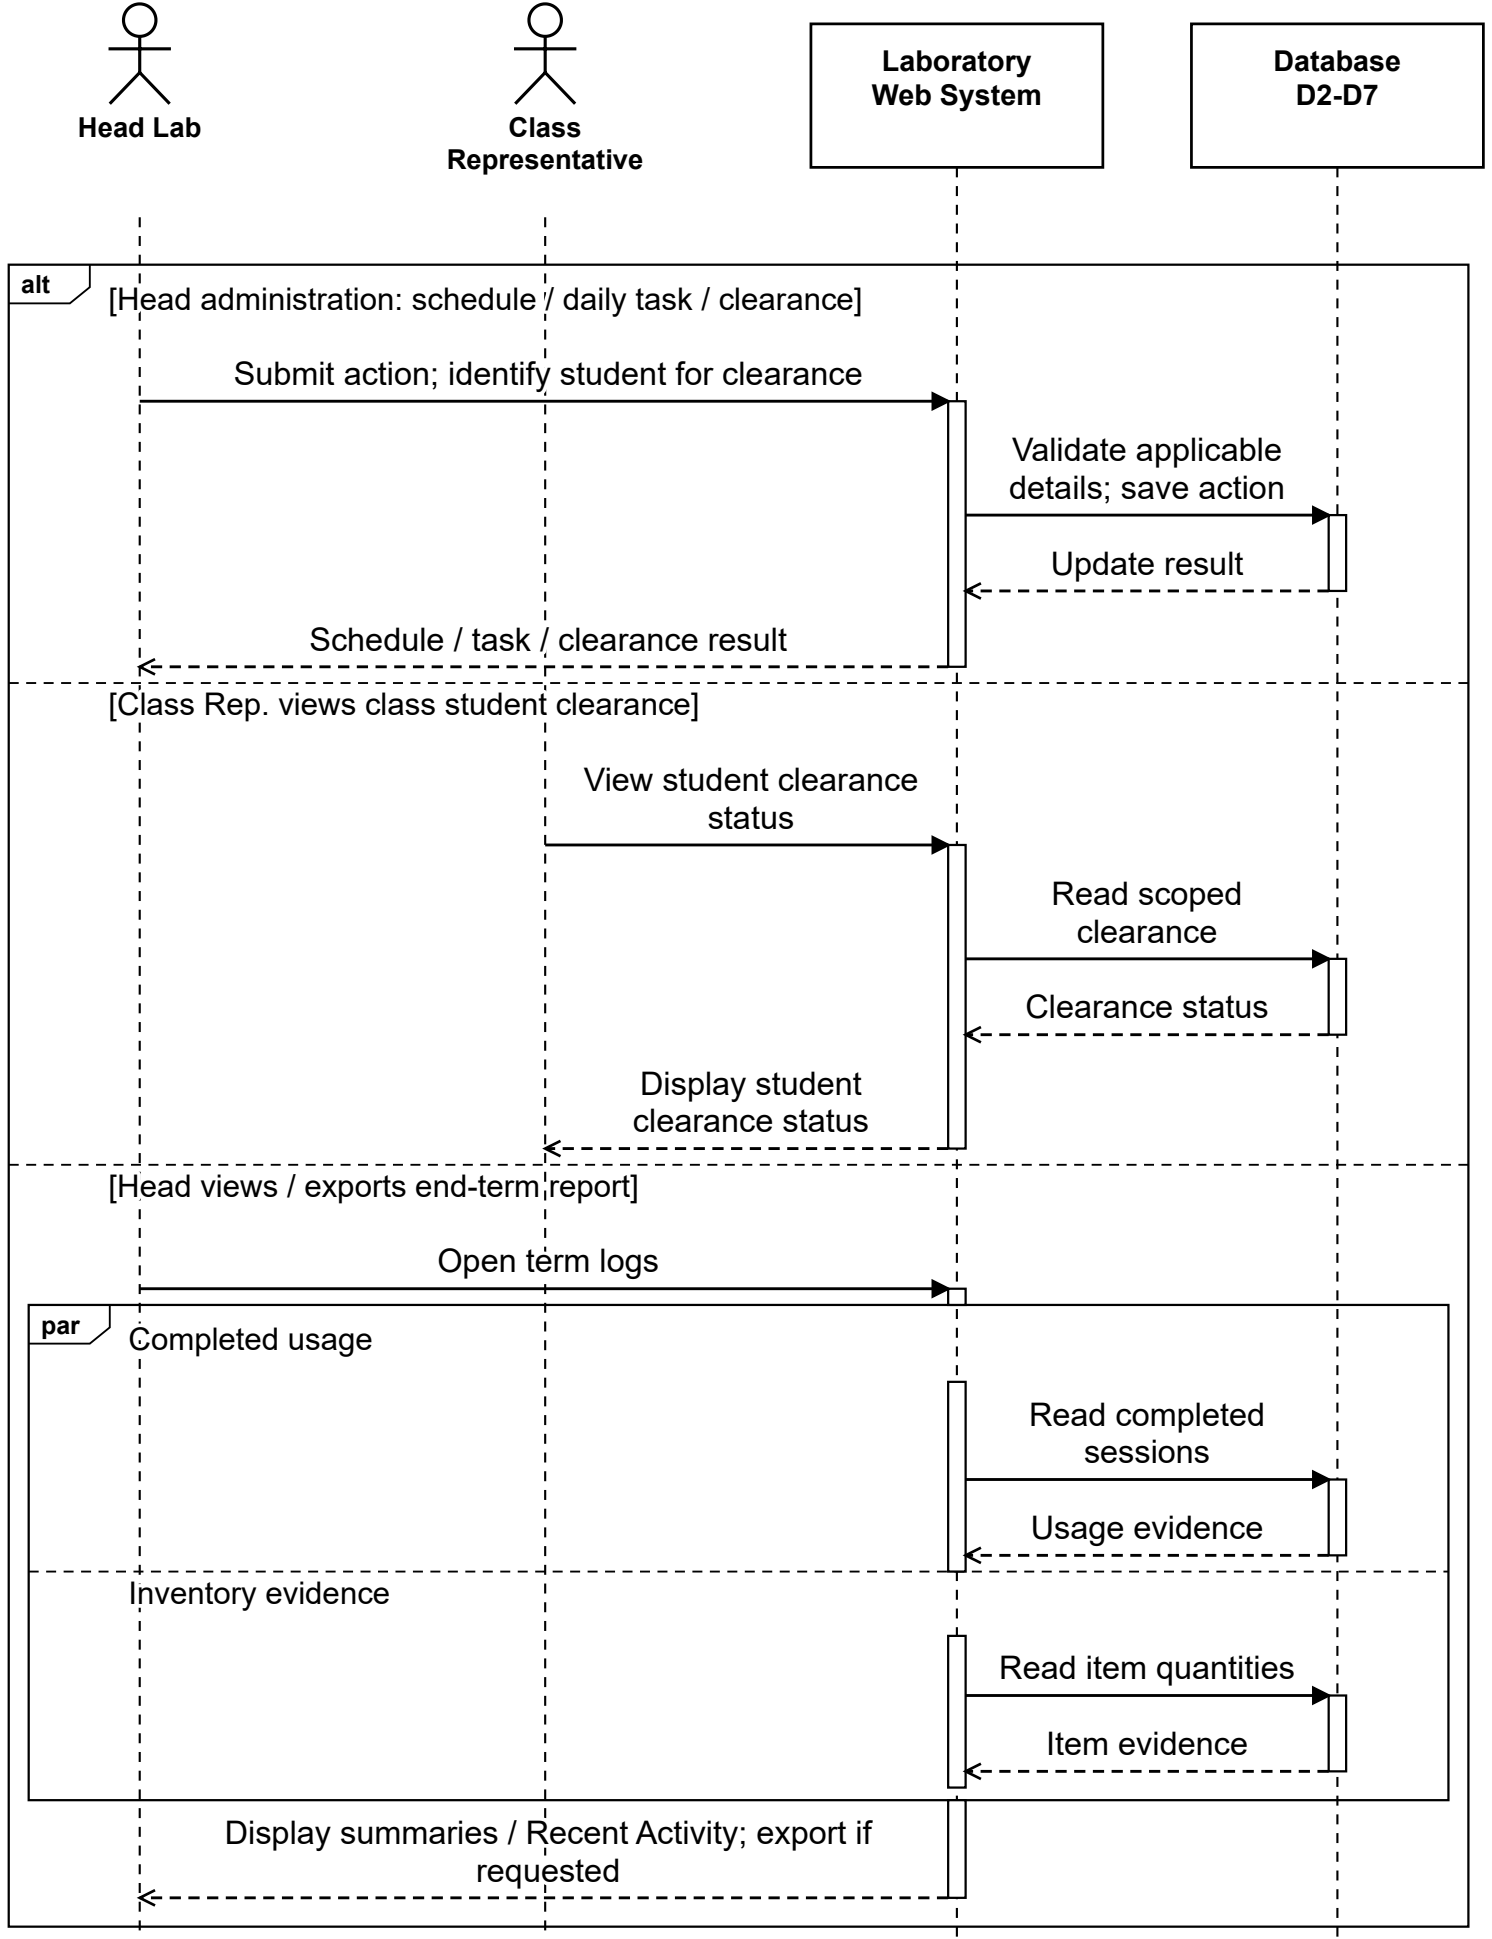

Deployment — technology-neutral design

Documented functions; candidate node placement. No implementation or hosting selection is asserted.

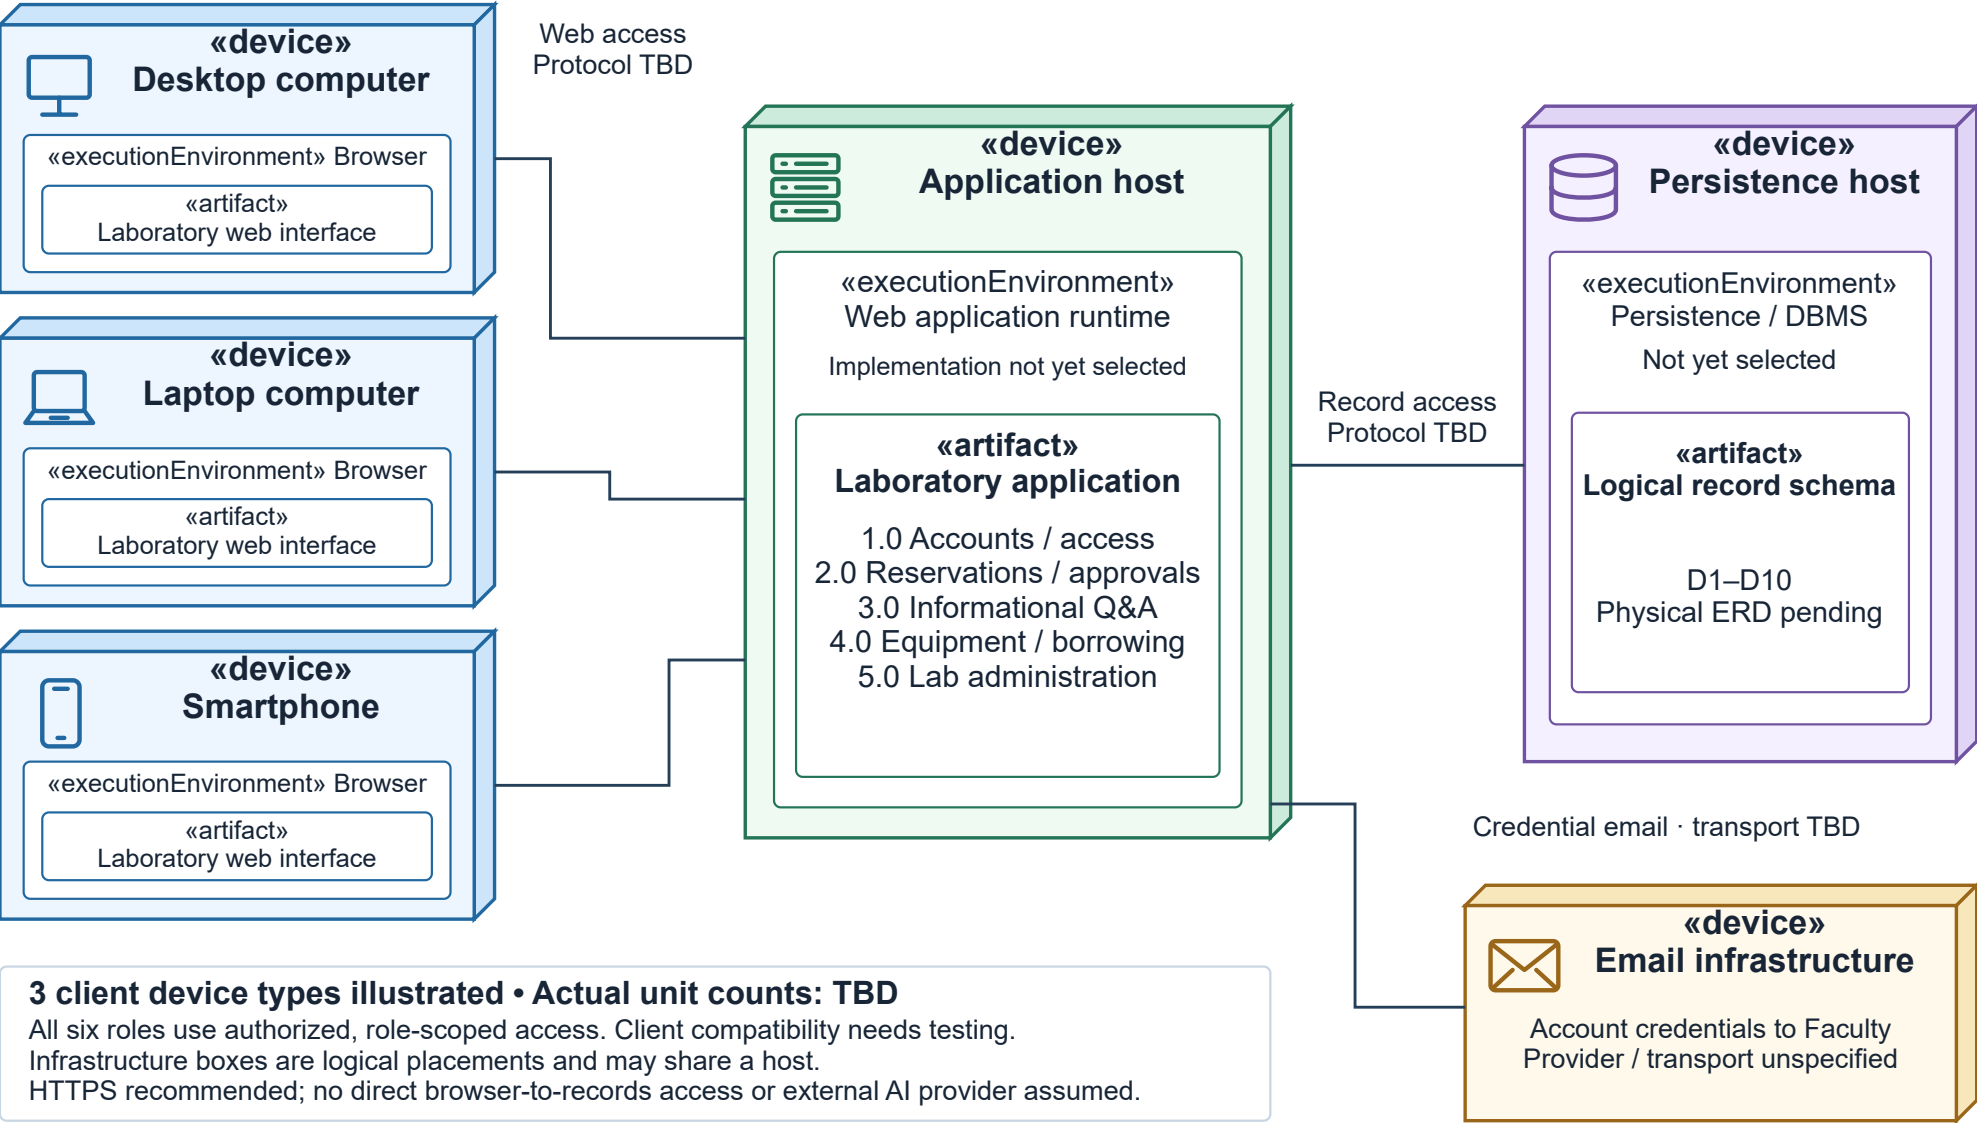

The current paper says construction has not begun and the ERD is pending. The documentation site's hosting and the paused collaboration-workspace draft are not the proposed laboratory application stack.