


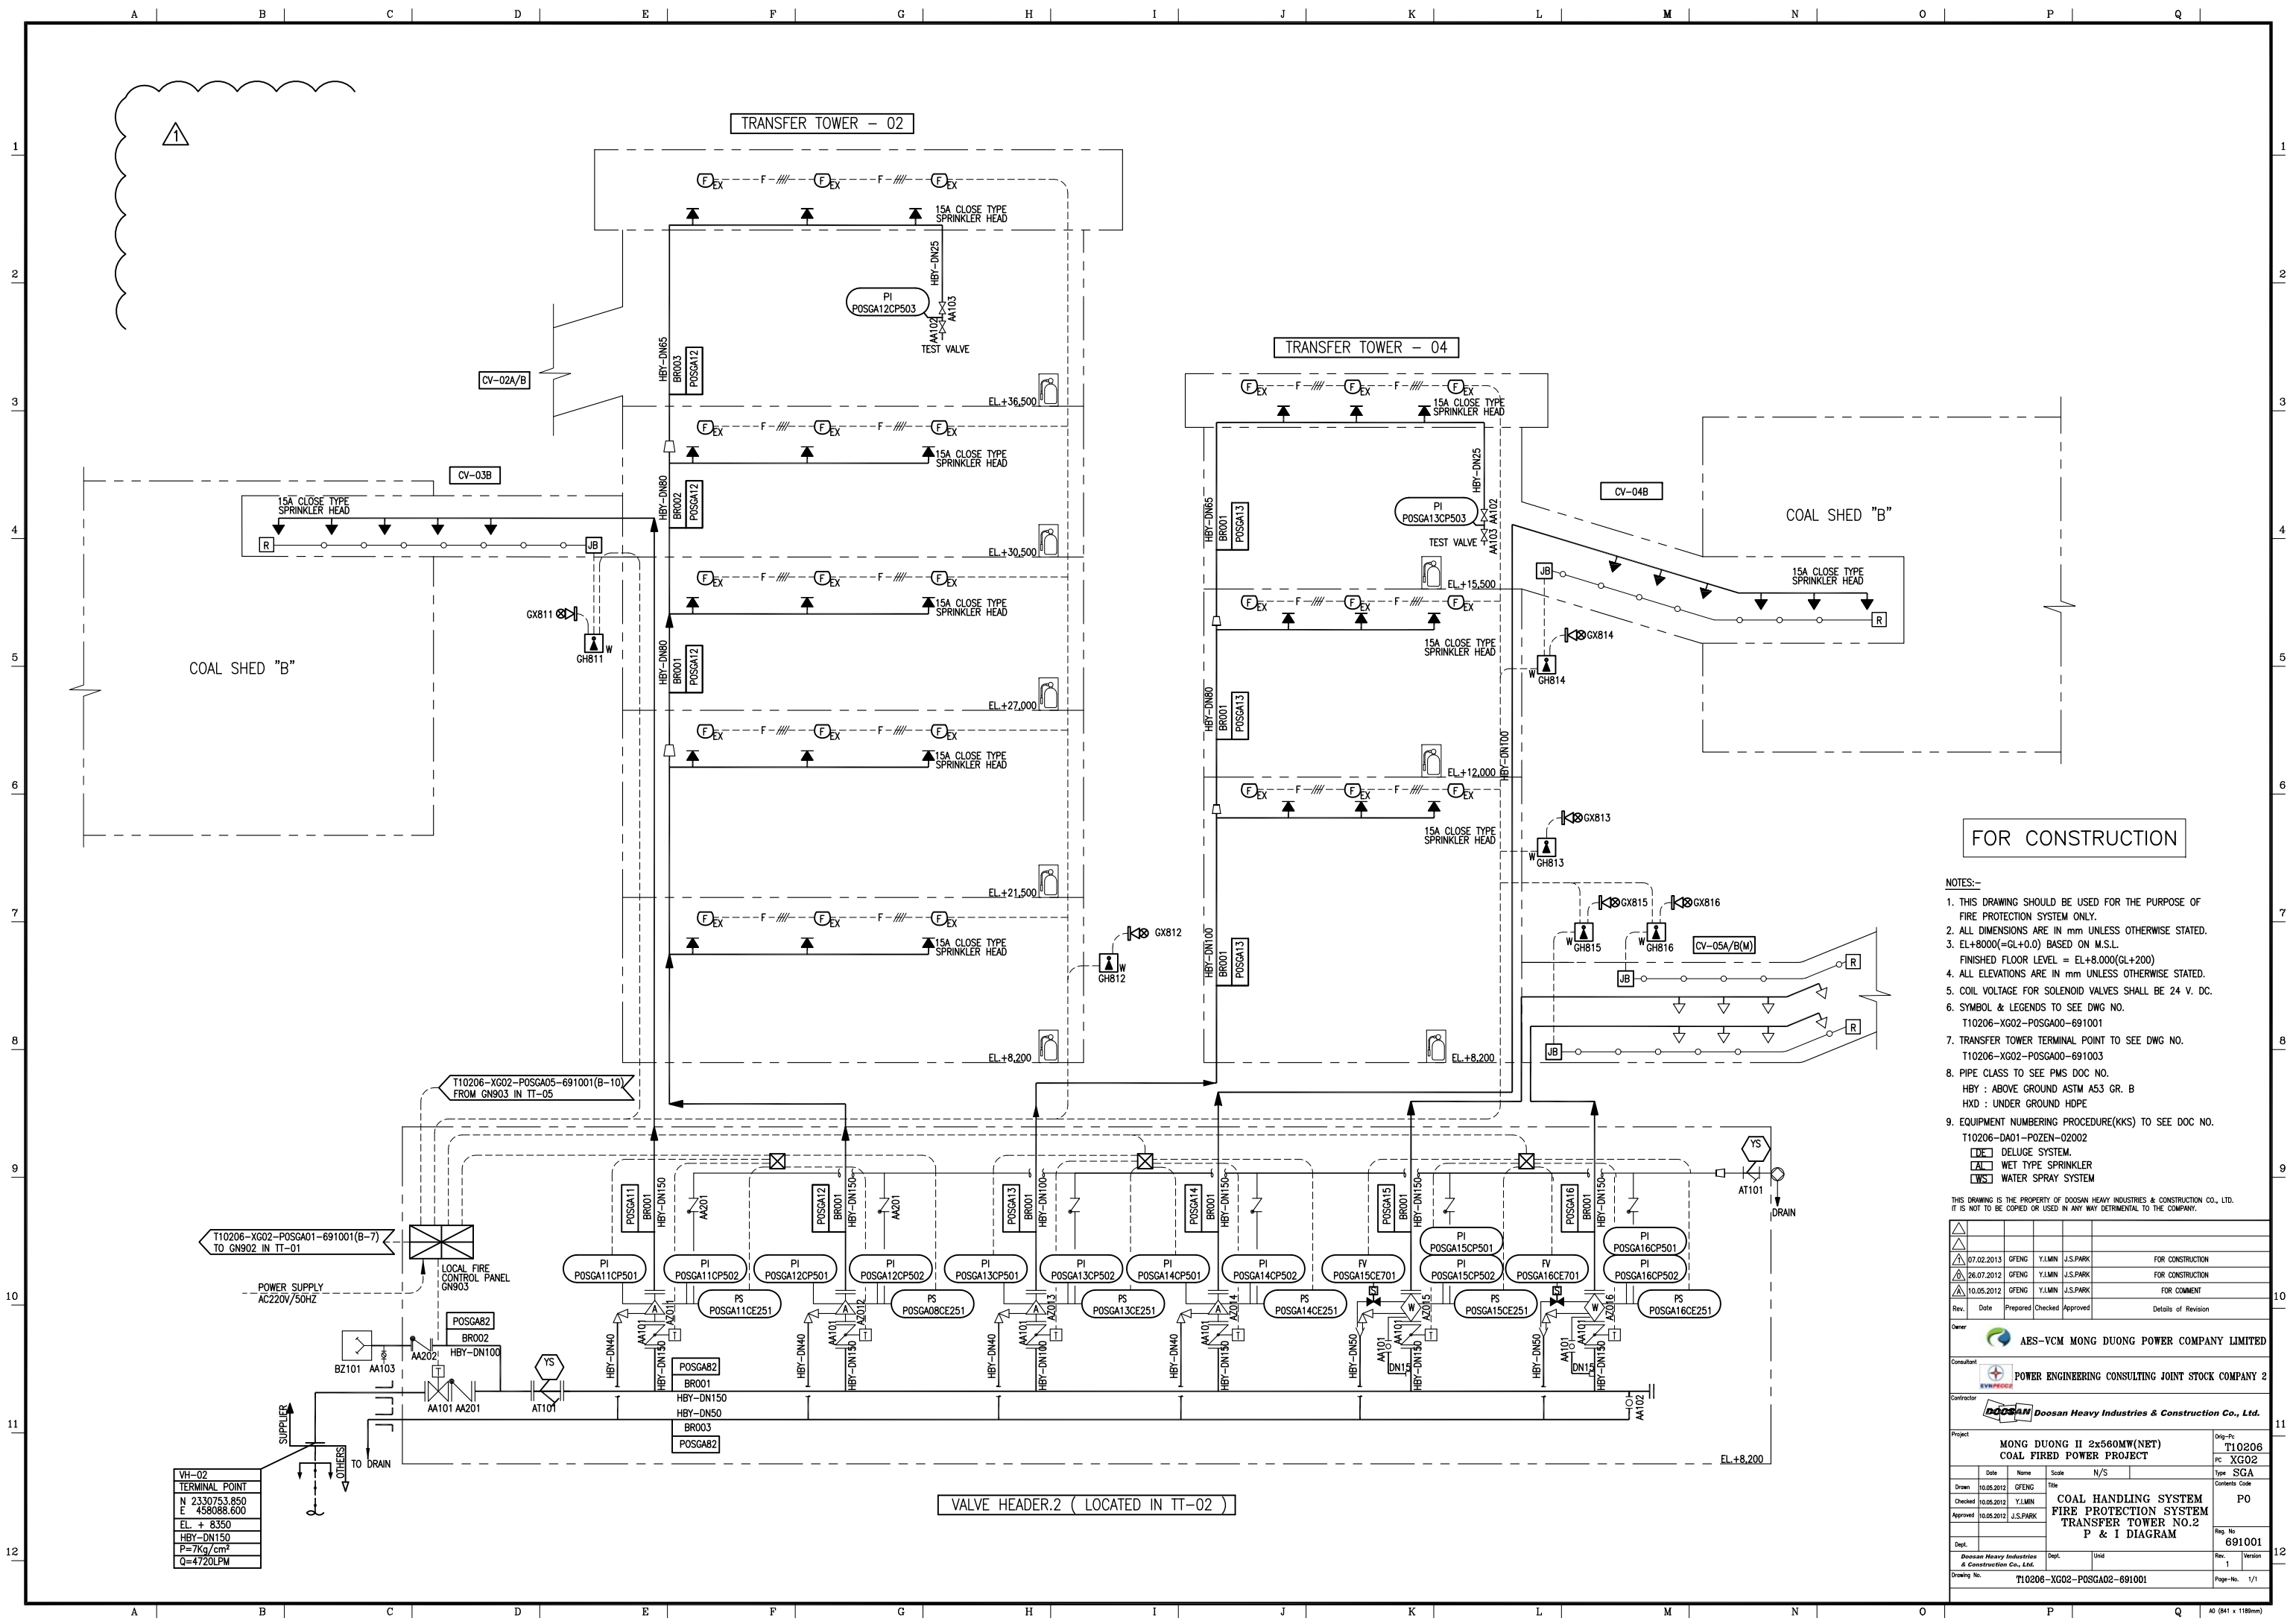

FOR CONSTRUCTION

- NOTES:-
- THIS DRAWING SHOULD BE USED FOR THE PURPOSE OF FIRE PROTECTION SYSTEM ONLY.
 - ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
 - EL+8000(=GL+0.0) BASED ON M.S.L.
FINISHED FLOOR LEVEL = EL+8.000(GL+200)
 - ALL ELEVATIONS ARE IN mm UNLESS OTHERWISE STATED.
 - COIL VOLTAGE FOR SOLENOID VALVES SHALL BE 24 V. DC.
 - SYMBOL & LEGENDS TO SEE DWG NO. T10206-XG02-POSGA00-691001
 - TRANSFER TOWER TERMINAL POINT TO SEE DWG NO. T10206-XG02-POSGA00-691003
 - PIPE CLASS TO SEE PMS DOC NO. HBY : ABOVE GROUND ASTM A53 GR. B
HXD : UNDER GROUND HDPE
 - EQUIPMENT NUMBERING PROCEDURE(KKS) TO SEE DOC NO. T10206-DA01-POZEN-02002
- DE DELUGE SYSTEM.
AL WET TYPE SPRINKLER
WS WATER SPRAY SYSTEM

THIS DRAWING IS THE PROPERTY OF DOOSAN HEAVY INDUSTRIES & CONSTRUCTION CO., LTD. IT IS NOT TO BE COPIED OR USED IN ANY WAY DETRIMENTAL TO THE COMPANY.

Rev.	Date	Prepared	Checked	Approved	Details of Revision
07.02.2013	GFENG	Y.L.MIN	J.S.PARK		FOR CONSTRUCTION
26.07.2012	GFENG	Y.L.MIN	J.S.PARK		FOR CONSTRUCTION
10.05.2012	GFENG	Y.L.MIN	J.S.PARK		FOR COMMENT
Owner					
AES-VCM MONG DUONG POWER COMPANY LIMITED					
Consultant					
POWER ENGINEERING CONSULTING JOINT STOCK COMPANY 2					
Contractor					
Doosan Heavy Industries & Construction Co., Ltd.					
Project					Original No.
MONG DUONG II 2x560MW(NET)					T10206
COAL FIRED POWER PROJECT					PC XG02
Drawn					Type SGA
Date 10.05.2012					Contents Code
Name GFENG					P0
Scale N/S					Reg. No.
Time					691001
Checked 10.05.2012					Rev.
Y.L.MIN					1
Approved 10.05.2012					Version
J.S.PARK					
Dept.					Page-No.
Doosan Heavy Industries & Construction Co., Ltd.					1/1
Drawing No.					
T10206-XG02-POSGA02-691001					