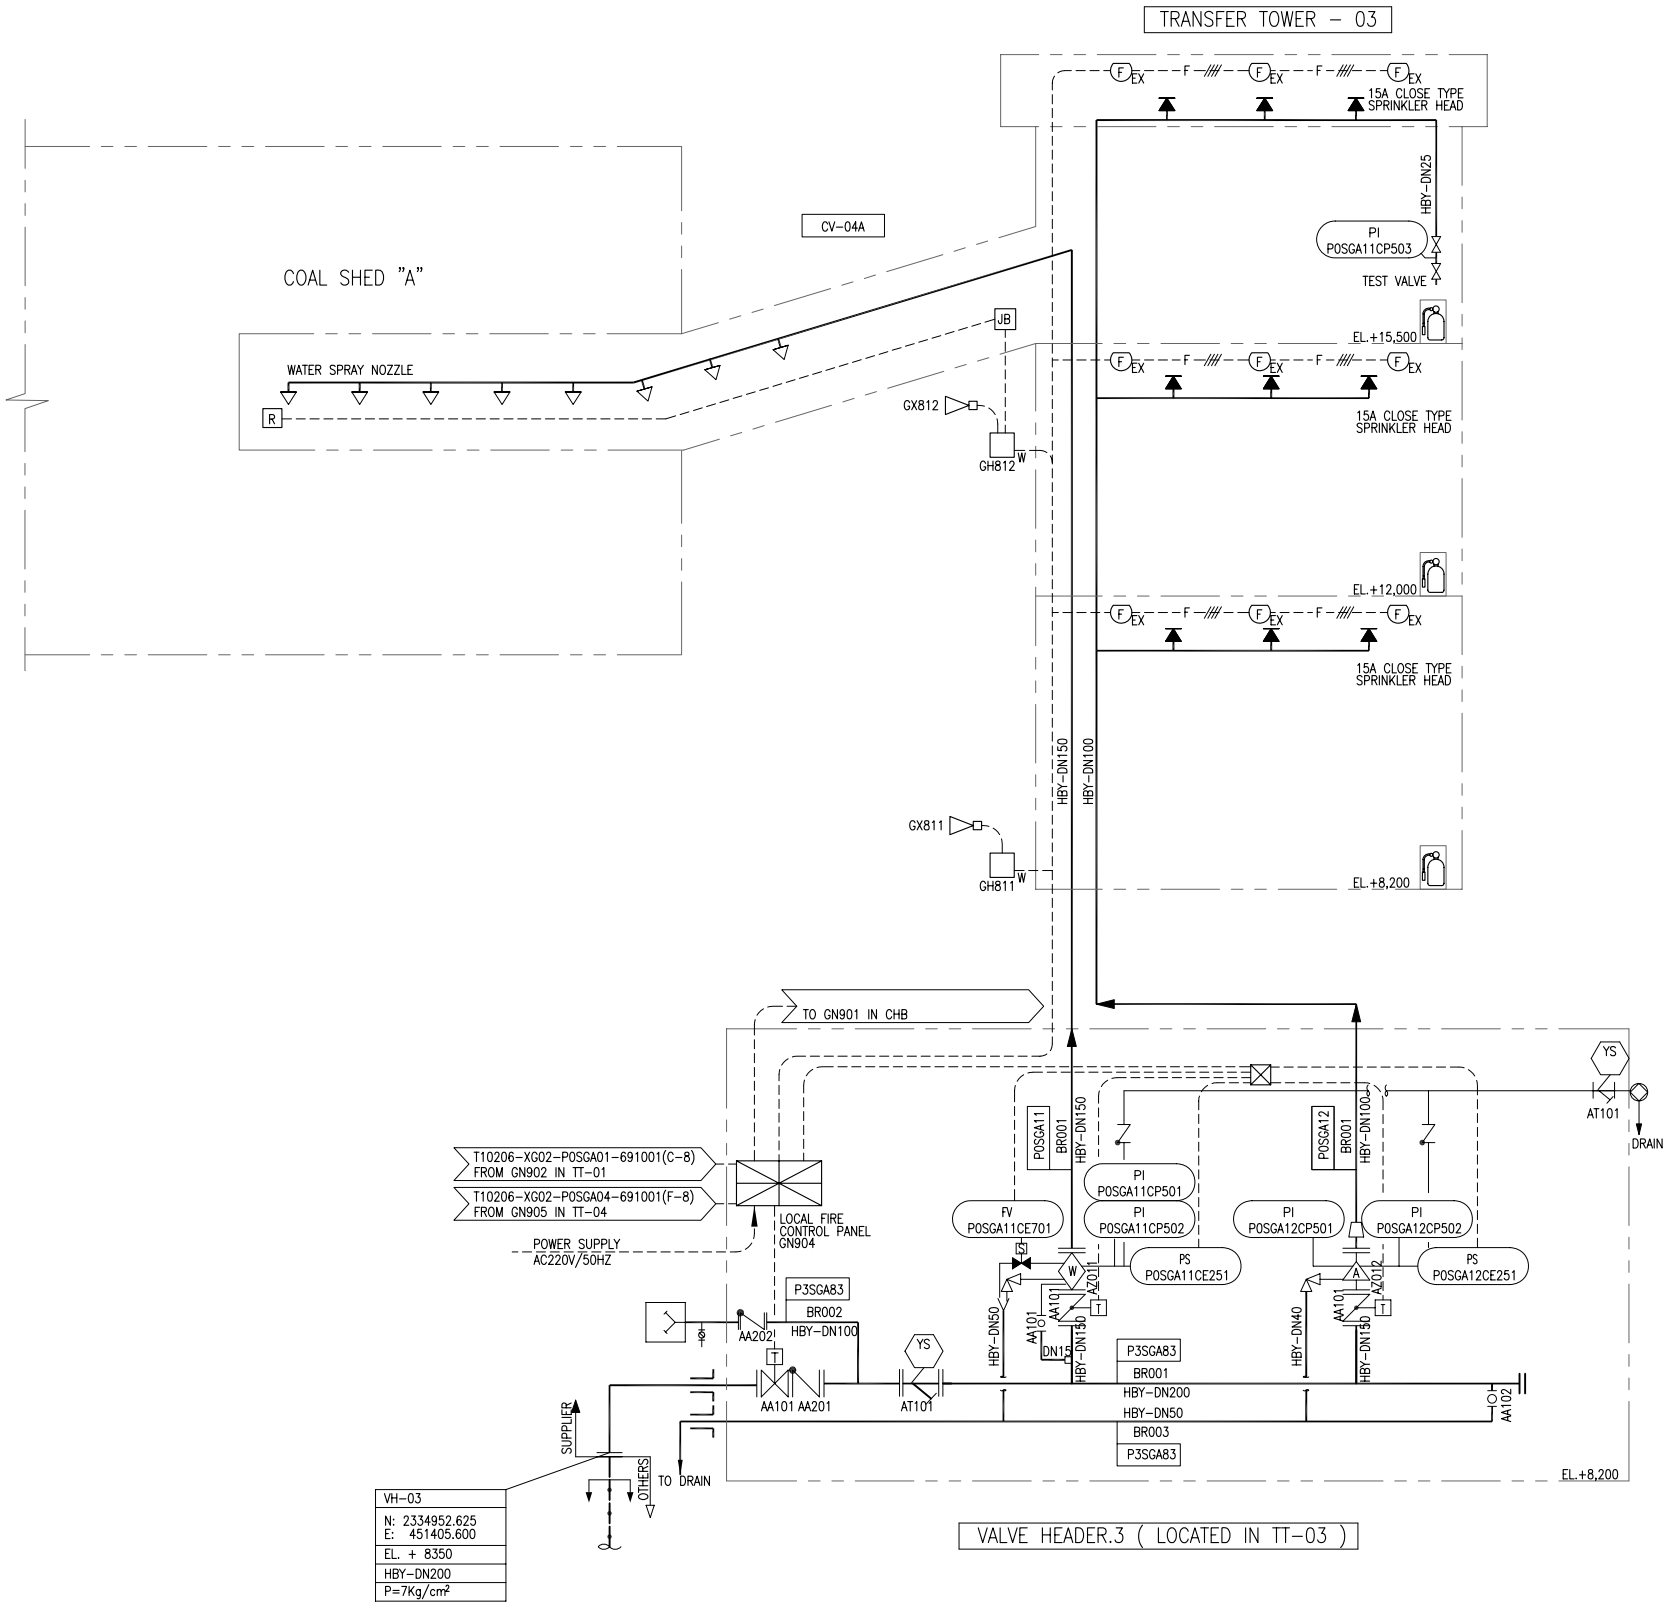

VALVE HEADER.3 (LOCATED IN TT-03)

FOR COMMENT

NOTES:-

1. THIS DRAWING SHOULD BE USED FOR THE PURPOSE OF FIRE PROTECTION SYSTEM ONLY.
2. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
3. EL+8000(=GL+0.0) BASED ON M.S.L.
   FINISHED FLOOR LEVEL = EL+8.000(GL+200)
4. ALL ELEVATIONS ARE IN mm UNLESS OTHERWISE STATED.
5. COIL VOLTAGE FOR SOLENOID VALVES SHALL BE 24 V. DC.
6. SYMBOL & LEGENDS TO SEE DWG NO.
   T10206-XG02-POSGA00-691001
7. TRANSFER TOWER TERMINAL POINT TO SEE DWG NO.
   T10206-XG02-POSGA00-691003
8. PIPE CLASS TO SEE PMS DOC NO.
   HBY : ABOVE GROUND ASTM A53 GR. B
   HXD : UNDER GROUND HDPE
9. EQUIPMENT NUMBERING PROCEDURE(KKS) TO SEE DOC NO.
   T10206-DA01-P0ZEN-02002
   DE : DELUGE SYSTEM.
   AL : WET TYPE SPRINKLER
   WS : WATER SPRAY SYSTEM

THIS DRAWING IS THE PROPERTY OF DOOSAN HEAVY INDUSTRIES & CONSTRUCTION CO., LTD. IT IS NOT TO BE COPIED OR USED IN ANY WAY DETRIMENTAL TO THE COMPANY.

Rev.	Date	Prepared	Checked	Approved	Details of Revision
1	10.05.2012	GFENG	Y.I.MIN	J.S.PARK	FOR COMMENT

Owner: AES-VCM MONG DUONG POWER COMPANY LIMITED

Consultant: POWER ENGINEERING CONSULTING JOINT STOCK COMPANY 2

Contractor: Doosan Heavy Industries & Construction Co., Ltd.

Project: MONG DUONG II 2x560MW(NET) COAL FIRED POWER PROJECT

Orig-Pc T10206 / PC XG02 / Type SGA

	Date	Name
Drawn	10.05.2012	GFENG
Checked	10.05.2012	Y.I.MIN
Approved	10.05.2012	J.S.PARK
Dept.		

Scale N/S

Title: COAL HANDLING SYSTEM FIRE PROTECTION SYSTEM TRANSFER TOWER NO.3 P & I DIAGRAM

Contents Code P0

Reg. No 691001

Rev. A / Version

Doosan Heavy Industries & Construction Co., Ltd. — Dept. — Unid

Drawing No. T10206-XG02-P0SGA03-691001

Page-No. 1/1

A0 (841 x 1189mm)