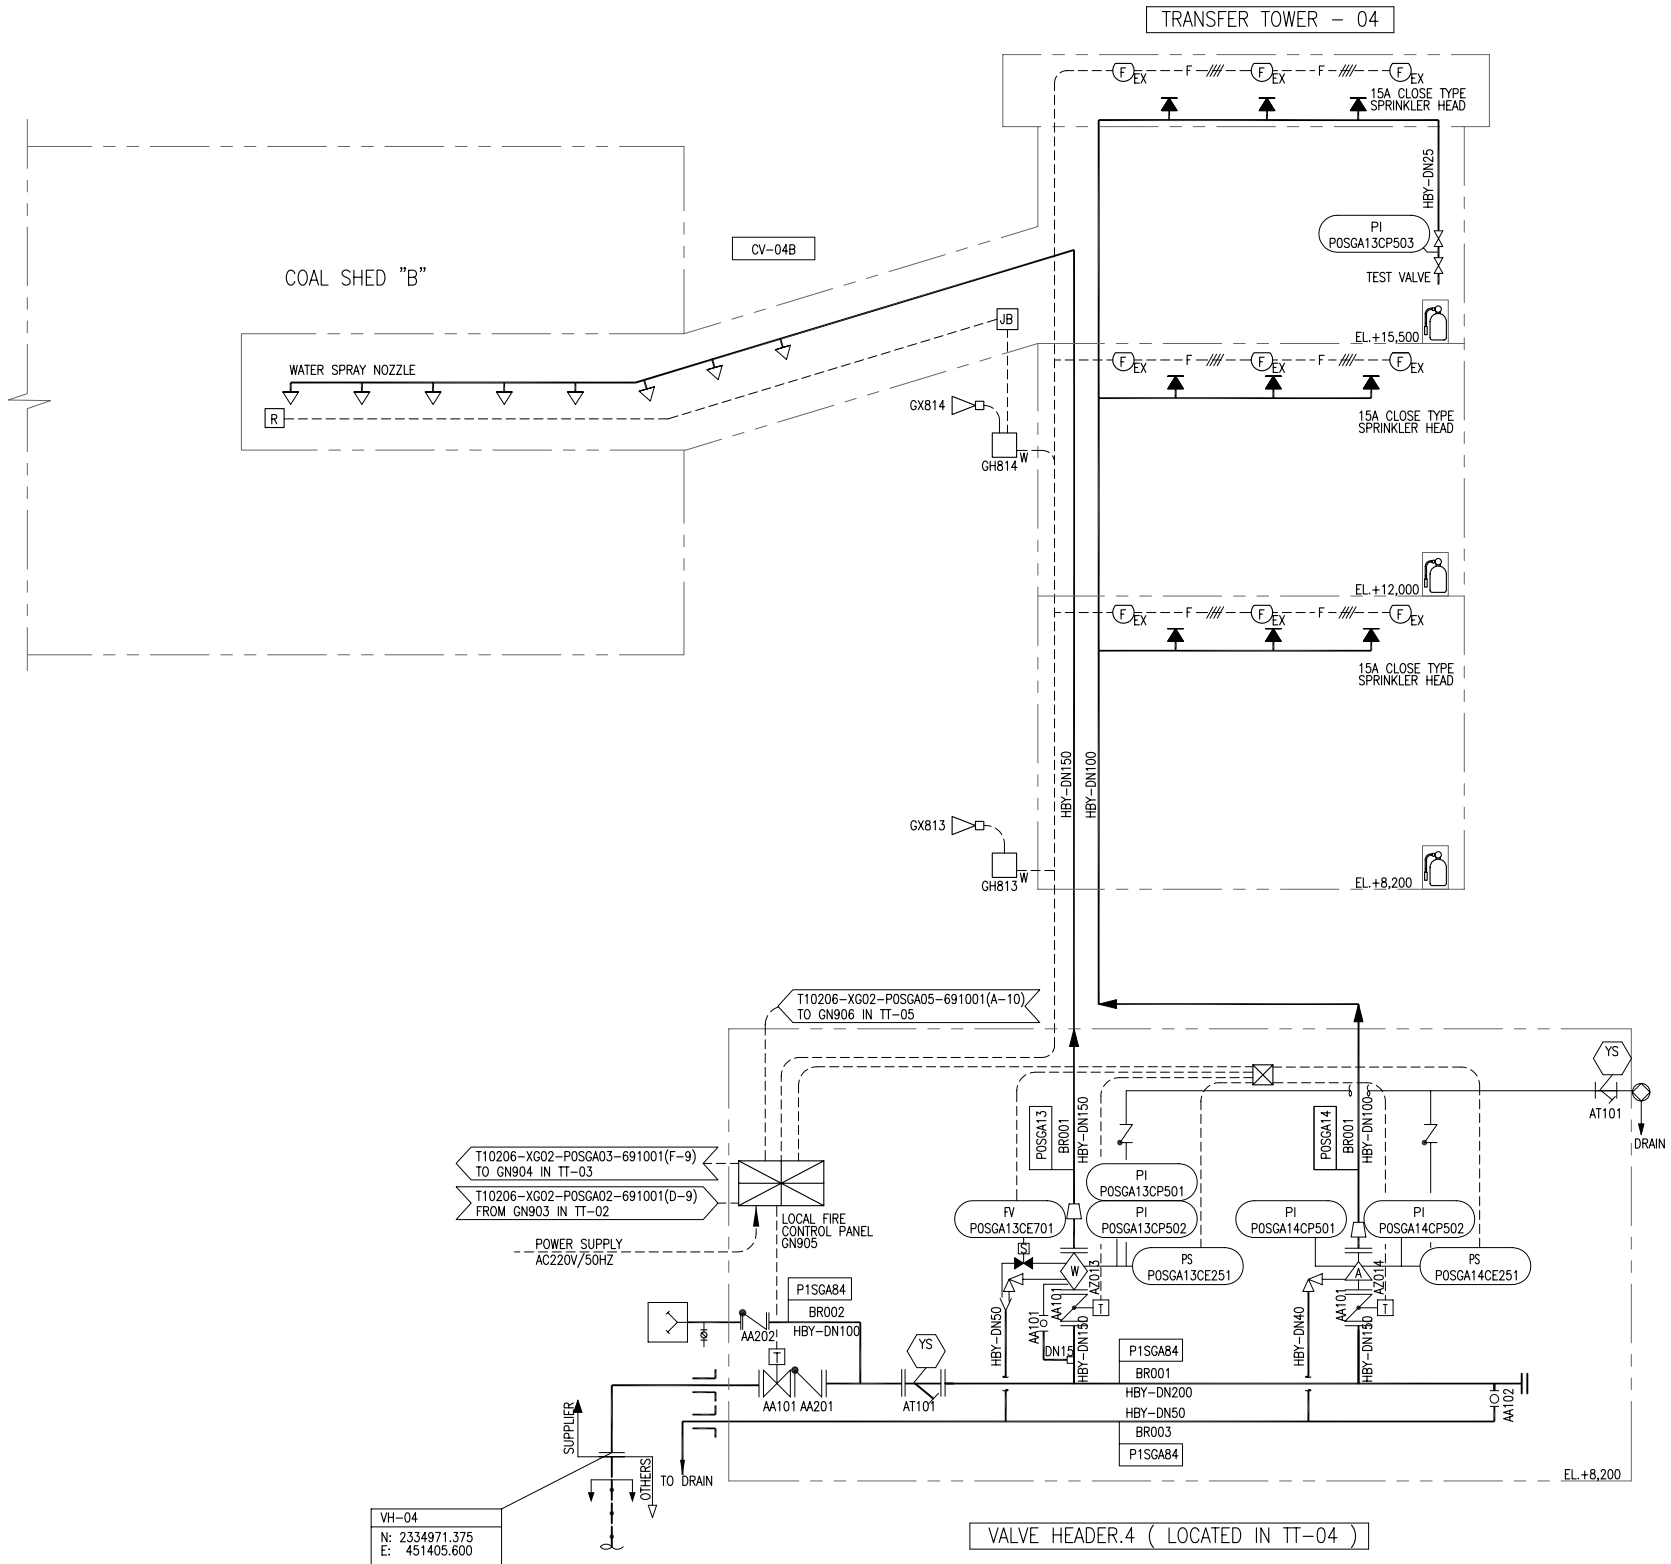


VALVE HEADER.4 ( LOCATED IN TT-04 )

FOR COMMENT

NOTES:-

1. THIS DRAWING SHOULD BE USED FOR THE PURPOSE OF FIRE PROTECTION SYSTEM ONLY.
2. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
3. EL+8000(=GL+0.0) BASED ON M.S.L.
   FINISHED FLOOR LEVEL = EL+8.000(GL+200)
4. ALL ELEVATIONS ARE IN mm UNLESS OTHERWISE STATED.
5. COIL VOLTAGE FOR SOLENOID VALVES SHALL BE 24 V. DC.
6. SYMBOL & LEGENDS TO SEE DWG NO.
   T10206-XG02-POSGA00-691001
7. TRANSFER TOWER TERMINAL POINT TO SEE DWG NO.
   T10206-XG02-POSGA00-691003
8. PIPE CLASS TO SEE PMS DOC NO.
   HBY : ABOVE GROUND ASTM A53 GR. B
   HXD : UNDER GROUND HDPE
9. EQUIPMENT NUMBERING PROCEDURE(KKS) TO SEE DOC NO.
   T10206-DA01-POZEN-02002
   DE : DELUGE SYSTEM.
   AL : WET TYPE SPRINKLER
   WS : WATER SPRAY SYSTEM

THIS DRAWING IS THE PROPERTY OF DOOSAN HEAVY INDUSTRIES & CONSTRUCTION CO., LTD. IT IS NOT TO BE COPIED OR USED IN ANY WAY DETRIMENTAL TO THE COMPANY.

| Rev. | Date | Prepared | Checked | Approved | Details of Revision |
|---|---|---|---|---|---|
| 1 | 10.05.2012 | GFENG | Y.I.MIN | J.S.PARK | FOR COMMENT |

Owner: AES-VCM MONG DUONG POWER COMPANY LIMITED

Consultant: POWER ENGINEERING CONSULTING JOINT STOCK COMPANY 2

Contractor: Doosan Heavy Industries & Construction Co., Ltd.

Project: MONG DUONG II 2x560MW(NET) COAL FIRED POWER PROJECT

Orig-Pr. T10206 PC XG02 Type SGA Contents Code P0 Reg. No 691001

| | Date | Name |
|---|---|---|
| Drawn | 10.05.2012 | GFENG |
| Checked | 10.05.2012 | Y.I.MIN |
| Approved | 10.05.2012 | J.S.PARK |
| Dept. | | |

Scale N/S

Title: COAL HANDLING SYSTEM FIRE PROTECTION SYSTEM TRANSFER TOWER NO.4 P & I DIAGRAM

Doosan Heavy Industries & Construction Co., Ltd. Dept. Unid Rev. A Version

Drawing No. T10206-XG02-POSGA04-691001 Page-No. 1/1

A0 (841 x 1189mm)