


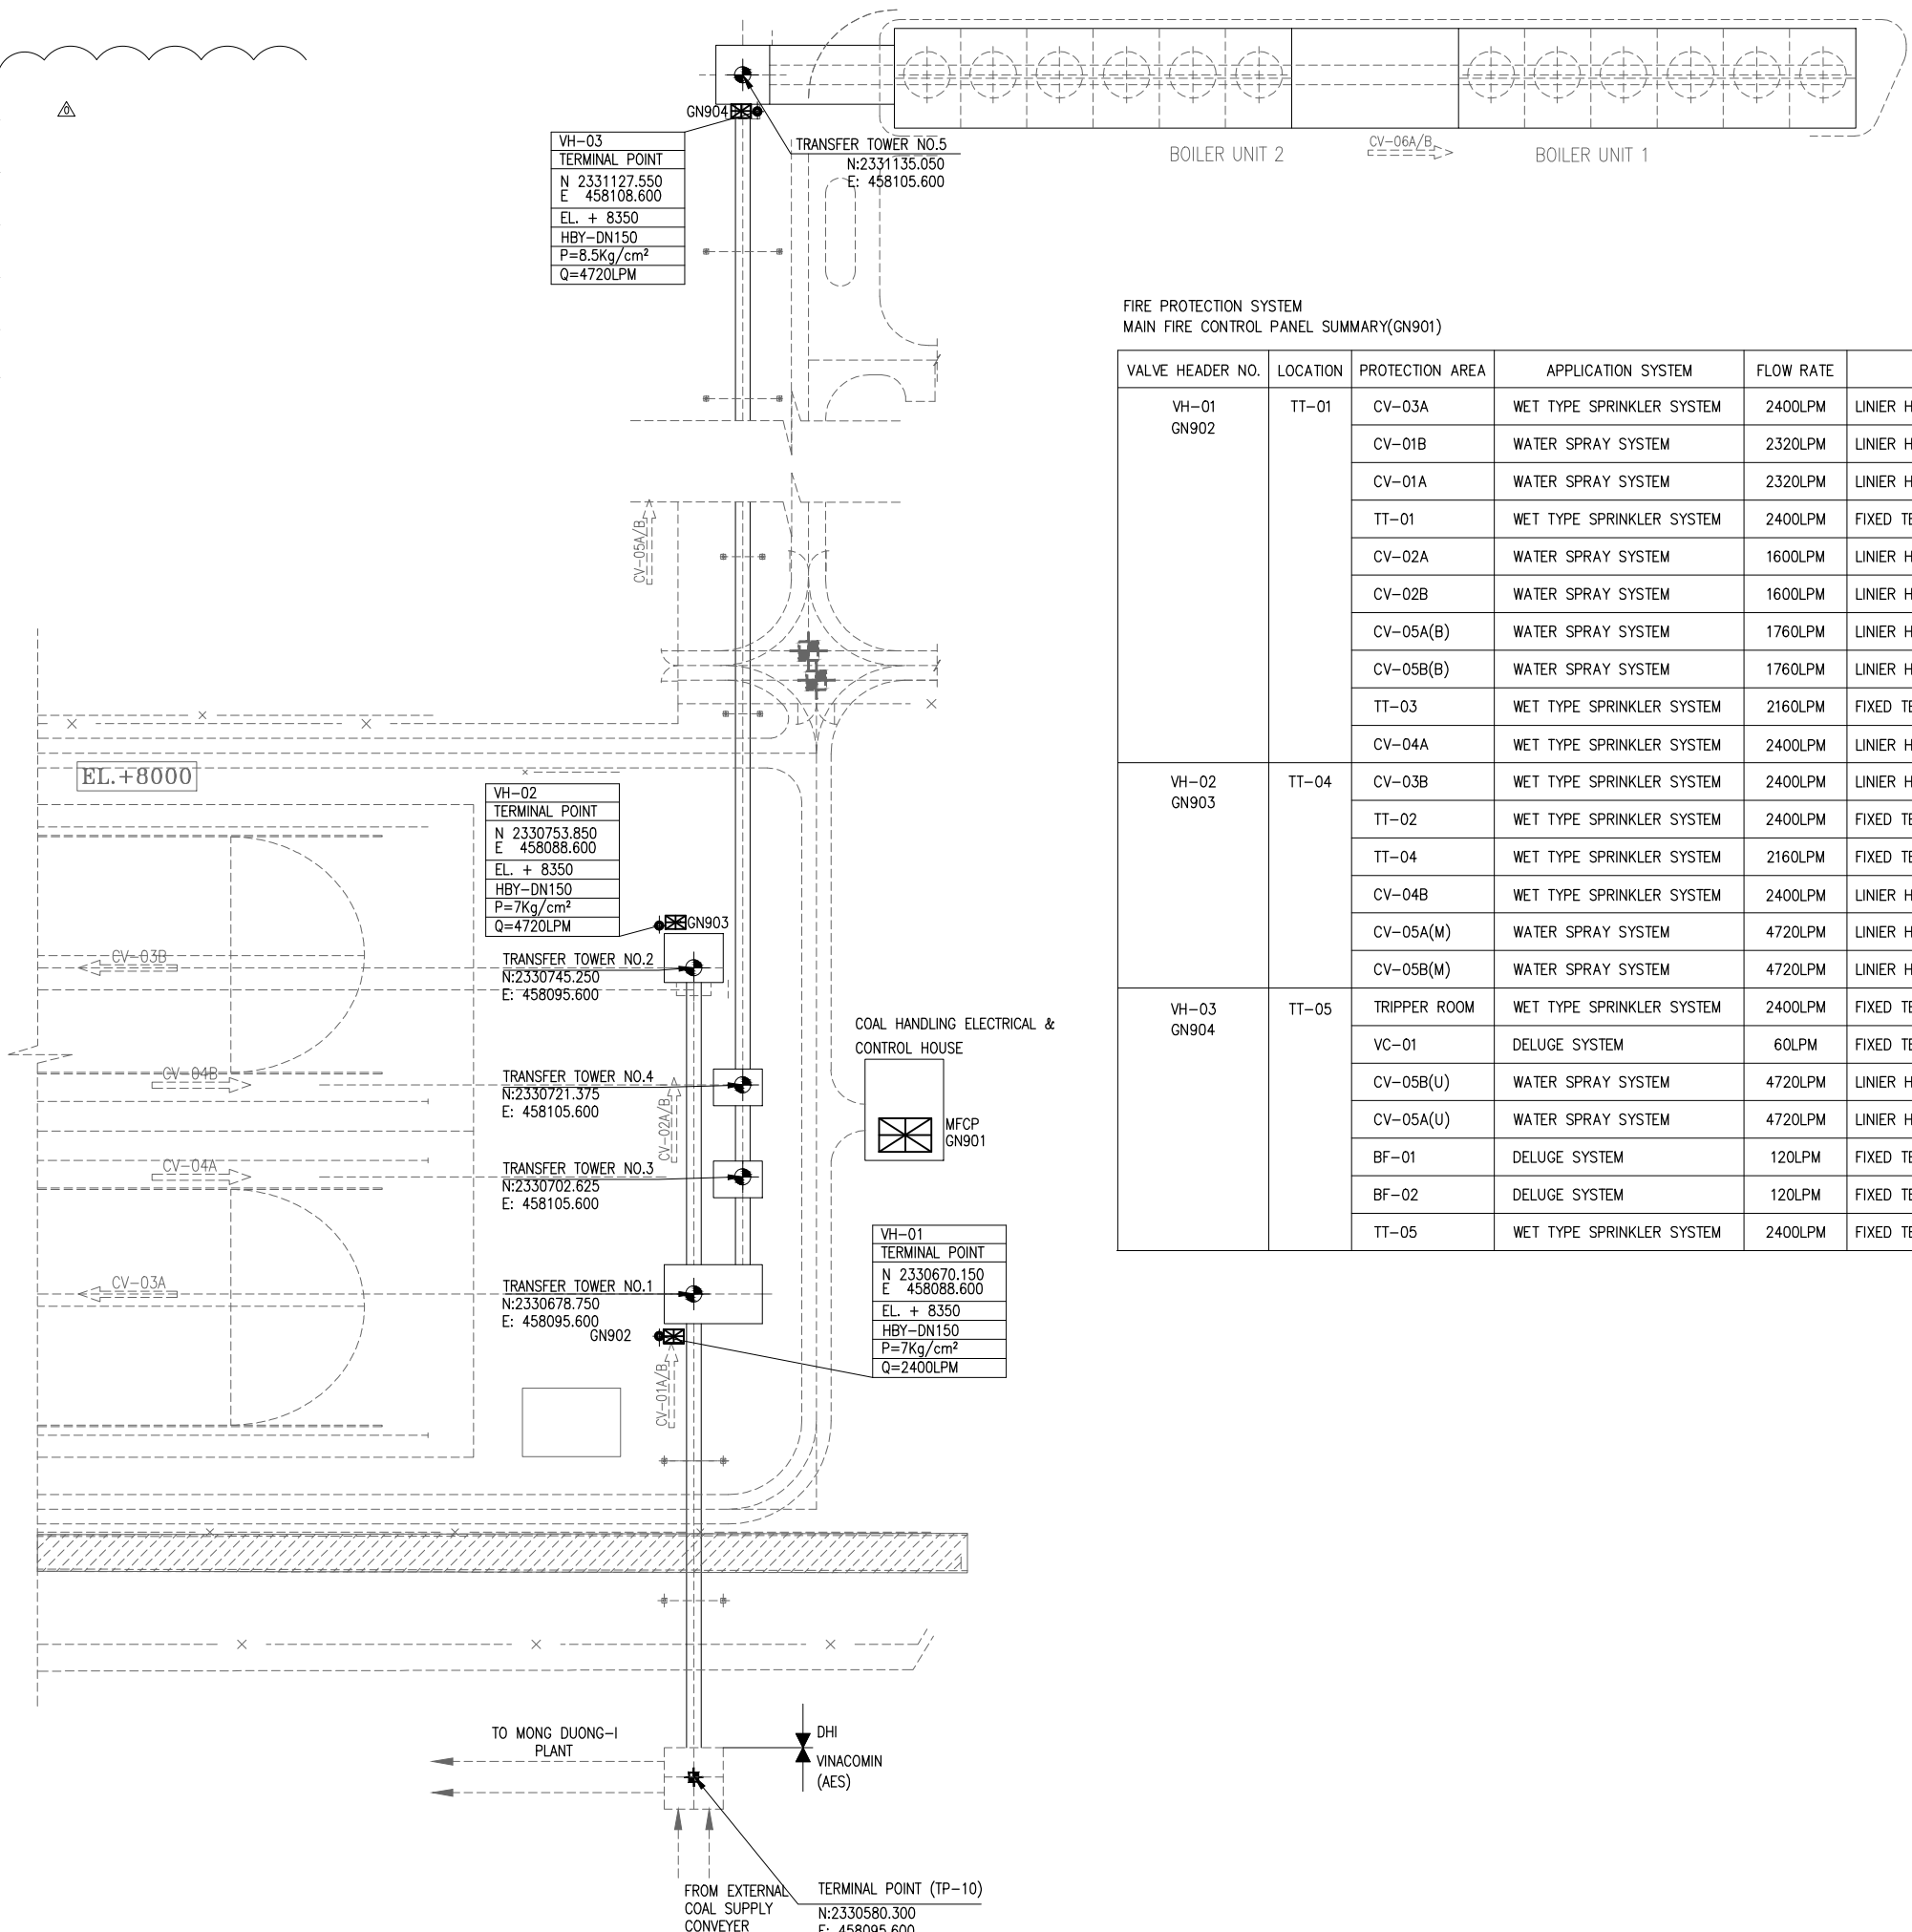

FIRE PROTECTION SYSTEM
MAIN FIRE CONTROL PANEL SUMMARY(GN901)

VALVE HEADER NO.	LOCATION	PROTECTION AREA	APPLICATION SYSTEM	FLOW RATE	DETECTION TYPE	REMARK
VH-01 GN902	TT-01	CV-03A	WET TYPE SPRINKLER SYSTEM	2400LPM	LINIER HEAT DETECTOR A, B	
		CV-01B	WATER SPRAY SYSTEM	2320LPM	LINIER HEAT DETECTOR A, B	
		CV-01A	WATER SPRAY SYSTEM	2320LPM	LINIER HEAT DETECTOR A, B	
		TT-01	WET TYPE SPRINKLER SYSTEM	2400LPM	FIXED TEMPERATURE HEAT DETECTOR	
		CV-02A	WATER SPRAY SYSTEM	1600LPM	LINIER HEAT DETECTOR A, B	
		CV-02B	WATER SPRAY SYSTEM	1600LPM	LINIER HEAT DETECTOR A, B	
		CV-05A(B)	WATER SPRAY SYSTEM	1760LPM	LINIER HEAT DETECTOR A, B	
		CV-05B(B)	WATER SPRAY SYSTEM	1760LPM	LINIER HEAT DETECTOR A, B	
		TT-03	WET TYPE SPRINKLER SYSTEM	2160LPM	FIXED TEMPERATURE HEAT DETECTOR	
		CV-04A	WET TYPE SPRINKLER SYSTEM	2400LPM	LINIER HEAT DETECTOR A, B	
VH-02 GN903	TT-04	CV-03B	WET TYPE SPRINKLER SYSTEM	2400LPM	LINIER HEAT DETECTOR A, B	
		TT-02	WET TYPE SPRINKLER SYSTEM	2400LPM	FIXED TEMPERATURE HEAT DETECTOR	
		TT-04	WET TYPE SPRINKLER SYSTEM	2160LPM	FIXED TEMPERATURE HEAT DETECTOR	
		CV-04B	WET TYPE SPRINKLER SYSTEM	2400LPM	LINIER HEAT DETECTOR A, B	
		CV-05A(M)	WATER SPRAY SYSTEM	4720LPM	LINIER HEAT DETECTOR A, B	
		CV-05B(M)	WATER SPRAY SYSTEM	4720LPM	LINIER HEAT DETECTOR A, B	
VH-03 GN904	TT-05	TRIPPER ROOM	WET TYPE SPRINKLER SYSTEM	2400LPM	FIXED TEMPERATURE HEAT DETECTOR	
		VC-01	DELUGE SYSTEM	60LPM	FIXED TEMPERATURE HEAT DETECTOR	
		CV-05B(U)	WATER SPRAY SYSTEM	4720LPM	LINIER HEAT DETECTOR A, B	
		CV-05A(U)	WATER SPRAY SYSTEM	4720LPM	LINIER HEAT DETECTOR A, B	
		BF-01	DELUGE SYSTEM	120LPM	FIXED TEMPERATURE HEAT DETECTOR	
		BF-02	DELUGE SYSTEM	120LPM	FIXED TEMPERATURE HEAT DETECTOR	
		TT-05	WET TYPE SPRINKLER SYSTEM	2400LPM	FIXED TEMPERATURE HEAT DETECTOR	

FOR CONSTRUCTION

- NOTES:-
- THIS DRAWING SHOULD BE USED FOR THE PURPOSE OF FIRE PROTECTION SYSTEM ONLY.
 - ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE STATED.
 - EL+8000(=GL+0.0) BASED ON M.S.L.
FINISHED FLOOR LEVEL = EL+8.000(GL+200)
 - ALL ELEVATIONS ARE IN mm UNLESS OTHERWISE STATED.
 - COIL VOLTAGE FOR SOLENOID VALVES SHALL BE 24 V. DC.
 - SYMBOL & LEGENDS TO SEE DWG NO. T10206-XG02-POSGA00-691001
 - TRANSFER TOWER TERMINAL POINT TO SEE DWG NO. T10206-XG02-POSGA00-691003
 - PIPE CLASS TO SEE PMS DOC NO.
HBY : ABOVE GROUND ASTM A53 GR. B
HXD : UNDER GROUND HDPE
 - EQUIPMENT NUMBERING PROCEDURE(KKS) TO SEE DOC NO. T10206-DA01-POZEN-02002
- ☐ DE DELUGE SYSTEM.
☐ AL WET TYPE SPRINKLER SYSTEM
☐ WS WATER SPRAY SYSTEM
- THIS DRAWING IS THE PROPERTY OF DOOSAN HEAVY INDUSTRIES & CONSTRUCTION CO., LTD.
IT IS NOT TO BE COPIED OR USED IN ANY WAY DETRIMENTAL TO THE COMPANY.

△					
△					
△					
○	26.07.2012	GFENG	YJMIN	J.S.PARK	FOR CONSTRUCTION
△	10.05.2012	GFENG	YJMIN	J.S.PARK	FOR COMMENT
Rev.	Date	Prepared	Checked	Approved	Details of Revision
Owner					
 AES-VCM MONG DUONG POWER COMPANY LIMITED					
Consultant					
 POWER ENGINEERING CONSULTING JOINT STOCK COMPANY 2					
Contractor					
 Doosan Heavy Industries & Construction Co., Ltd.					
Project					Orig-PC T10206 PC XG02 Type SGA
	Date	Name	Scale	1/700	COAL HANDLING SYSTEM FIRE PROTECTION SYSTEM TERMINAL POINT LAYOUT DRAWING
Drawn	10.05.2012	GFENG	Title		
Checked	10.05.2012	YJMIN			
Approved	10.05.2012	J.S.PARK			
Dept.					
<i>Doosan Heavy Industries & Construction Co., Ltd.</i>					Reg. No. 691003
Drawing No.			Dept.	Unit	Rev. 0 Version 0
T10206-XG02-POSGA00-691003					Page-No. 1/1