

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q					
	EQUIPMENT				MISCELLANEOUS			SELF-ACTUATED DEVICES—PRESSURE			VALVES—ACTUATORS			DISTRIBUTED CONTROL & SHARED DISPLAY								
1	SILO BAG FILTER CONVEYOR SCREW CONVEYOR HOOD TRIPPER ROTARY VALVE				EXPANSION JOINT DOOSAN OTHERS SUPPLIER INTERFACE AIR FILTER WITH REGULATOR SILENCER LOCAL CONTROL PANEL L.C.P LOCAL CONTROL STATION L.C.S			PRV PRESSURE REDUCING REGULATOR SELF CONTAINED PSV PRESSURE RELIEF OR SAFETY VALVE ANGLE PATTERN SPRING OR WEIGHT LOADED OR WITH INTEGRAL PILOT LOADED OR WITH INTEGRAL PILOT			PNEUMATIC DIAPHRAGM PNEUMATIC CYLINDER. SINGLE-ACTING SOLENOID ACTUATOR ROTARY MOTOR (SHOWN TYPICALLY WITH ELECTRIC SIGNAL)			NORMALLY ACCESSIBLE TO OPERATOR INDICATOR/ CONTROLLER/ RECORDER OR ALARM POINT – USUALLY USED TO INDICATE DISPLAY –SHARED DISPLAY –SHARED CONTROL –ACCESS LIMITED TO COMMUNICATION LINK –OPERATOR INTERFACE ON COMMUNICATION LINK								
2														LOGIC & SEQUENCE CONTROL				2				
3								SENSOR—LEVEL						GENERAL SYMBOL; FOR UNDEFINED COMPLEX LOGIC OR SEQUENCE CONTROL				3				
4	PROCESS PIPING							DIAPHRAGM OPERATED VALVE WITH TIMER KIT CONTROL			ALARM ANNUNCIATOR							4				
5	MAIN PROCESS FLOW PIPING SECONDARY PROCESS FLOW PIPING CONCENTRIC REDUCER INCREASER VENT PIPING BY VENDOR BOUNDARY OF EQUIPMENT PACKAGE PROVIDED BY SUPPLIER				FANS			SENSORS – PRESSURE			HIGH-HIGH DENSITY ALARM ANNUNCIATOR							5				
6					CENTRIFUGAL BLOWER OR COMPRESSOR CENTRIFUGAL FAN			SENSORS – TEMPERATURE			HIGH-HIGH LEVEL ALARM ANNUNCIATOR							6				
7								TI – TEMPERATURE ELEMENT WITH INDICATOR TW – THERMOWELL TE – TEMPERATURE ELEMENT TT – TEMPERATURE ELEMENT WITH TRANSDUCER			SPEED ALARM ANNUNCIATOR							7				
8	LINE VALVES				DAMPERS			SENSORS – DUST MONITOR			SWITCH			VALVE				8				
9	GATE BALL (2-WAY)				PARALLEL BLADE SINGLE BLADE OR BUTTERFLY			DM DUST MONITOR			SS SPEED SWITCH			SOV SOLENOID VALVE PCV PRESSURE MODULATING CONTROL VALVE								9
10	VALVE STATUS SYMBOLS				DUST COLLECTORS			GENERAL INSTRUMENTS (NOTE 1)			INDICATOR							10				
11	OPEN DURING NORMAL OPERATION (ALL VALVES EXCEPT BUTTERFLY) CLOSED DURING NORMAL OPERATION				CDC : CYCLONE DUST COLLECTOR (SHOWN) BDC : BAG TYPE DUST COLLECTOR DYNAMIC TYPE DUST COLLECTOR			INSTRUMENT FOR SINGLE MEASURED VARIABLE AND ANY NUMBER OF FUNCTIONS. INSTRUMENT IS LOCALLY MOUNTED MEASUREMENT INDICATED ON LOCAL PANEL (LOCAL CONTROL SYSTEM) (TYPICAL)			PDI PRESSURE DIFFERENTIAL INDICATOR											11
12	DRAINS				SIGNALS & LINES			GAGE										12				
	DIRECT DRAIN INDIRECT DRAIN OR FUNNEL DRAIN				DCS TA DCS RE DCS RU TOTAL ALARM TO DCS REMOTE MODE SIGNAL TO DCS RUN SIGNAL TO DCS			CONNECTION TO PROCESS OR MECHANICAL LINK OR INSTRUMENT SUPPLY PNEUMATIC SIGNAL OR UNDEFINED SIGNAL ELECTRIC SIGNAL			PG PRESSURE GAGE											
	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	AD (841 x 1189mm)				

THIS DRAWING IS THE PROPERTY OF DOOSAN HEAVY INDUSTRIES & CONSTRUCTION CO., LTD.
IT IS NOT TO BE COPIED OR USED IN ANY WAY DETRIMENTAL TO THE COMPANY.

Rev.	Date	Prepared	Checked	Approved	Details of Revision
1	16.07.2012	ILSIN	Y.LMIN	J.S.PARK	FOR CONSTRUCTION
2	09.04.2012	ILSIN	Y.LMIN	J.S.PARK	FOR COMMENT

Owner

AES-VCM MONG DUONG POWER COMPANY LIMITED


Consultant

POWER ENGINEERING CONSULTING JOINT STOCK COMPANY 2

Contractor

Doosan Heavy Industries & Construction Co., Ltd.


Project	MONG DUONG II 2x560MW(NET) COAL FIRED POWER PROJECT				Orig-Prj T10206
Drawn	05.10.2011	ILSIN	Y.LMIN	J.S.PARK	PC XG02
Checked	05.10.2011	ILSIN	Y.LMIN	J.S.PARK	Type ECN
Approved	05.10.2011	ILSIN	Y.LMIN	J.S.PARK	Contents Code P0
Dept.	Doosan Heavy Industries & Construction Co., Ltd.				Reg. No 680001
Drawing No.	T10206-XG02-POECN00-680001				Rev. 0
					Version 1/1

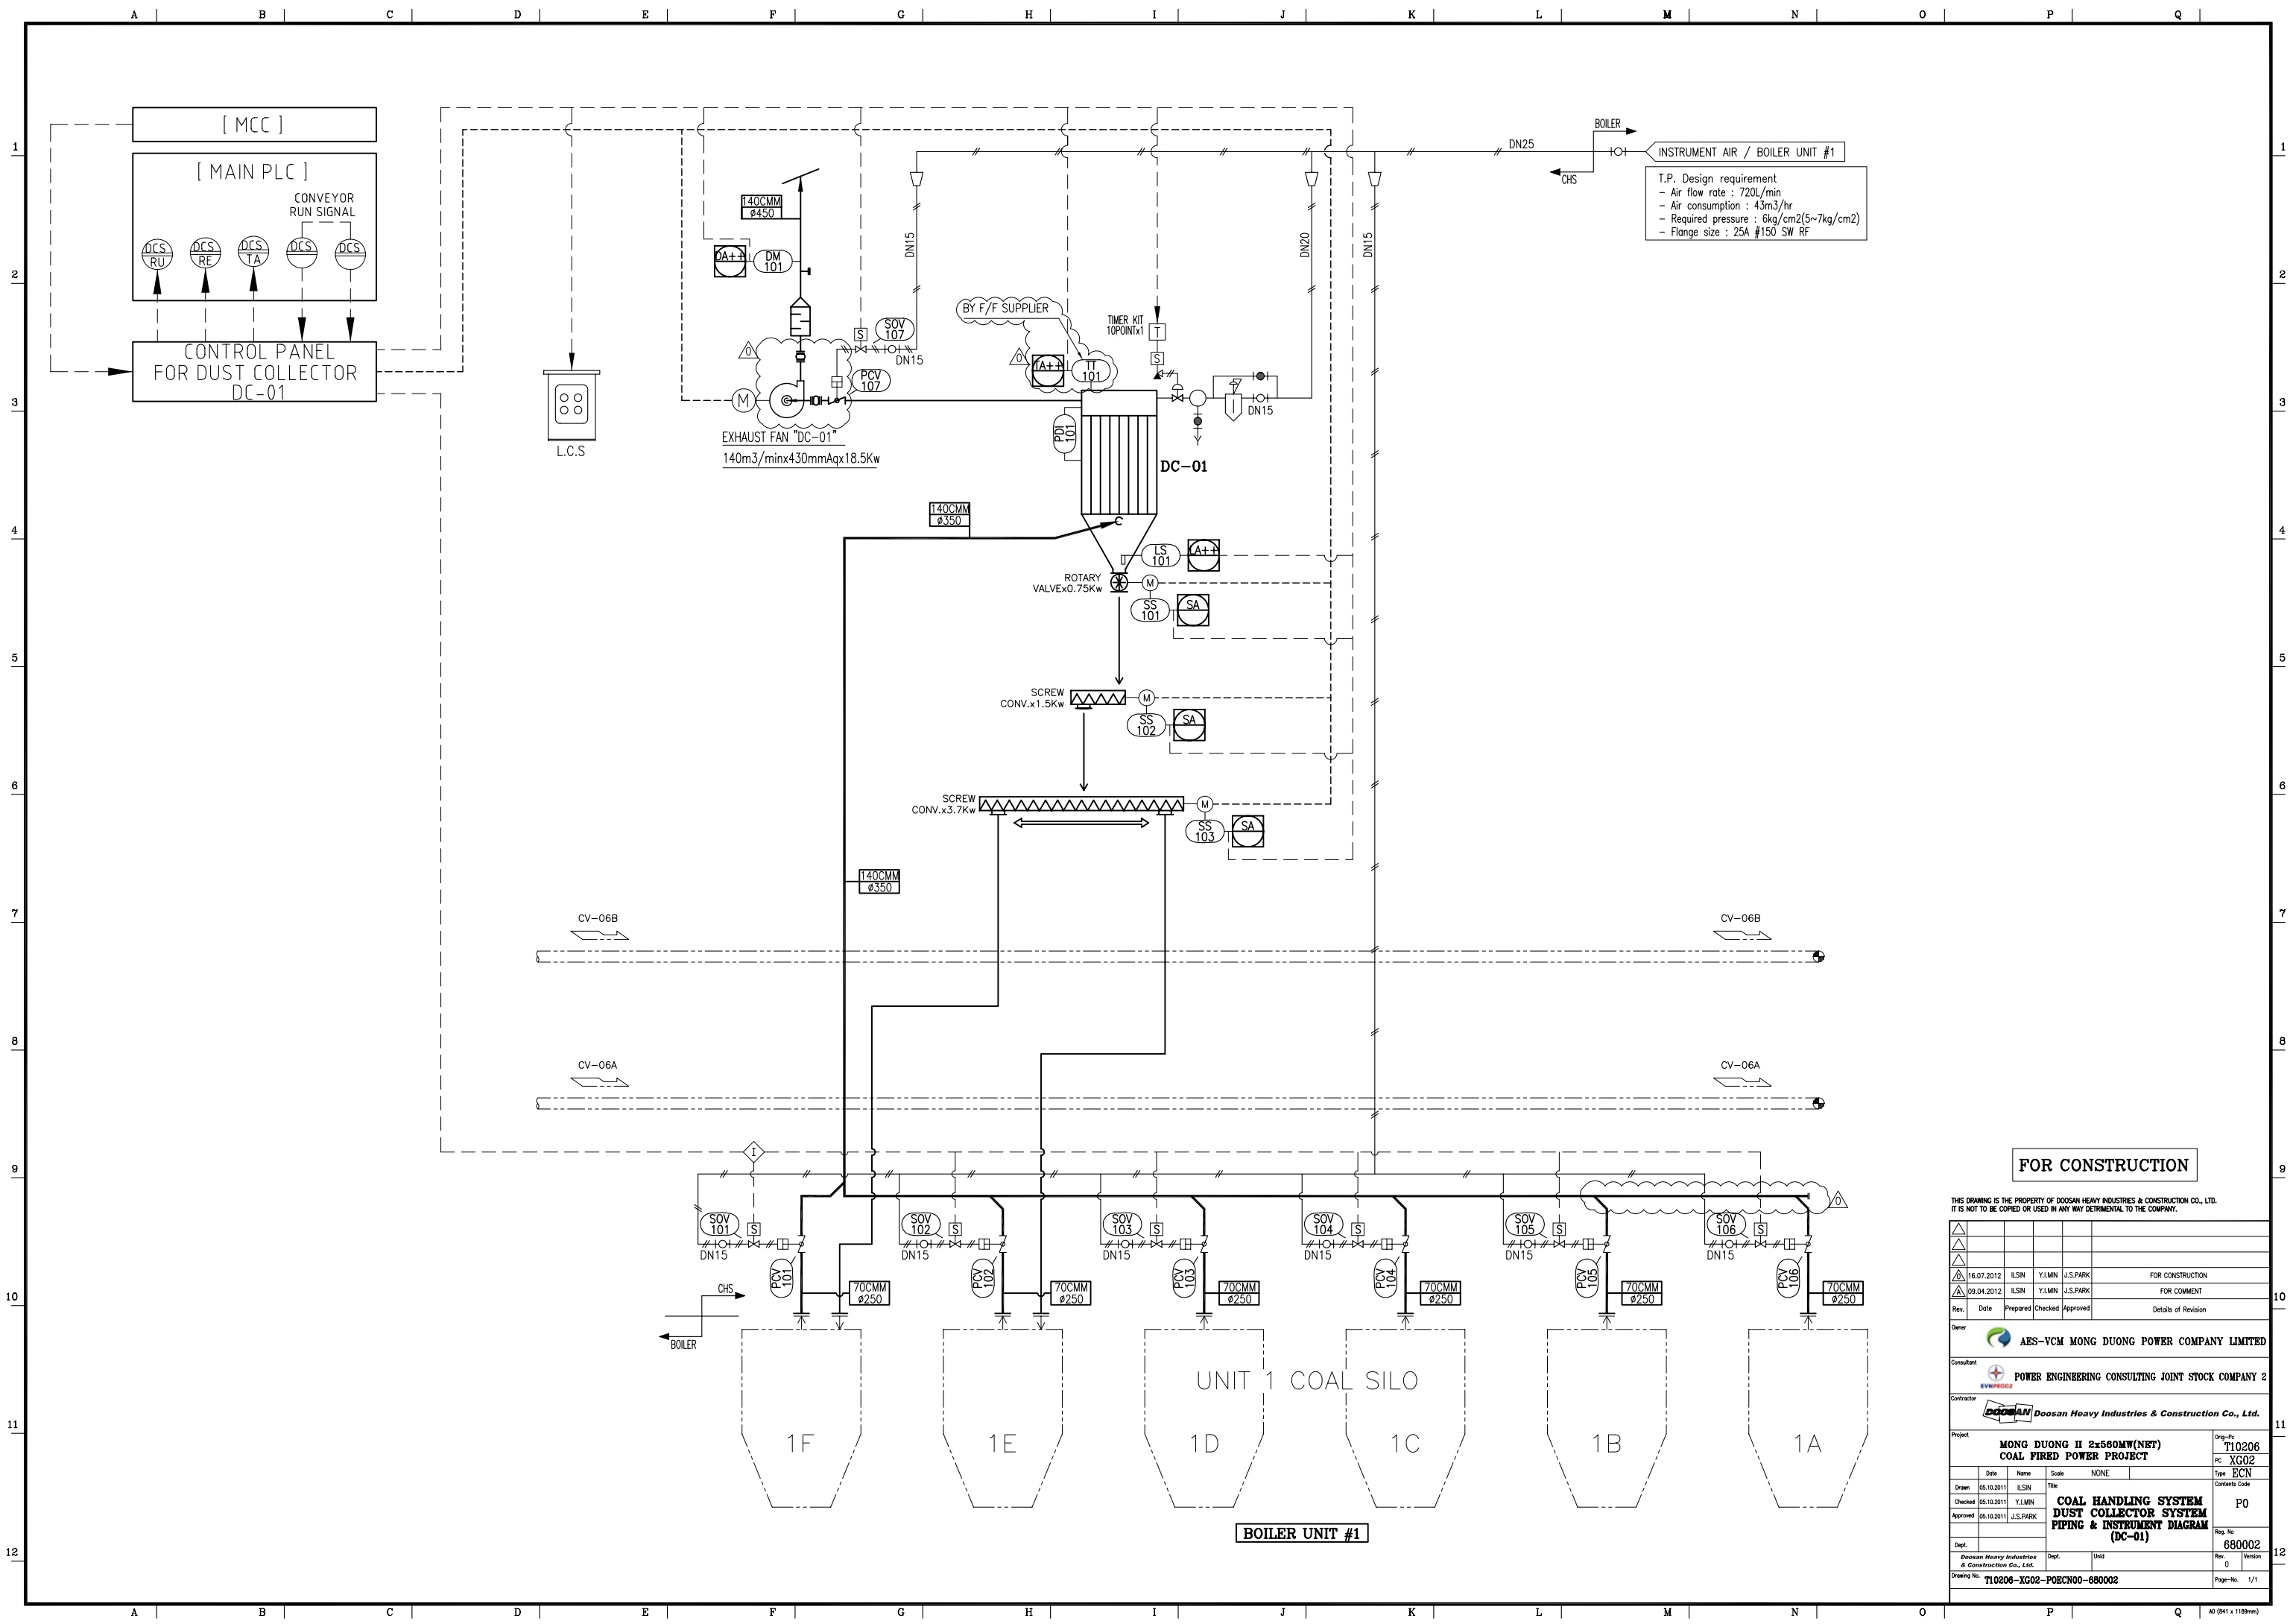

FOR CONSTRUCTION

THIS DRAWING IS THE PROPERTY OF DOOSAN HEAVY INDUSTRIES & CONSTRUCTION CO., LTD.
IT IS NOT TO BE COPIED OR USED IN ANY WAY DETRIMENTAL TO THE COMPANY.

△					
△					
△	16.07.2012	ILSIN	Y.I.MIN	J.S.PARK	FOR CONSTRUCTION
△	09.04.2012	ILSIN	Y.I.MIN	J.S.PARK	FOR COMMENT
Rev.	Date	Prepared	Checked	Approved	Details of Revision
Owner	AES-VCM MONG DUONG POWER COMPANY LIMITED				
Consultant	POWER ENGINEERING CONSULTING JOINT STOCK COMPANY 2				
Contractor	Doosan Heavy Industries & Construction Co., Ltd.				
Project	MONG DUONG II 2x560MW(NET) COAL FIRED POWER PROJECT				Orig. No. T10206
Drawn	05.10.2011	ILSIN	Y.I.MIN	J.S.PARK	PC XG02
Checked	05.10.2011	ILSIN	Y.I.MIN	J.S.PARK	Type ECN
Approved	05.10.2011	ILSIN	Y.I.MIN	J.S.PARK	Contents Code P0
Dept.	Doosan Heavy Industries & Construction Co., Ltd.				Reg. No. 680002
Drawing No.	T10206-XG02-POECN00-680002				Rev. 0
					Version 0
					Page-No. 1/1

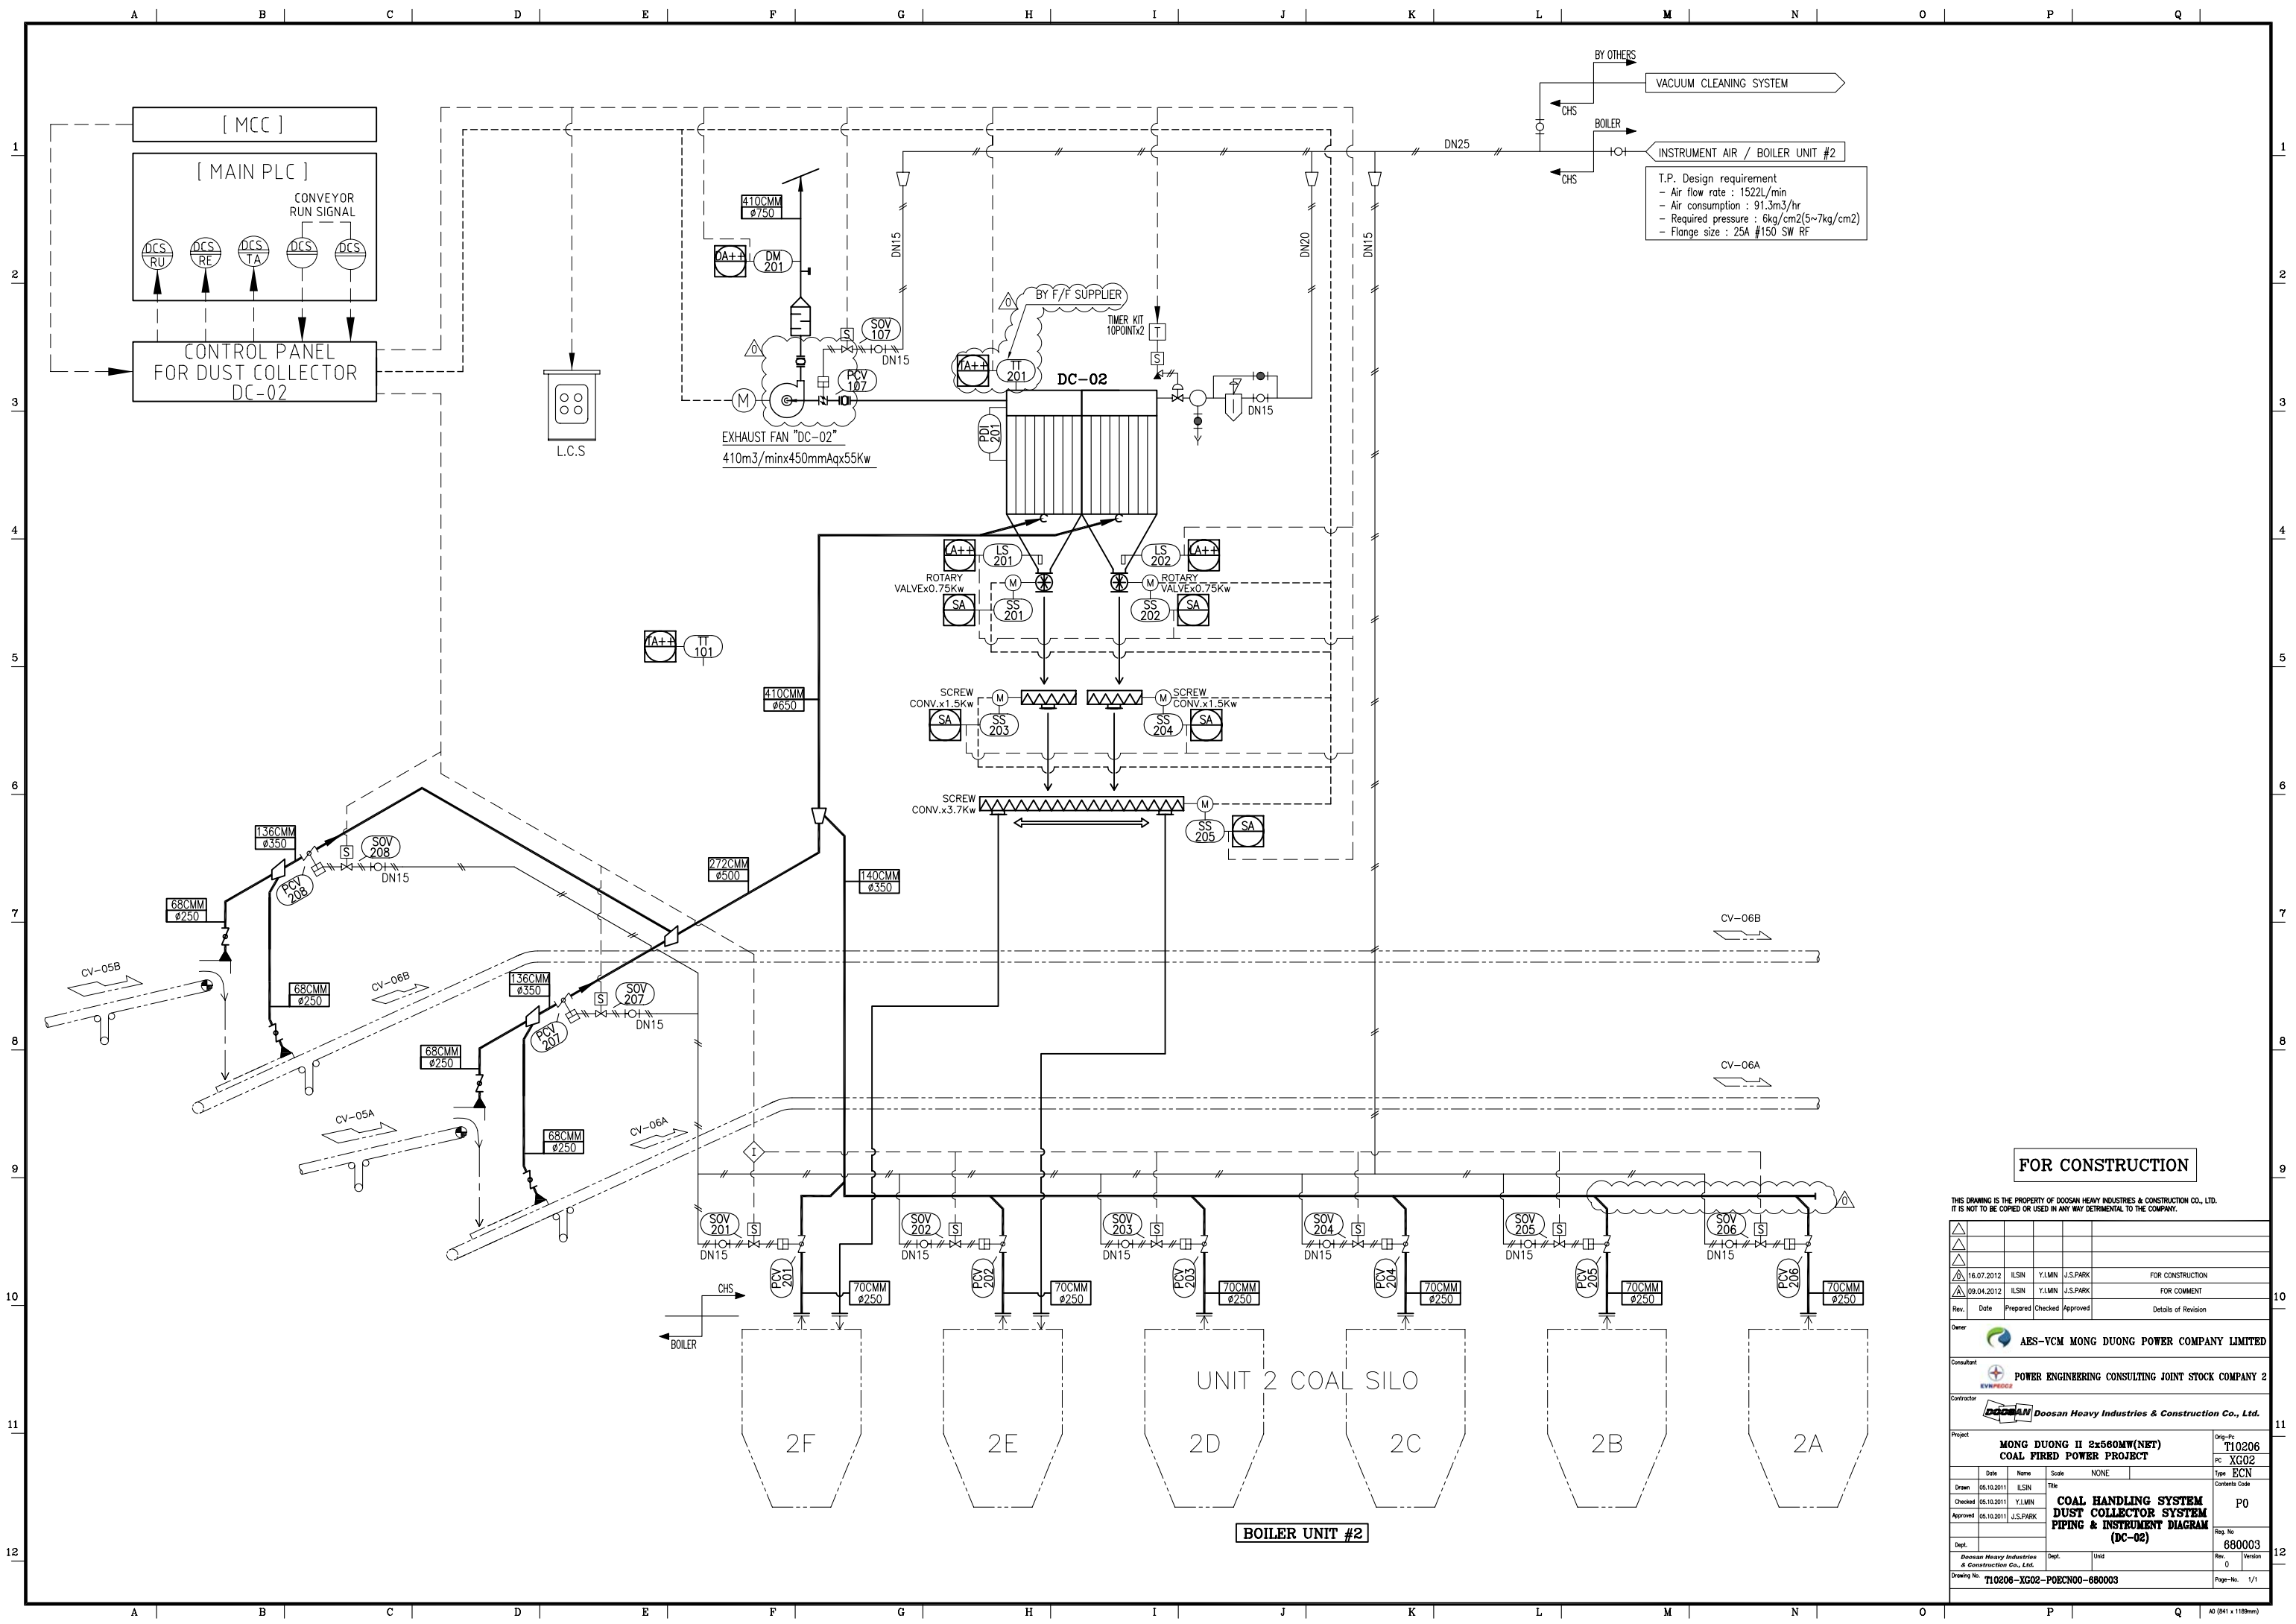

FOR CONSTRUCTION

THIS DRAWING IS THE PROPERTY OF DOOSAN HEAVY INDUSTRIES & CONSTRUCTION CO., LTD.
IT IS NOT TO BE COPIED OR USED IN ANY WAY DETRIMENTAL TO THE COMPANY.

Rev.	Date	Prepared	Checked	Approved	Details of Revision
1	16.07.2012	ILSIN	Y.LMIN	J.S.PARK	FOR CONSTRUCTION
2	09.04.2012	ILSIN	Y.LMIN	J.S.PARK	FOR COMMENT
Owner					
AES-VCM MONG DUONG POWER COMPANY LIMITED					
Consultant					
POWER ENGINEERING CONSULTING JOINT STOCK COMPANY 2					
Contractor					
Doosan Heavy Industries & Construction Co., Ltd.					
Project					Original
MONG DUONG II 2x560MW(NET)					T10206
COAL FIRED POWER PROJECT					PC_XG02
Drawn	05.10.2011	ILSIN	Scale	NONE	Type
Checked	05.10.2011	Y.LMIN	Title		ECN
Approved	05.10.2011	J.S.PARK			
Contents Code					P0
Dept.					Reg. No
Doosan Heavy Industries & Construction Co., Ltd.					680003
Drawing No.					Rev.
T10206-XG02-POECN00-680003					0
					Version
					1/1