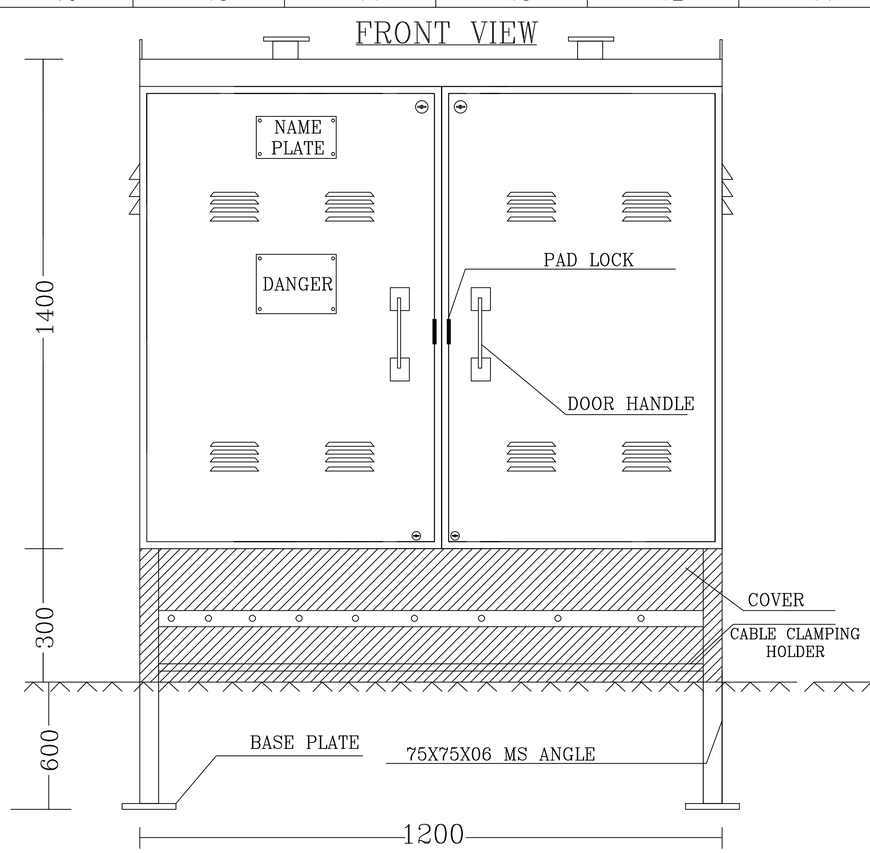

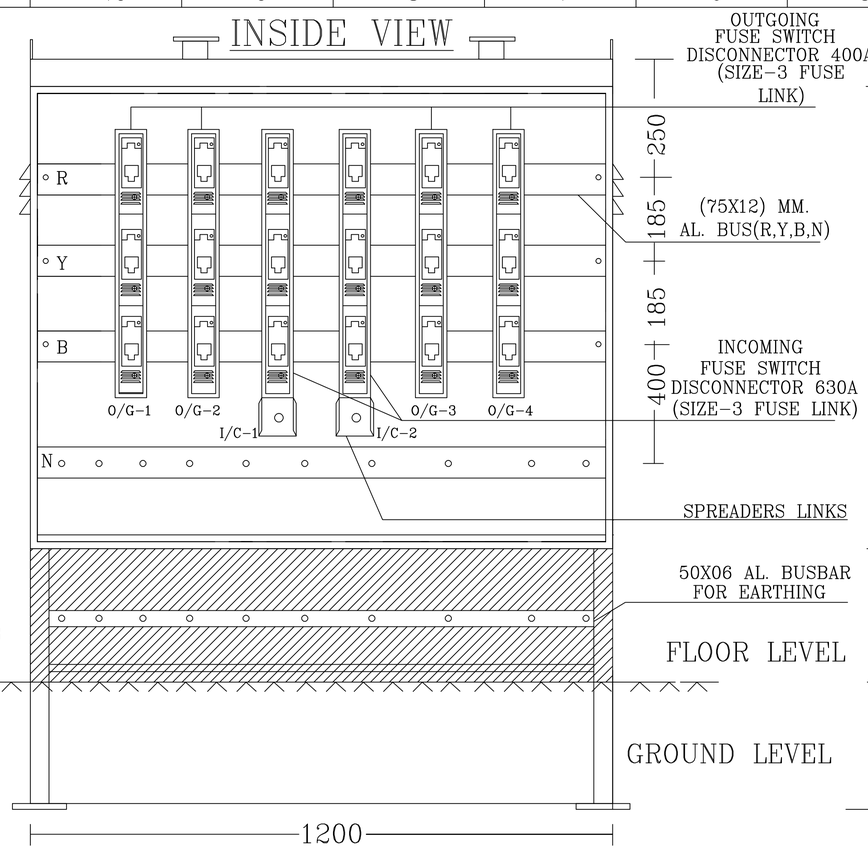

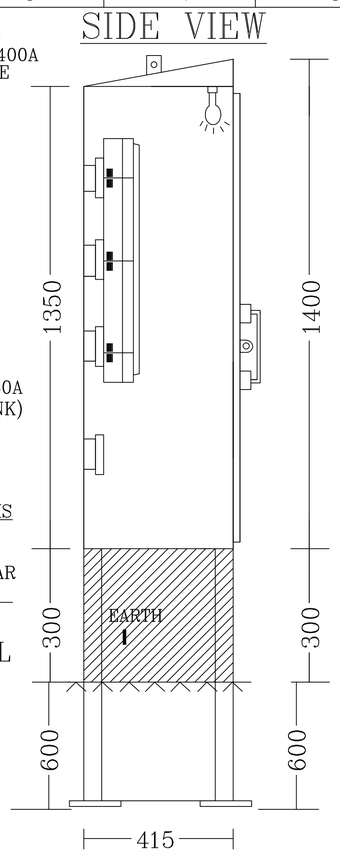

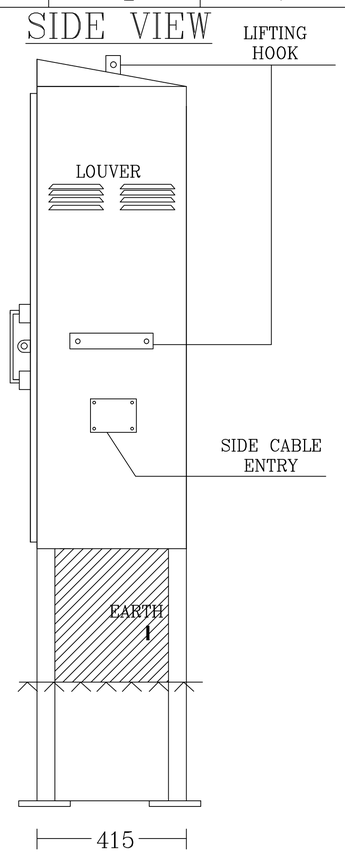

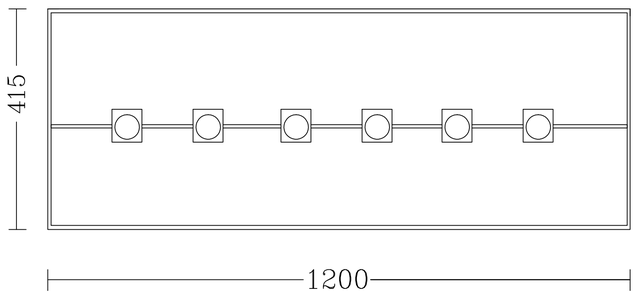

GLAND PLATE

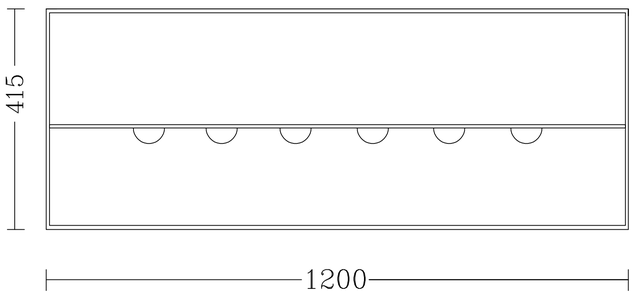

CABLE CAMP DETAILS

General Notes :

1. All dimensions are in mm. unless otherwise stated.
   The panel will be made on 3.15mm thick crca sheet steel.
2. Degree of protection : IP-43.
3. All opening shall be covered by foam rubber gasket.
4. Enclosure shall be painted by light gray-631.
5. Feeder/board tally plates are of anodised with engraved lettering.
6. Door shall be earthed with pvc insulated multistrand copper wire.
7. Aluminum Busbar size: 75 x 12 AL. busbar for phases
   75 x 12 AL. busbar for neutral
   50 x 06 x 01 AL. busbar for earthing.
8. Dimensions may be changed during manufacturing.



COVER ON ANGLE FRAME

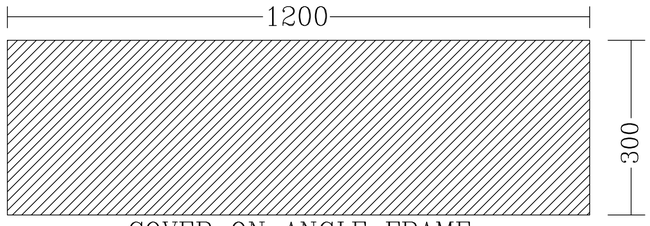

COVER ON ANGLE FRAME

	NAME	DATE
DRAWN	SOUMAVA GOSWAMI	14.08.2021
CHECKED	HALDER	14.08.2021
APPROVED	N.D	14.08.2021

MFG.BY : AMIT PROJECT & CONTROLS
KOLKATA (CPRI TESTED)
AN ISO-9001 : 2015 COMPANY
8 PAGLADANGA ROAD,KOL-105

CLIENT: WBSEDCL

VENDOR NAME- M.M.BROTHERS

AGENCY NAME- ASHIKA INFRA PROJECTS PVT. LTD.

PROJECT-

TITLE: 6WAY LT FEEDER PILLAR(900A)

DRG. NO. APC21/AIL/4387

SHEET: 1 OF 2 | TOTAL SHEET : 2

REV.-0	DATE:
REV.-1	DATE:
REV.-2	DATE:
REV.-3	DATE:

The copying, distribution and utilization of this document offenders will be held liable for the payment of damages

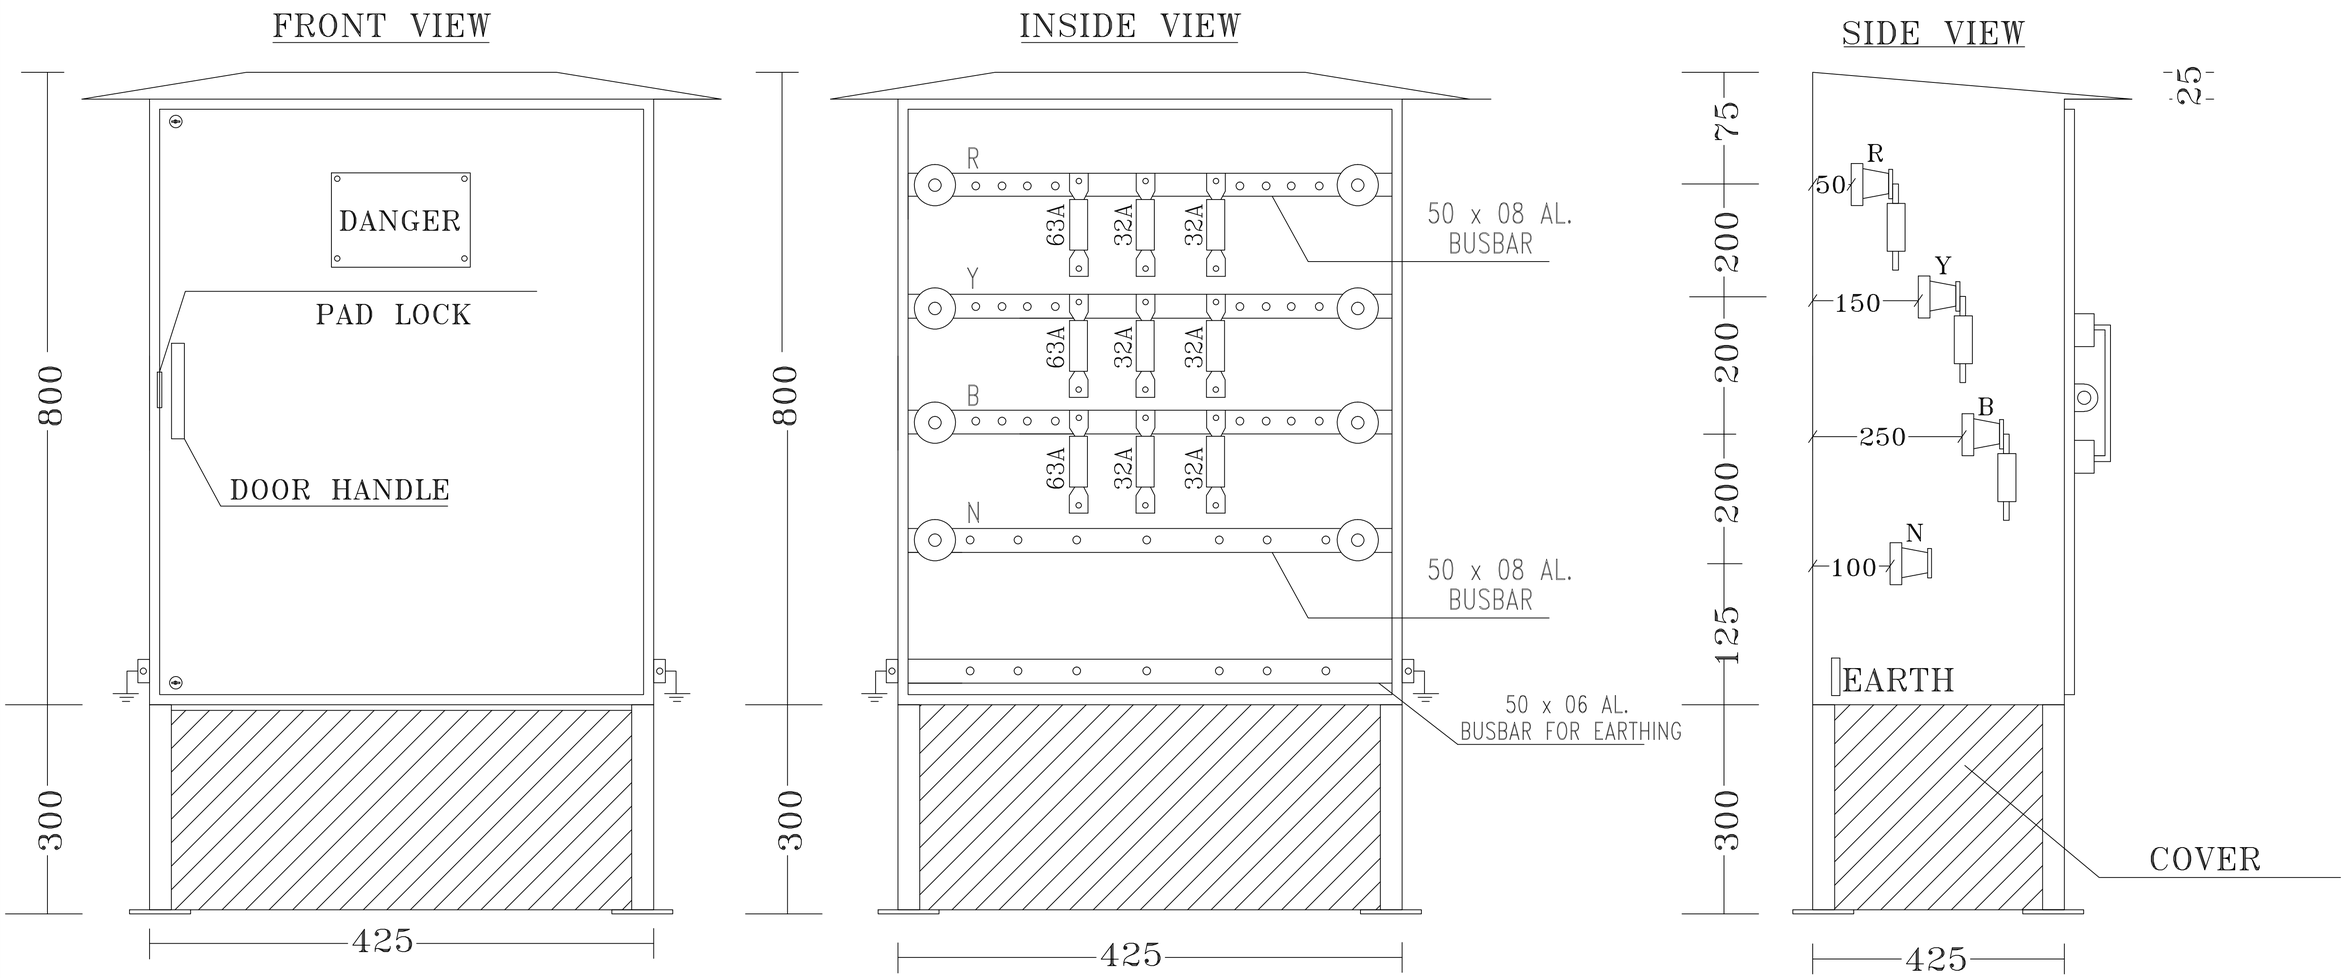

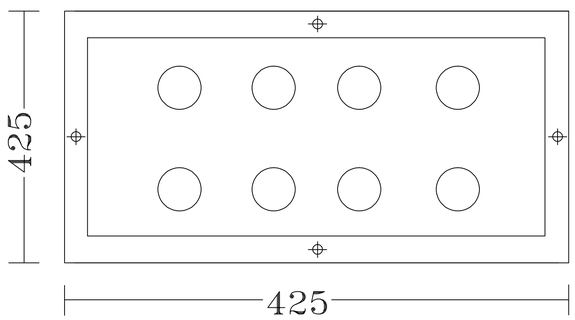

BOTTOM VIEW

General Notes :

1. All dimensions are in mm. unless otherwise stated.
   The panel will be made on 2.5mm thick crca sheet steel.
2. Degree of protection : IP-43.
3. All opening shall be covered by foam rubber gasket.
4. Enclosure shall be painted by light gray-631.
5. Feeder/board tally plates are of anodised with engraved lettering.
6. Door shall be earthed with pvc insulated multistrand copper wire.
7. Aluminum Busbar size: 50 x 08 AL. busbar for phases
   50 x 08 AL. busbar for neutral
   50 x 06 x 01 g.i. busbar for earthing.
8. Dimensions may be changed during manufacturing.

200A OUTDOOR SERVICE JUNCTION BOX (QTY - 5000)				
	INCOMER FEDER			
1	PORCELIN KITKAT FUSE (63A)	3	NOS	REPUTED
2	PORCELIN KITKAT FUSE (32A)	6	NOS	REPUTED

	NAME	DATE
DRAWN	SOUMAVA GOSWAMI	14.08.2021
CHECKED	HALDER	14.08.2021
APPROVED	N.D	14.08.2021

MFG.BY : AMIT PROJECT & CONTROLS
KOLKATA (CPRI TESTED)
AN ISO-9001 : 2008 COMPANY
8 PAGLADANGA ROAD,KOL-105

APC

CLIENT: WBSEDCL

VENDOR NAME- M.M.BROTHERS

AGENCY NAME- ASHIKA INFRA PROJECTS PVT. LTD.

PROJECT-

TITLE: 200A SERVICE JUNCTION BOX

DRG. NO. APC21/AIL/4389

SHEET: 1 OF 1 | TOTAL SHEET : 2

NOT TO SCALE

REV.-0	DATE:
REV.-1	DATE:
REV.-2	DATE:
REV.-3	DATE:

The copying, distribution and utilization of this document offenders will be held liable for the payment of damages