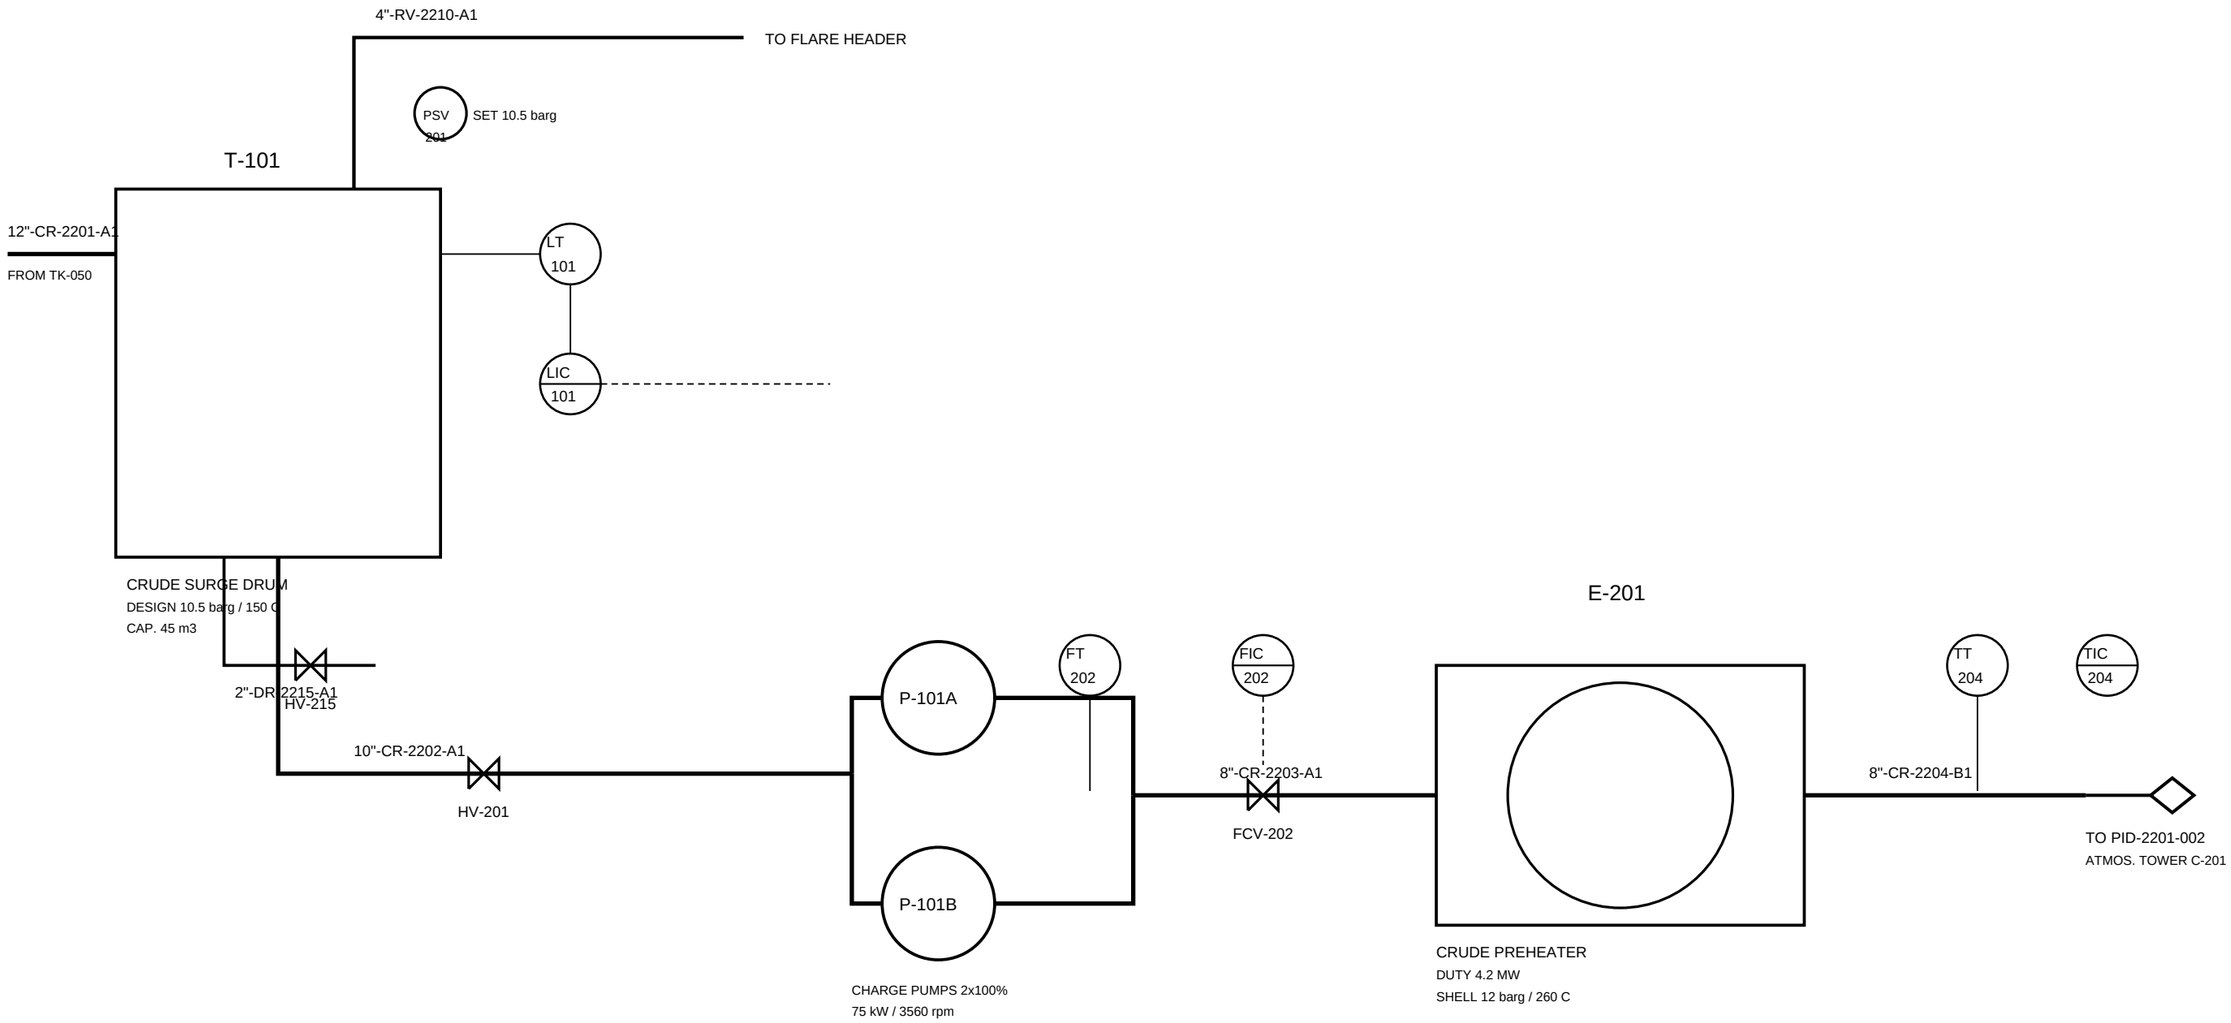

NOTES:

1. ALL LINES TO BE HYDROTESTED PER SPEC PS-1100.
2. PUMP P-101B IS INSTALLED SPARE, AUTO-START ON LOW DISCHARGE PRESSURE.
3. PSV-201 DISCHARGES TO THE UNIT 2200 FLARE HEADER.
4. INSULATION: H = HOT SERVICE, P = PERSONNEL PROTECTION.

LEGEND

--- PROCESS LINE
- - ELECTRICAL SIGNAL
(O) FIELD INSTRUMENT
(-) PANEL MOUNTED INSTRUMENT

PIPING & INSTRUMENTATION DIAGRAM
CRUDE FEED SURGE & CHARGE PUMPS

DWG No. PID-2201-001 REV 3
SHEET 1 OF 4

UNIT 2200 - CRUDE DISTILLATION DATE: 2026-03-14
CLIENT: NORTHPORT REFINING SCALE: NTS