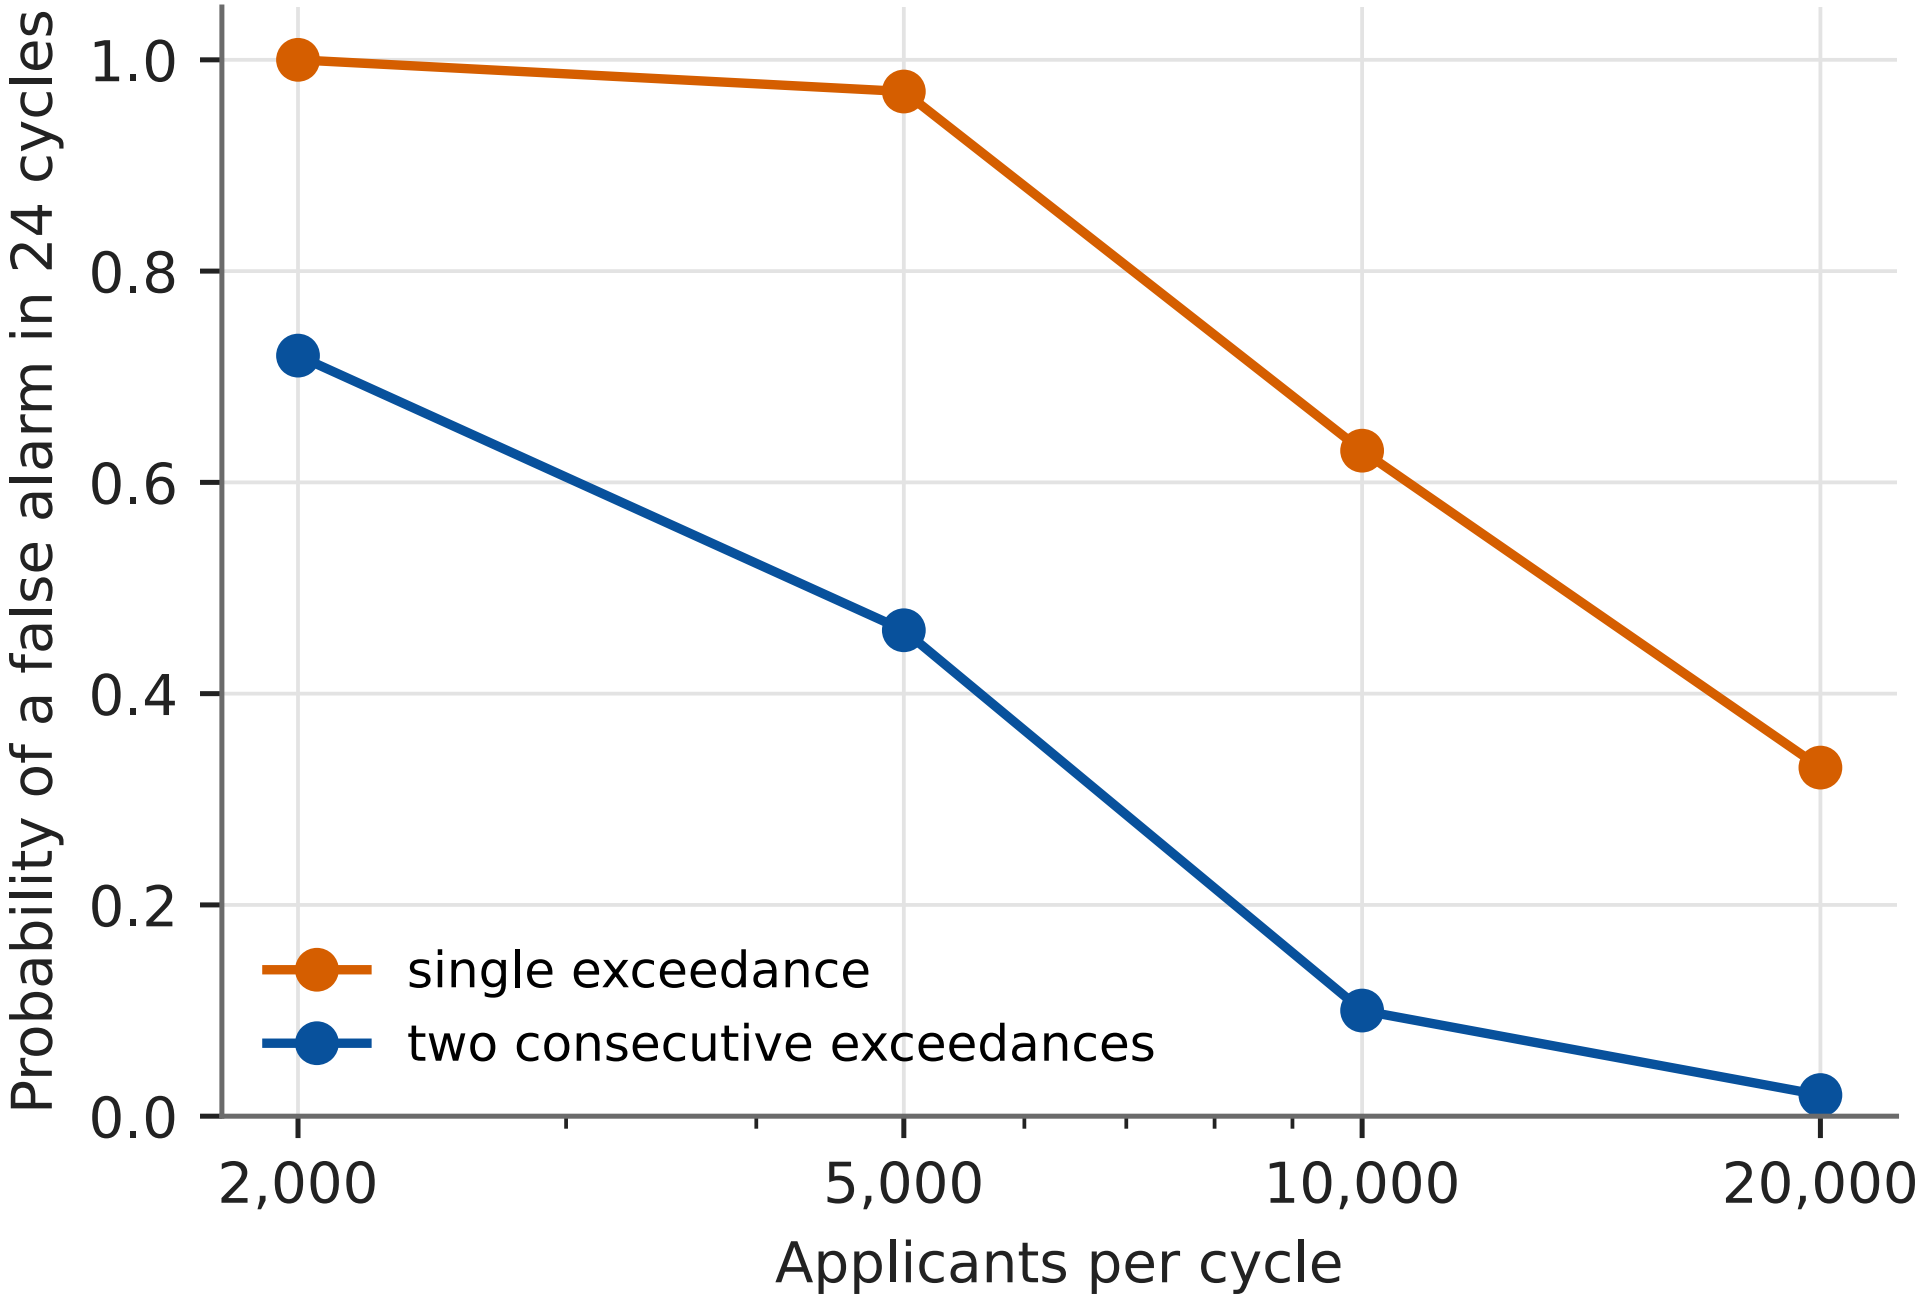
Probability of a false alarm in 24 cycles
1.0
0.8
0.6
0.4
0.2
0.0
single exceedance
two consecutive exceedances
2,000
5,000
10,000
20,000
Applicants per cycle