


# Switch customer-enclosure requirement

SABLE HARBOR | 2026-09-11 | SYNTHETIC DESIGN / PROCUREMENT PENDING

Aggregate: 126 U / 96.4 kW peak / 11 racks

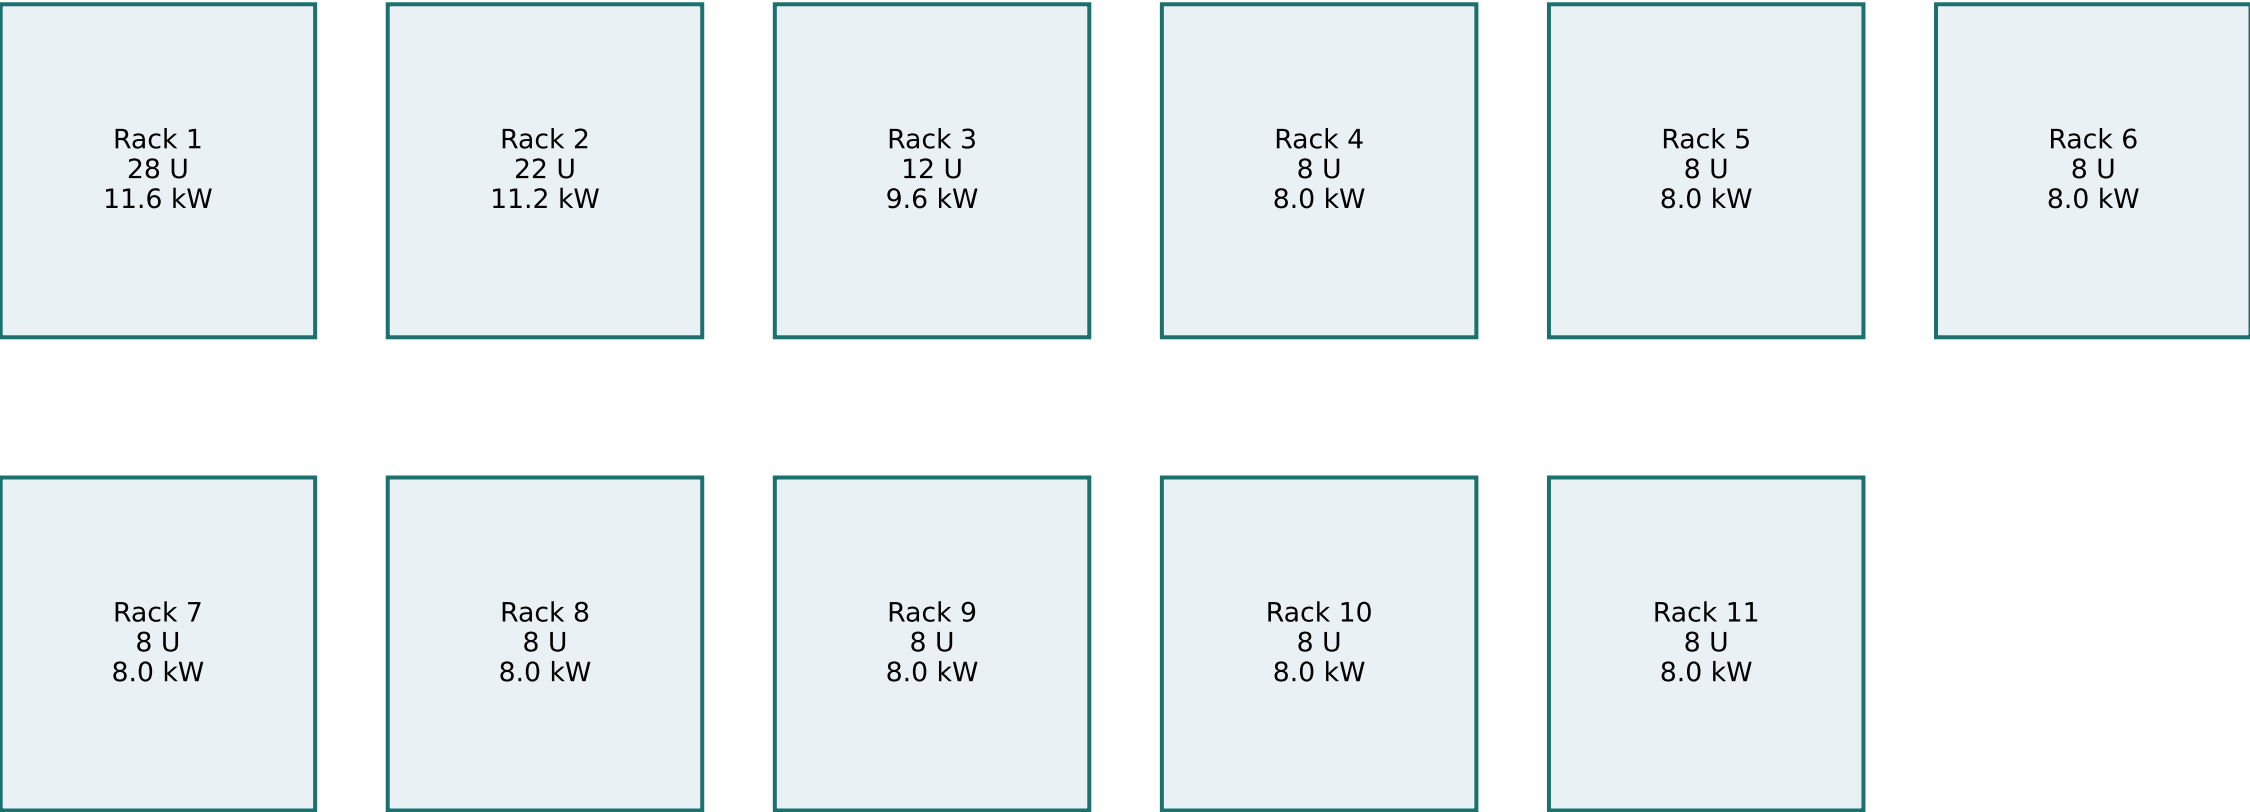

Controlled aisle, separate A/B and management paths; final rack placement unaccepted

Concept only; no engineering approval, assigned provider space or constructed facility.

Source: runtime\_sites / runtime\_capital\_plan 2026-09-11 • Generated by enterprise/runtime/render.py