


SENSITIVITY (Dutch session durations; primary: f19_capacity_threshold_dc). Where the 8-port, 100 kW station breaks, by arm
 Point = mean (left) or P95 over 50 seeds (right); bar = 95% CI, cluster bootstrap over 50 scenario seeds

Demand not served, lower bound (% of requested energy)

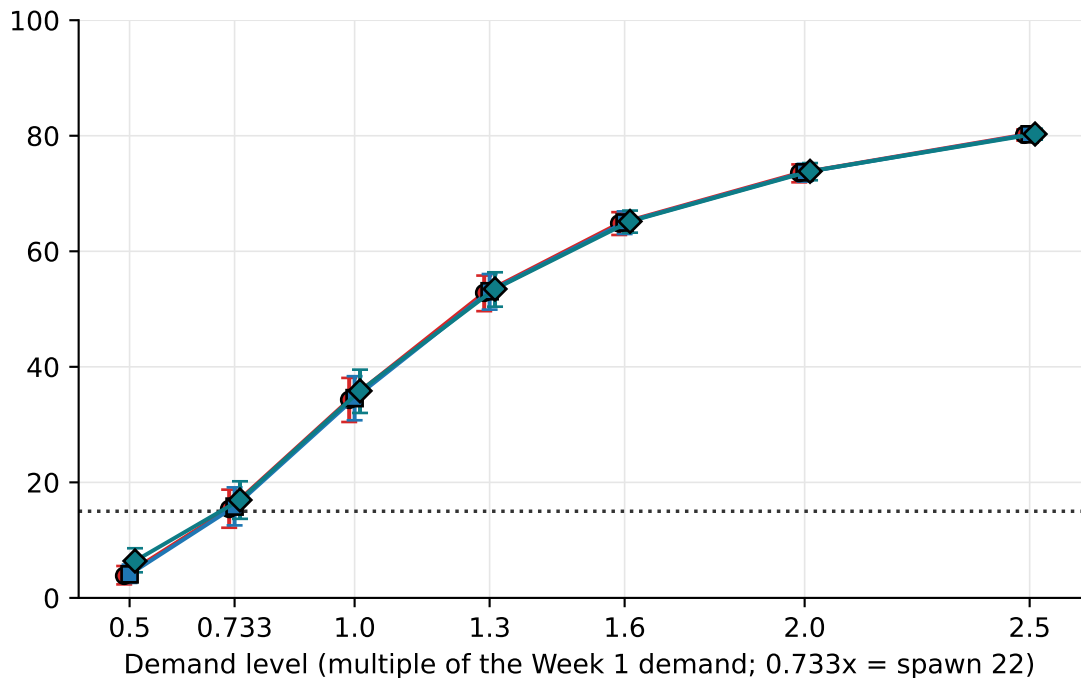

..... Target: demand not served < 15%

● AFAP

■ Round Robin

◆ TD3 extended seed 102 (final RL)

..... Transformer limit, 100 kW

95th-percentile per-seed peak station power (kW)

