
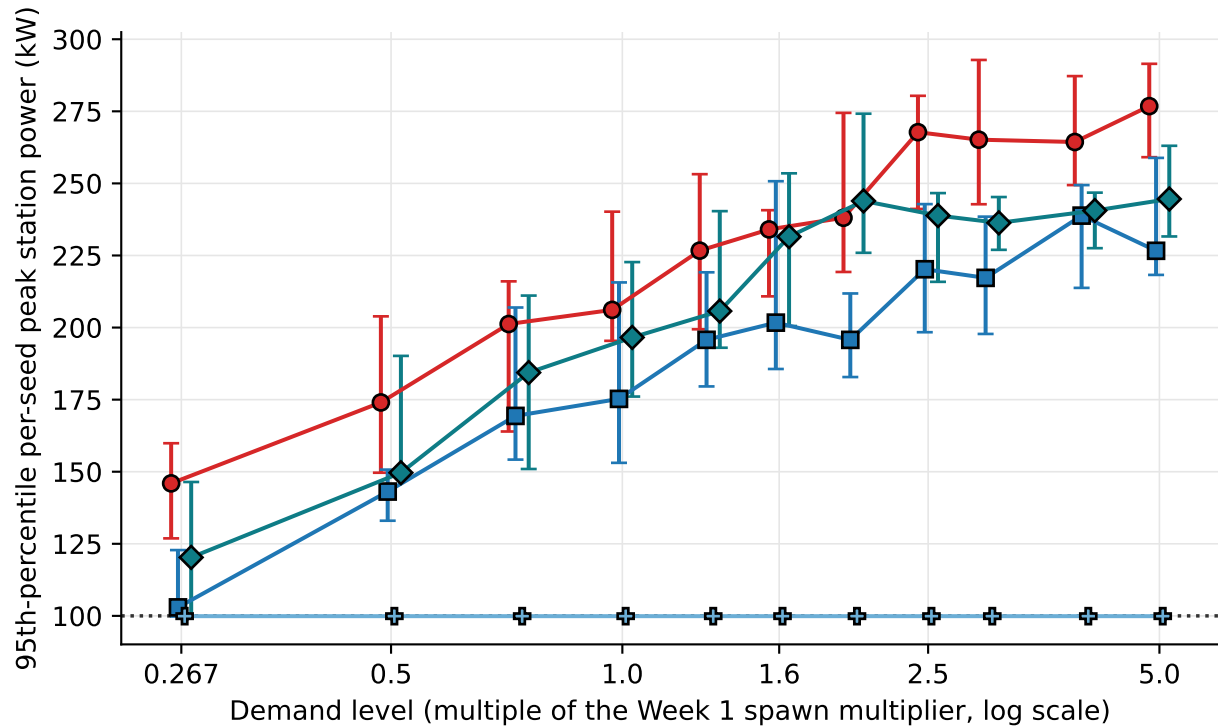


Where the 8-port, 100 kW station breaks under 42-minute DC sessions (primary model)
 Point = mean (left) or P95 over 50 seeds (right); bar = 95% CI, cluster bootstrap over 50 scenario seeds

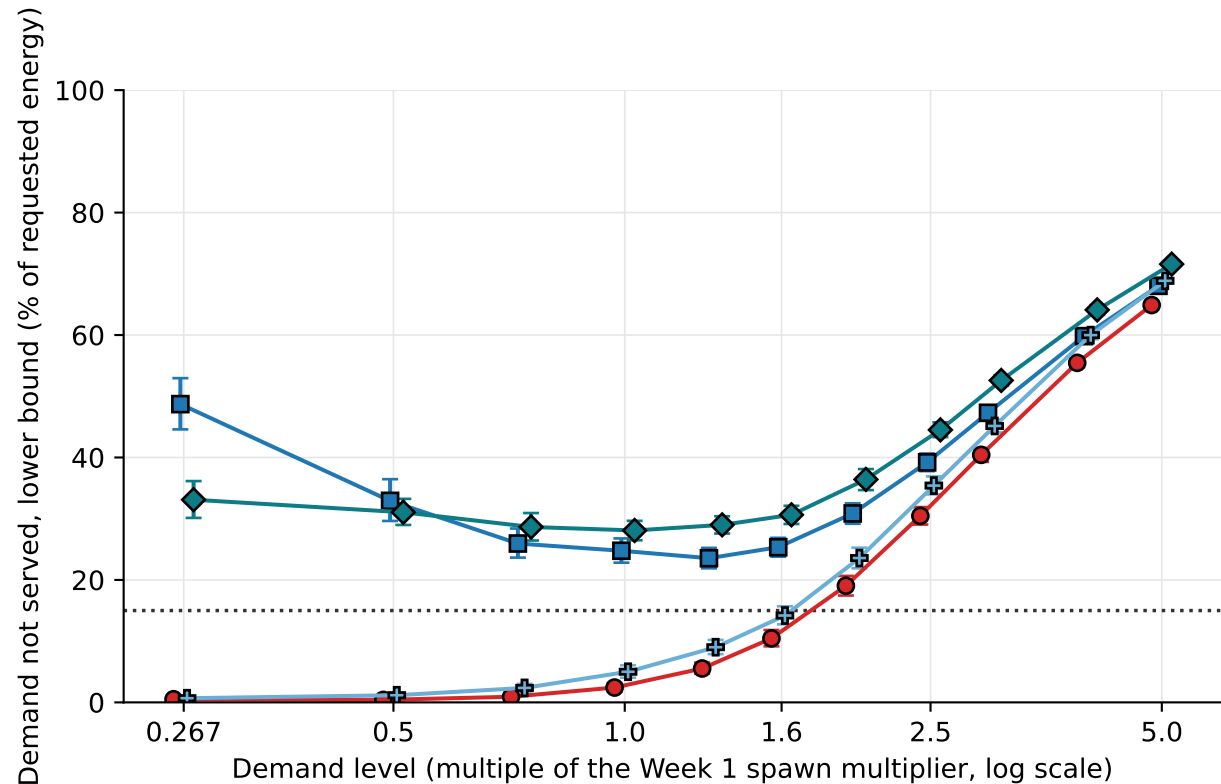

..... Target: demand not served < 15%
 Transformer limit, 100 kW
 Round Robin (EV2Gym, follows the setpoint)
 Round Robin, transformer-aware
 Final RL model (out of training distribution)