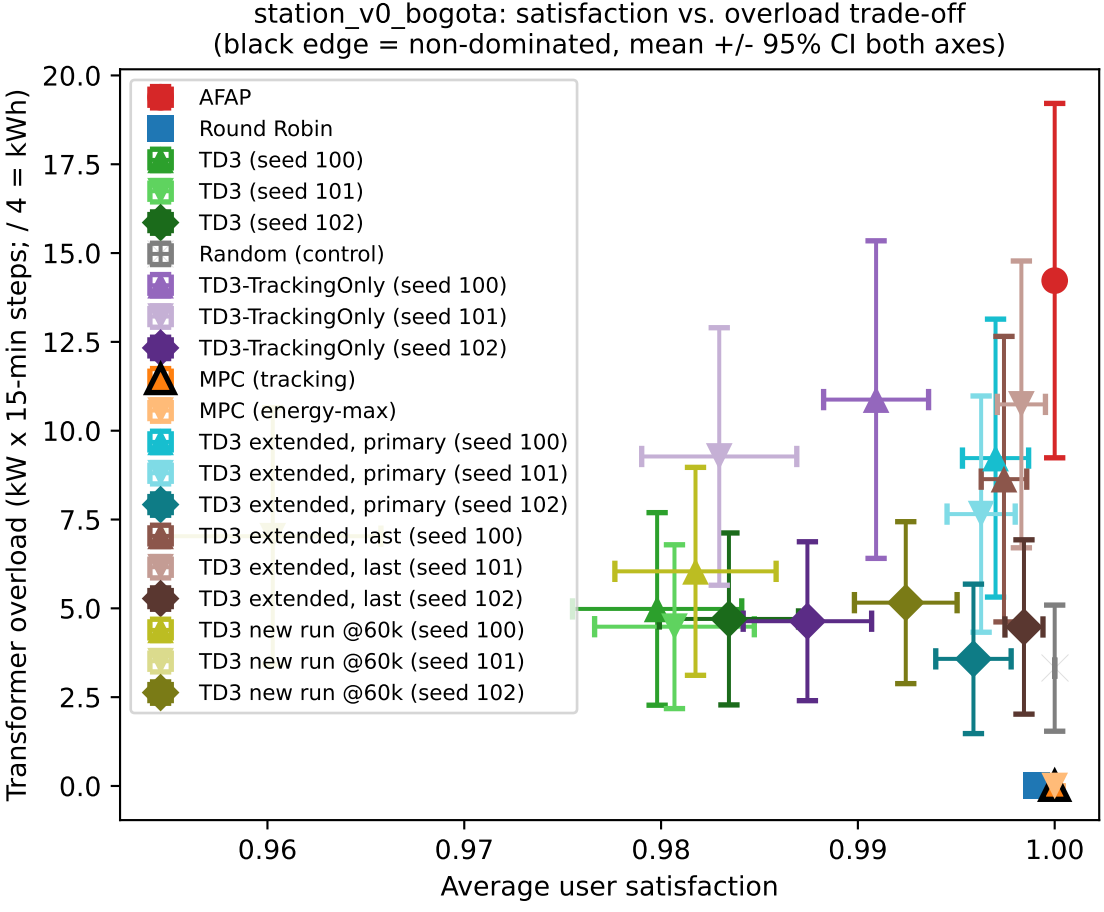
station_v0_bogota: satisfaction vs. overload trade-off
(black edge = non-dominated, mean +/- 95% CI both axes)
Transformer overload (kW x 15-min steps; / 4 = kWh)
Average user satisfaction
20.0
17.5
15.0
12.5
10.0
7.5
5.0
2.5
0.0
0.96
0.97
0.98
0.99
1.00
AFAP
Round Robin
TD3 (seed 100)
TD3 (seed 101)
TD3 (seed 102)
Random (control)
TD3-TrackingOnly (seed 100)
TD3-TrackingOnly (seed 101)
TD3-TrackingOnly (seed 102)
MPC (tracking)
MPC (energy-max)
TD3 extended, primary (seed 100)
TD3 extended, primary (seed 101)
TD3 extended, primary (seed 102)
TD3 extended, last (seed 100)
TD3 extended, last (seed 101)
TD3 extended, last (seed 102)
TD3 new run @60k (seed 100)
TD3 new run @60k (seed 101)
TD3 new run @60k (seed 102)