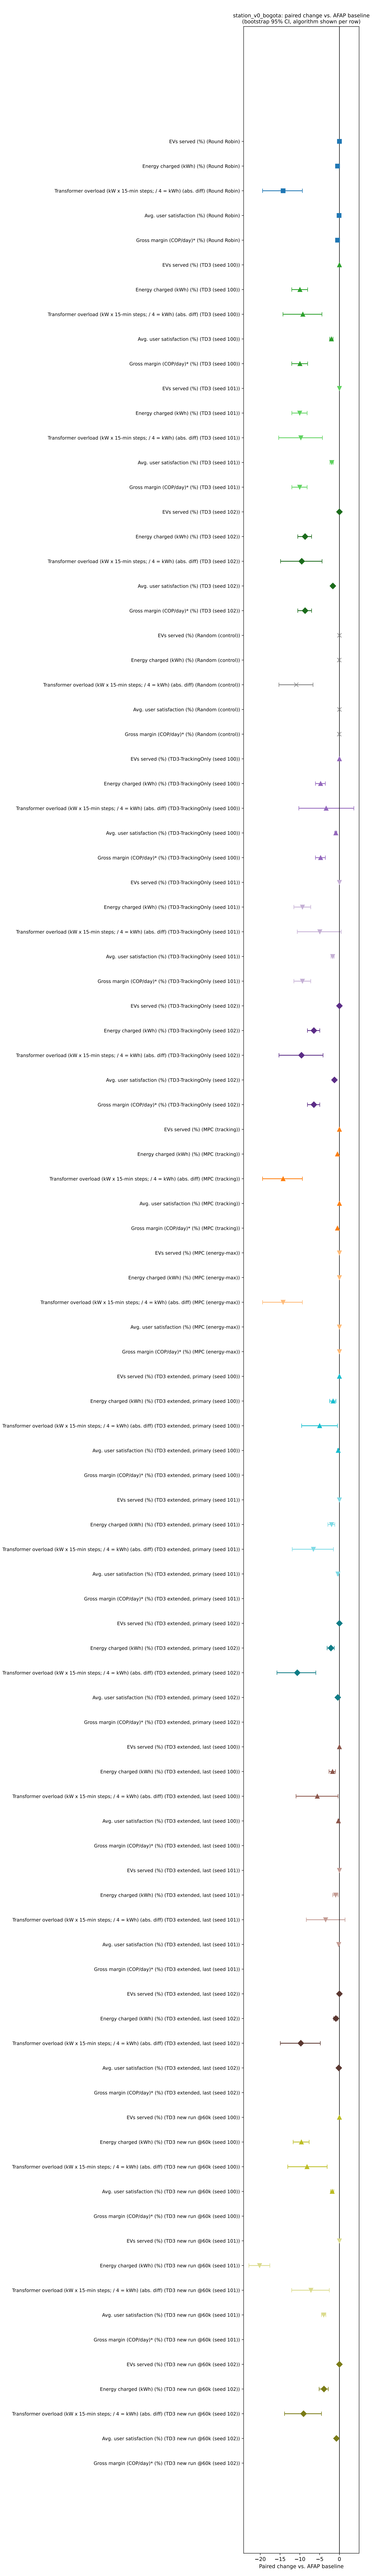
station_v0_bogota: paired change vs. AFAP baseline
(bootstrap 95% CI, algorithm shown per row)
EVs served (%) (Round Robin)
Energy charged (kWh) (%) (Round Robin)
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (Round Robin)
Avg. user satisfaction (%) (Round Robin)
Gross margin (COP/day)* (%) (Round Robin)
EVs served (%) (TD3 (seed 100))
Energy charged (kWh) (%) (TD3 (seed 100))
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (TD3 (seed 100))
Avg. user satisfaction (%) (TD3 (seed 100))
Gross margin (COP/day)* (%) (TD3 (seed 100))
EVs served (%) (TD3 (seed 101))
Energy charged (kWh) (%) (TD3 (seed 101))
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (TD3 (seed 101))
Avg. user satisfaction (%) (TD3 (seed 101))
Gross margin (COP/day)* (%) (TD3 (seed 101))
EVs served (%) (TD3 (seed 102))
Energy charged (kWh) (%) (TD3 (seed 102))
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (TD3 (seed 102))
Avg. user satisfaction (%) (TD3 (seed 102))
Gross margin (COP/day)* (%) (TD3 (seed 102))
EVs served (%) (Random (control))
Energy charged (kWh) (%) (Random (control))
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (Random (control))
Avg. user satisfaction (%) (Random (control))
Gross margin (COP/day)* (%) (Random (control))
EVs served (%) (TD3-TrackingOnly (seed 100))
Energy charged (kWh) (%) (TD3-TrackingOnly (seed 100))
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (TD3-TrackingOnly (seed 100))
Avg. user satisfaction (%) (TD3-TrackingOnly (seed 100))
Gross margin (COP/day)* (%) (TD3-TrackingOnly (seed 100))
EVs served (%) (TD3-TrackingOnly (seed 101))
Energy charged (kWh) (%) (TD3-TrackingOnly (seed 101))
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (TD3-TrackingOnly (seed 101))
Avg. user satisfaction (%) (TD3-TrackingOnly (seed 101))
Gross margin (COP/day)* (%) (TD3-TrackingOnly (seed 101))
EVs served (%) (TD3-TrackingOnly (seed 102))
Energy charged (kWh) (%) (TD3-TrackingOnly (seed 102))
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (TD3-TrackingOnly (seed 102))
Avg. user satisfaction (%) (TD3-TrackingOnly (seed 102))
Gross margin (COP/day)* (%) (TD3-TrackingOnly (seed 102))
EVs served (%) (MPC (tracking))
Energy charged (kWh) (%) (MPC (tracking))
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (MPC (tracking))
Avg. user satisfaction (%) (MPC (tracking))
Gross margin (COP/day)* (%) (MPC (tracking))
EVs served (%) (MPC (energy-max))
Energy charged (kWh) (%) (MPC (energy-max))
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (MPC (energy-max))
Avg. user satisfaction (%) (MPC (energy-max))
Gross margin (COP/day)* (%) (MPC (energy-max))
EVs served (%) (TD3 extended, primary (seed 100))
Energy charged (kWh) (%) (TD3 extended, primary (seed 100))
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (TD3 extended, primary (seed 100))
Avg. user satisfaction (%) (TD3 extended, primary (seed 100))
Gross margin (COP/day)* (%) (TD3 extended, primary (seed 100))
EVs served (%) (TD3 extended, primary (seed 101))
Energy charged (kWh) (%) (TD3 extended, primary (seed 101))
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (TD3 extended, primary (seed 101))
Avg. user satisfaction (%) (TD3 extended, primary (seed 101))
Gross margin (COP/day)* (%) (TD3 extended, primary (seed 101))
EVs served (%) (TD3 extended, primary (seed 102))
Energy charged (kWh) (%) (TD3 extended, primary (seed 102))
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (TD3 extended, primary (seed 102))
Avg. user satisfaction (%) (TD3 extended, primary (seed 102))
Gross margin (COP/day)* (%) (TD3 extended, primary (seed 102))
EVs served (%) (TD3 extended, last (seed 100))
Energy charged (kWh) (%) (TD3 extended, last (seed 100))
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (TD3 extended, last (seed 100))
Avg. user satisfaction (%) (TD3 extended, last (seed 100))
Gross margin (COP/day)* (%) (TD3 extended, last (seed 100))
EVs served (%) (TD3 extended, last (seed 101))
Energy charged (kWh) (%) (TD3 extended, last (seed 101))
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (TD3 extended, last (seed 101))
Avg. user satisfaction (%) (TD3 extended, last (seed 101))
Gross margin (COP/day)* (%) (TD3 extended, last (seed 101))
EVs served (%) (TD3 extended, last (seed 102))
Energy charged (kWh) (%) (TD3 extended, last (seed 102))
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (TD3 extended, last (seed 102))
Avg. user satisfaction (%) (TD3 extended, last (seed 102))
Gross margin (COP/day)* (%) (TD3 extended, last (seed 102))
EVs served (%) (TD3 new run @60k (seed 100))
Energy charged (kWh) (%) (TD3 new run @60k (seed 100))
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (TD3 new run @60k (seed 100))
Avg. user satisfaction (%) (TD3 new run @60k (seed 100))
Gross margin (COP/day)* (%) (TD3 new run @60k (seed 100))
EVs served (%) (TD3 new run @60k (seed 101))
Energy charged (kWh) (%) (TD3 new run @60k (seed 101))
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (TD3 new run @60k (seed 101))
Avg. user satisfaction (%) (TD3 new run @60k (seed 101))
Gross margin (COP/day)* (%) (TD3 new run @60k (seed 101))
EVs served (%) (TD3 new run @60k (seed 102))
Energy charged (kWh) (%) (TD3 new run @60k (seed 102))
Transformer overload (kW x 15-min steps; / 4 = kWh) (abs. diff) (TD3 new run @60k (seed 102))
Avg. user satisfaction (%) (TD3 new run @60k (seed 102))
Gross margin (COP/day)* (%) (TD3 new run @60k (seed 102))
−20
−15
−10
−5
0
Paired change vs. AFAP baseline