



Where the 8-port, 100 kW station breaks: demand not served (left) and peak power (right), by arm
 Point = mean (left) or P95 over 50 seeds (right); bar = 95% CI, cluster bootstrap over 50 scenario seeds

Demand not served, lower bound (% of requested energy)

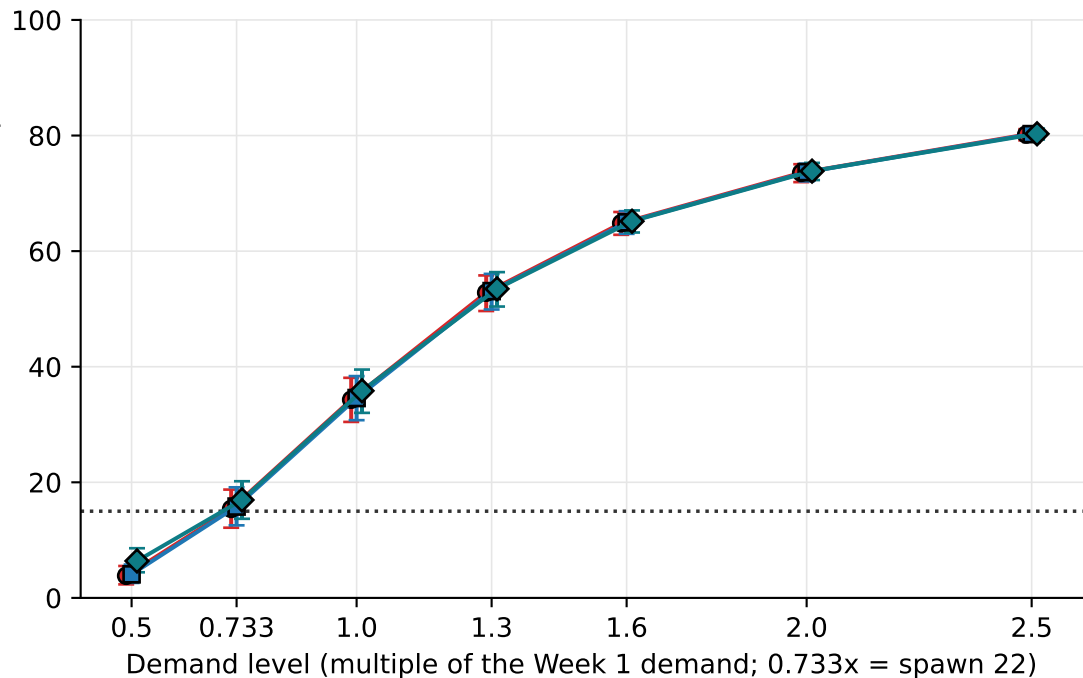

95th-percentile per-seed peak station power (kW)

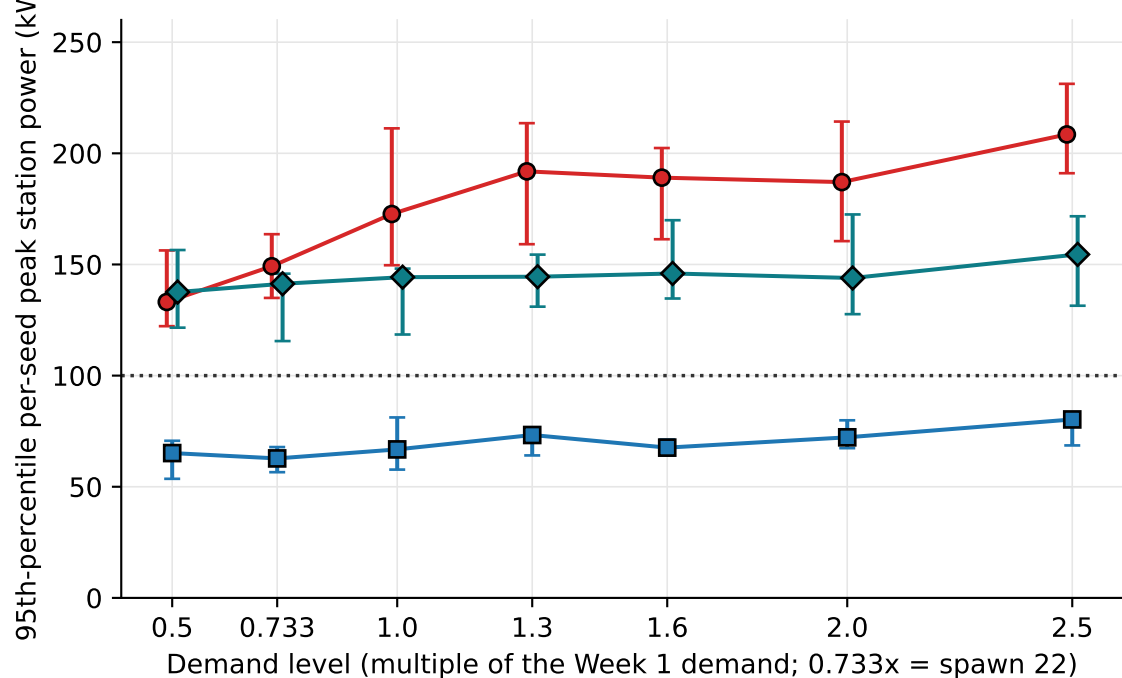

..... Target: demand not served < 15% AFAP Round Robin TD3 extended seed 102 (final RL) Transformer limit, 100 kW