

From : Koshy John Kallada

Ref : RFQ – Filter addition Jan26(1)

RFQ

Sr. No.	Title	Brief	Pages
A. Filter addition to condition			
A.1	LRC	Adding LRC filter to existing condition	2 - 4
A.2	Time	Adding time filter to condition	5 - 6

Site info

Link - <http://103.160.145.141/index.php>

A.1 LRC

Page in site – CN

Sample of LRC filter function - Structure and contents

Conditions

CN-Test	Edit	Delete
CN - 1WB	Edit	Delete
CN - 1PB	Edit	Delete
CN - 1HA	Edit	Delete
CN - PB1	Edit	Delete
CN - WB1	Edit	Delete
C1 - GP	Edit	Delete
C1 - GW	Edit	Delete
C1 - GH	Edit	Delete
C1 - GP H	Edit	Delete

Conditions Editor

Condition 1

☒ Enable this condition

PSAR signals on a HeikinAshi candle Green pin bar between Stochastics K line levels 10 100

Indicator P - 1 FS - 1

☒ Filter

☐ LRC

(a) Display results only where candle

☐ high is below middle LRC

☐ high is below lower LRC

Settings

Period Standard deviation

Notes

1. The contents to be added are marked within the green border.
2. Add this filter function only for the Condition 1 as seen in picture.
3. On ticking the filter function, the filter contents should display in the screen.
4. The LRC indicator to be used is the same as that in the home page.
5. The function of the LRC filter is that upon making the necessary settings it will display only those matching results in the alert report. LRC filter function is explained in pages 3 to 4.
6. The time frame for LRC will be the same as to what will be set in the scan.
7. An existing LRC function of the CN page is marked within red borders . Delete this condition or function. However if

suitable, the developer may use and make updates to the codes and structure of this condition to develop the LRC filter in the position shown above.

☐ Enable this condition

Filters

Upper LRC Line

Period


Default

Value

Default

LRC filter function explained

LRC channel lines

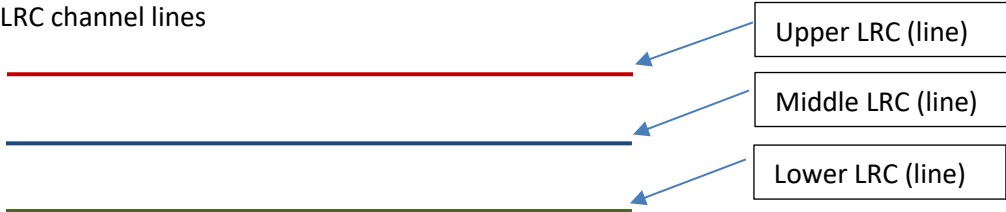


How the LRC filter functions on checking the following options ?

☒ high is below middle LRC

According to this filter option, it will display only those alert results where the alert signal candle's high occurred is below middle LRC line.


Diagram example

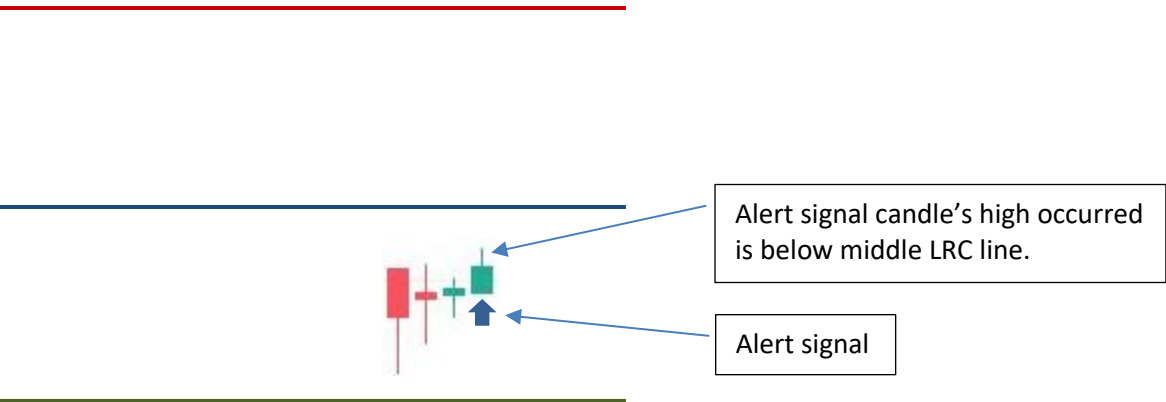

☒ high is below lower LRC

According to this filter option, it will display only those alert results where the alert signal candle's high occurred is below lower LRC line.

Diagram example

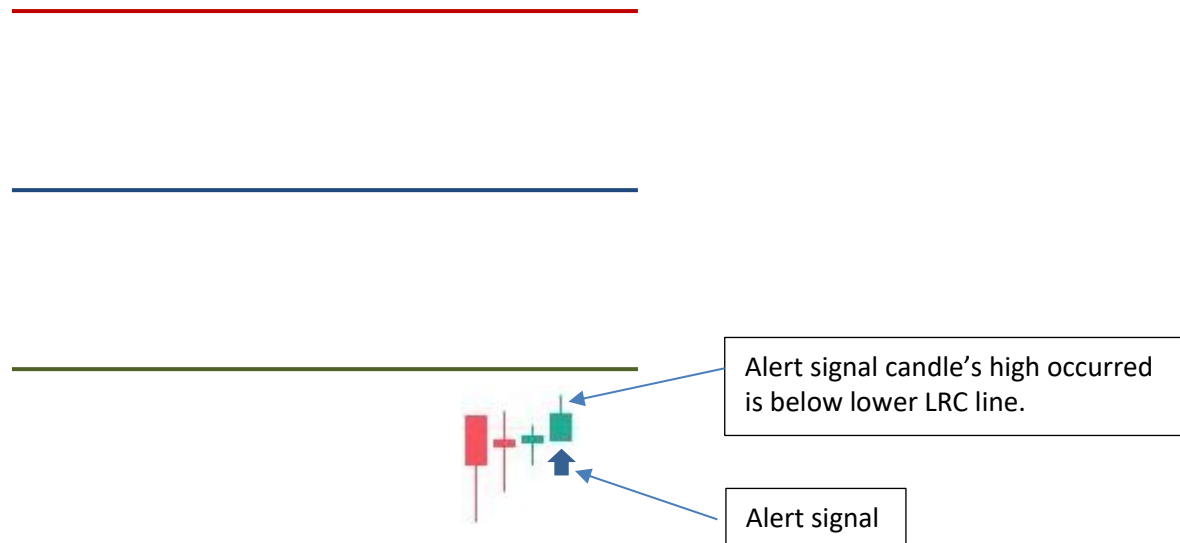

A.2 Time

Page in site – CN

Sample of time filter function - Structure and contents

Conditions

CN - Test	Edit	Delete
CN - 1WB	Edit	Delete
CN - 1PB	Edit	Delete
CN - 1HA	Edit	Delete
CN - PB1	Edit	Delete
CN - WB1	Edit	Delete
C1 - GP	Edit	Delete
C1 - GW	Edit	Delete
C1 - GH	Edit	Delete
C1 - GP H	Edit	Delete

Conditions Editor

☒ Enable this condition

PSAR signals on a HeikinAshi candle Green pin bar between Stochastics K line levels 10 100

Indicator P - 1 FS - 1

☒ Filter

☐ LRC

(a) Display results only where candle

☐ high is below middle LRC

☐ high is below lower LRC

Settings

Period Standard deviation

☐ Time

(a) Exclude results between 00:00 and 00:00

Notes

1. The contents to be added are marked within the green border.
2. Add this filter function only for the Condition 1 as seen in picture.
3. On ticking the filter function, the filter contents should display in the screen.
4. This function means that when a time within the range of the chart or market hours (9:15 AM to 3:30 PM) is entered in the input box (Eg: 10:45 AM and 11:45 AM), all the alert or scan results occurring during that time period (10:45 AM to 11:45

AM) will be excluded in the alert report. Also in the time range input box, same time (Eg: 09:45 AM and 09:45 AM) is entered in both the boxes, then it means that all alert or scan results occurring at that time (09:45 AM) will be excluded in the alert report.