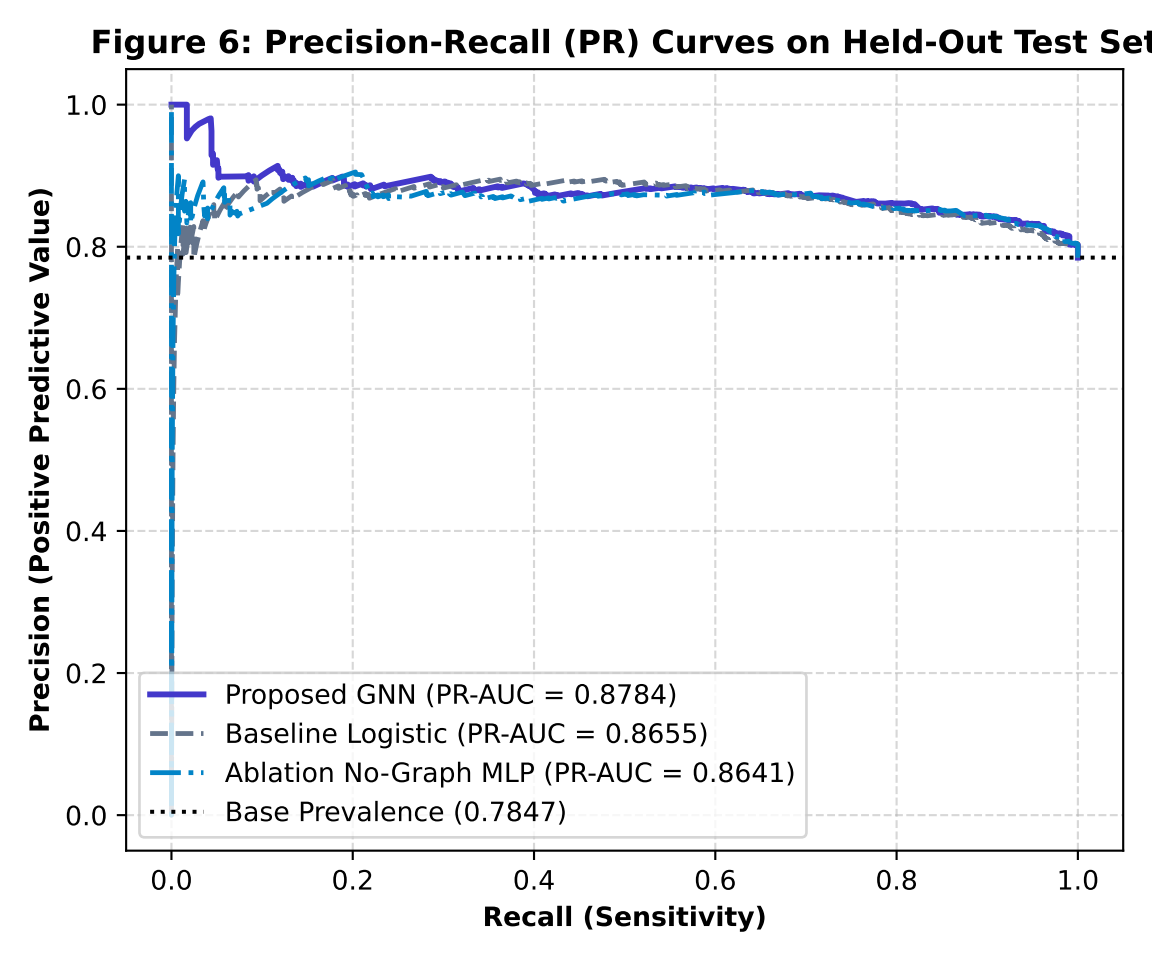
Figure 6: Precision-Recall (PR) Curves on Held-Out Test Set
Precision (Positive Predictive Value)
Recall (Sensitivity)
1.0
0.8
0.6
0.4
0.2
0.0
0.0
0.2
0.4
0.6
0.8
1.0
Proposed GNN (PR-AUC = 0.8784)
Baseline Logistic (PR-AUC = 0.8655)
Ablation No-Graph MLP (PR-AUC = 0.8641)
Base Prevalence (0.7847)