Village Water Resilience Study

Demo research RAG document: study findings, table, chart, assumptions

Research question: Does solar pump telemetry improve water availability and maintenance response? Sample: 6 villages, April to September 2026. Method: meter readings, pump downtime logs, and household interviews. Limitation: monsoon effects may confound August results.

Metric	April	June	August	Interpretation
Daily water L	520	640	770	availability improved
Downtime hrs	19	11	6	maintenance faster
Household score	3.1	3.8	4.2	satisfaction rose

Daily water availability by month

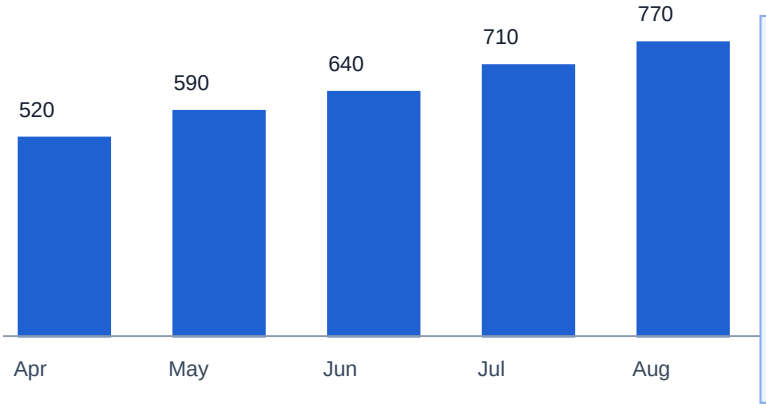

Recommendation: expand telemetry, but keep a manual audit sample. Ask for an executive summary, evidence, risks, assumptions, and final recommendation.

Research Evidence Map

Page 2: claims linked to evidence

Finding 1: Average water availability increased from 520 L/day to 770 L/day. Evidence: chart on page 1 and table row Daily water L. Finding 2: downtime declined from 19 hours to 6 hours. Evidence: maintenance logs summarized in the table.

Risk: The August peak overlaps with monsoon recharge. Assumption: telemetry contributed to faster maintenance, but rainfall also helped. Missing evidence: long term dry-season measurement after September 2026.

Use cases to test: research summary, chart interpretation, assumptions, risk analysis, quiz generation, and citation page checks.