

Q2	Posi- tion	Modified from	Date	Intr./Appd.
			04/Mar/2024	

Customer's installation




AC installation

SONIC
NOZZLE

Filter option

PDP option

ELEKTRONIKON
CONTROLLER
MK5

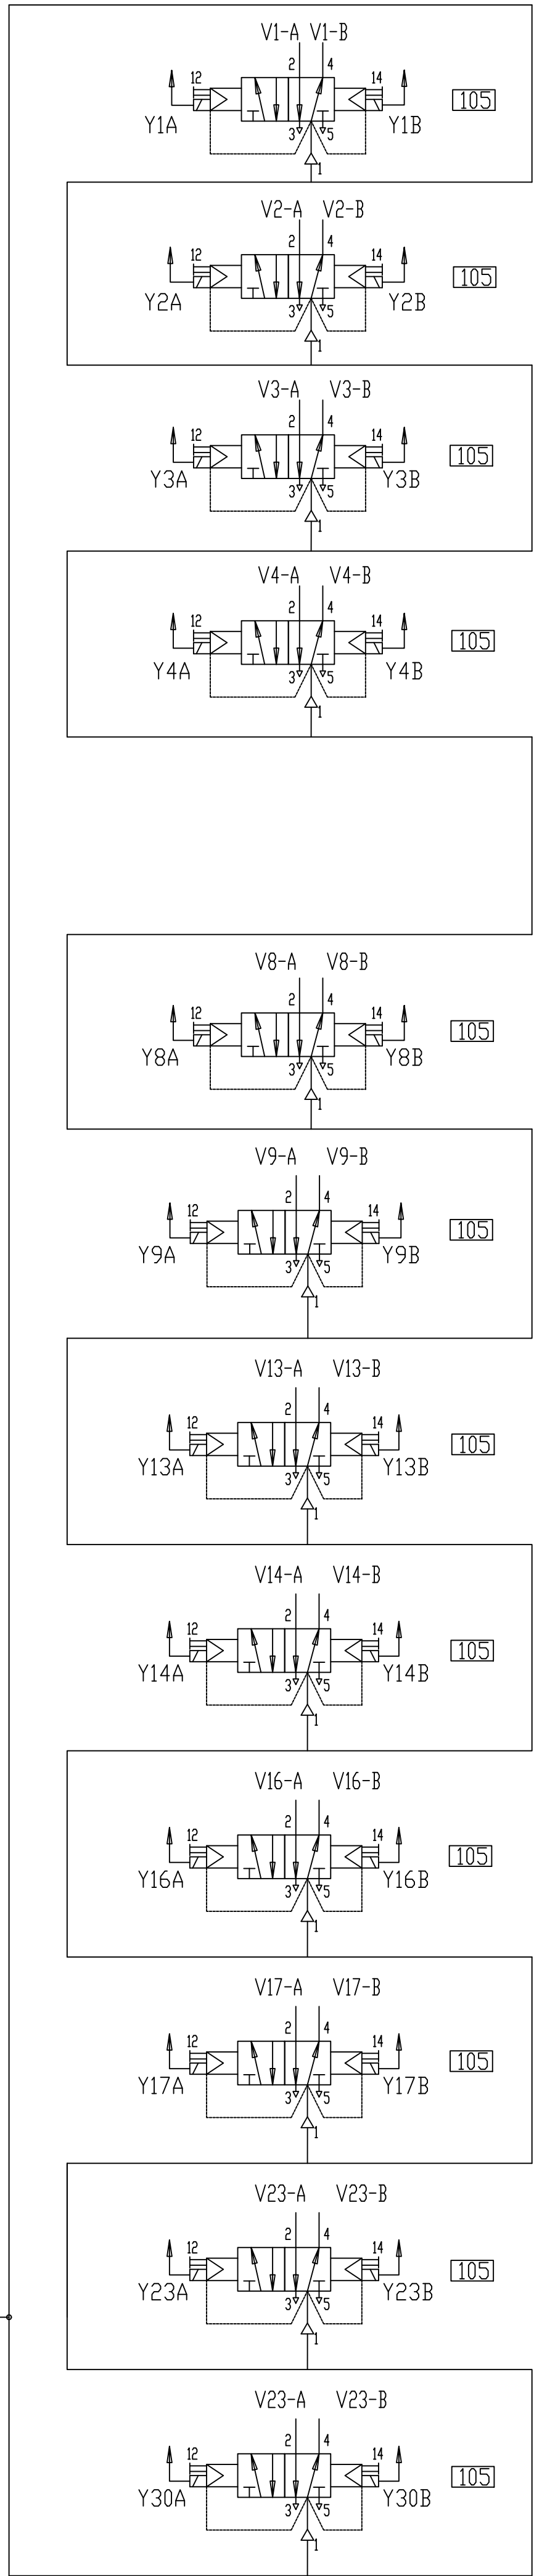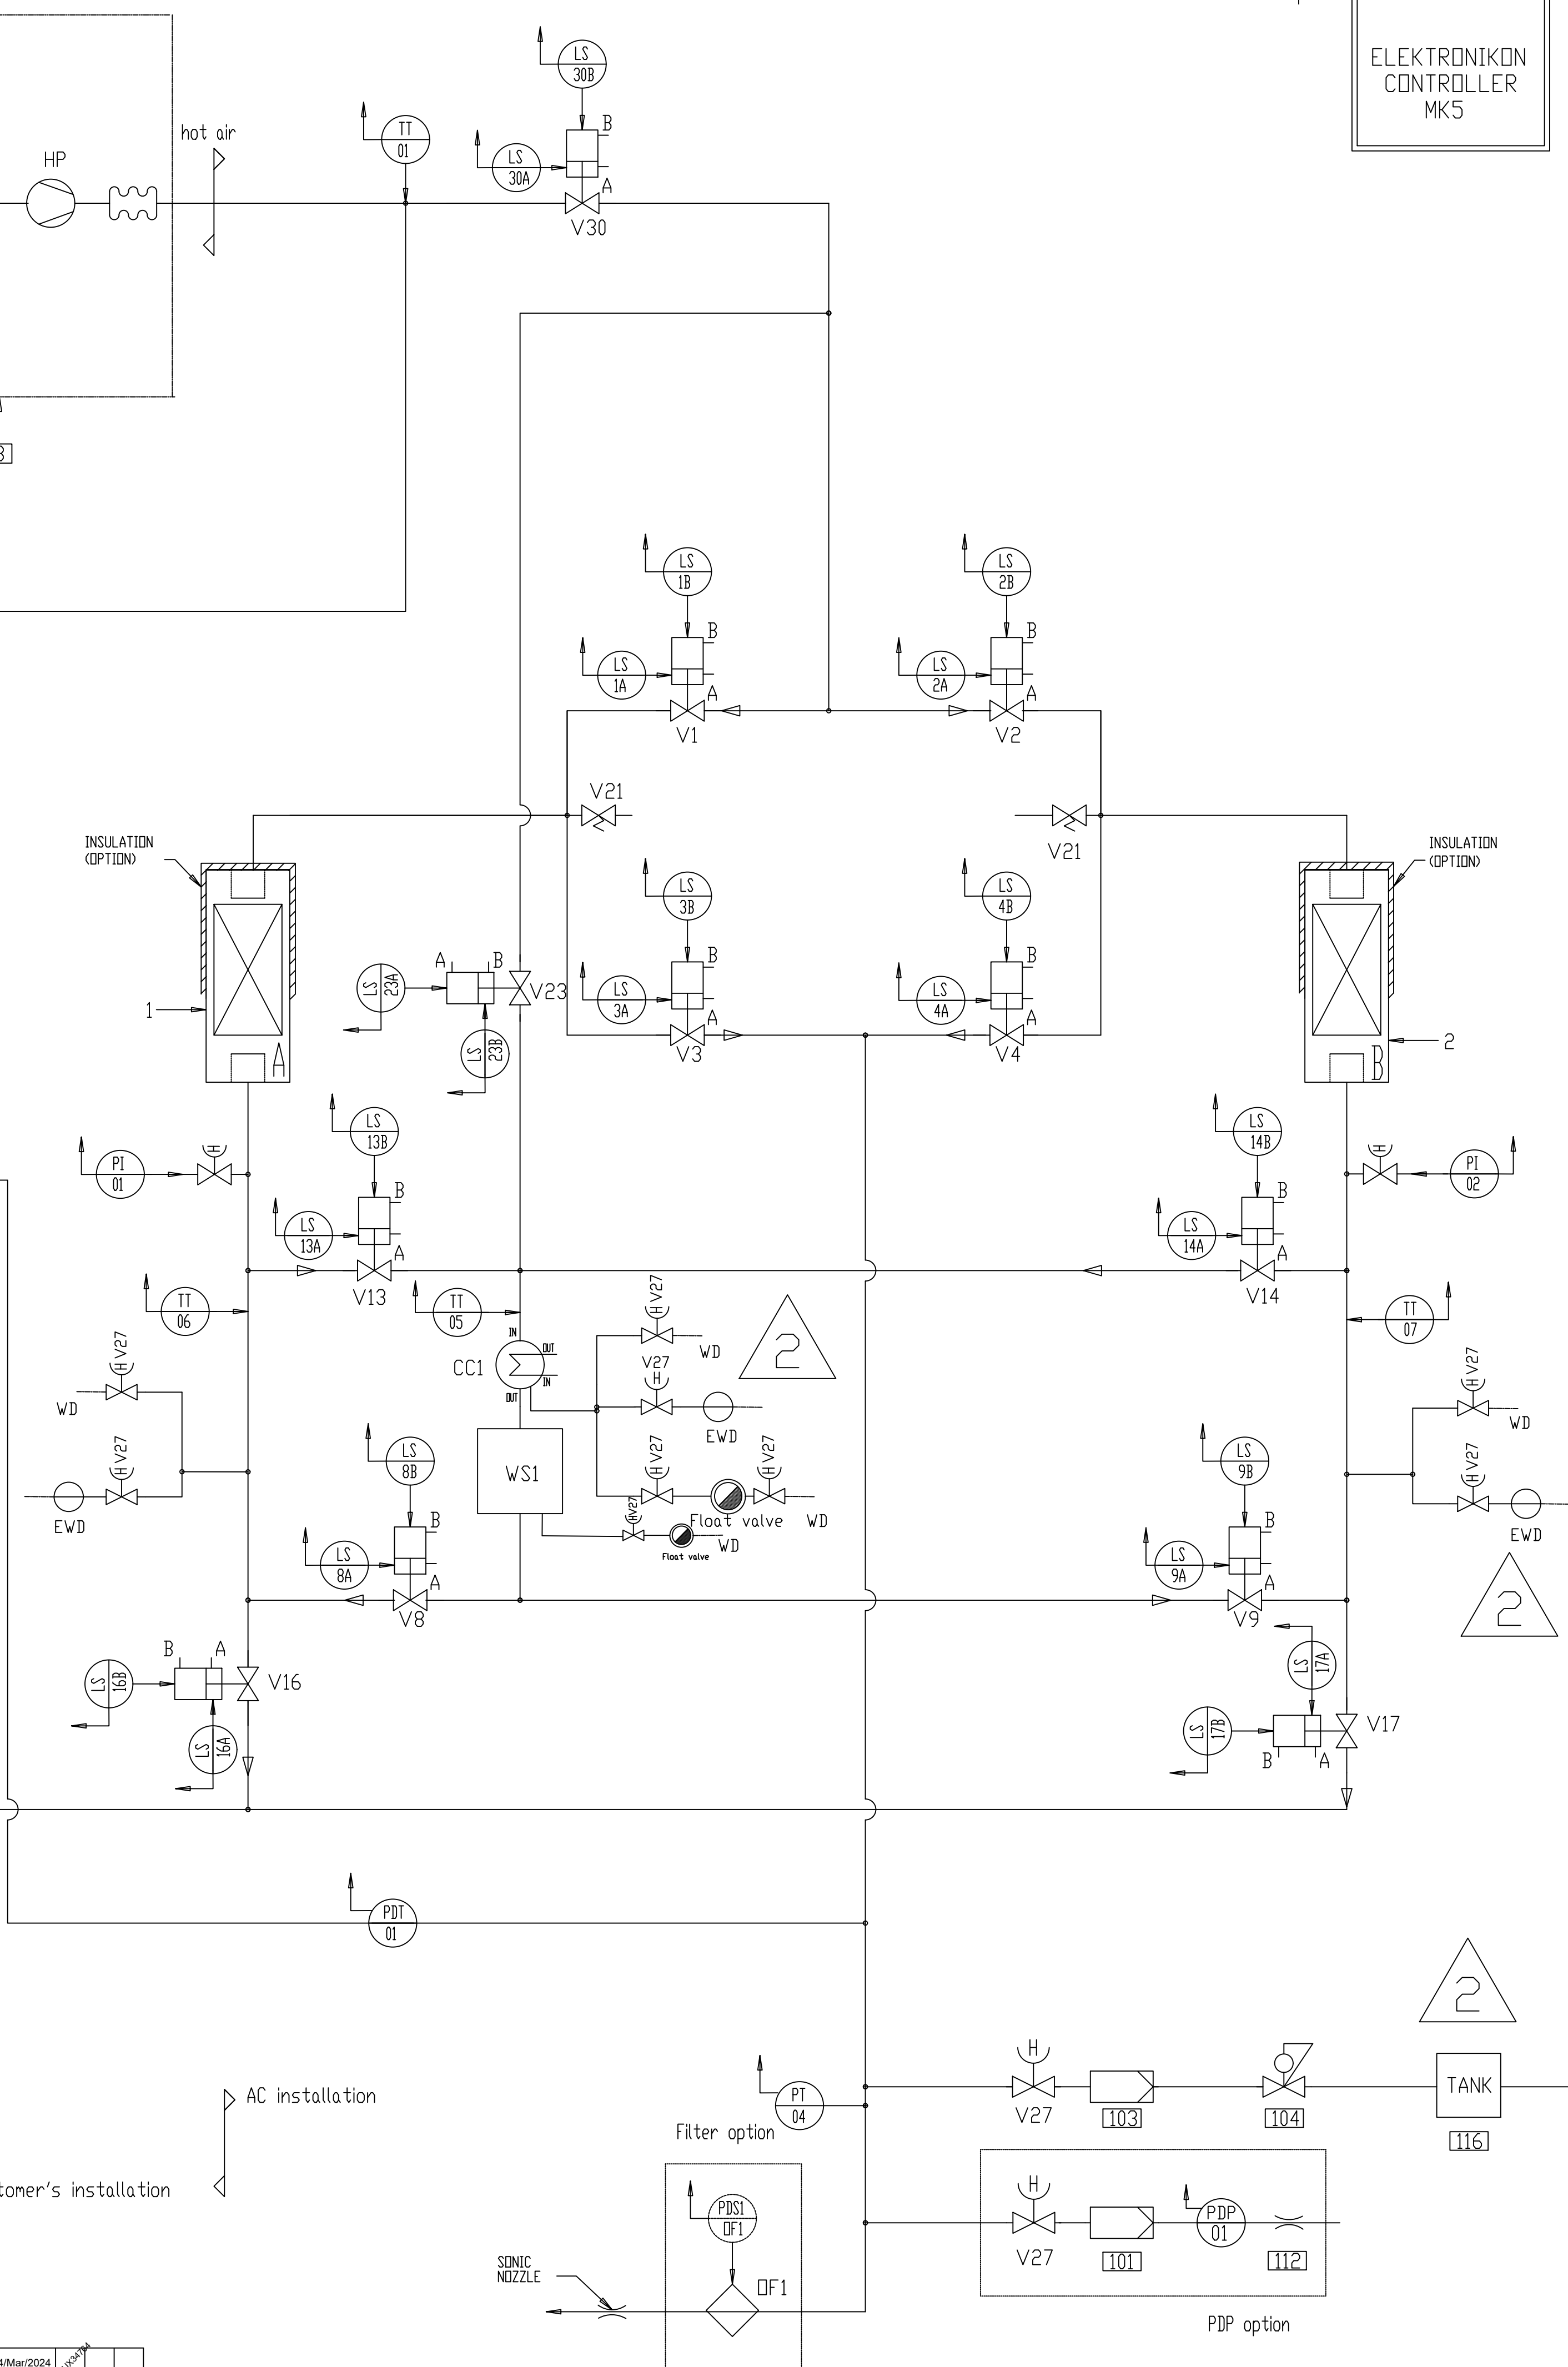

A	VALVE OPEN
B	VALVE CLOSED
V1,V2	INLET VALVES REGENERATION
V3,V4	OUTLET VALVES
V5	REGENERATION BYPASS VALVE
V8,V9	COOLER OUTLET VALVES
V13	REGENERATION VALVE A
V14	REGENERATION VALVE B
V16,17	COOLER AIR VALVES
V21	SAFETY VALVES VESSELS (OPTIONAL)
V23	COOLER 1 AIR INLET VALVE
V27	MANUAL VALVE
V30	HOT AIR INLET VALVE
TT01	TEMPERATURE HOT AIR INLET
TT05	TEMPERATURE COOLER INLET
TT06	TEMPERATURE BOTTOM VESSEL A
TT07	TEMPERATURE BOTTOM VESSEL B
101	DUST FILTER
103	PILOT AIR FILTER
104	PRESSURE REGULATOR
105	5/2 SPOOLVALVE BISTABLE
112	SINGLE DIRECTION FLOW RESTRICTION
116	PILOT AIR TANK (AVAILABLE ONLY FOR 4150&5000)
R1/R2	HEATER ELEMENTS
CC1,CC2	COOLERS
LS	LIMIT SWITCH
PI	PRESSURE INDICATOR
PDP01	PRESSURE DEWPOINT
PT04	PRESSURE OUTLET
PDT01	PRESSURE DROP DRYER
PDS	ANALOG POSITIONER
EWD	ELECTRONIC WATER DRAIN
WD	WATER DRAIN
DF1	OUTLET FILTER (OPTION)
PDS1	DELTA P OUTLET FILTER
1	VESSEL A
2	VESSEL B
3	COMPRESSOR
LP	LOW PRESSURE
IC	INTERCOOLER
HP	HIGH PRESSURE
WS1,WS2	WATER SEPARATORS (AVAILABLE ONLY FOR 4150&5000)

WATER DRAIN _____
AIR _____
SIGNAL AIR _____
SIGNAL ELECT. _____
INSULATION

All materials supplied are in compliance with the requirements of the List of Prohibited Substances

Tolerances, if not indicated, according to:									
ATLAS COPCO STANDARD CLASS									
Name					DIAGRAM FLOW				
Material					NOT APPLICABLE				
Treatment					Not Applicable				
Scale		Family		A1		Compare		Drawing owner	
Version Draw		Blank nr.		Blank nr.		Replaces		WUX	
Version Draw		Blank nr.		Blank nr.		Replaces		WUX	
Des checked		Prod checked		Approved		Date		2023-01-11	
Parent 3D Model		Ed. Version 3D		Designation		Sheet ()		01 01	
Approved		Approved		Approved		Date		2023-01-11	

9829225870-01