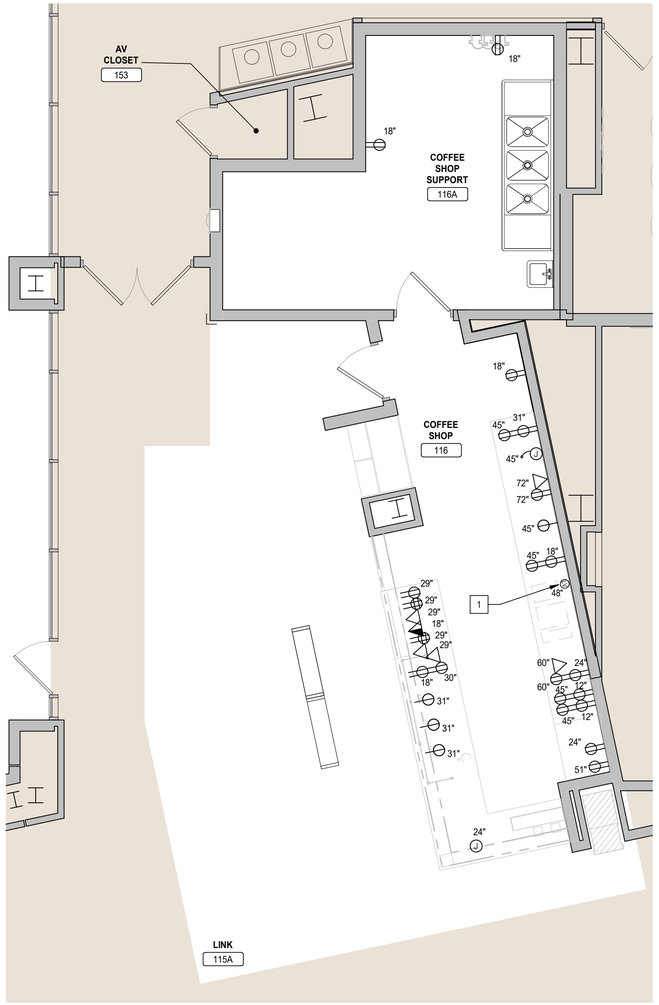

1 FLOOR 1 POWER AND VOICE/DATA COORDINATION PLAN
1/4" = 1'-0"

GENERAL NOTES - POWER AND DATA PLAN

A. THIS SHEET IS FOR DESIGN INTENT AND LOCATIONS OF POWER, VOICE, DATA AND CARD READER DEVICES ONLY. REFER TO VENDOR AND ELECTRICAL ENGINEERING DRAWINGS FOR SCOPE OF WORK FOR ELECTRICAL AND COMMUNICATION DESIGN. DEVICE MOUNTING HEIGHTS INDICATED ON ARCHITECTURAL PLANS GOVERN.

B. FIRE SAFETY MUST BE MAINTAINED FOR ALL PERSONNEL WORKING ON THE FLOOR. ALL FIRE ALARMS, SPEAKERS, ETC. MUST REMAIN OPERABLE AT ALL TIMES. NOTIFY PROPERTY SECURITY CONSULTANT AND PROPERTY MANAGER OF DAMAGED SYSTEMS AND REPAIR OR REPLACE DAMAGED SYSTEMS IMMEDIATELY.

C. OUTLETS SHOWN BACK TO BACK ON PARTITION WALLS SHALL BE OFFSET 1'-0", MINIMUM OR MOUNTED AT DIFFERENT HEIGHTS IF INDICATED.

D. INSTALL WALL MOUNTED OUTLETS 18 INCHES ABOVE FINISHED FLOOR, U.N.O.

E. USE EXISTING ELECTRICAL AND VOICE/DATA OUTLETS LOCATED ON WALL WHEN POSSIBLE.

F. FOR LIGHT SWITCHES, OUTLETS AND RECEPTACLE COVER PLATES MATCH EXISTING IN TYPE AND FINISH.

G. GENERAL CONTRACTOR SHALL PROPERLY LABEL ALL ELECTRICAL PANELS.

KEYNOTES - POWER AND DATA

NOTE: ALL KEYNOTES MAY NOT BE USED ON THIS SHEET

NO.	DESCRIPTION
1	PROVIDE LOW VOLTAGE CONNECTION FOR AUTOMATIC PAPER TOWEL DISPENSER. SEE ENGINEER'S DRAWINGS FOR FURTHER INFORMATION.

LEGEND:

- SINGLE OUTLET
- DUPLEX OUTLET
- 42" DEVICE HEIGHT A.F.F.
- QUAD OUTLET
- DATA OUTLET
- TELEPHONE JACK
- MISCELLANEOUS JUNCTION BOX.
- LV LOW VOLTAGE POWER LOCATION

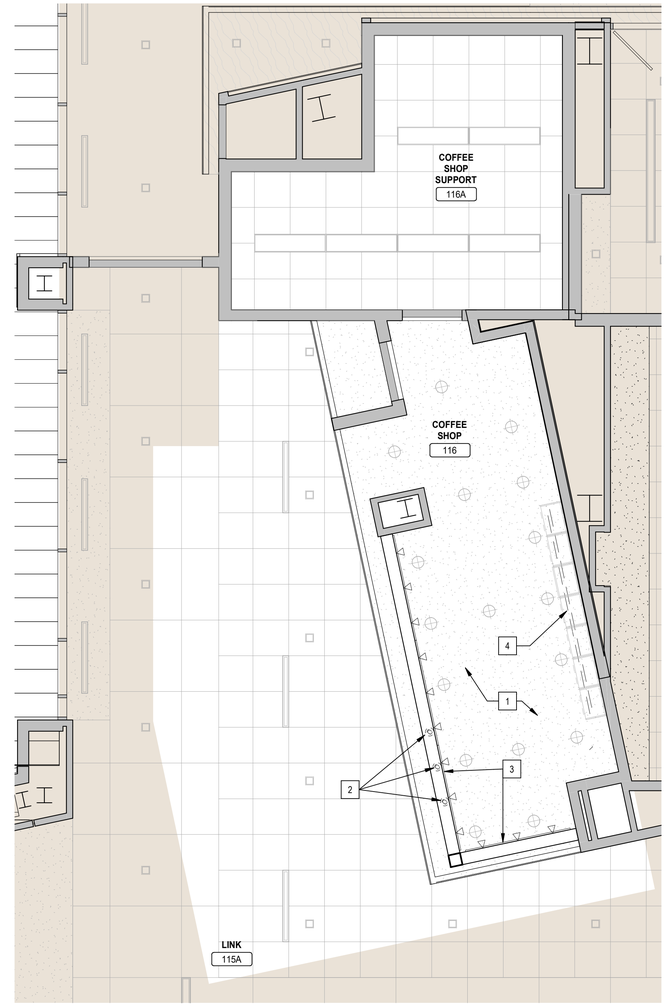

2 01 - FIRST FLOOR REFLECTED CEILING PLAN
1/4" = 1'-0"

GENERAL NOTES - CEILING PLAN

A. COORDINATE THE WORK OF ALL TRADES TO INSURE CLEARANCES FOR FIXTURES, DUCTS, PIPING, SOFFITS, CEILING SUSPENSION SYSTEM, ETC.. NECESSARY TO MAINTAIN THE FINISHED CEILING HEIGHTS INDICATED ON DRAWINGS PRIOR TO CONSTRUCTION.

B. THIS DRAWING IS INTENDED AS DESIGN INTENT FOR LIGHTING LAYOUT.

C. IN THE EVENT OF DISCREPANCIES BETWEEN THE ARCHITECT OF RECORD'S REFLECTED CEILING PLAN AND THE ENGINEERS ELECTRICAL LIGHTING PLAN, IMMEDIATELY NOTIFY THE OWNER'S PROJECT MANAGER AND ARCHITECT OF RECORD IN WRITING BEFORE ORDERING MATERIALS OR PROCEEDING WITH WORK.

D. GENERAL CONTRACTOR TO VERIFY AMOUNT OF EXISTING LIGHT FIXTURES AND PROVIDE NEW TO MATCH EXISTING AS REQUIRED TO MEET DESIGN INTENT.

E. ACT. CEILING AND GRID SYSTEM AND GYPSUM BOARD CEILING SYSTEMS TO REMAIN THROUGHOUT, U.N.O.

F. COORDINATE INSTALLATION OF SOUND MASKING SYSTEM WITH SOUND MASKING ALLIANCE PARTNER. GENERAL CONTRACTOR SHALL PROVIDE AND INSTALL ELECTRIC SERVICE (120V, 20 AMP) TO SOUND MASKING TRANSFORMERS PROVIDED BY LENCORE ACOUSTICS.

G. SEE SHEET A301 FOR FINISH INFORMATION AND FINISH SCHEDULE.

KEYNOTES - REFLECTED CEILING

NOTE: ALL KEYNOTES MAY NOT BE USED ON THIS SHEET

NO.	DESCRIPTION
1	ALL FACES OF GYPSUM BOARD SOFFIT TO BE REPAINTED TO MATCH EXISTING.
2	REMOVE (3) PENDANT LIGHT FIXTURES.
3	INSTALL TRACK LIGHTING ON INSIDE FACE OF CASEWORK ABOVE.
4	INSTALL UNDERCABINET LIGHTS.

LIGHTING LEGEND:

- EXISTING FIXTURES
- NEW TRACK LIGHTING
- UNDERCABINET LIGHT FIXTURES

RSP

1220 Marshall St NE
Minneapolis, MN
55413-1036

612.677.7100
rsparch.com

Project Contact:
BENNET JOHNSON
(612) 677-7253

CONSULTANTS

CERTIFICATION

I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Architect under the laws of the state of Minnesota.

Name	DAVID C. NORBACK
License No.	11902
Expiration Date	6/30/2024
Date Signed	FEBRUARY 26, 2024

PROJECT FOR

UNITEDHEALTH GROUP®

9700 Healthcare Lane,
Minnetonka, MN
55343

UHG Project #	K1110358
Location Code	MN017
Business Unit	UHC CORPORATE
Project No.	61381110358
Drawn By	MJoC
Checked By	BAJ
Date	26 FEBRUARY 2024

NOTICE: The designs shown and described herein including all technical drawings, graphics, and models thereof, are proprietary and cannot be copied, duplicated or commercially exploited, in whole or in part, without express written permission of RSP Architects. These are available for limited review and evaluation by clients, consultants, contractors, government agencies, vendors and office personnel only in accordance with this Notice.

© Copyright RSP Architects 2024. All rights reserved.

ISSUES / REVISIONS

NO.	DATE	DESCRIPTION

FLOOR 1 SECURITY AND PVD PLAN AND REFLECTED CEILING PLAN

A201