Building Inspection Division
City of Lakeland
THESE PLANS HAVE BEEN REVIEWED FOR COMPLIANCE WITH THE CURRENT EDITION. OF THE FLORIDA BUILDING CODE OR THE CITY OF LAKELAND LAND DEVELOPMENT CODE
Date: 06/30/20
Permit Number: BLD16-00198

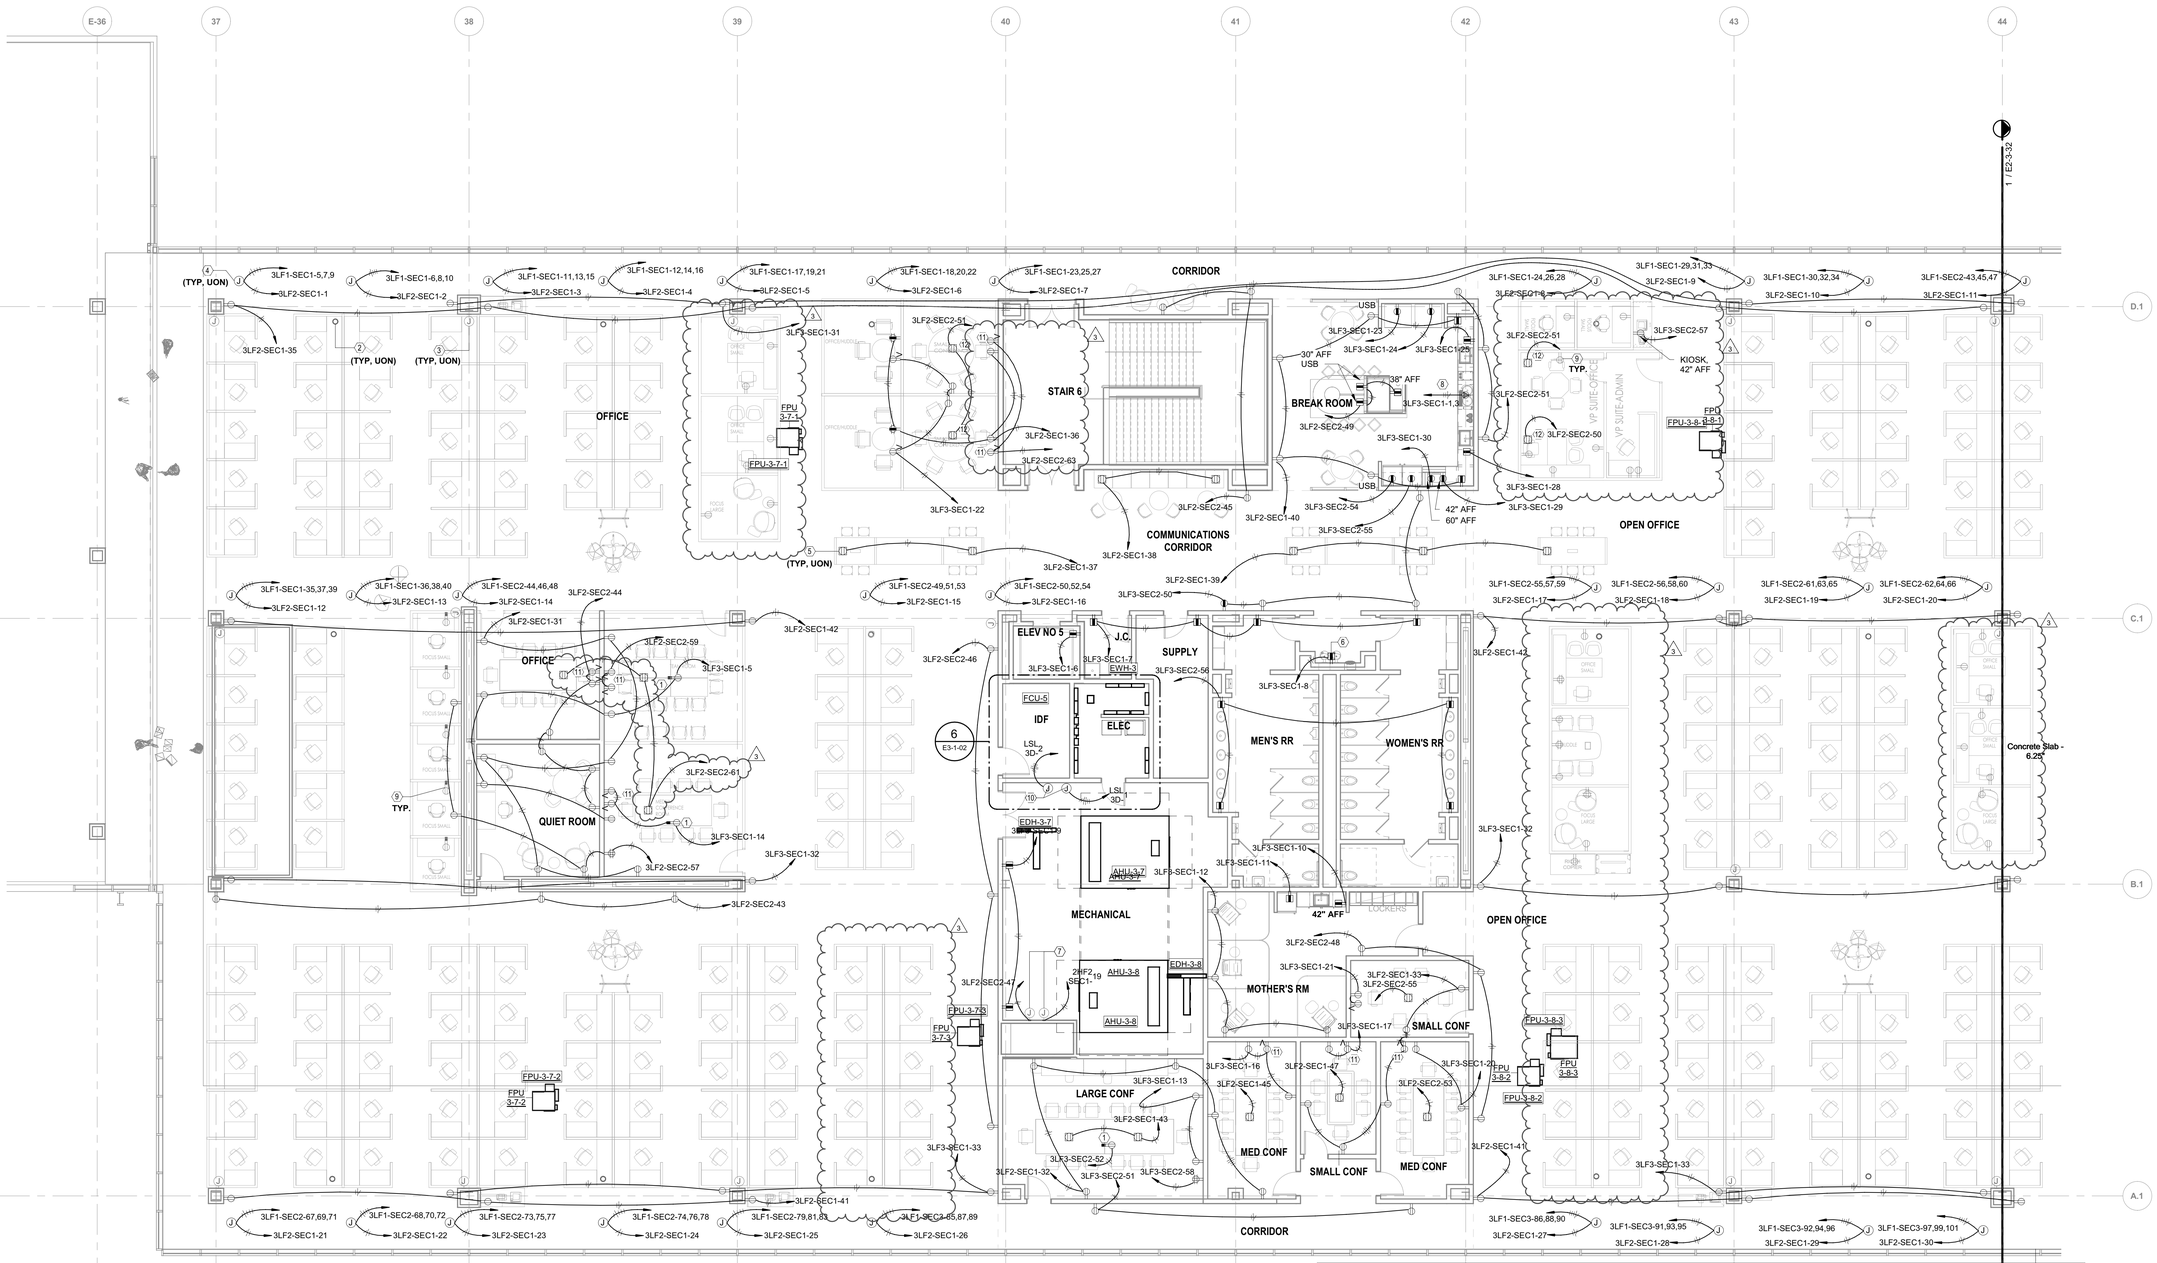

GENERAL NOTE:

1. POKE-THRU LOCATIONS ARE TO BE COORDINATED WITH OWNER PROVIDED FURNITURE LAYOUT; LOCATIONS SHOWN ARE FOR REFERENCE PURPOSES ONLY.

1 PARTIAL POWER PLAN - LEVEL 3 - AREA A

Scale: 1/8" = 1'-0"

SCALE: 1/8" = 1'-0" 0 2' 4' 8' 16' 24'

N TN

KEYED NOTES

#	KEYNOTE
1	PROJECTOR: DUPLEX RECEPTACLE FLUSH WITH CEILING. COORDINATE EXACT LOCATION IN FIELD PRIOR TO ROUGH-IN.
2	FURNITURE FEED POKE-THRU: POWER AND DATA FLOOR BOX (EQUAL TO WIREMOLD EVOLUTION 6 SERIES SERIES) FOR CONNECTION TO FURNITURE POWER WHIP. COORDINATE EXACT LOCATION OF CONNECTION POINT AND WHIP LENGTH WITH FURNITURE VENDOR AND OWNER. EXTEND 3/4" CONDUIT TO NEAREST COLUMN AND TERMINATE ABOVE CEILING IN FURNITURE FEED JUNCTION BOX. REFER TO TYPICAL FURNITURE FEED WIRING DIAGRAM DETAIL 2 ON SHEET E6-1-02.
3	FURNITURE BASE FEED: PROVIDE JUNCTION BOX AT 18" AFF FOR CONNECTION TO FURNITURE POWER WHIP. COORDINATE EXACT LOCATION OF CONNECTION POINT AND WHIP LENGTH WITH FURNITURE VENDOR, EXTEND 1" CONDUIT TO NEAREST ABOVE CEILING FURNITURE FEED JUNCTION BOX. REFER TO TYPICAL FURNITURE FEED WIRING DIAGRAM DETAIL 2 ON SHEET E6-1-02.
4	FURNITURE FEED JUNCTION BOX: JUNCTION BOX LOCATED ABOVE CEILING WITH FURNITURE FEED OR DEMOUNTABLE WALL CIRCUITS. EXTEND 1" CONDUIT WITH CIRCUITS SHOWN TO EITHER BASE FEED IN COLUMN OR FLOOR BOX AS SHOWN. REFER TO TYPICAL FURNITURE FEED WIRING DIAGRAM DETAIL 2 ON SHEET E6-1-02.
5	FLOOR BOX WITH POWER AND DATA COMPARTMENTS. PROVIDE WITH (1) DUPLEX RECEPTACLE AND (1) DATA COMPARTMENT. REFER TO "TY" SHEETS FOR ADDITIONAL DATA REQUIREMENTS AND COORDINATE WITH OWNER DRAWINGS FOR FURNITURE LAYOUT AND PLACEMENT OF FLOOR BOX.
6	ELECTRIC WATER COOLER: PROVIDED GFCI CIRCUIT BREAKER FOR CONNECTION TO RECEPTACLE LOCATED INSIDE WATER COOLER ACCESS PANEL. COORDINATE EXACT LOCATION WITH PLUMBING CONTRACTOR PRIOR TO ROUGH-IN.
7	MECHANICAL CONTROL TRANSFORMER: PROVIDE JUNCTION BOXES AT 60" AFF FOR VAV CONTROL TRANSFORMER(S). TRANSFORMER PROVIDED BY MECHANICAL CONTRACTOR INSTALLED BY ELECTRICAL CONTRACTOR, COORDINATE PRIMARY VOLTAGE, QUANTITY, AND LOCATION. ALL CONROL WIRING WILL BE PROVIDED AND INSTALLED BY MECHANICAL CONTRACTOR.
8	COFFEE BREWER (208V, 10) - PROVIDE NEMA 14-50R RECEPTACLE (3) #6, (1) #10 GROUND, 1" CONDUIT. VERIFY EXACT NEMA CONFIGURATION WITH MANUFACTURER INSTALLATION MANUAL PRIOR TO ROUGH-IN.
9	DEMOUNTABLE WALL SYSTEMS: NEAREST AVAILABLE FURNITURE FEED JUNCTION BOX CIRCUITS TO PREWIRED PARTITION WALLS. 50% OF THE RECEPTACLES IN EACH ROOM SHALL BE CONNECTED TO THE CONTROLLED PANEL CIRCUIT. ALL OTHER RECEPTACLES SHALL BE CONNECTED TO THE UNCONTROLLED PANEL CIRCUITS, MAX OF 6 RECEPTACLES PER CIRCUIT. TYPICAL OF ALL PRE-WIRED REMOVAL PARTITIONS, ALSO KNOW AS DEMOUNTABLE WALLS. REFER TO TYPICAL FURNITURE FEED WIRING DIAGRAM DETAIL 2 ON SHEET E6-1-02.
10	FIRE ALARM NACC: PROVIDE 120 VOLT 20 AMP CONNECTION TO CABINET.
11	PROVIDE (1) QUAD RECEPTACLE AT 78" AFF AND (1) DUPLEX RECEPTACLE AT 18" AFF. REFER TO DETAIL ON SHEET E6-1-03 PRIOR TO ROUGH-IN. ELECTRICAL CONTRACTOR TO PROVIDE ALL CONDUITS INDICATED FOR FULLY FUNCTIONAL SYSTEM.
12	PROVIDE IN-FLOOR RACEWAY (EQUAL TO CONNECTRAC SERIES) POWER/DATA SYSTEM.

AECOM
BATSON-COOK CONSTRUCTION

PROJECT

PUBLIX HEADQUARTERS BUILDING ADDITION AND PARKING LOT EXPANSION

3300 PUBLIX CORPORATE PARKWAY
LAKELAND, FL 33811

CLIENT

Publix

3300 PUBLIX CORPORATE PARKWAY
LAKELAND, FL 33811

www.publix.com

CONSULTANT

AECOM

AECOM TECHNICAL SERVICES, INC.
800 Douglas Entrance
North Tower, 2nd Floor
Coral Gables, FL 33134
305.444.4691 tel 305.447.3580 fax
www.aecom.com

ARCHITECTURE
LICENSE NO. AA26000687

ENGINEERING
CA LIC. NO. 8115

http://www.aecom.com

REGISTRATION

HENRYK B. JUSZCZYK, PROFESSIONAL ENGINEER, STATE OF FLORIDA, LICENSE NO. 58082

THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY HENRYK B. JUSZCZYK, PROFESSIONAL ENGINEER, STATE OF FLORIDA, LICENSE NO. 58082 ON THE DATE INDICATED HERE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

Henryk B Juszczyk
Digitally signed by Henryk B Juszczyk
Date: 2020.06.19 16:14:46-04'00'

KEY PLAN

EXISTING	A	B

ISSUE/REVISION

I/R	DATE	DESCRIPTION
3	MAY 01, 2020	SI-004
2	OCT 25,2019	BUILDING DEPARTMENT COMMENTS
1	SEP 30, 2019	100% CONSTRUCTION DOCUMENTS
0	AUG 23, 2019	CONSTRUCTION DOCUMENTS

PROJECT NUMBER

60601397

SHEET TITLE

PARTIAL POWER PLAN - LEVEL 3 AREA A

SHEET NUMBER

E2-3-31

This drawing has been prepared for the use of AECOM's client and may not be used, reproduced or relied upon by third parties, except as agreed by AECOM and its client, as required by law or for use by governmental reviewing agencies. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that modifies this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

NOTICE: THE OFFICIAL RECORD OF THIS SHEET IS THE ELECTRONIC FILE SIGNED AND SEALED UNDER RULE 61G15-23.004, F.A.C.

©2016 AECOM Corporation

Project Management Initials:
Designer: Designer Checked: Checker Approved: Approver/ARCH E1 30"x42"

Last Plotted: 5/12/2020 11:06:02 AM
Filename: BIM 360://60601397-Publix HQ/60601397_Publix HQ_ELECT_R2019.rvt

Printed on ___ % Post-Consumer Recycled Content Paper