Building Inspection Division
City of Lakeland
THESE PLANS HAVE BEEN REVIEWED FOR COMPLIANCE WITH THE CURRENT EDITION, OF THE FLORIDA BUILDING CODE OR THE CITY OF LAKELAND LAND DEVELOPMENT CODE
Date: 06/30/20
Permit Number: BLD16-00198

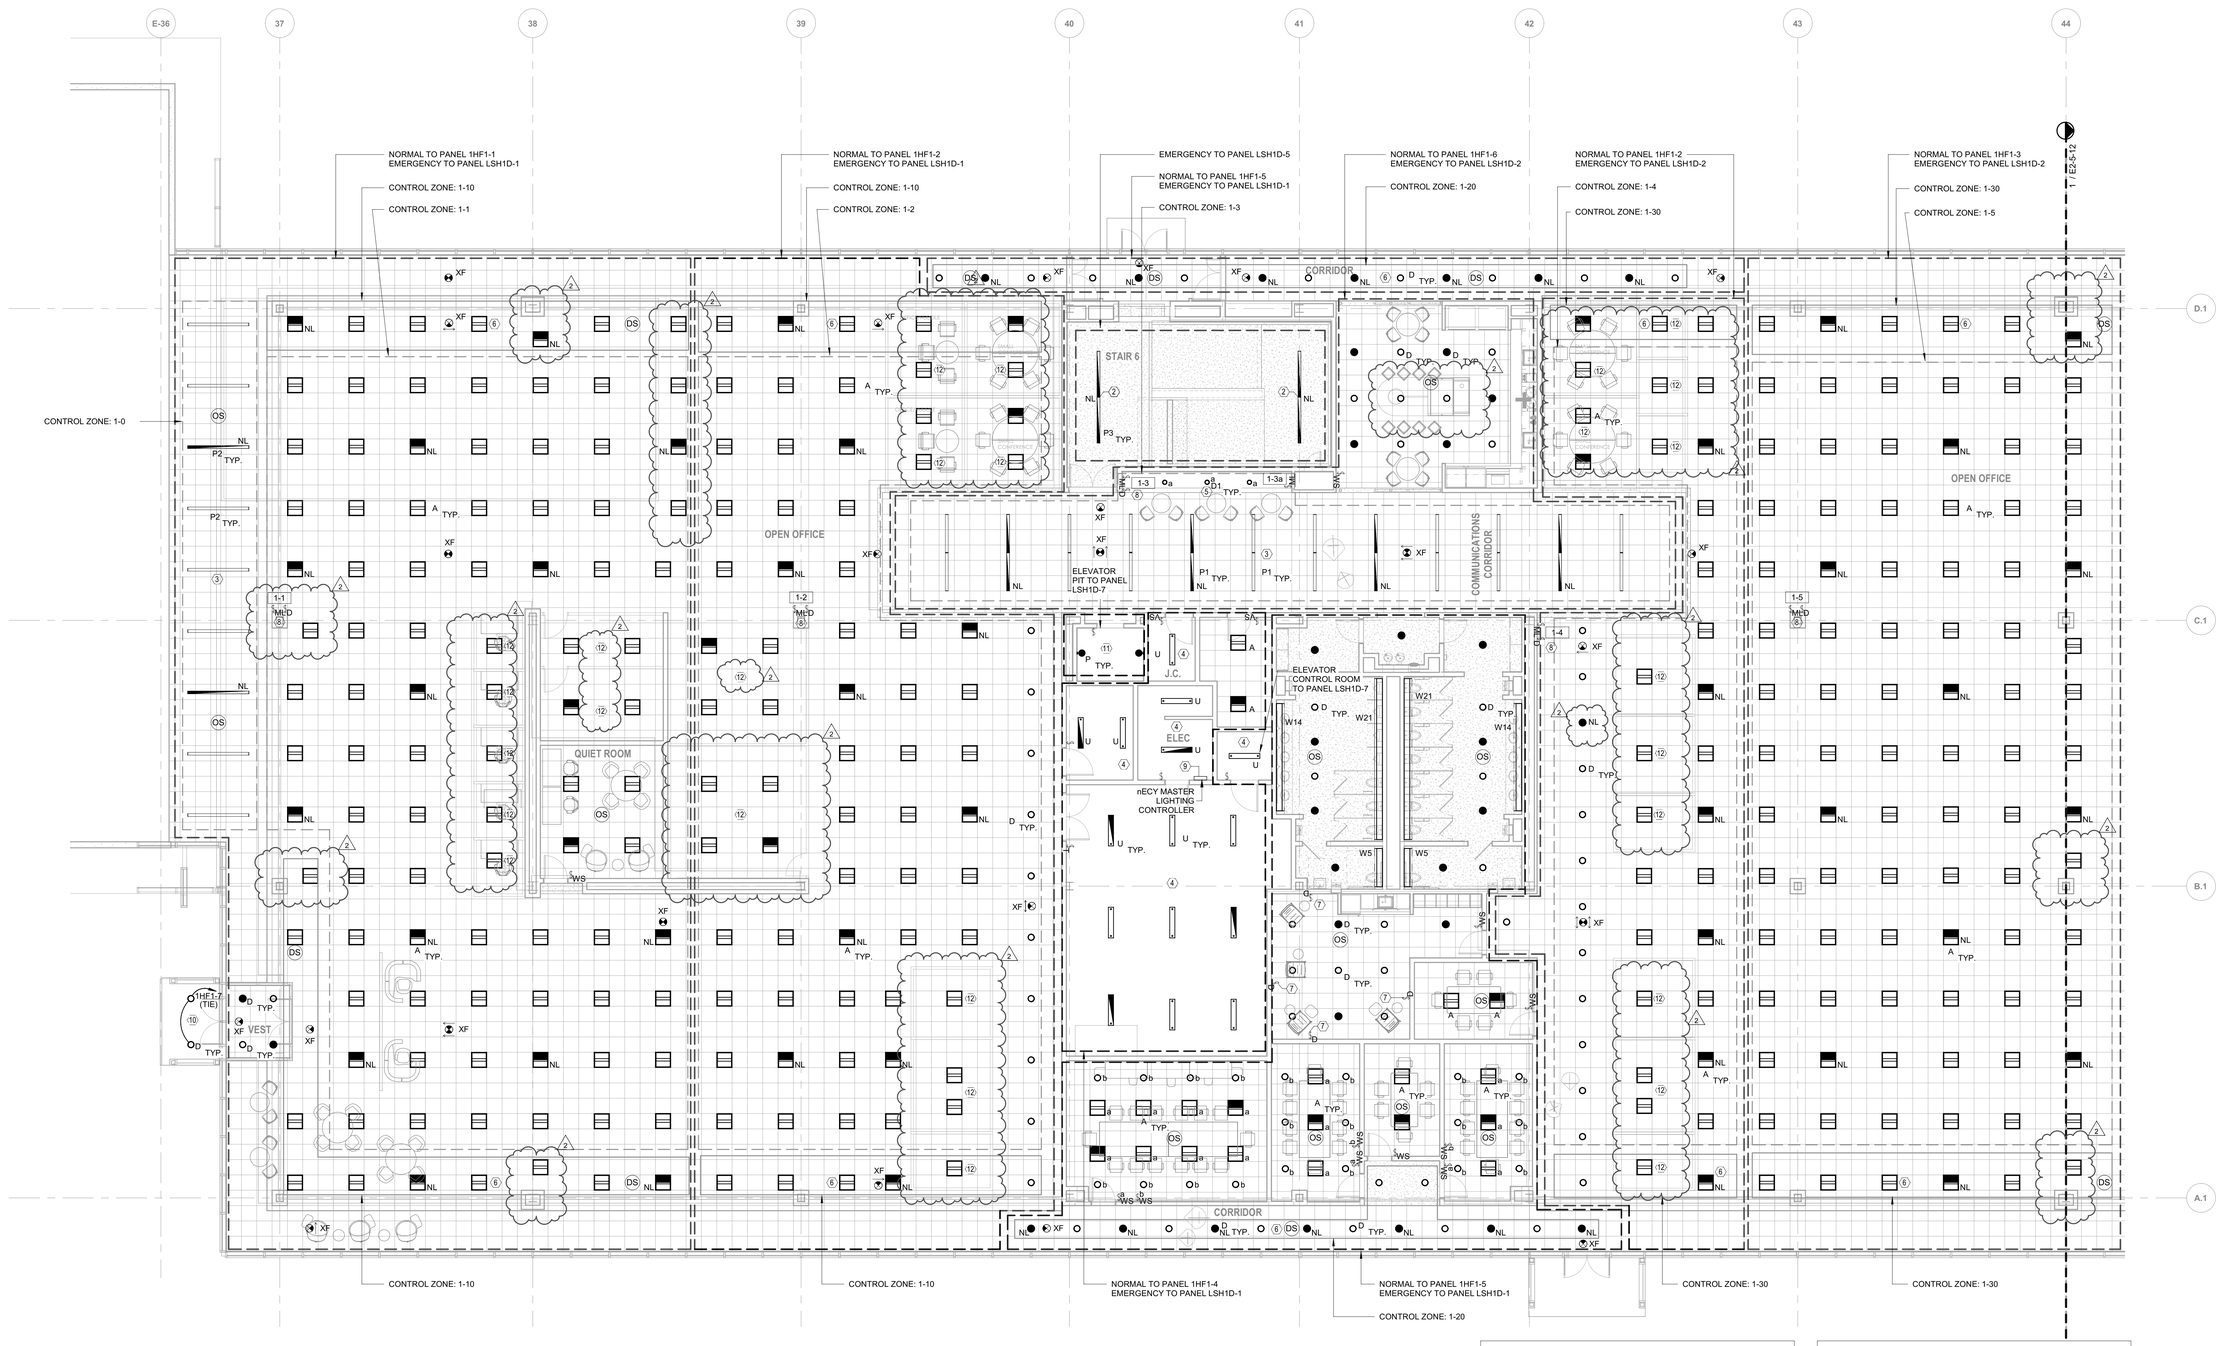

GENERAL LIGHTING NOTES

1. OPEN OFFICE FIXTURES AND CORRIDOR FIXTURES SHALL BE nLIGHT AIR ENABLED AND CONTROLLED VIA nECY LIGHTING CONTROL SYSTEM SHOWN WITH MANUAL OVERRIDES LOCATED WITHIN EACH ZONE. SEE DETAIL 2 ON SHEET E6-1-03 FOR CONTROL SCHEDULE.
2. ALL LIGHTING CONTROLS SHALL BE COMPATIBLE WITH DESIGNATED nLIGHT SYSTEM.
3. LIGHTING CONTROLS SHALL BE TIED INTO EXITING FACILITY MANAGEMENT SYSTEM.
4. ALL FIXTURES ON AN EMERGENCY CIRCUIT IN THE OPEN OFFICE AND CORRIDORS SHALL OPERATE AS NIGHT LIGHTS DURING UNOCCUPIED HOURS.
5. EXIT SIGNS SHALL ALWAYS BE ON. THEY SHALL NOT BE CONTROLLED VIA CONTROL ZONES.

1 PARTIAL LIGHTING PLAN - LEVEL 1 - AREA A

Scale: 1/8" = 1'-0"

SCALE: 1/8" = 1'-0" 0 2' 4' 8' 16' 24'

N TN

KEYED NOTES

#	KEYNOTE
1	NOT USED.
2	BOTTOM OF FIXTURE SHALL BE MOUNTED @ 8'-0" A.F.F. REFER TO ARCHITECTURAL DRAWINGS FOR MORE INFORMATION.FIELD COORDINATE WITH ARCHITECT/OWNER.
3	BOTTOM OF FIXTURE SHALL BE MOUNTED @ 10'-0" A.F.F. REFER TO ARCHITECTURAL DRAWINGS FOR ADDITIONAL INFORMATION. FIELD COORDINATE WITH ARCHITECT/OWNER.
4	FIXTURE SHALL BE MOUNTED TO STRUCTURE ABOVE. BOTTOM OF FIXTURE SHALL BE PENDANT MOUNTED @ 12'-0" A.F.F. COORDINATE EXACT LOCATIONS WITH MECHANICAL EQUIPMENT AND PIPING PRIOR TO ROUGH-IN.
5	WALL WASH FIXTURE SHALL BE AIMED TO ILLUMINATE WALL ART. COORDINATE WITH ARCHITECT/OWNER.
6	FIXTURES IN THIS CONTROL ZONE SHALL UTILIZE DAYLIGHTING CONTROLS VIA NEAREST DAYLIGHT SENSOR.
7	PROVIDE DIMMER SWITCH IN EACH MOTHERS ROOM CUBICLE TO CONTROL LIGHT FIXTURE WITHIN THAT CUBICLE. COORDINATE EXACT LOCATION WITH OWNER PRIOR TO ROUGH-IN.

KEYED NOTES

#	KEYNOTE
8	PROVIDE MANUAL OVERRIDE ON/OFF SWITCH AND PROVIDE JUNCTION BOX WITH BLANK COVER PLATE FOR FUTURE CONTROL ZONE DIMMER SWITCH.
9	PLACE OPEN OFFICE CONTROL ZONE DIMMER SWITCHES IN ELECTRICAL ROOM ADJACENT TO LIGHTING SYSTEM CONTROLLER. THERE SHALL BE ONE DIMMER SWITCH PER CONTROL ZONE.
10	TIE RECESSED CANOPY DOWNLIGHTS TO SITE BOLLARD CIRCUIT 1HF1-7. ROUTE CIRCUIT THROUGH CONTACTOR CONTROLLED VIA PHOTOCELL AND TIMECLOCK.
11	VAPOR TIGHT LIGHT FIXTURES SHALL BE LOCATED IN PIT. CONTRACTOR SHALL PROVIDE ADDITIONAL FIXTURES AS NEEDED TO MEET THE REQUIRED 10FC AT PIT FLOOR PER ASME 17.1 SECTION 2.2.5.1. FIXTURES SHALL BE CONTROLLED VIA A LOCAL SINGLE POLE TOGGLE SWITCH.
12	PROVIDE WIRELESS DIMMABLE WALL SWITCH FOR LOCAL CONTROL OF THE LIGHTING FIXTURE(S) IN THE SAME ROOM.

AECOM
BATSON-COOK CONSTRUCTION

PROJECT

PUBLIX HEADQUARTERS BUILDING ADDITION AND PARKING LOT EXPANSION

3300 PUBLIX CORPORATE PARKWAY
LAKELAND, FL 33811

CLIENT

Publix

3300 PUBLIX CORPORATE PARKWAY
LAKELAND, FL 33811

www.publix.com

CONSULTANT

AECOM

AECOM TECHNICAL SERVICES, INC.
800 Douglas Entrance
North Tower, 2nd Floor
Coral Gables, FL 33134
305.444.4691 tel 305.447.3580 fax
www.aecom.com

ARCHITECTURE
LICENSE NO. AA26000687

ENGINEERING
CA LIC. NO. 8115

http://www.aecom.com

REGISTRATION

HENRYK B. JUSZCZYK, PROFESSIONAL ENGINEER, STATE OF FLORIDA, LICENSE NO. 58082

THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY HENRYK B. JUSZCZYK, PROFESSIONAL ENGINEER, STATE OF FLORIDA, LICENSE NO. 58082 ON THE DATE INDICATED HERE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

Henryk B Juszczyk
Digitally signed by Henryk B Juszczyk
Date: 2020.06.19 16:15:35-04'00'

KEY PLAN

EXISTING | A | B

ISSUE/REVISION

I/R	DATE	DESCRIPTION
2	MAY 01, 2020	SI-004
1	SEP 30, 2019	100% CONSTRUCTION DOCUMENTS
0	AUG 23, 2019	CONSTRUCTION DOCUMENTS

PROJECT NUMBER

60601397

SHEET TITLE

PARTIAL LIGHTING PLAN - LEVEL 1 AREA A

SHEET NUMBER

E2-5-11

NOTICE: THE OFFICIAL RECORD OF THIS SHEET IS THE ELECTRONIC FILE SIGNED AND SEALED UNDER RULE 61G15-23.004, F.A.C.

The drawing has been prepared for the use of AECOM's client and may not be used, reproduced or relied upon by third parties, except as agreed by AECOM and its clients, as required by law or for use by governmental reviewing agencies. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that modifies this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

Project Management Initials: Designer: Designer Checked: Checker Approved: Approver/ARCH E1 30"x42"
Last Plotted: 5/12/2020 11:06:19 AM
Filename: BM:\60601397\Publix HQ\60601397_Publix HQ_ELECT_R2019.rvt

Printed on ___% Post-Consumer Recycled Content Paper
©2016 AECOM Corporation