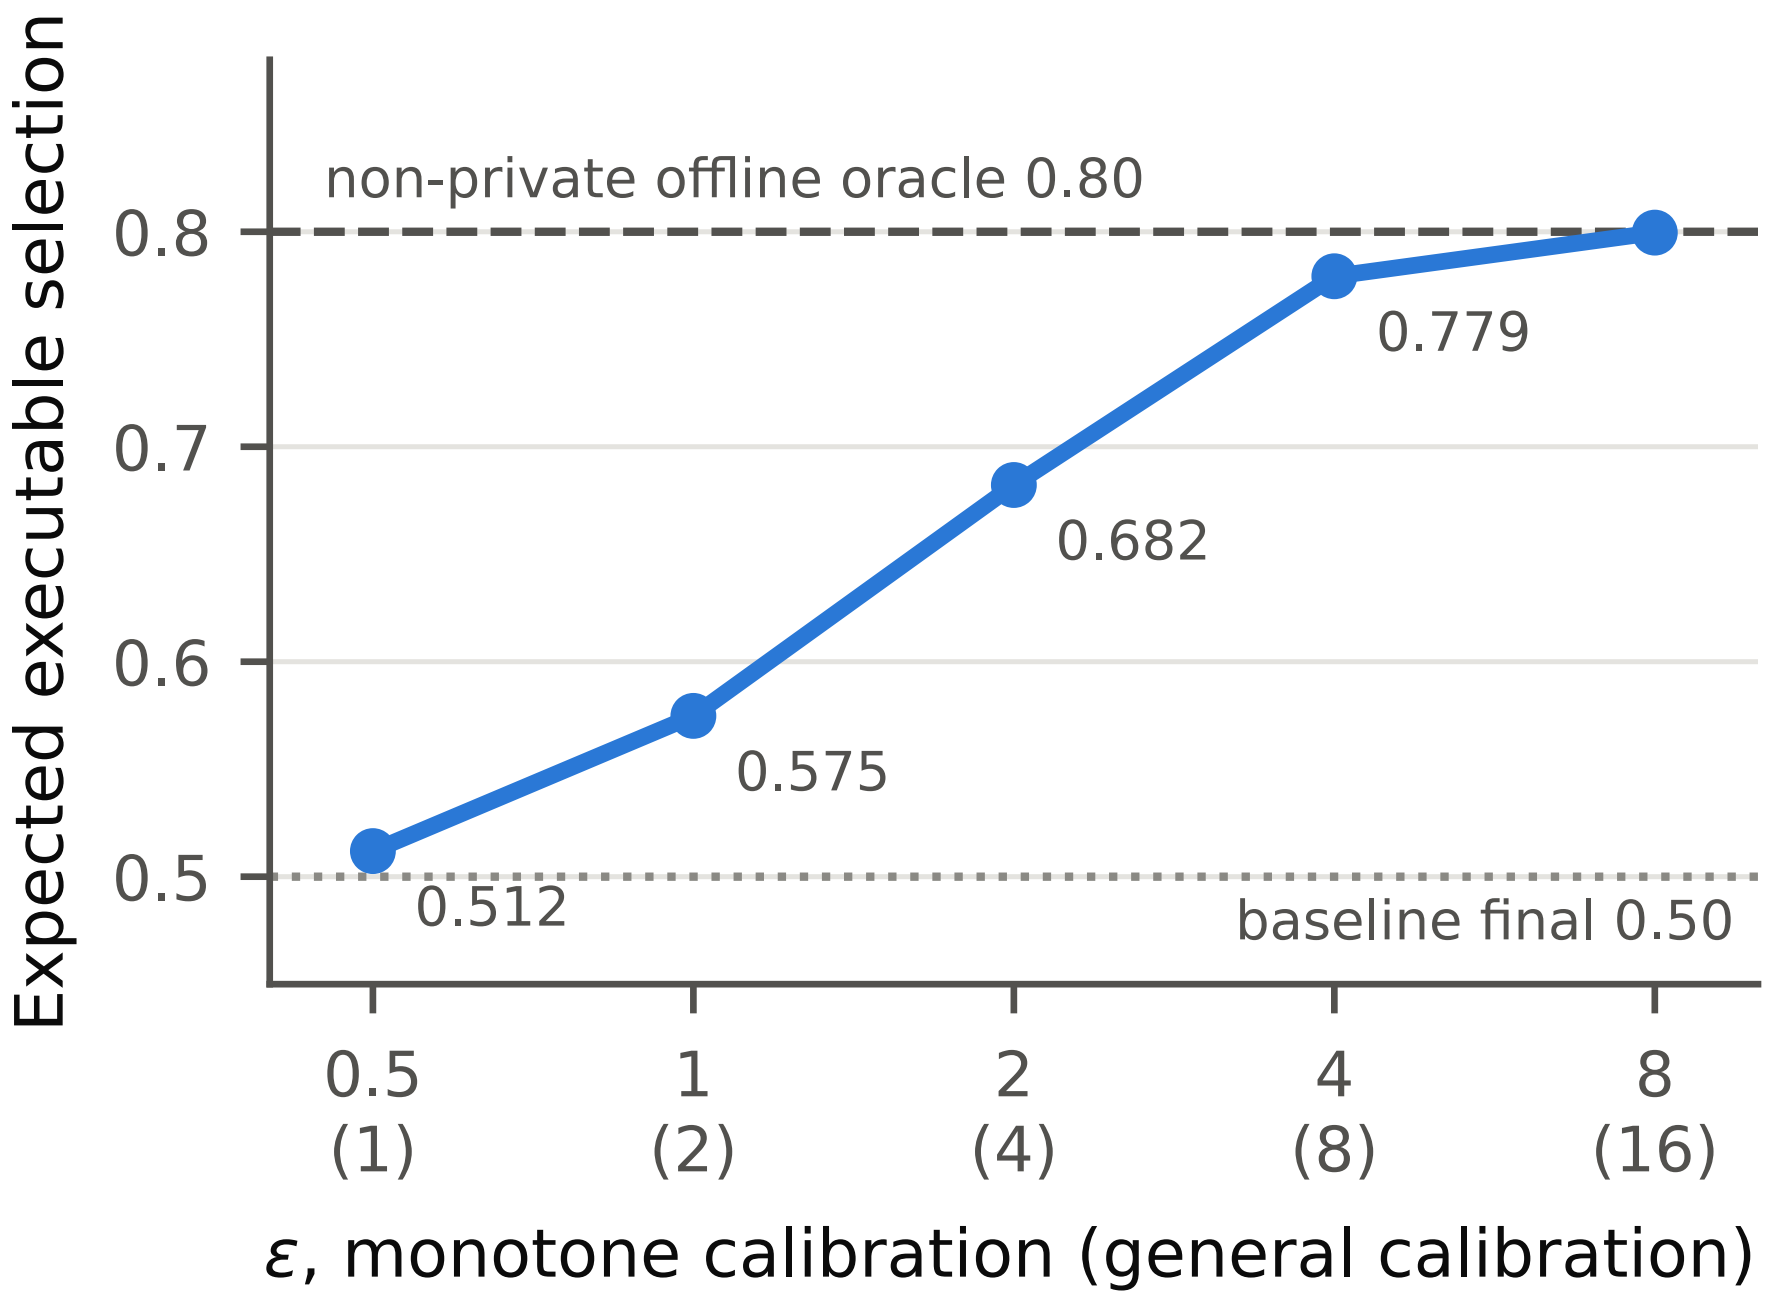
Expected executable selection
non-private offline oracle 0.80
0.8
0.7
0.6
0.5
0.779
0.682
0.575
0.512
baseline final 0.50
0.5
(1)
1
(2)
2
(4)
4
(8)
8
(16)
ε, monotone calibration (general calibration)