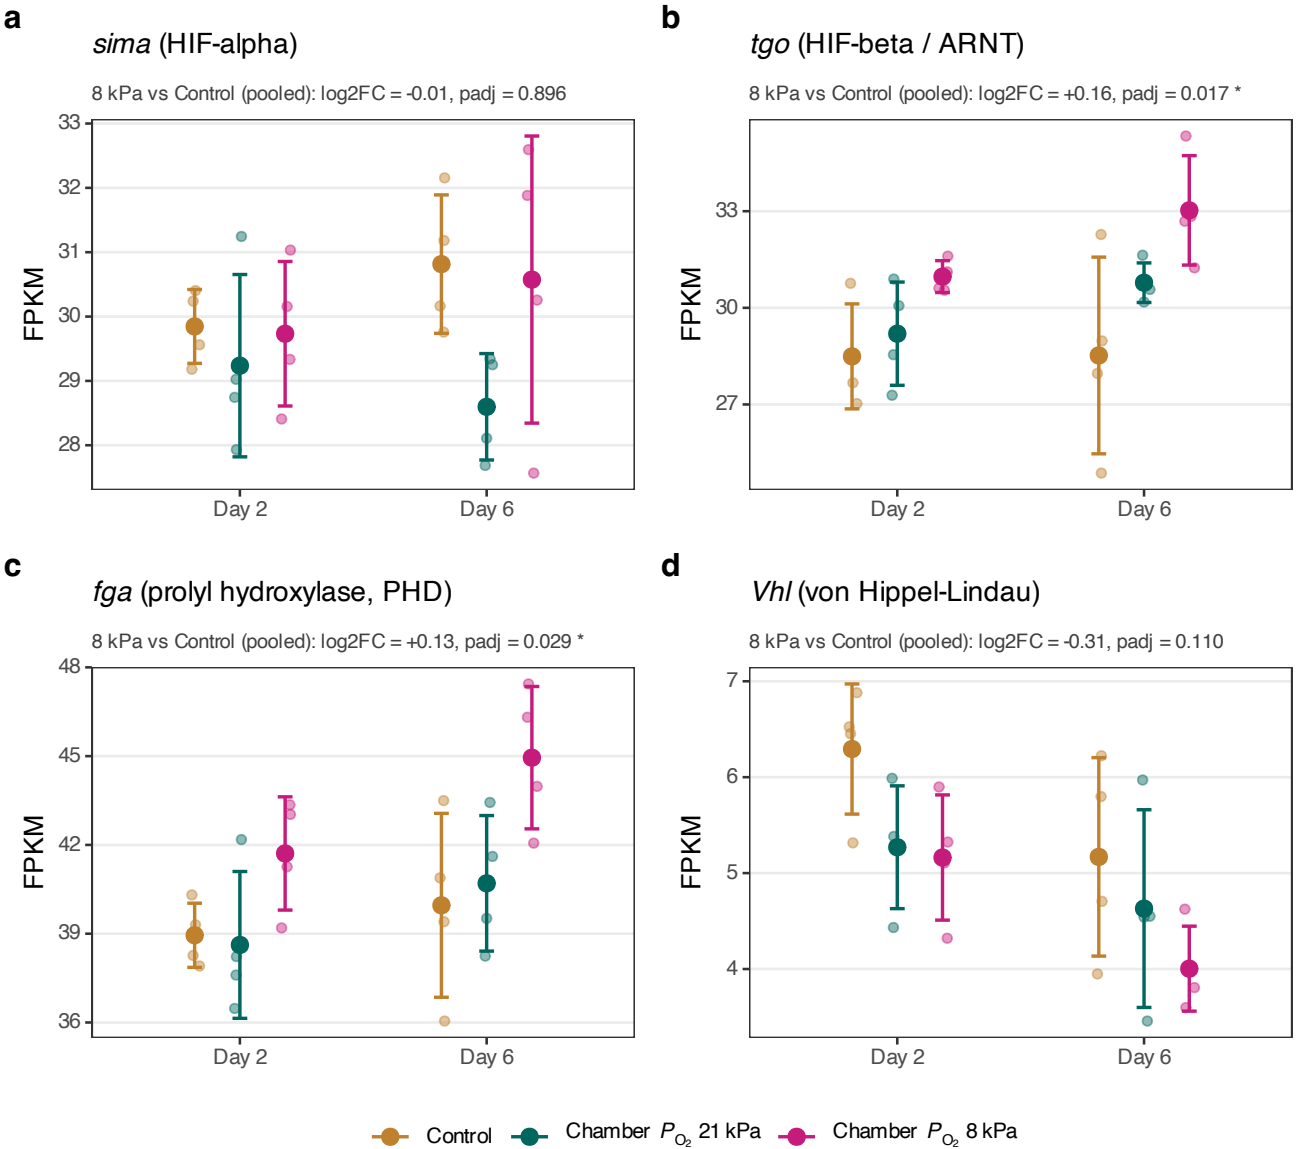
a
sima (HIF-alpha)
8 kPa vs Control (pooled): log2FC = -0.01, padj = 0.896
FPKM
33
32
31
30
29
28
Day 2
Day 6
b
tgo (HIF-beta / ARNT)
8 kPa vs Control (pooled): log2FC = +0.16, padj = 0.017 *
FPKM
33
30
27
Day 2
Day 6
c
fga (prolyl hydroxylase, PHD)
8 kPa vs Control (pooled): log2FC = +0.13, padj = 0.029 *
FPKM
48
45
42
39
36
Day 2
Day 6
d
Vhl (von Hippel-Lindau)
8 kPa vs Control (pooled): log2FC = -0.31, padj = 0.110
FPKM
7
6
5
4
Day 2
Day 6
Control
Chamber P_{O_2} 21 kPa
Chamber P_{O_2} 8 kPa