



NOTE: Plsss remove the Power Factor Analysis and Historical Reports in here . Plss also change the REMS to RECMS Development of an AI-Assisted Residential Energy Management Control System



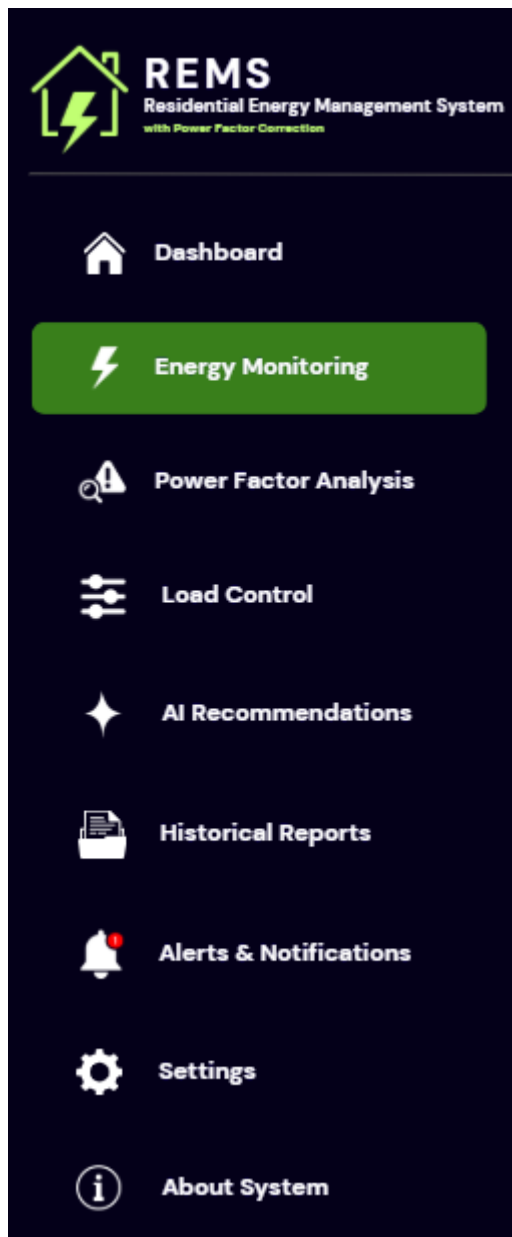

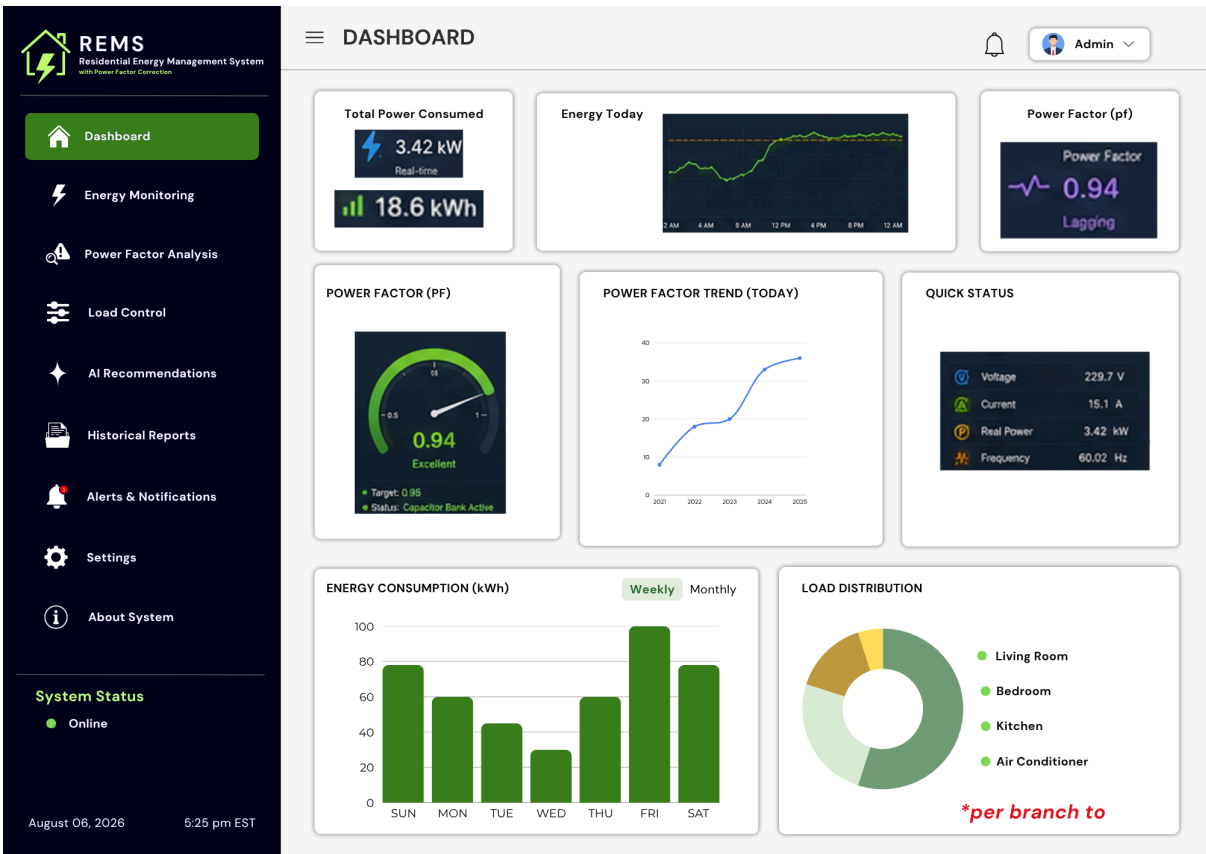

REMS
Residential Energy Management System
with Power Factor Correction

Dashboard

Energy Monitoring

Power Factor Analysis

Load Control

AI Recommendations

Historical Reports

Alerts & Notifications

Settings

About System

System Status

Online

August 06, 20265:25 pm EST

ENERGY MONITORING

*history ng data

Admin

Overview

Voltage

Current

Power

pf

Monthly

Voltage (Avg.)
239.7 V
Min: 221.3 V Max: 235.6 V

Current (Avg.)
15.1 A
Min: 2.1 A Max: 22.3 A

Power (Real)
3.42 kW
Min: 0.45 kW Max: 4.78 kW

Energy Today
18.6 kWh
↑ 12% vs yesterday

total data ng main branch (main branch pzem)

voltage

current

power

power factor



REMS
Residential Energy Management System
with Power Factor Correction

Dashboard

Energy Monitoring

Power Factor Analysis

Load Control

AI Recommendations

Historical Reports

Alerts & Notifications

Settings

About System

System Status

Online

August 06, 20265:25 pm EST

ENERGY MONITORING

Admin

Overview

Voltage

Current

Power

pf

Monthly

*voltage per pzem

Voltage

*may pilian ng month or date dito depende sa option na pinili


August

Branch 1

*voltage live data

Voltage (Today)

237.3 V

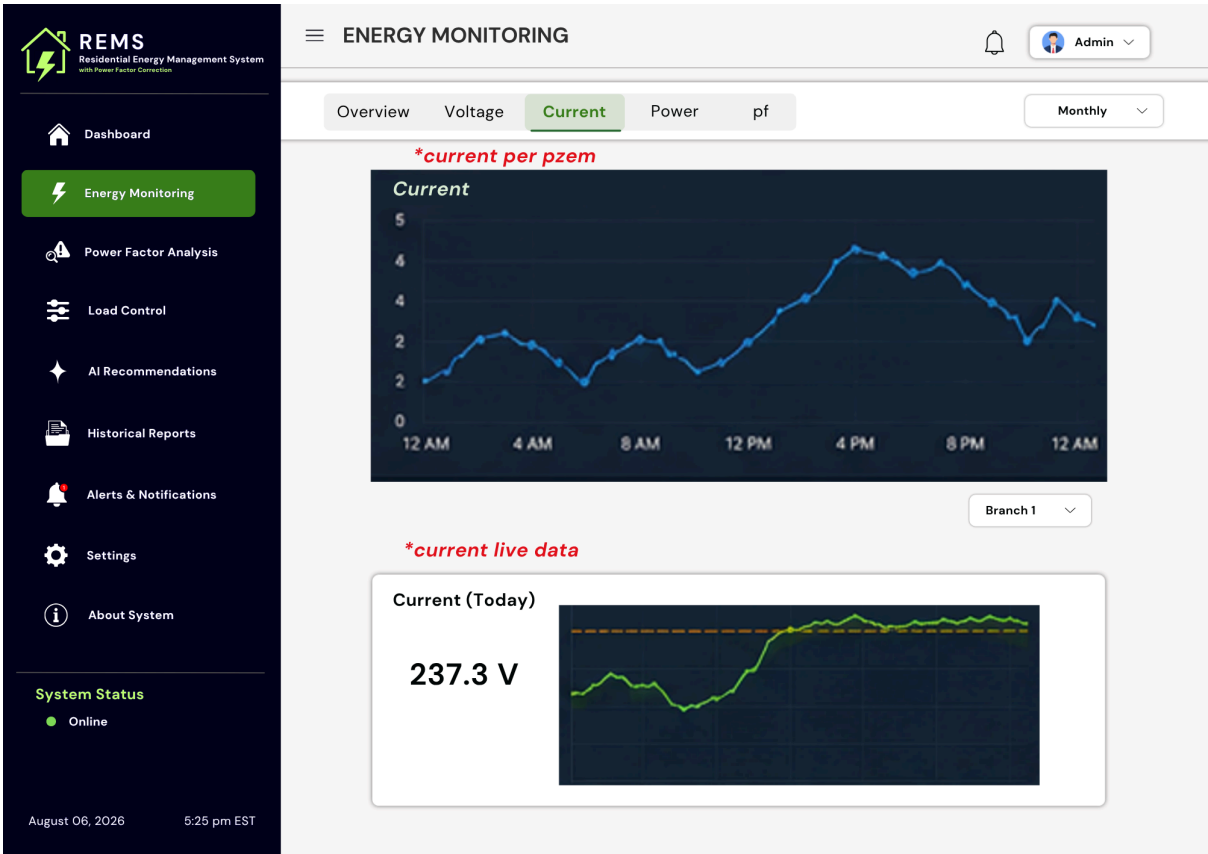



REMS
Residential Energy Management System
with Power Factor Correction

Dashboard

Energy Monitoring

Power Factor Analysis

Load Control

AI Recommendations

Historical Reports

Alerts & Notifications

Settings

About System

System Status

Online

August 06, 20265:25 pm EST

ENERGY MONITORING

Admin

OverviewVoltageCurrentPowerpf

Monthly

**power per pzem*

Power




Branch 1

**power live data*

Power (Today)

237.3 V

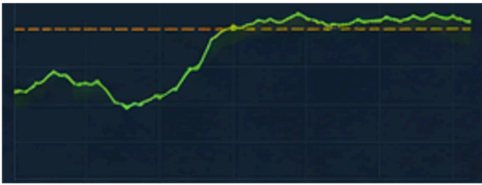



REMS
Residential Energy Management System
with Power Factor Correction

Dashboard

Energy Monitoring

Power Factor Analysis

Load Control

AI Recommendations

Historical Reports

Alerts & Notifications

Settings

About System

System Status

Online

August 06, 20265:25 pm EST

ENERGY MONITORING

Admin

OverviewVoltageCurrentPowerpf

Monthly

**pf per pzem*

Power Factor (pf)




Branch 1

**pf live data*

pf (Today)

237.3 V

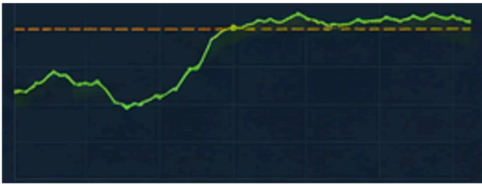



REMS
Residential Energy Management System
with Power Factor Correction

Dashboard

Energy Monitoring

Power Factor Analysis

Load Control

AI Recommendations

Historical Reports

Alerts & Notifications

Settings

About System

System Status

Online

August 06, 2026

5:25 pm EST

LOAD CONTROL

Admin

Living Room
0.85 kW

Bedroom
0.85 kW

Kitchen
0.75 kW

Air Conditioner
1.17 kW

Garage
0.00 kW

DEVICES

Device	Room	Power (kW)	Status	Control
Living Room Lights	Living Room	0.12	ON	ON
TV	Living Room	0.15	ON	ON
Outlet Group 1	Living Room	0.20	ON	ON
Air Conditioner	Air Conditioner	1.17	ON	ON
Bedroom Lights	Bedroom	0.08	ON	ON
Outlet Group 2	Bedroom	0.12	ON	ON
Refrigerator	Kitchen	0.10	ON	ON
Kitchen Outlets	Kitchen	0.25	ON	ON

MANUAL OVERRIDE

Enable Manual Control

ON

Override Duration
2 hours

APPLY

SCHEDULE

Enable Schedule

OFF

View / Edit Schedule

Total Connected Load

3.42 kW

Total Devices

8

Devices ON

8

Devices OFF

0



REMS
Residential Energy Management System
with Power Factor Correction

Dashboard

Energy Monitoring

Power Factor Analysis

Load Control

AI Recommendations

Historical Reports

Alerts & Notifications

Settings

About System

System Status

Online

August 06, 2026

5:25 pm EST

AI RECOMMENDATIONS

Admin

Recommendations Insights

Recommendation	Priority	Action
Living room lights have been ON for 4 hours. Consider turning OFF to save energy.	Medium	View
Air conditioner is operating at low efficiency. Recommended temperature: 25°C.	High	View
Power factor dropped below 0.90 at 7:35 AM. Capacitor bank was automatically switched ON.	High	View
Great job! You saved 5.3 kg of CO₂ today. Keep optimizing your energy usage.	Low	View
Peak usage detected between 6 PM - 9 PM. Consider scheduling non-essential loads.	Medium	View



REMS
Residential Energy Management System
with Power Factor Correction

 Dashboard

 Energy Monitoring

 Power Factor Analysis

 Load Control

 AI Recommendations

 Historical Reports

 Alerts & Notifications

 Settings

 About System

System Status

Online

August 06, 20265:25 pm EST

SETTINGS

Admin

GeneralUsers

SYSTEM SETTINGS

System Name

REMCS

Location

Rojas Residence

Time Zone

(GMT+08:00) Asia, Philippines

Date & Time

August 7, 2026 4:04 PM

Sync

SAVE CHANGES

PFC SETTINGS (AUTO-CORRECTION)

Target Power Factor

0.97

Minimum PF Limit

0.84

Capacitor Switching Delay

30 sec

SAVE CHANGES