


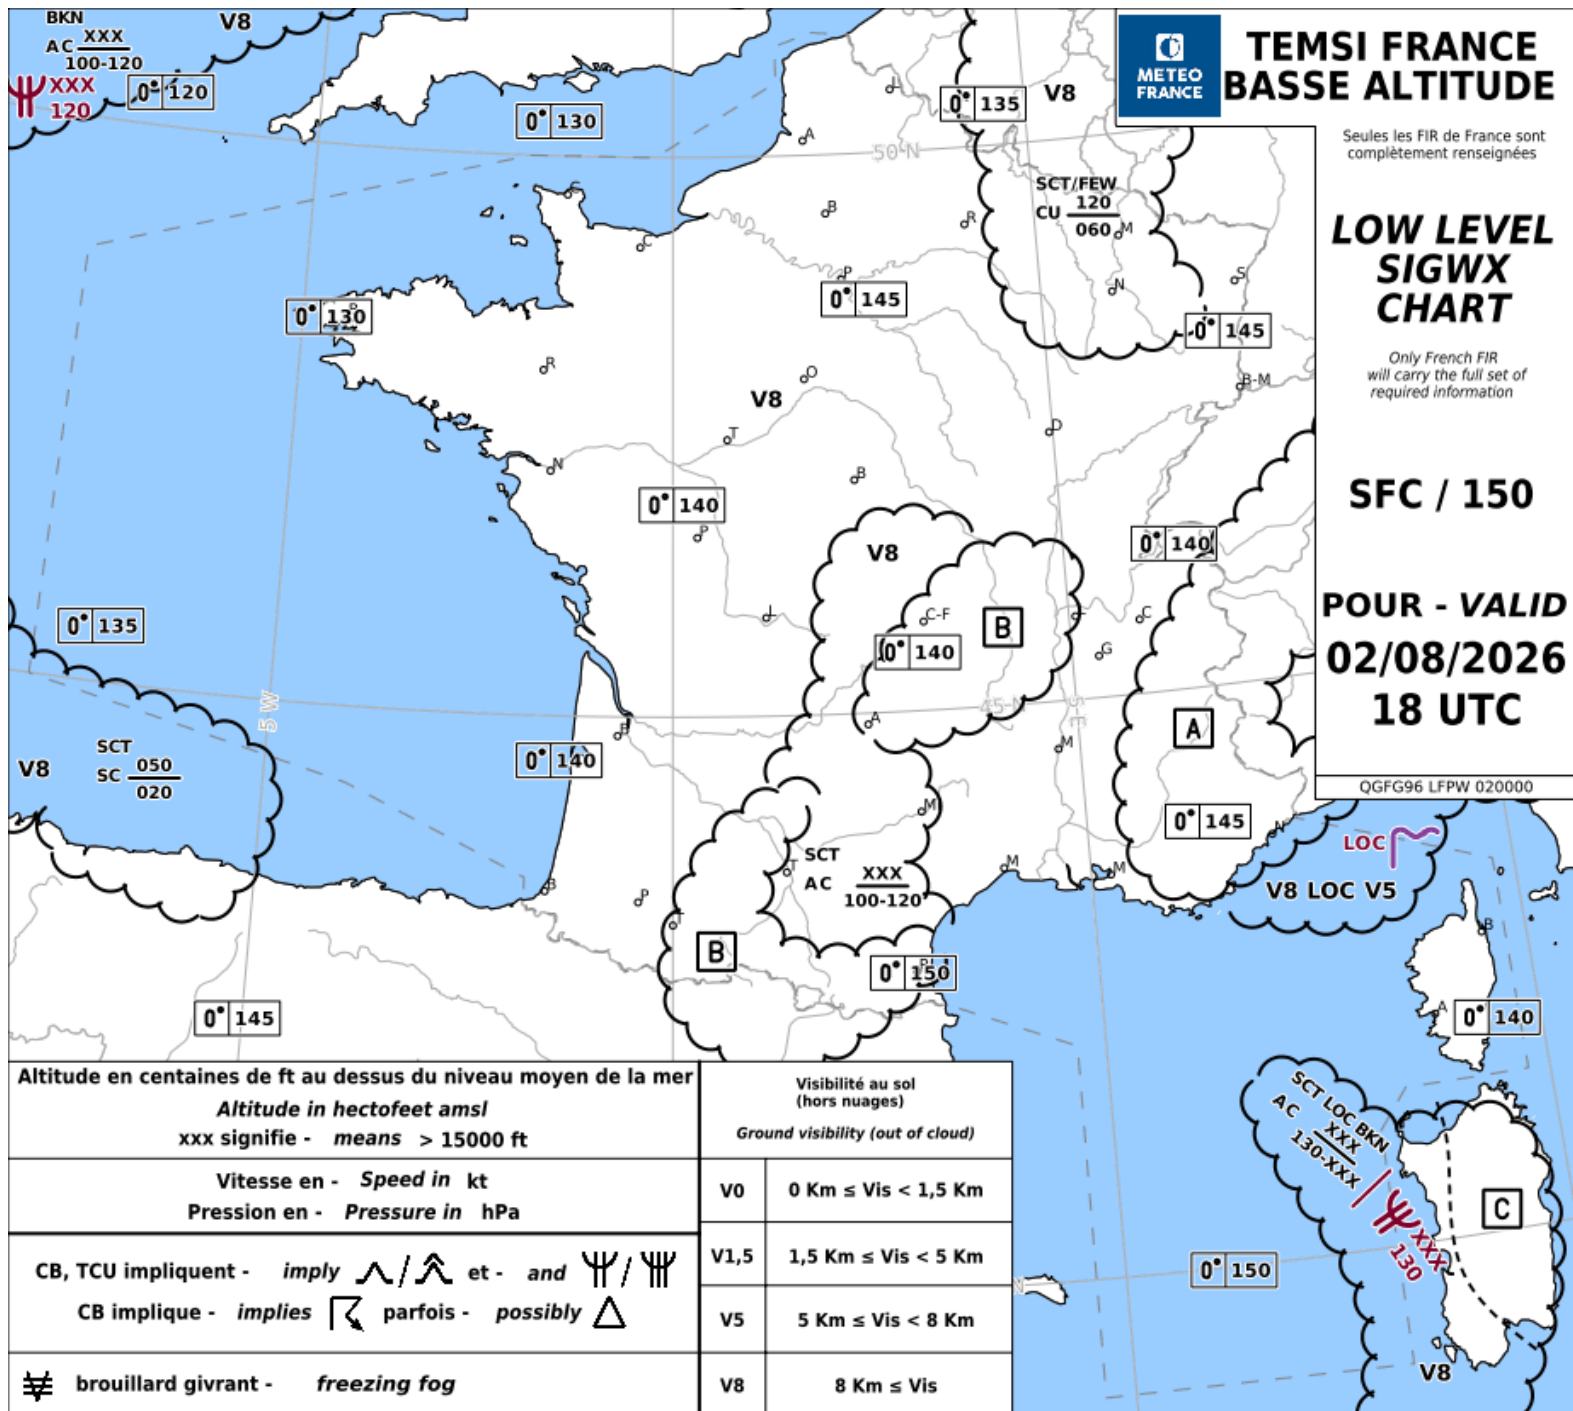

-10° XXX	
A	SCT CU 120 020-050
	SCT LOC BKN AC XXX 100
	ISOL CB XXX 050
	V8 LOC V1,5/
B	SCT AC XXX 100
	ISOL CB XXX 080
	V8 LOC V1,5/
C	LAN ISOL CB XXX 100
	LOC LAN V1,5/