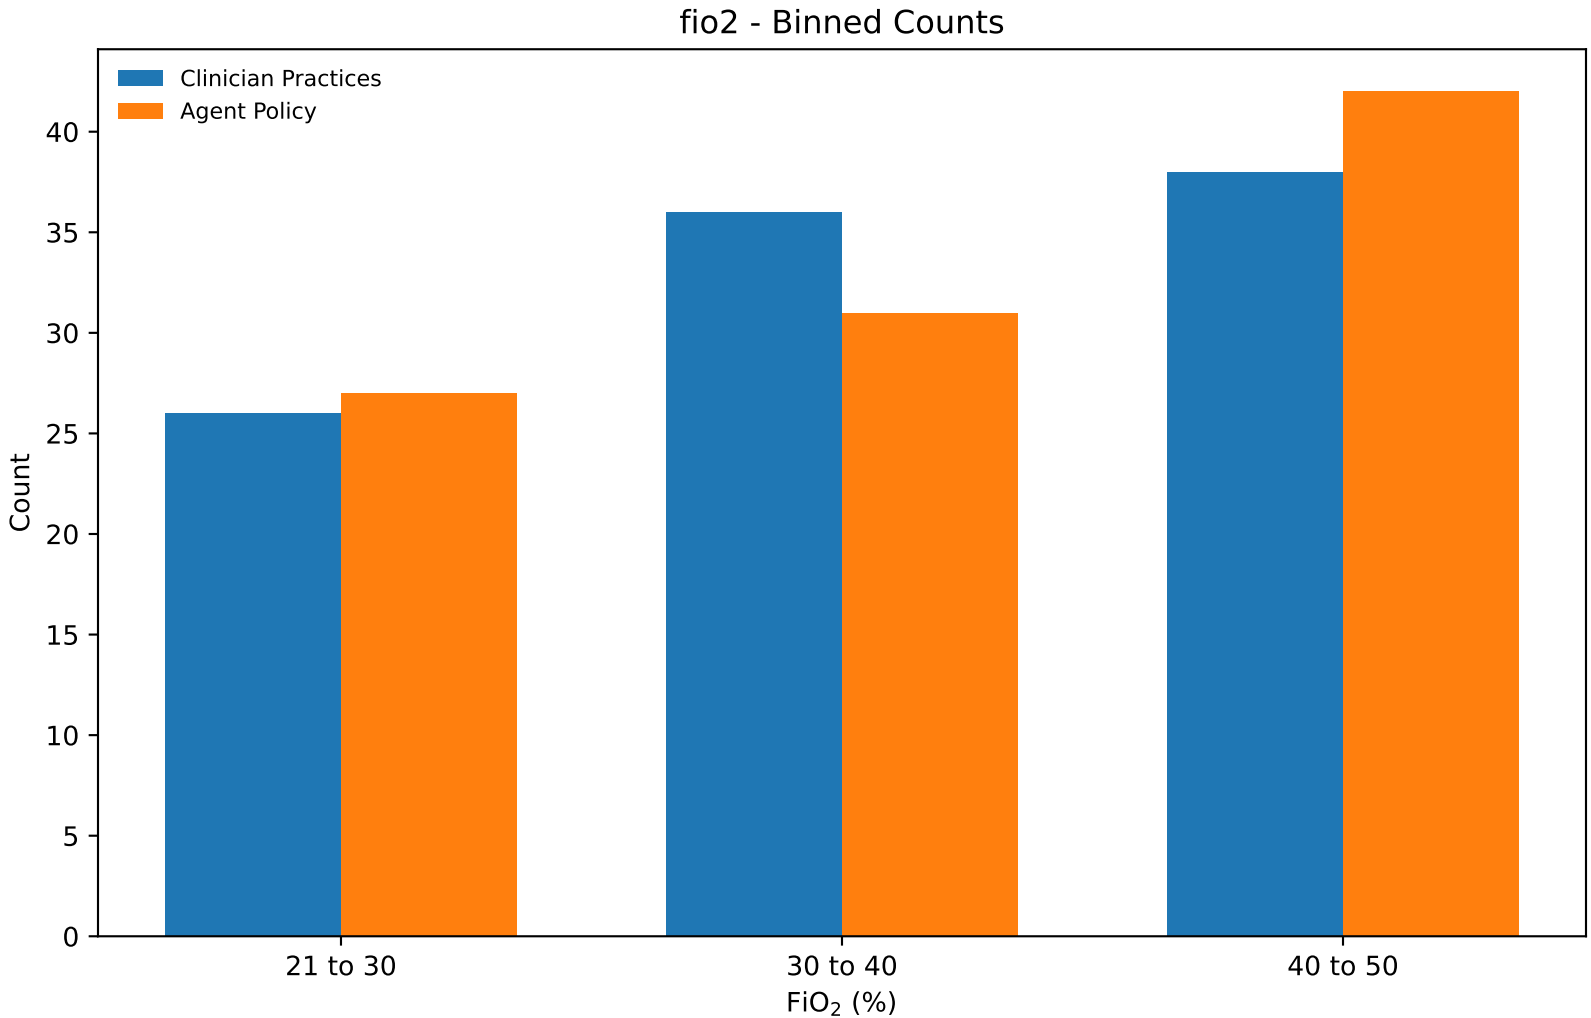
fio2 - Binned Counts
Clinician Practices
Agent Policy
Count
0
5
10
15
20
25
30
35
40
21 to 30
30 to 40
40 to 50
FiO2 (%)

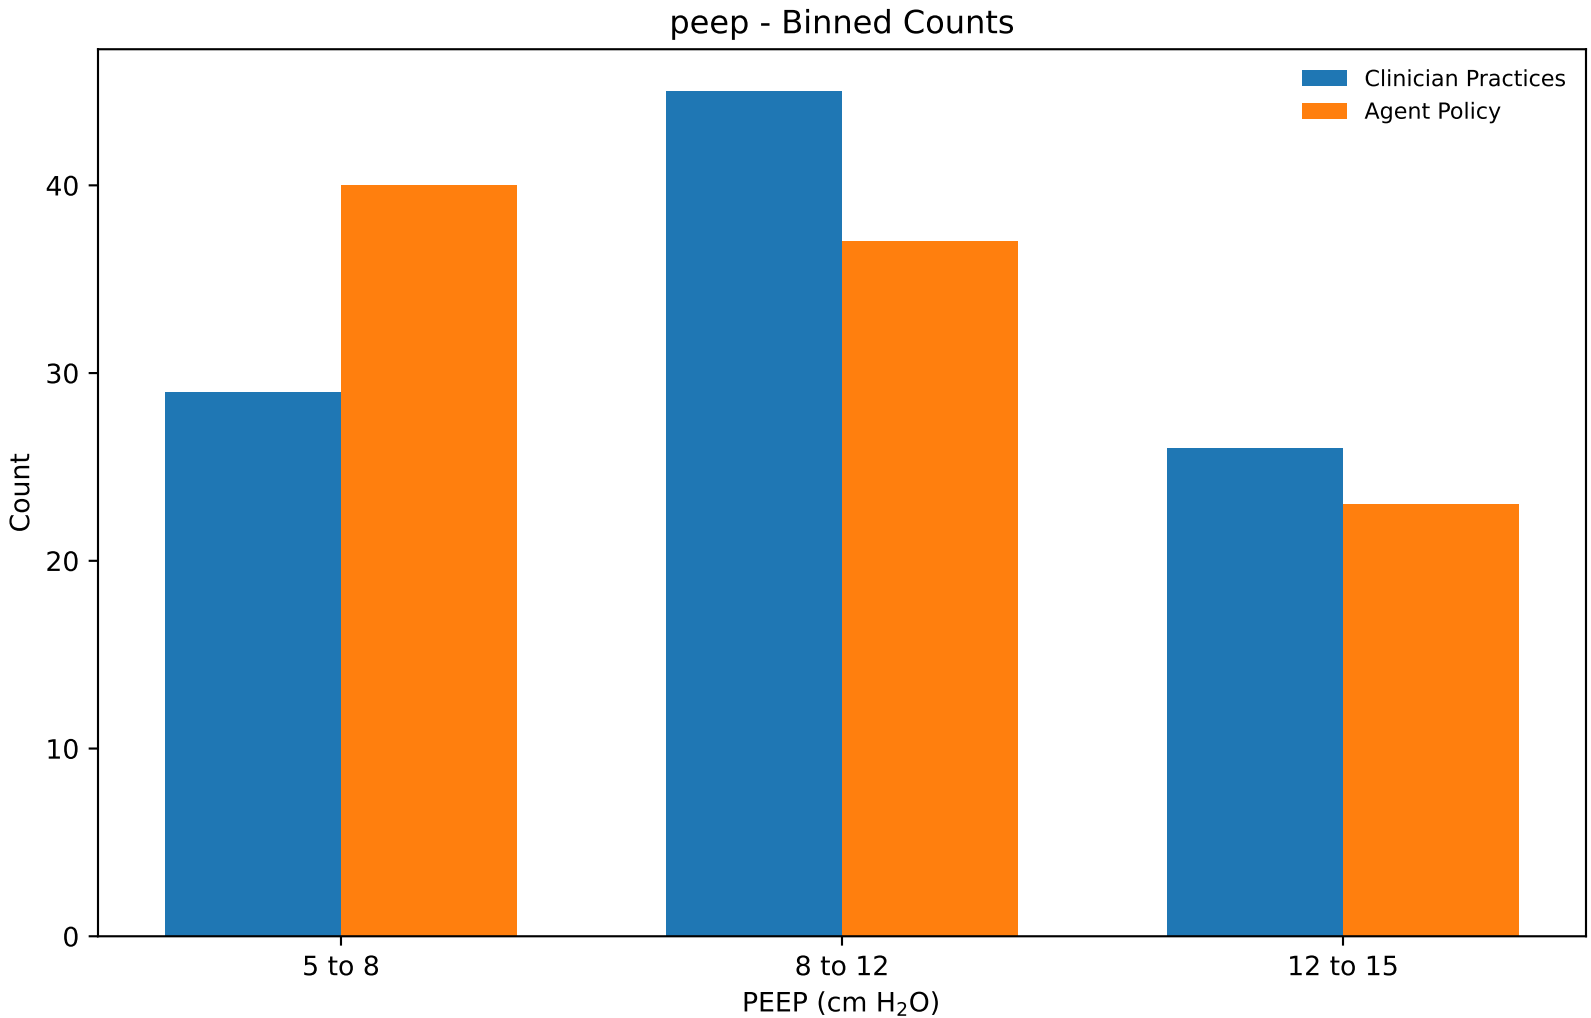
peep - Binned Counts
Clinician Practices
Agent Policy
Count
0
10
20
30
40
5 to 8
8 to 12
12 to 15
PEEP (cm $H_2O$)

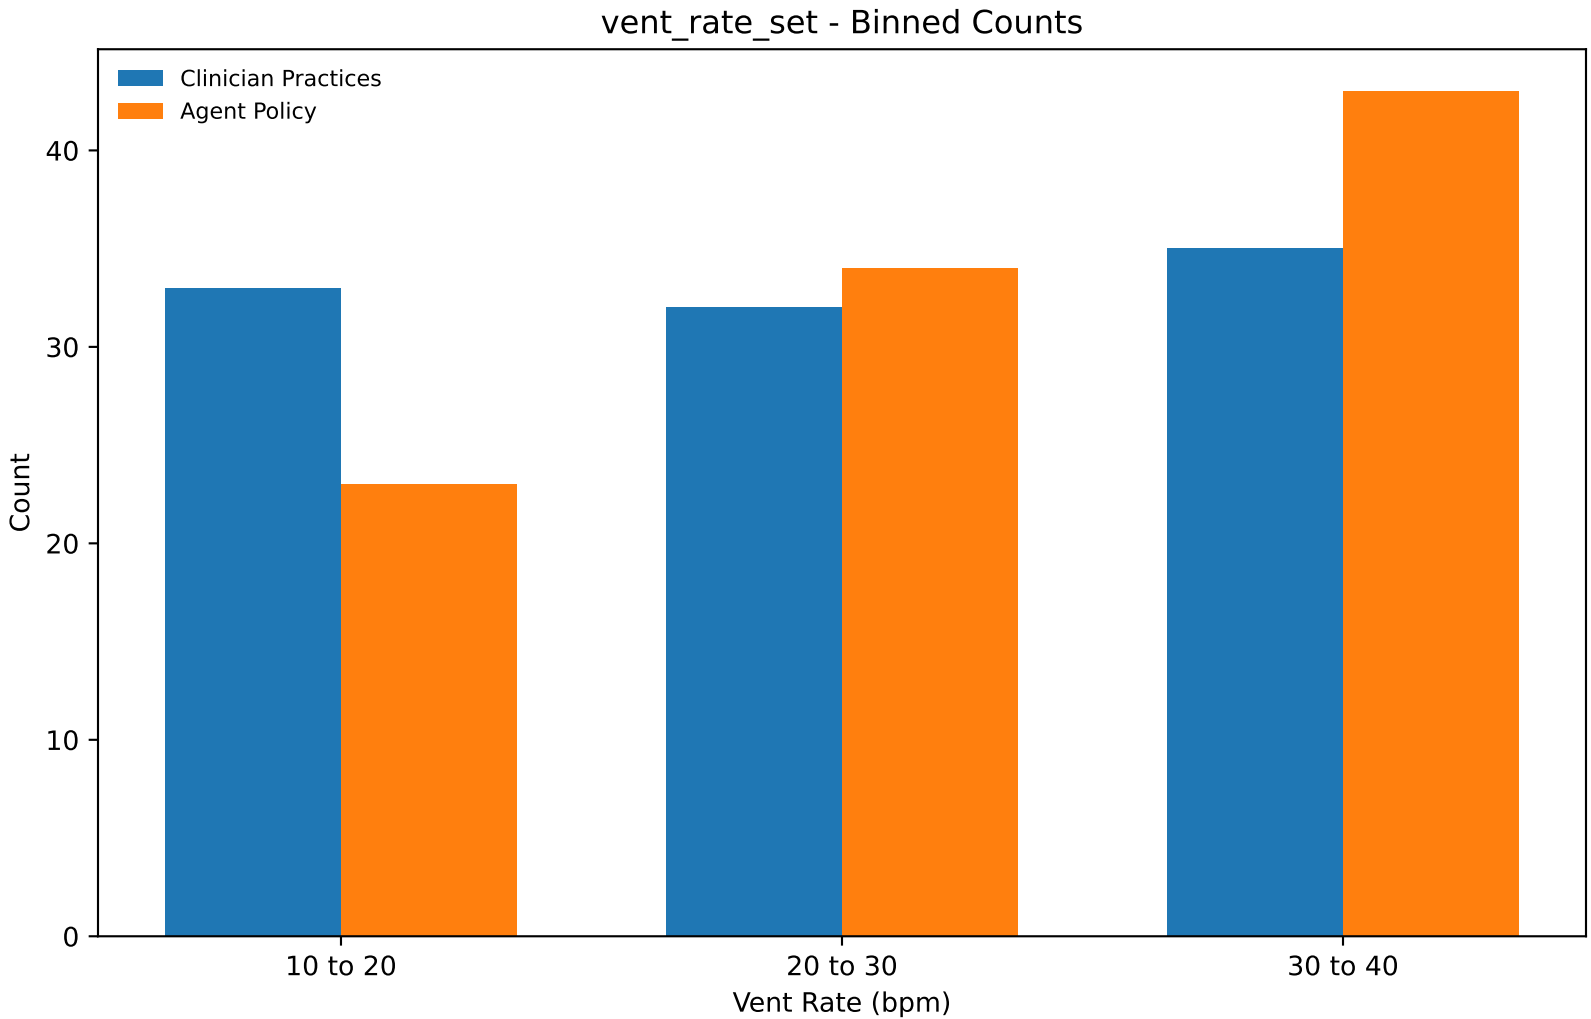
vent_rate_set - Binned Counts
Clinician Practices
Agent Policy
Count
0
10
20
30
40
10 to 20
20 to 30
30 to 40
Vent Rate (bpm)

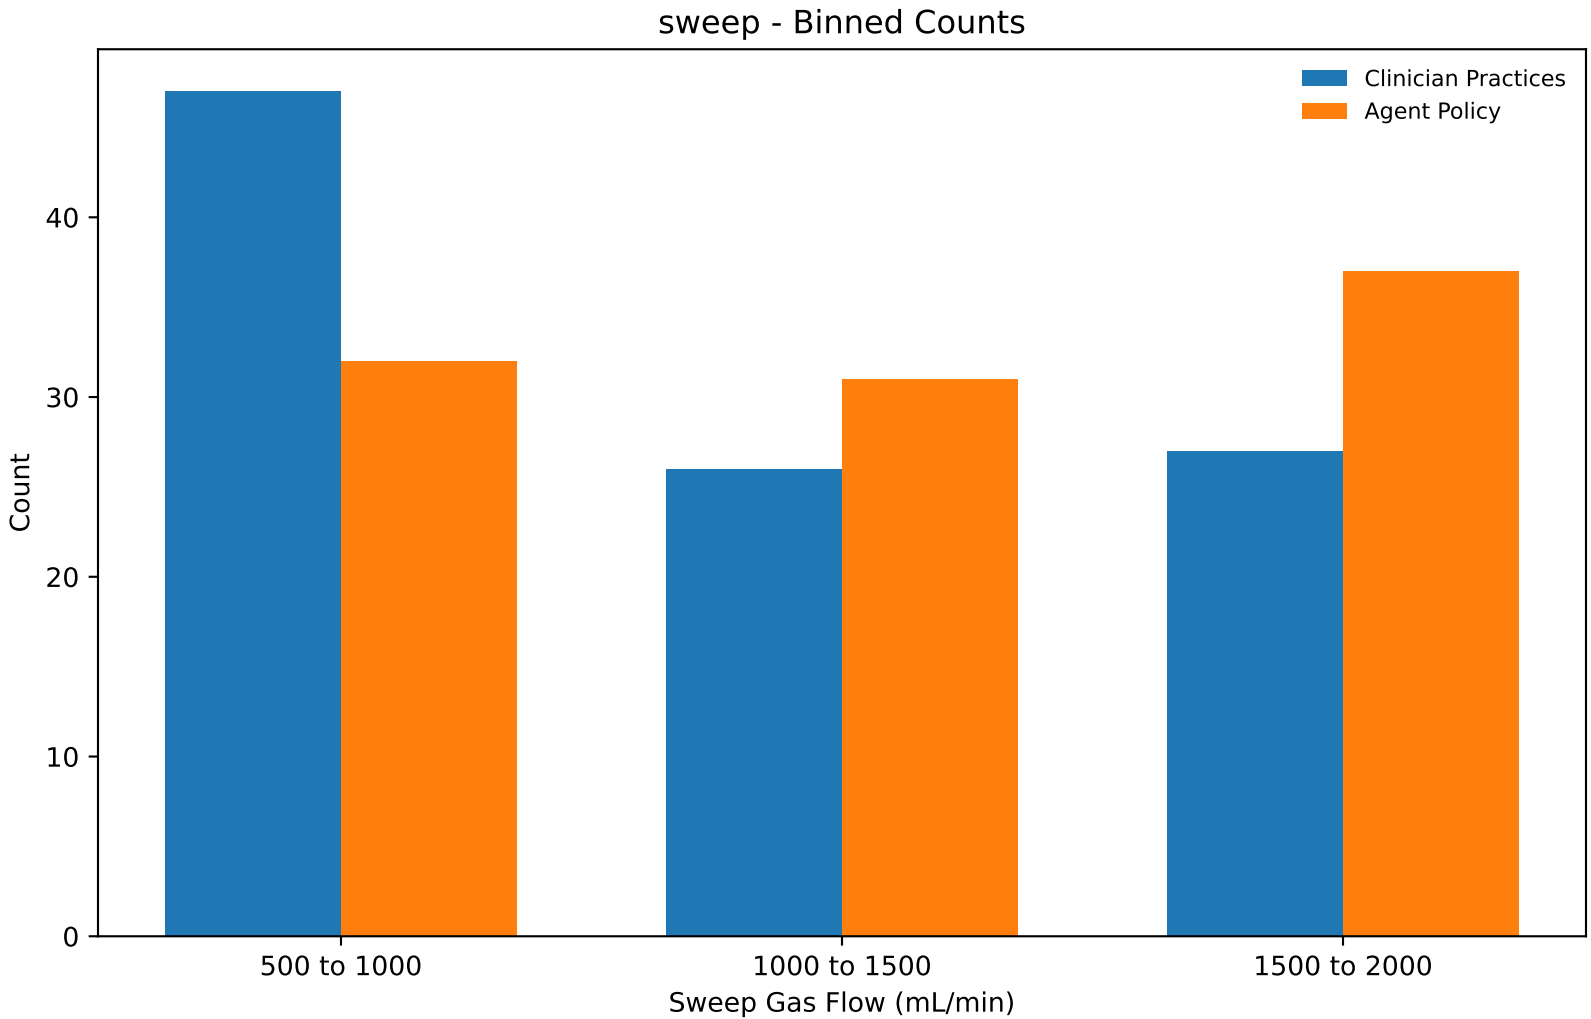
sweep - Binned Counts
Clinician Practices
Agent Policy
Count
0
10
20
30
40
500 to 1000
1000 to 1500
1500 to 2000
Sweep Gas Flow (mL/min)

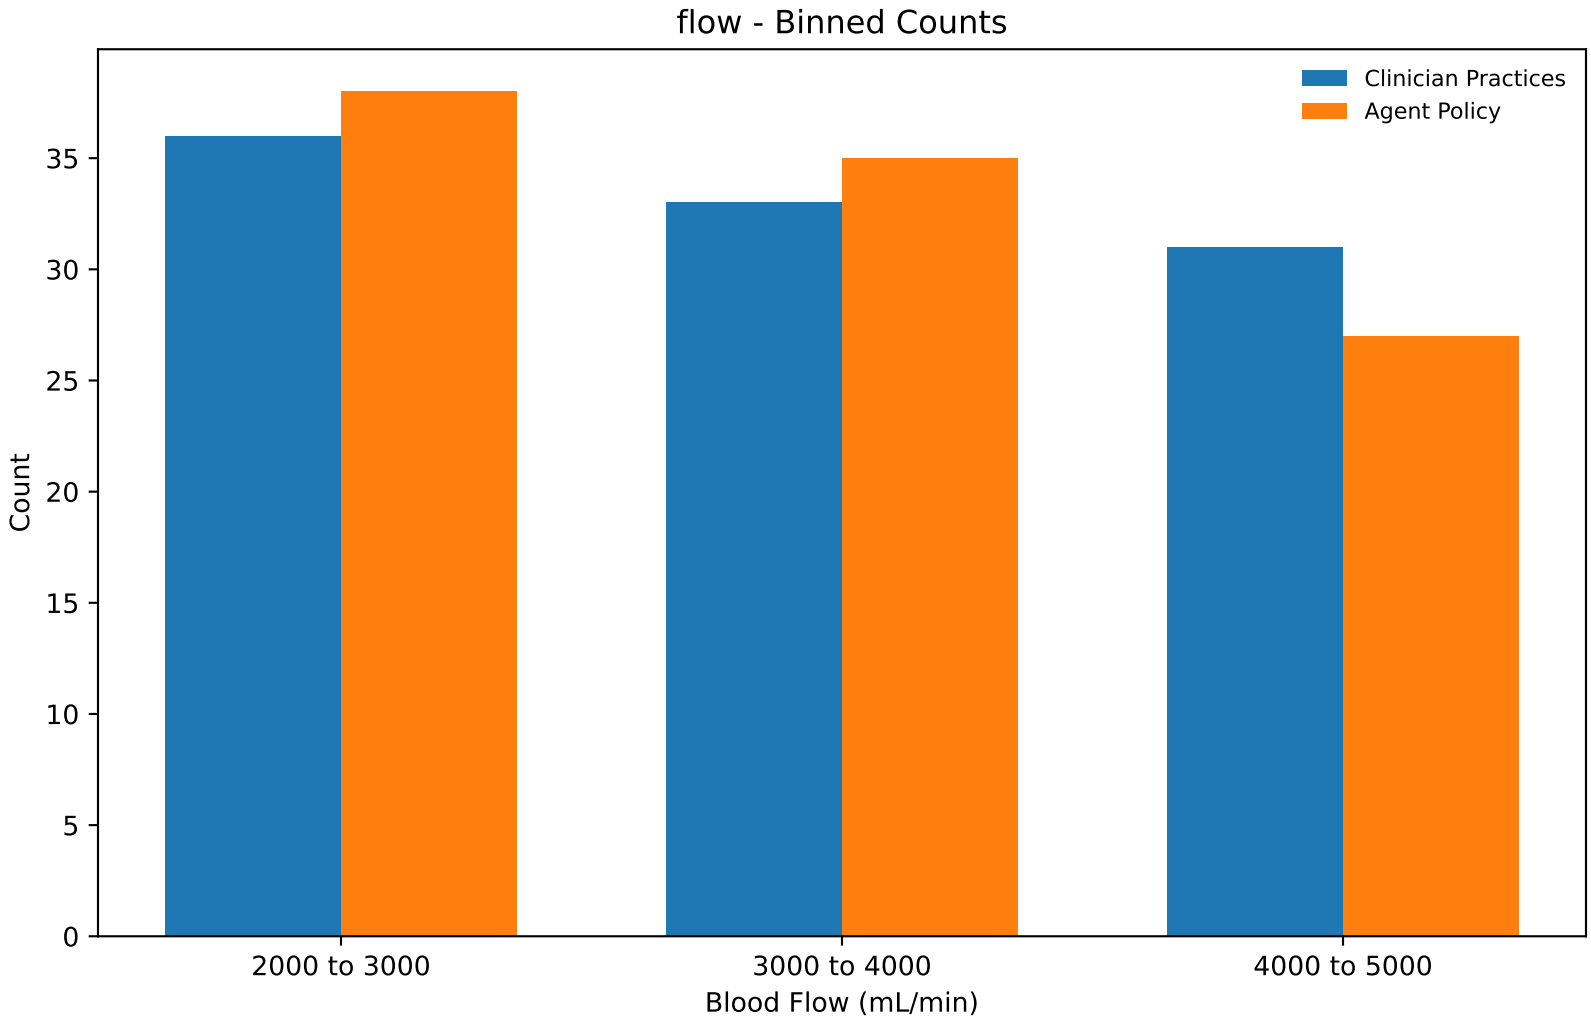
flow - Binned Counts
Clinician Practices
Agent Policy
Count
0
5
10
15
20
25
30
35
2000 to 3000
3000 to 4000
4000 to 5000
Blood Flow (mL/min)