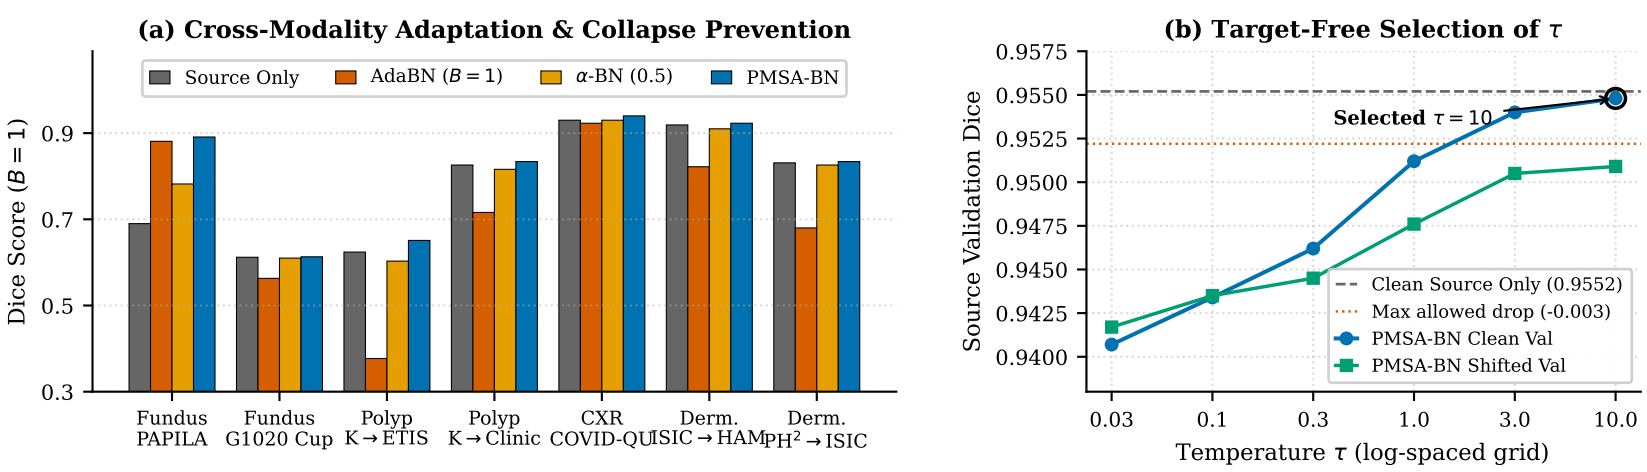
(a) Cross-Modality Adaptation & Collapse Prevention
Source Only
AdaBN (B = 1)
α-BN (0.5)
PMSA-BN
Dice Score (B = 1)
0.9
0.7
0.5
0.3
Fundus PAPILA
Fundus G1020 Cup
Polyp K → ETIS
Polyp K → Clinic
CXR COVID-QU
Derm. ISIC → HAM
Derm. PH² → ISIC
(b) Target-Free Selection of τ
Source Validation Dice
0.9575
0.9550
0.9525
0.9500
0.9475
0.9450
0.9425
0.9400
Selected τ = 10
Clean Source Only (0.9552)
Max allowed drop (-0.003)
PMSA-BN Clean Val
PMSA-BN Shifted Val
0.03
0.1
0.3
1.0
3.0
10.0
Temperature τ (log-spaced grid)