
THIS DRAWING IS THE PROPERTY OF AICPL AND CANNOT BE COPIED, REPRODUCED OR DISCLOSED TO THIRD PARTIES WITHOUT ANY WRITTEN AUTHORISATION

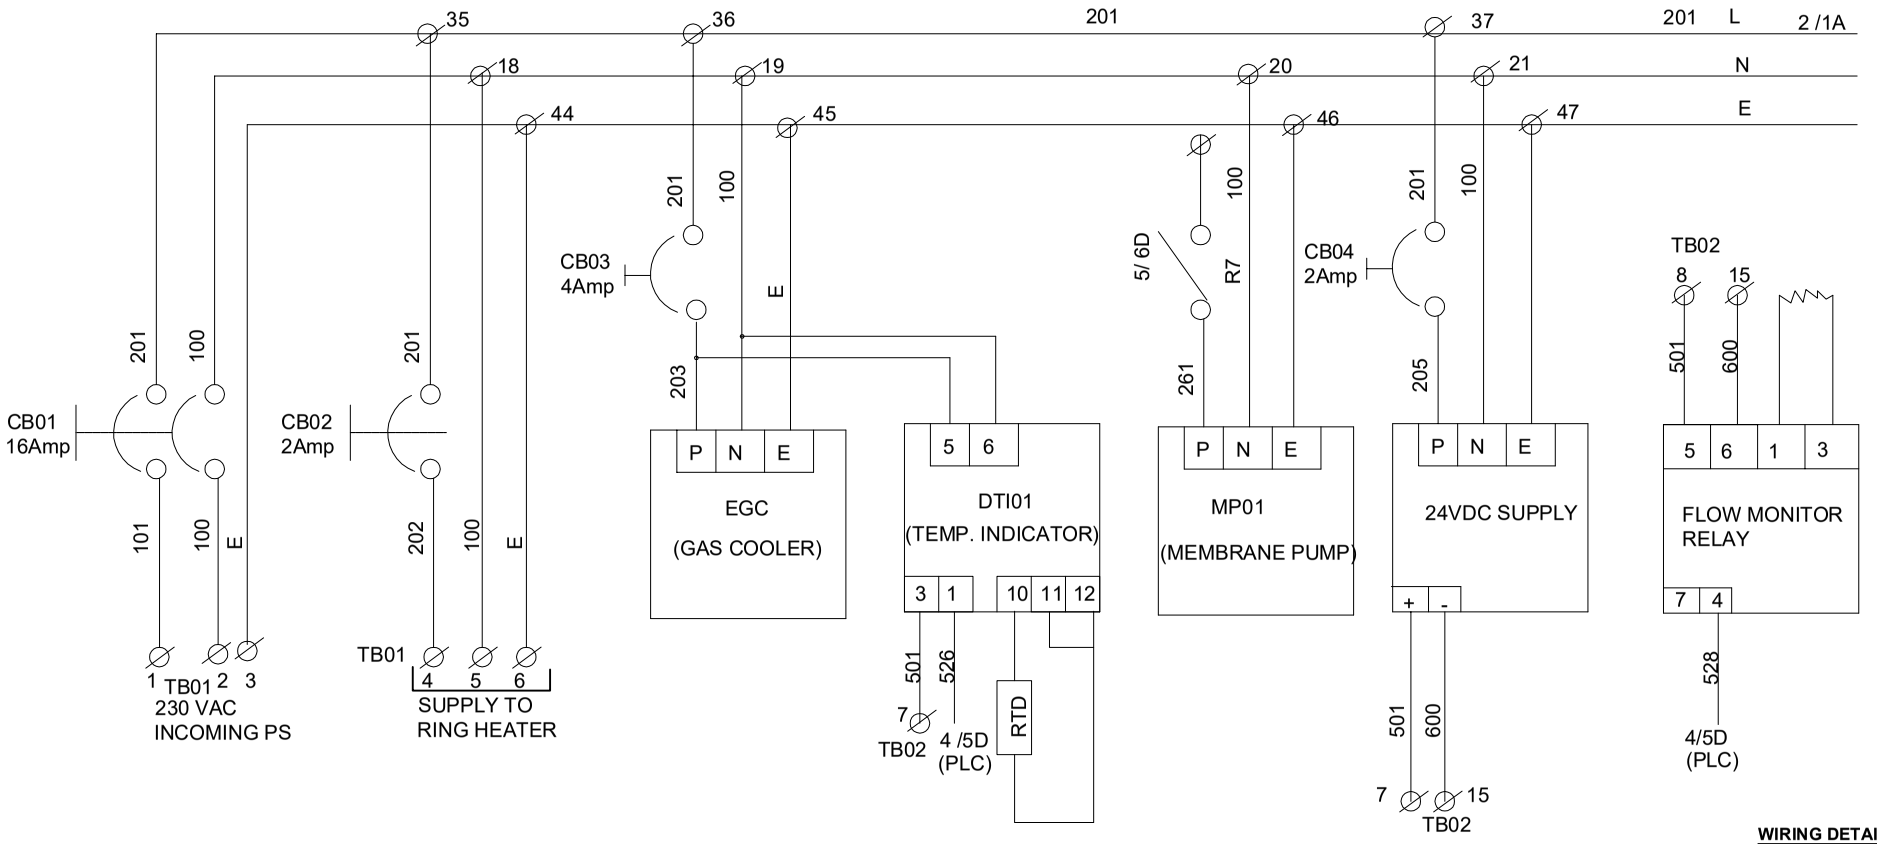

WIRING DETAILS

S.NO	SERIES	COLOUR / SIZE / APPLICATION
1.	200 100 E	RED 1.5Sqmm FOR NON UPS 220VAC 1Ø SUPPLY(L) BLACK 1.5Sqmm FOR NON UPS 220VAC 1Ø SUPPLY(N) GREEN 1.5Sqmm FOR EARTH
2.	300 400 E	RED 1.5Sqmm FOR UPS 220VAC 1Ø SUPPLY(L) BLACK 1.5Sqmm FOR UPS 220VAC 1Ø SUPPLY(N) GREEN 1.5Sqmm FOR EARTH
3.	500 600	YELLOW 0.75Sqmm FOR 24VDC SUPPLY(+) (CONTROL CABLE) BLUE 0.75Sqmm FOR 24VDC SUPPLY(-)
4.	900	GREY 0.75Sqmm FOR SIGNAL

Analyser Instrument Co. Pvt. Ltd.
E-29(A), Road No. 2, I.P. INDUSTRIAL AREA, KOTA -324005 (RAJ.)

No.	BY	CHKD	APPR	DATE	DESCRIPTION
					FOR APPROVAL
00	S.G.	S.P.	S.J.	23.10.26	FOR APPROVAL


CUSTOMER.:	ULTRATCH CEMENT LTD. (BELA CEMENT WORKS)
PROJECT.:	CO& O2 GAS ANALYSER SYATEM FOR PRECALCINER CYCLONE
PO NO.:	BL/TME/8217000324 DTD.04.10.2026
DOC NO.:	AICPL.PO-2786.ULTRATECH.SCH.001

TITLE:-

WIRING DRAWING FOR CO & O2 GAS ANALYSER SYSTEM


SCALE	SHEET No.	1 OF 7
N.T.S.	REV	00

THIS DRAWING IS THE PROPERTY OF AICPL AND CANNOT BE COPIED, REPRODUCED OR DISCLOSED TO THIRD PARTIES WITHOUT ANY WRITTEN AUTHORISATION

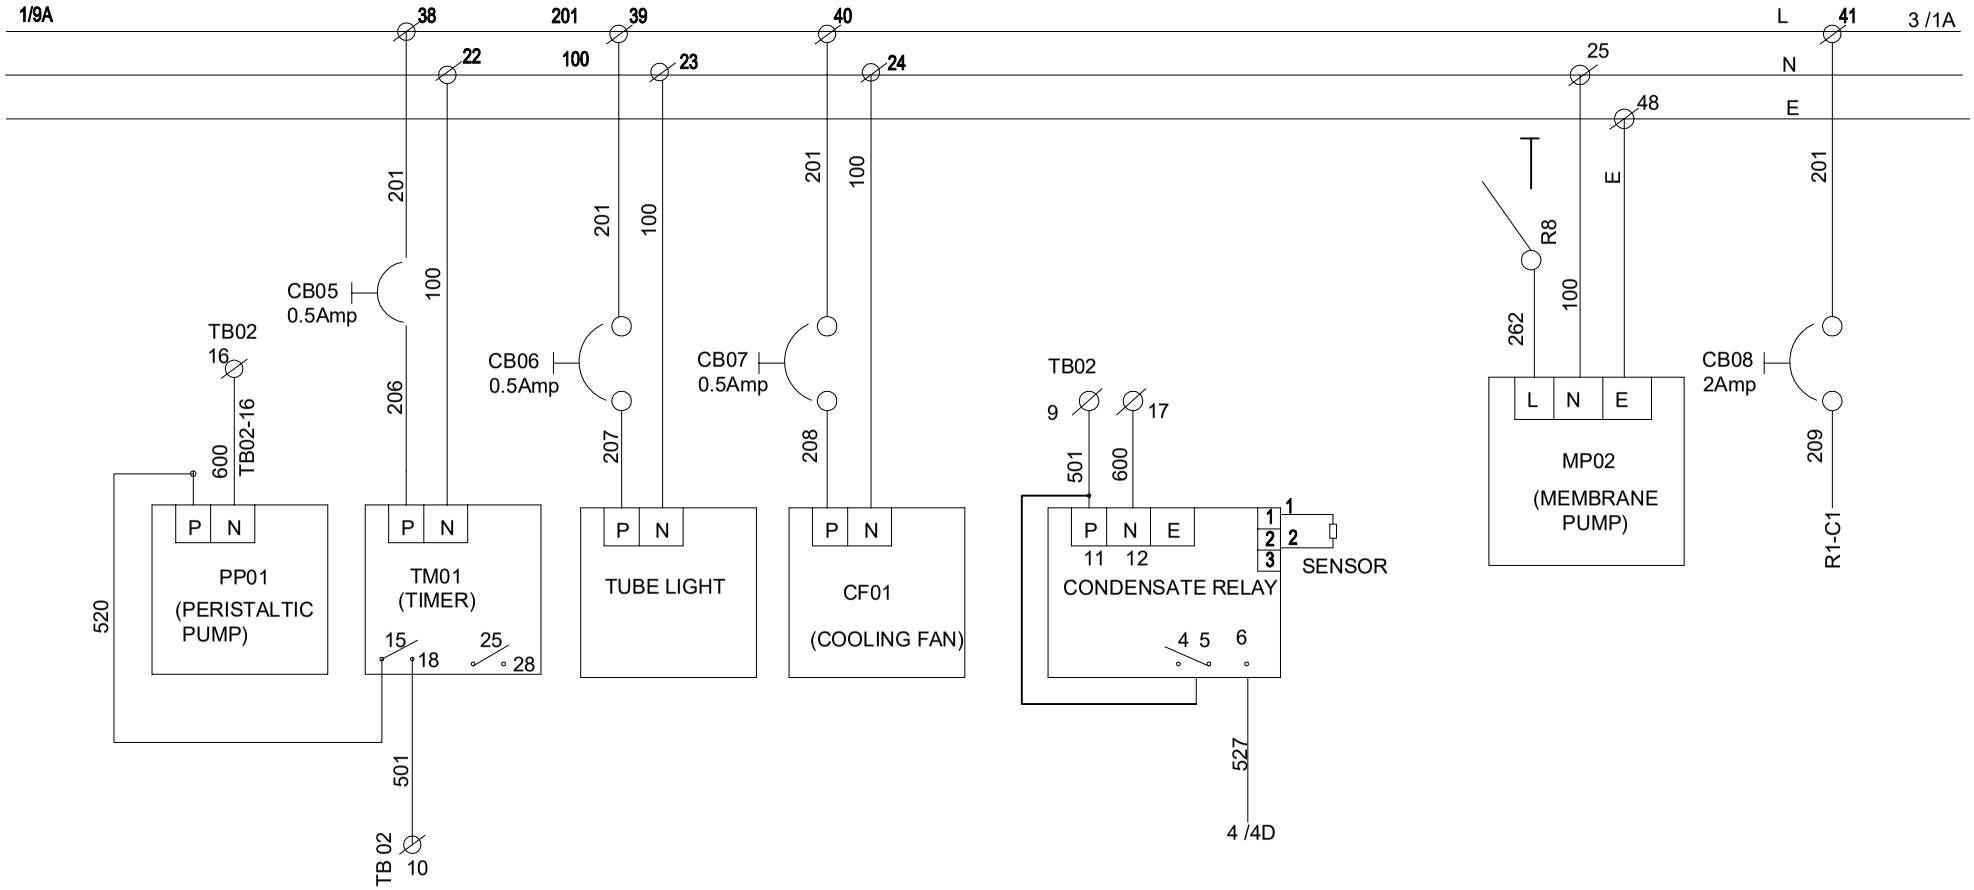

Analyser Instrument Co. Pvt. Ltd. E-29(A), Road No. 2, I.P. INDUSTRIAL AREA, KOTA -324005 (RAJ.)							CUSTOMER.:	ULTRATCH CEMENT LTD. (BELA CEMENT WORKS)	TITLE:- WIRING DRAWING FOR CO & O2 GAS ANALYSER SYSTEM		
							PROJECT.:	CO& O2 GAS ANALYSER SYATEM FOR PRECALCINER CYCLONE			
						FOR APPROVAL					
	00	S.G.	S.P.	S.J.	23.10.26	FOR APPROVAL	PO NO.:	BL/TME/8217000324 DTD.04.10.2026	SCALE	SHEET No.	2 OF 7
	No.	BY	CHKD	APPR	DATE	DESCRIPTION	DOC NO.:	AICPL.PO-2786.ULTRATECH.SCH.001	N.T.S.	REV	00


THIS DRAWING IS THE PROPERTY OF AICPL AND CANNOT BE COPIED, REPRODUCED OR DISCLOSED TO THIRD PARTIES WITHOUT ANY WRITTEN AUTHORISATION

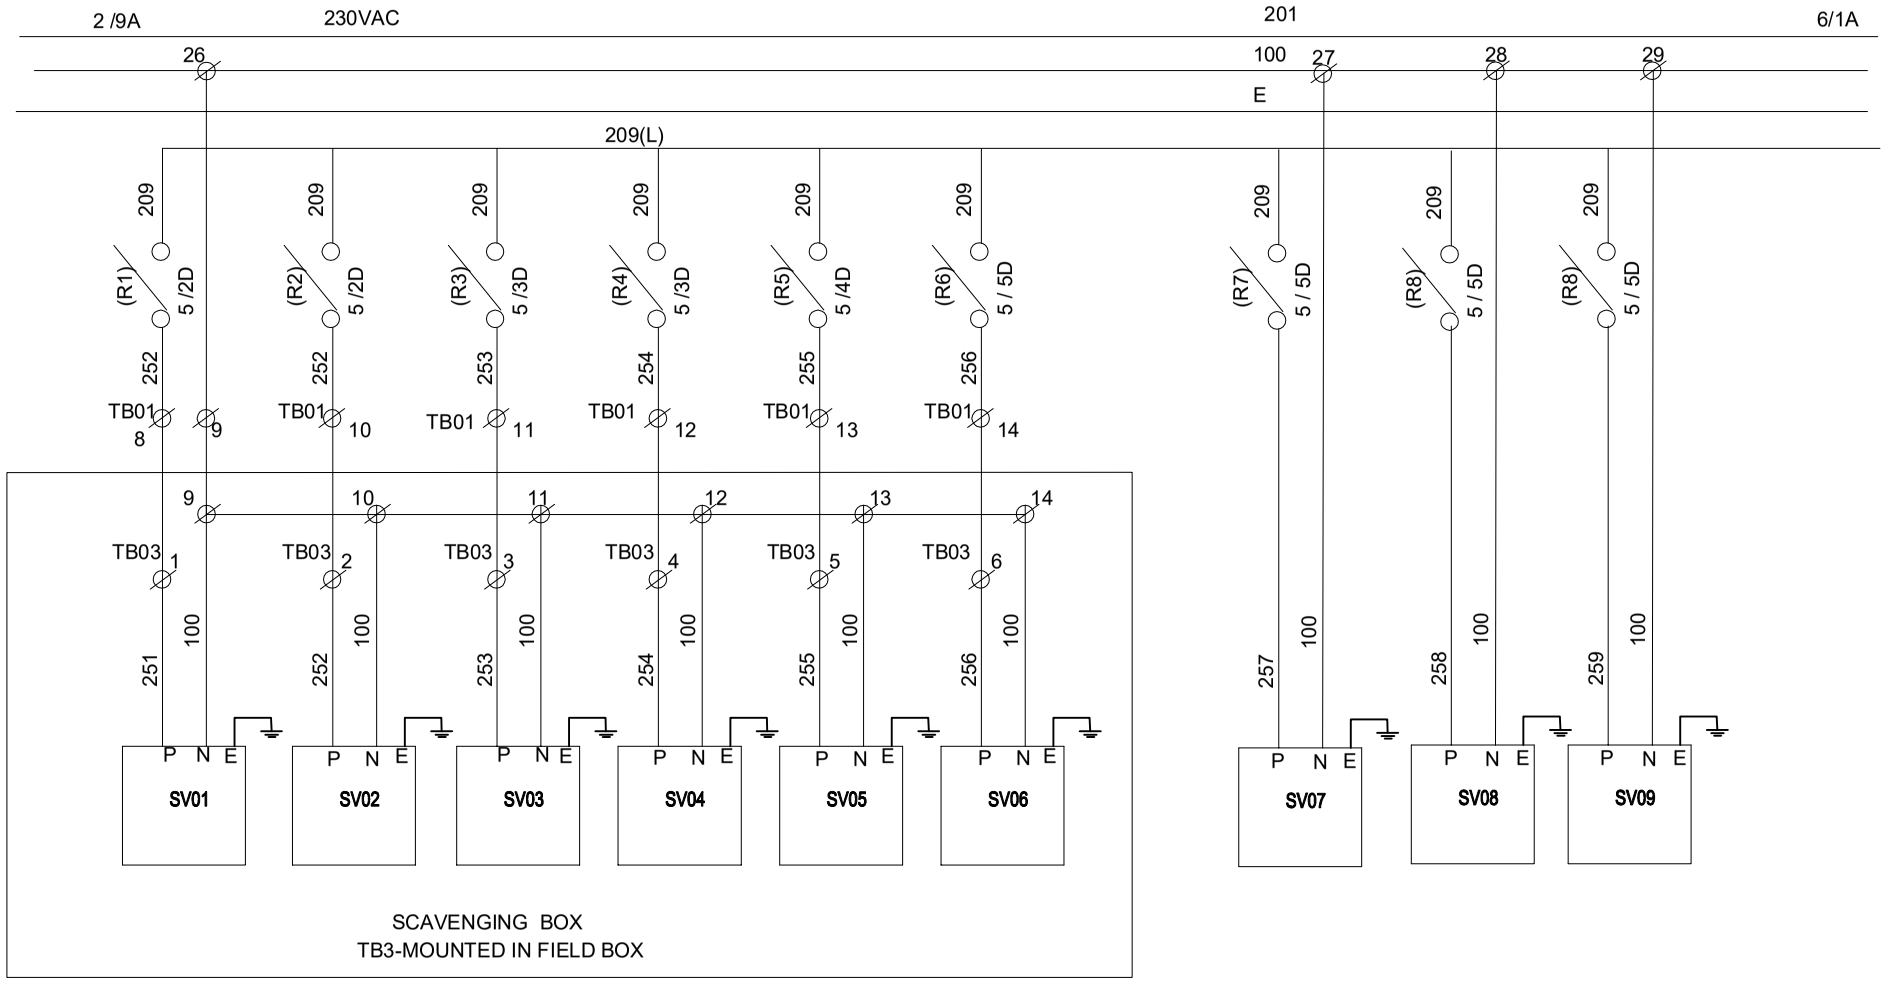

						CUSTOMER.:	ULTRATCH CEMENT LTD. (BELA CEMENT WORKS)	TITLE:-
						PROJECT.:	CO& O2 GAS ANALYSER SYATEM FOR PRECALCINER CYCLONE	WIRING DRAWING FOR CO & O2 GAS ANALYSER SYSTEM
					FOR APPROVAL			
00	S.G.	S.P.	S.J.	23.10.26	FOR APPROVAL	PO NO.:	BL/TME/8217000324 DTD.04.10.2026	SCALE / SHEET No. 3 OF 7
No.	BY	CHKD	APPR	DATE	DESCRIPTION	DOC NO.:	AICPL.PO-2786.ULTRATECH.SCH.001	N.T.S. / REV 00

Analyser Instrument Co. Pvt. Ltd.
E-29(A), Road No. 2, I.P. INDUSTRIAL AREA, KOTA -324005 (RAJ.)


THIS DRAWING IS THE PROPERTY OF AICPL AND CANNOT BE COPIED, REPRODUCED OR DISCLOSED TO THIRD PARTIES WITHOUT ANY WRITTEN AUTHORISATION

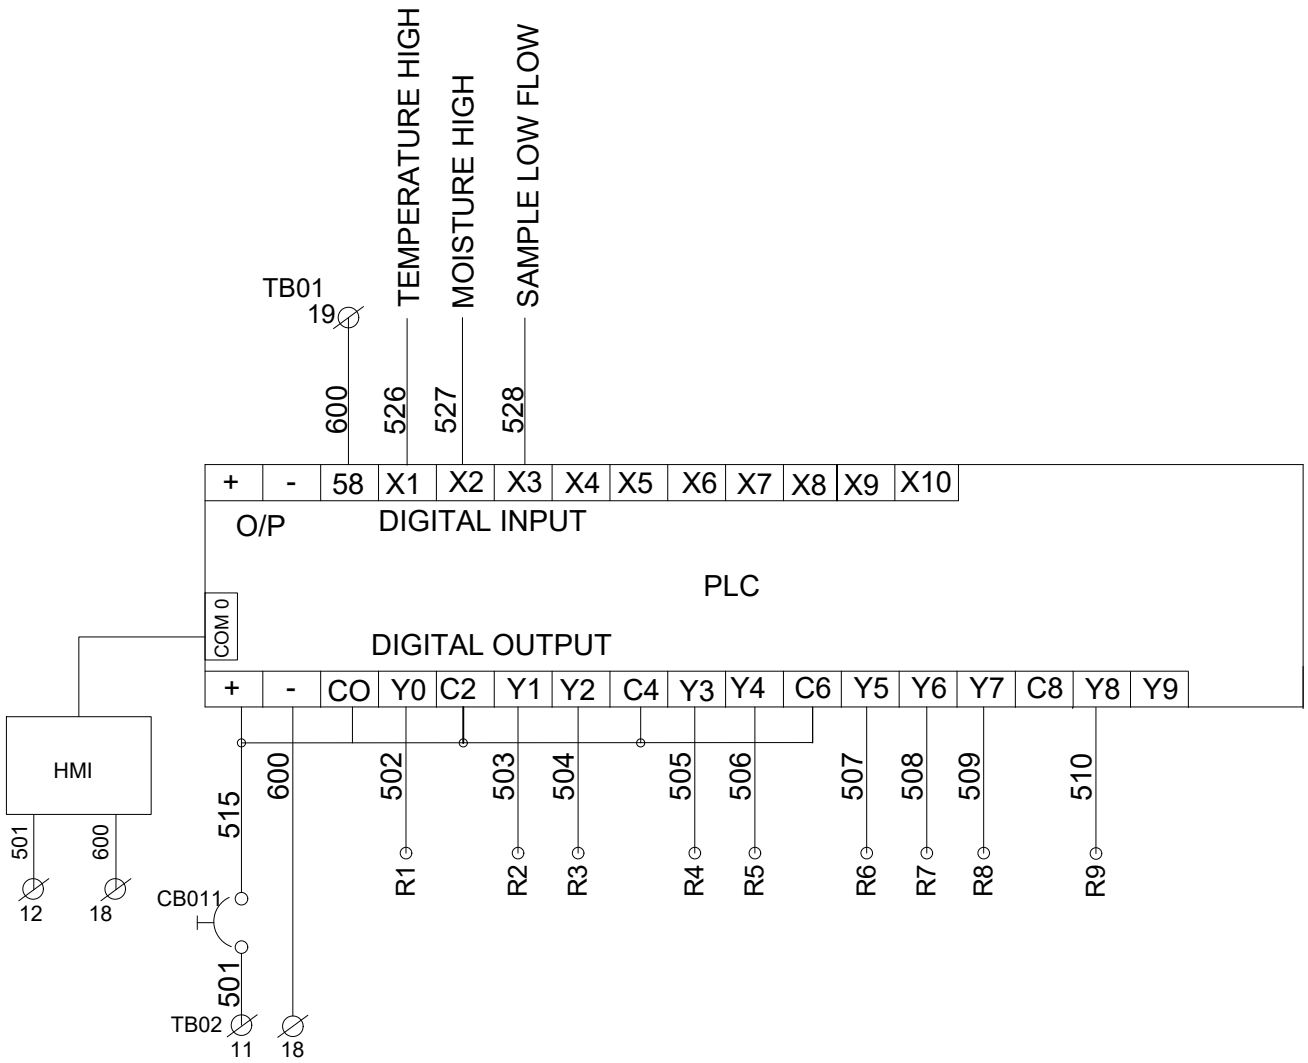

						CUSTOMER.:	ULTRATCH CEMENT LTD. (BELA CEMENT WORKS)	TITLE:- WIRING DRAWING FOR CO & O2 GAS ANALYSER SYSTEM
						PROJECT.:	CO& O2 GAS ANALYSER SYATEM FOR PRECALCINER CYCLONE	
					FOR APPROVAL			
00	S.G.	S.P.	S.J.	23.10.26	FOR APPROVAL	PO NO.:	BL/TME/8217000324 DTD.04.10.2026	SCALE / SHEET No. 4 OF 7
No.	BY	CHKD	APPR	DATE	DESCRIPTION	DOC NO.:	AICPL.PO-2786.ULTRATECH.SCH.001	N.T.S. / REV 00

Analyser Instrument Co. Pvt. Ltd.
E-29(A), Road No. 2, I.P. INDUSTRIAL AREA, KOTA -324005 (RAJ.)


THIS DRAWING IS THE PROPERTY OF AICPL AND CANNOT BE COPIED, REPRODUCED OR DISCLOSED TO THIRD PARTIES WITHOUT ANY WRITTEN AUTHORISATION

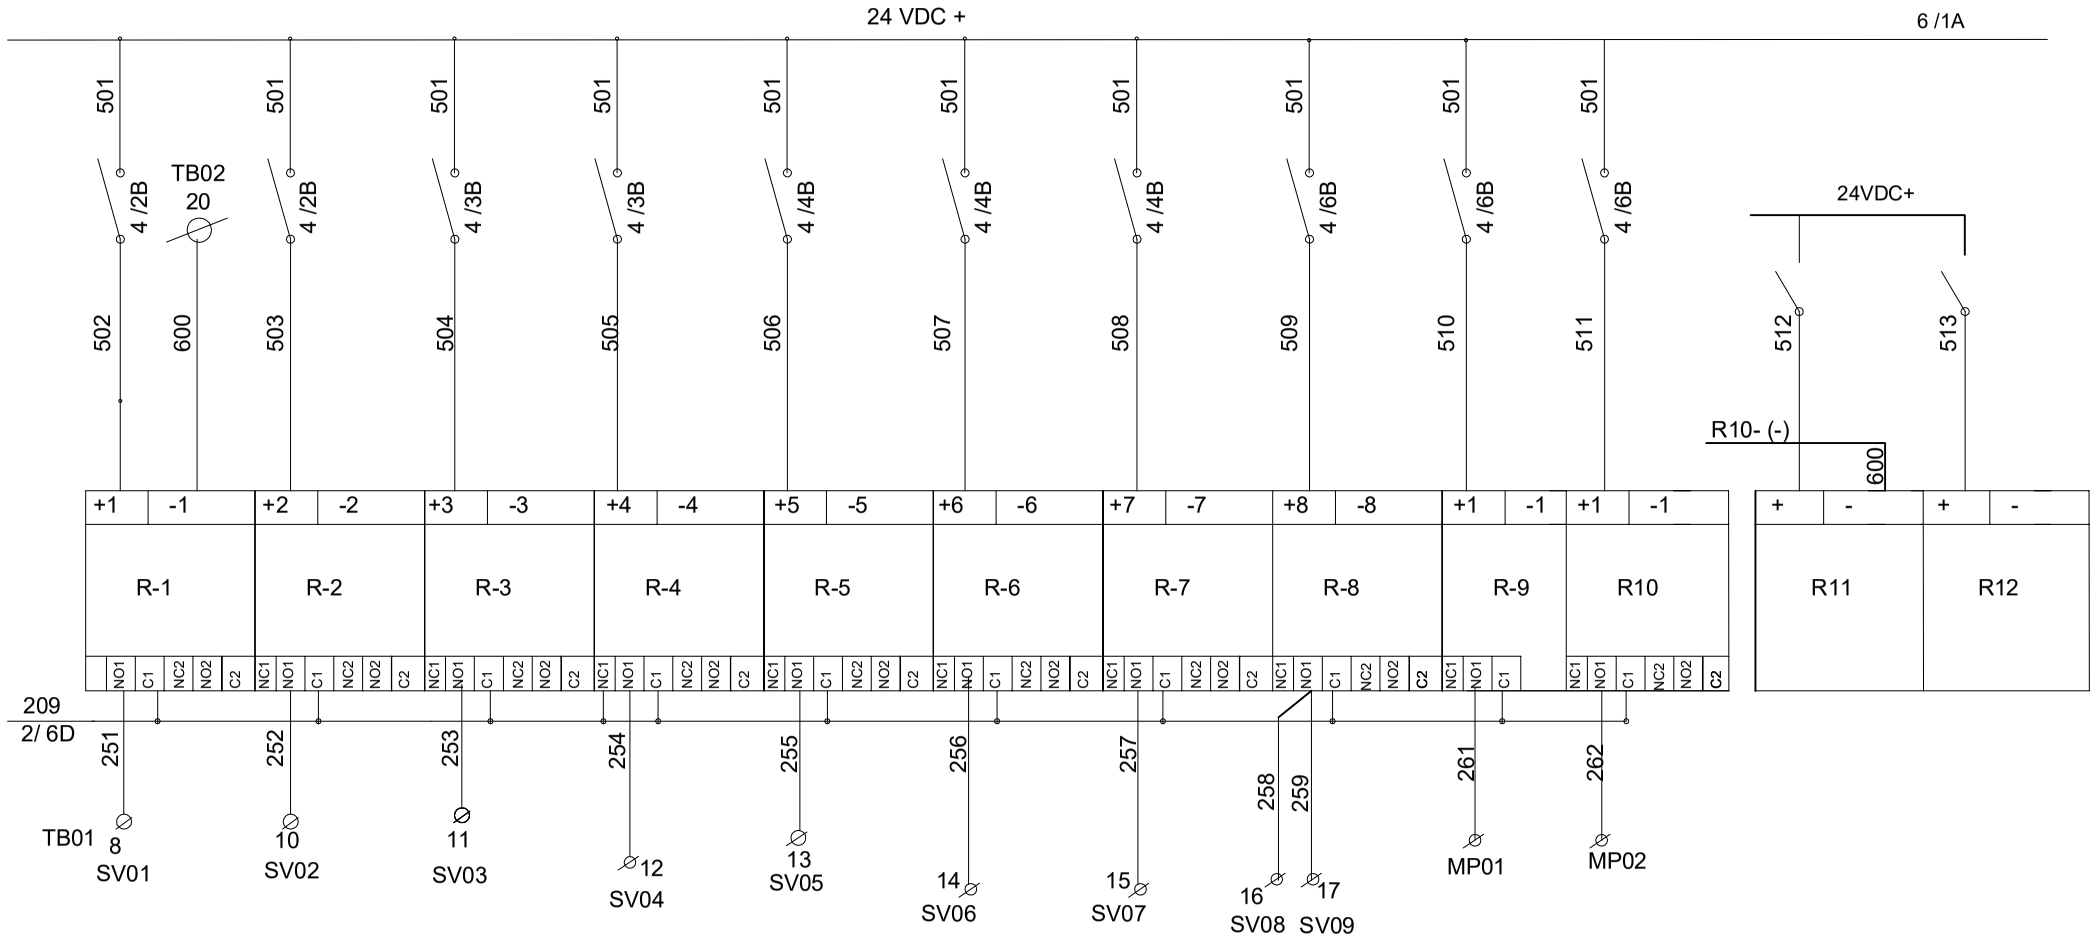

							CUSTOMER.:	ULTRATCH CEMENT LTD. (BELA CEMENT WORKS)	TITLE:-
							PROJECT.:	CO& O2 GAS ANALYSER SYATEM FOR PRECALCINER CYCLONE	WIRING DRAWING FOR CO & O2 GAS ANALYSER SYSTEM
						FOR APPROVAL			
00	S.G.	S.P.	S.J.	23.10.26	FOR APPROVAL		PO NO.:	BL/TME/8217000324 DTD.04.10.2026	SCALE / SHEET No. 5 OF 7
No.	BY	CHKD	APPR	DATE	DESCRIPTION		DOC NO.:	AICPL.PO-2786.ULTRATECH.SCH.001	N.T.S. / REV 00

Analyser Instrument Co. Pvt. Ltd.
E-29(A), Road No. 2, I.P. INDUSTRIAL AREA, KOTA -324005 (RAJ.)


THIS DRAWING IS THE PROPERTY OF AICPL AND CANNOT BE COPIED, REPRODUCED OR DISCLOSED TO THIRD PARTIES WITHOUT ANY WRITTEN AUTHORISATION

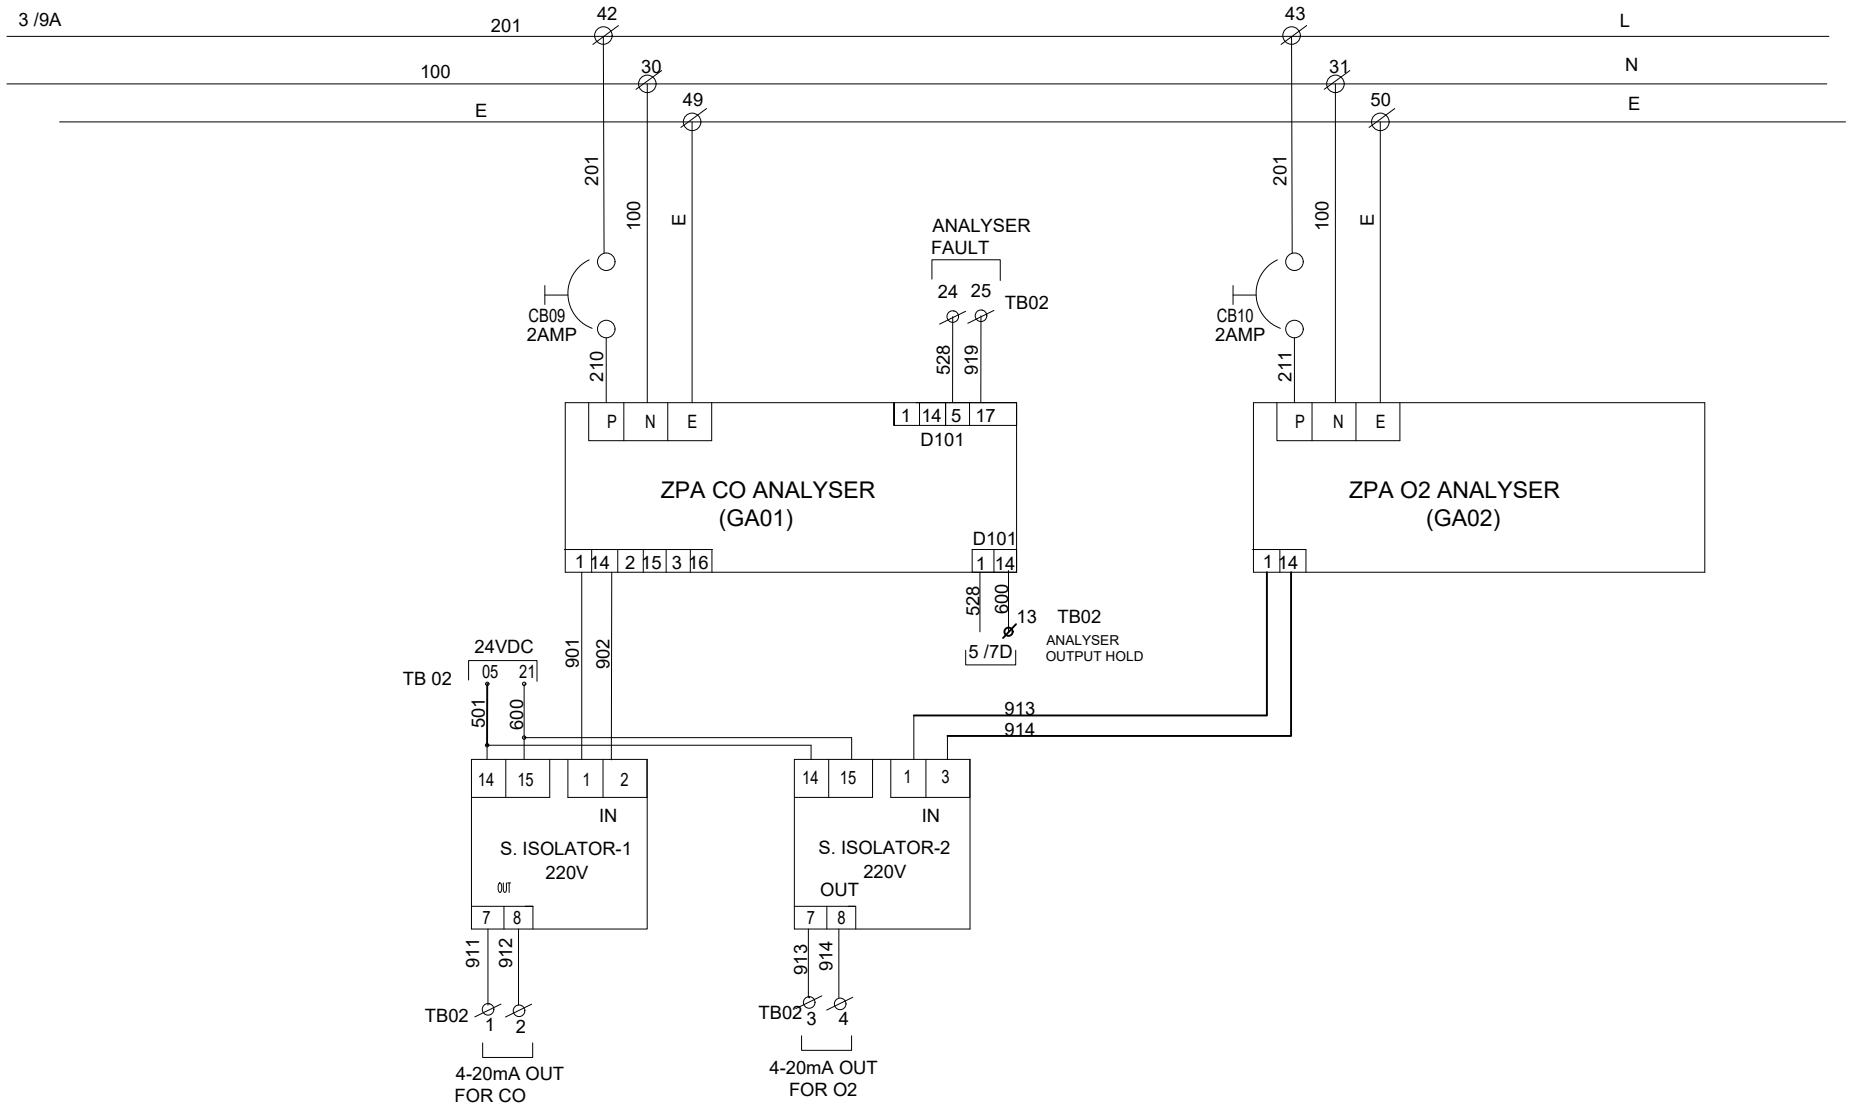

						CUSTOMER.:	ULTRATCH CEMENT LTD. (BELA CEMENT WORKS)	TITLE:- WIRING DRAWING FOR CO & O2 GAS ANALYSER SYSTEM
						PROJECT.:	CO& O2 GAS ANALYSER SYATEM FOR PRECALCINER CYCLONE	
					FOR APPROVAL			
00	S.G.	S.P.	S.J.	23.10.26	FOR APPROVAL	PO NO.:	BL/TME/8217000324 DTD.04.10.2026	SCALE / SHEET No. 6 OF 7
No.	BY	CHKD	APPR	DATE	DESCRIPTION	DOC NO.:	AICPL.PO-2786.ULTRATECH.SCH.001	N.T.S. / REV 00

Analyser Instrument Co. Pvt. Ltd.
E-29(A), Road No. 2, I.P. INDUSTRIAL AREA, KOTA -324005 (RAJ.)

THIS DRAWING IS THE PROPERTY OF AICPL AND CANNOT BE COPIED, REPRODUCED OR DISCLOSED TO THIRD PARTIES WITHOUT ANY WRITTEN AUTHORISATION

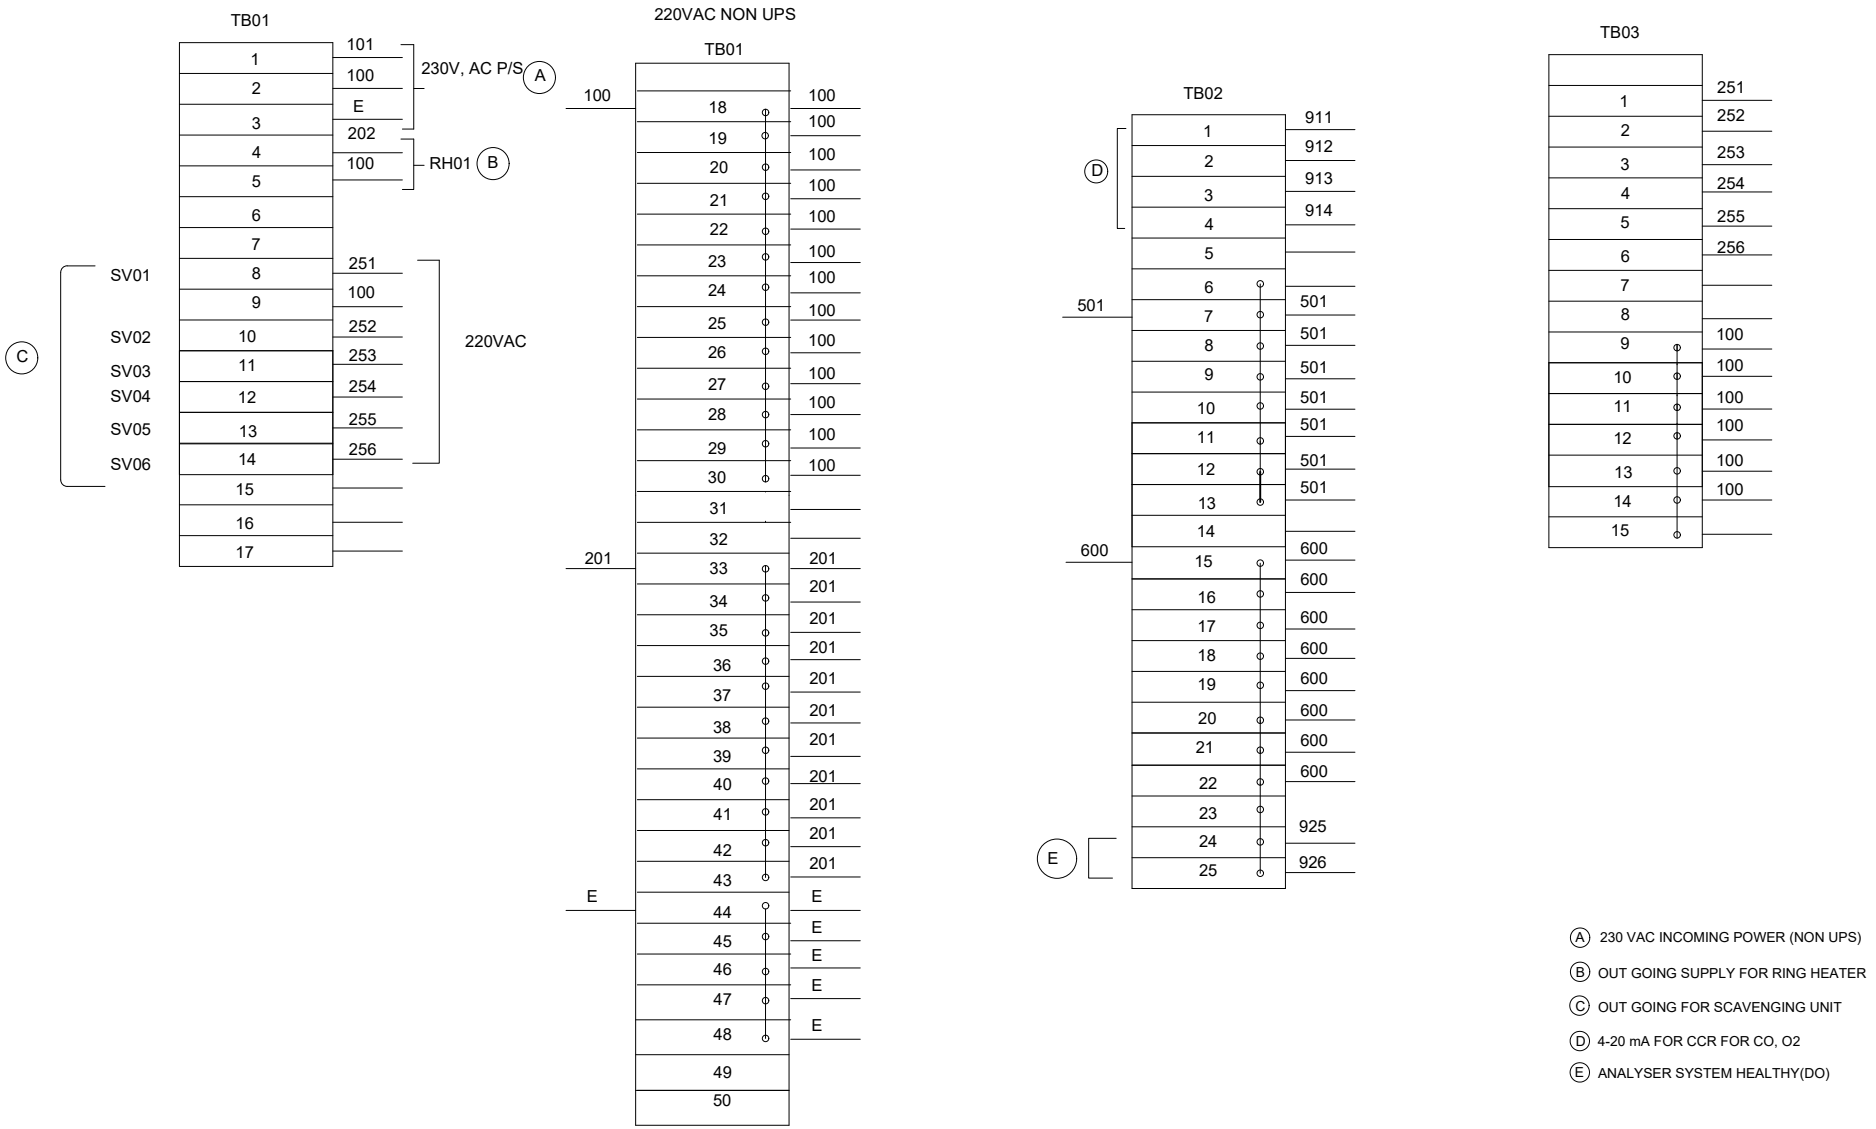

A 230 VAC INCOMING POWER (NON UPS)

B OUT GOING SUPPLY FOR RING HEATER

C OUT GOING FOR SCAVENGING UNIT

D 4-20 mA FOR CCR FOR CO, O2

E ANALYSER SYSTEM HEALTHY(DO)

Analyser Instrument Co. Pvt. Ltd. E-29(A), Road No. 2, I.P. INDUSTRIAL AREA, KOTA -324005 (RAJ.)							CUSTOMER.:	ULTRATCH CEMENT LTD. (BELA CEMENT WORKS)	TITLE:- WIRING DRAWING FOR CO & O2 GAS ANALYSER SYSTEM		
							PROJECT.:	CO& O2 GAS ANALYSER SYATEM FOR PRECALCINER CYCLONE			
						FOR APPROVAL					
	00	S.G.	S.P.	S.J.	23.10.26	FOR APPROVAL	PO NO.:	BL/TME/8217000324 DTD.04.10.2026	SCALE	SHEET No.	7 OF 7
	No.	BY	CHKD	APPR	DATE	DESCRIPTION	DOC NO.:	AICPL.PO-2786.ULTRATECH.SCH.001	N.T.S.	REV	00