


Final Model (MLP) Confusion Matrix

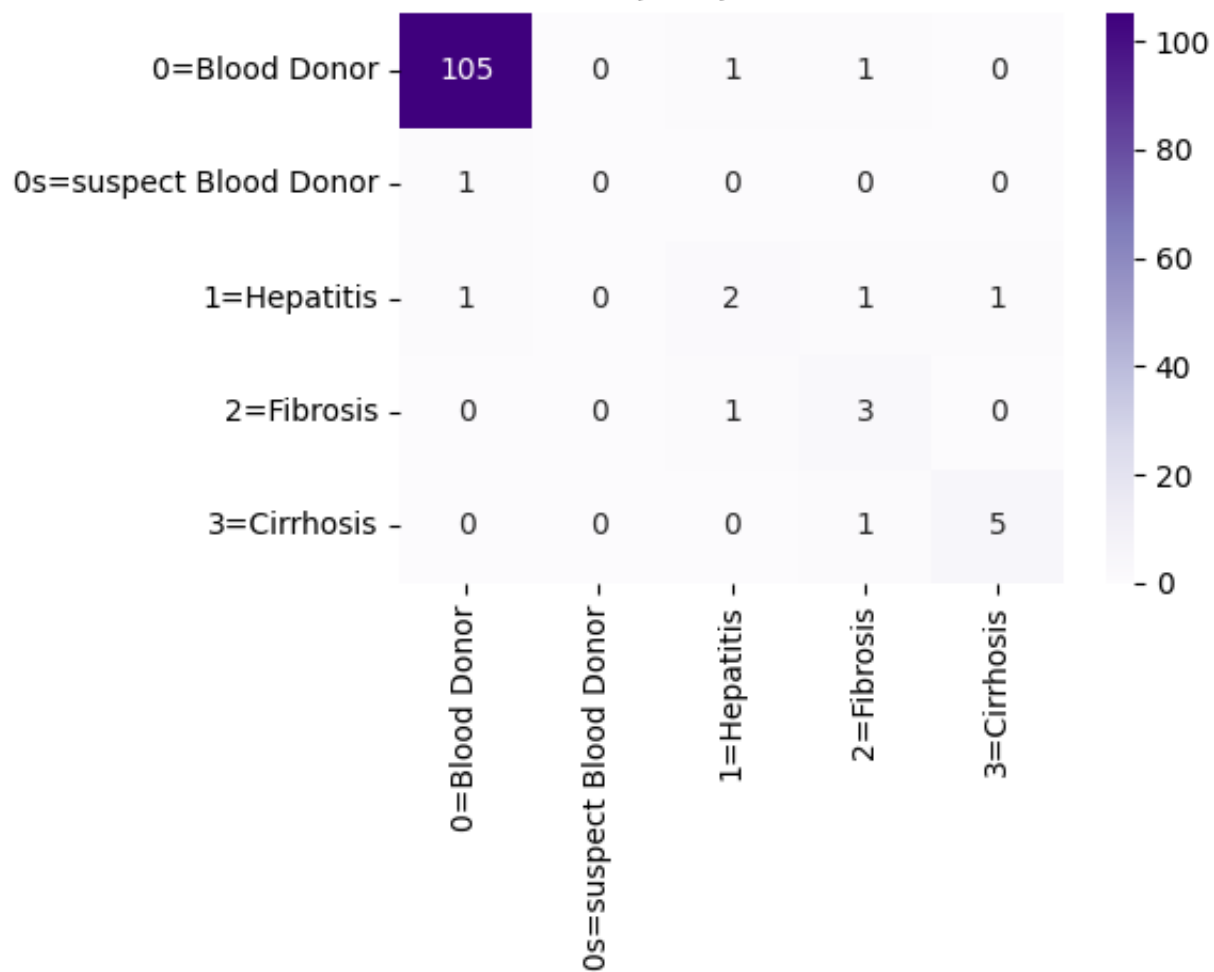

	precision	recall	f1-score	support
0=Blood Donor	0.98	0.98	0.98	107
0s=suspect Blood Donor	0.00	0.00	0.00	1
1=Hepatitis	0.50	0.40	0.44	5
2=Fibrosis	0.50	0.75	0.60	4
3=Cirrhosis	0.83	0.83	0.83	6
accuracy		0.93		123
macro avg	0.56	0.59	0.57	123
weighted avg	0.93	0.93	0.93	123