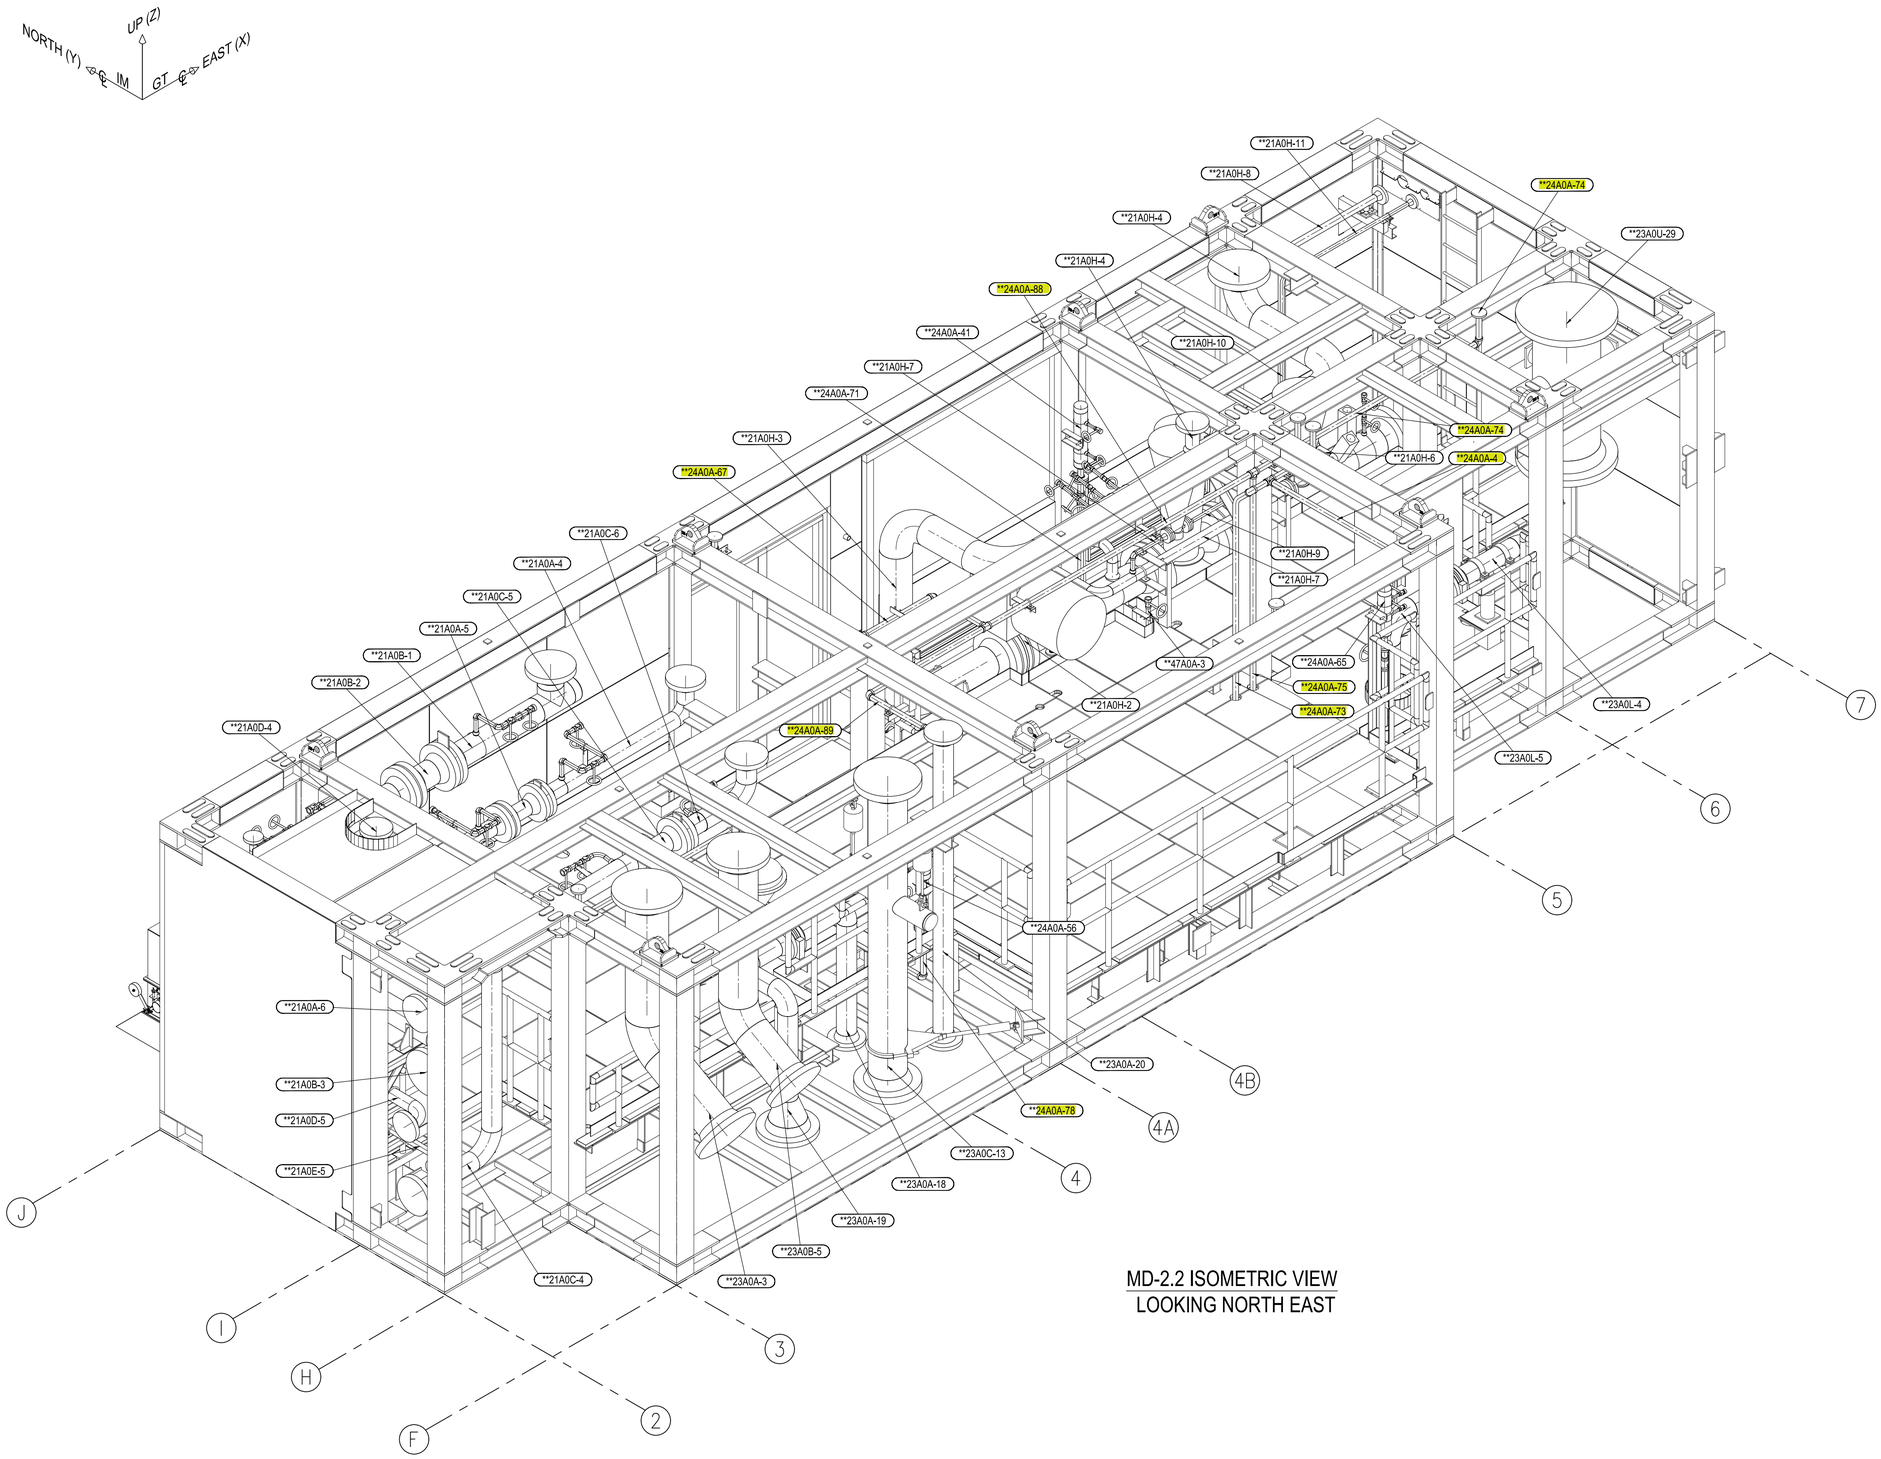


MD-2.2 ISOMETRIC VIEW
LOOKING NORTH EAST

REFERENCES

MDL ITEM #	MPWA MDL DESCRIPTION	DETAILS FOR
1	FOUNDATION PLAN AND SUMMARY LOADING DATA FOR MODULE GT ENCLOSURE	GENERAL LOCATION
20	GA DRAWING FOR MODULARIZED JAC GT ENCLOSURE	GENERAL LOCATION

NOTES

1. DIMENSIONS : MM [INCHES]
2. LABELING
   - ××XXXXXX ——PIPE LINE
   - (××XXX-X) ——SPOOL NO
3. SOME STRUCTURAL MEMBERS AND GRATINGS ARE HIDDEN FOR A MORE CLEAR VIEW WHERE IT IS CONSIDERED NECESSARY
4. WP : WORKING POINT FOR SLOPE LINE

REV.	DESCRIPTION	DATE	BY	CHECK	APPROVAL
0	ISSUED FOR CONSTRUCTION	01.MAY.2024	S.H.	M.F.	N.K.

This drawing is the property of Cimtas and all rights reserved

REVISIONS

CUSTOMER

PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2024 , Mitsubishi Power Americas, Inc.

MITSUBISHI POWER

CUSTOMER JOB NO: –

ITEM NO: MDL-150

DWG NAME: MD-2.2 PIPING SUPPORT & SPOOLS GENERAL ARRANGEMENTS DRAWINGS **(GA FOR SPOOLS)**


REF.DWG.NO.: –

PREPARED BY: cimtas

JOB NO	SHEET	SCALE	SIZE
2E00140	1/1	1/25	A1

DRAWING NO: 2E00140-PI-094-001-MD-2.2

REV. 0

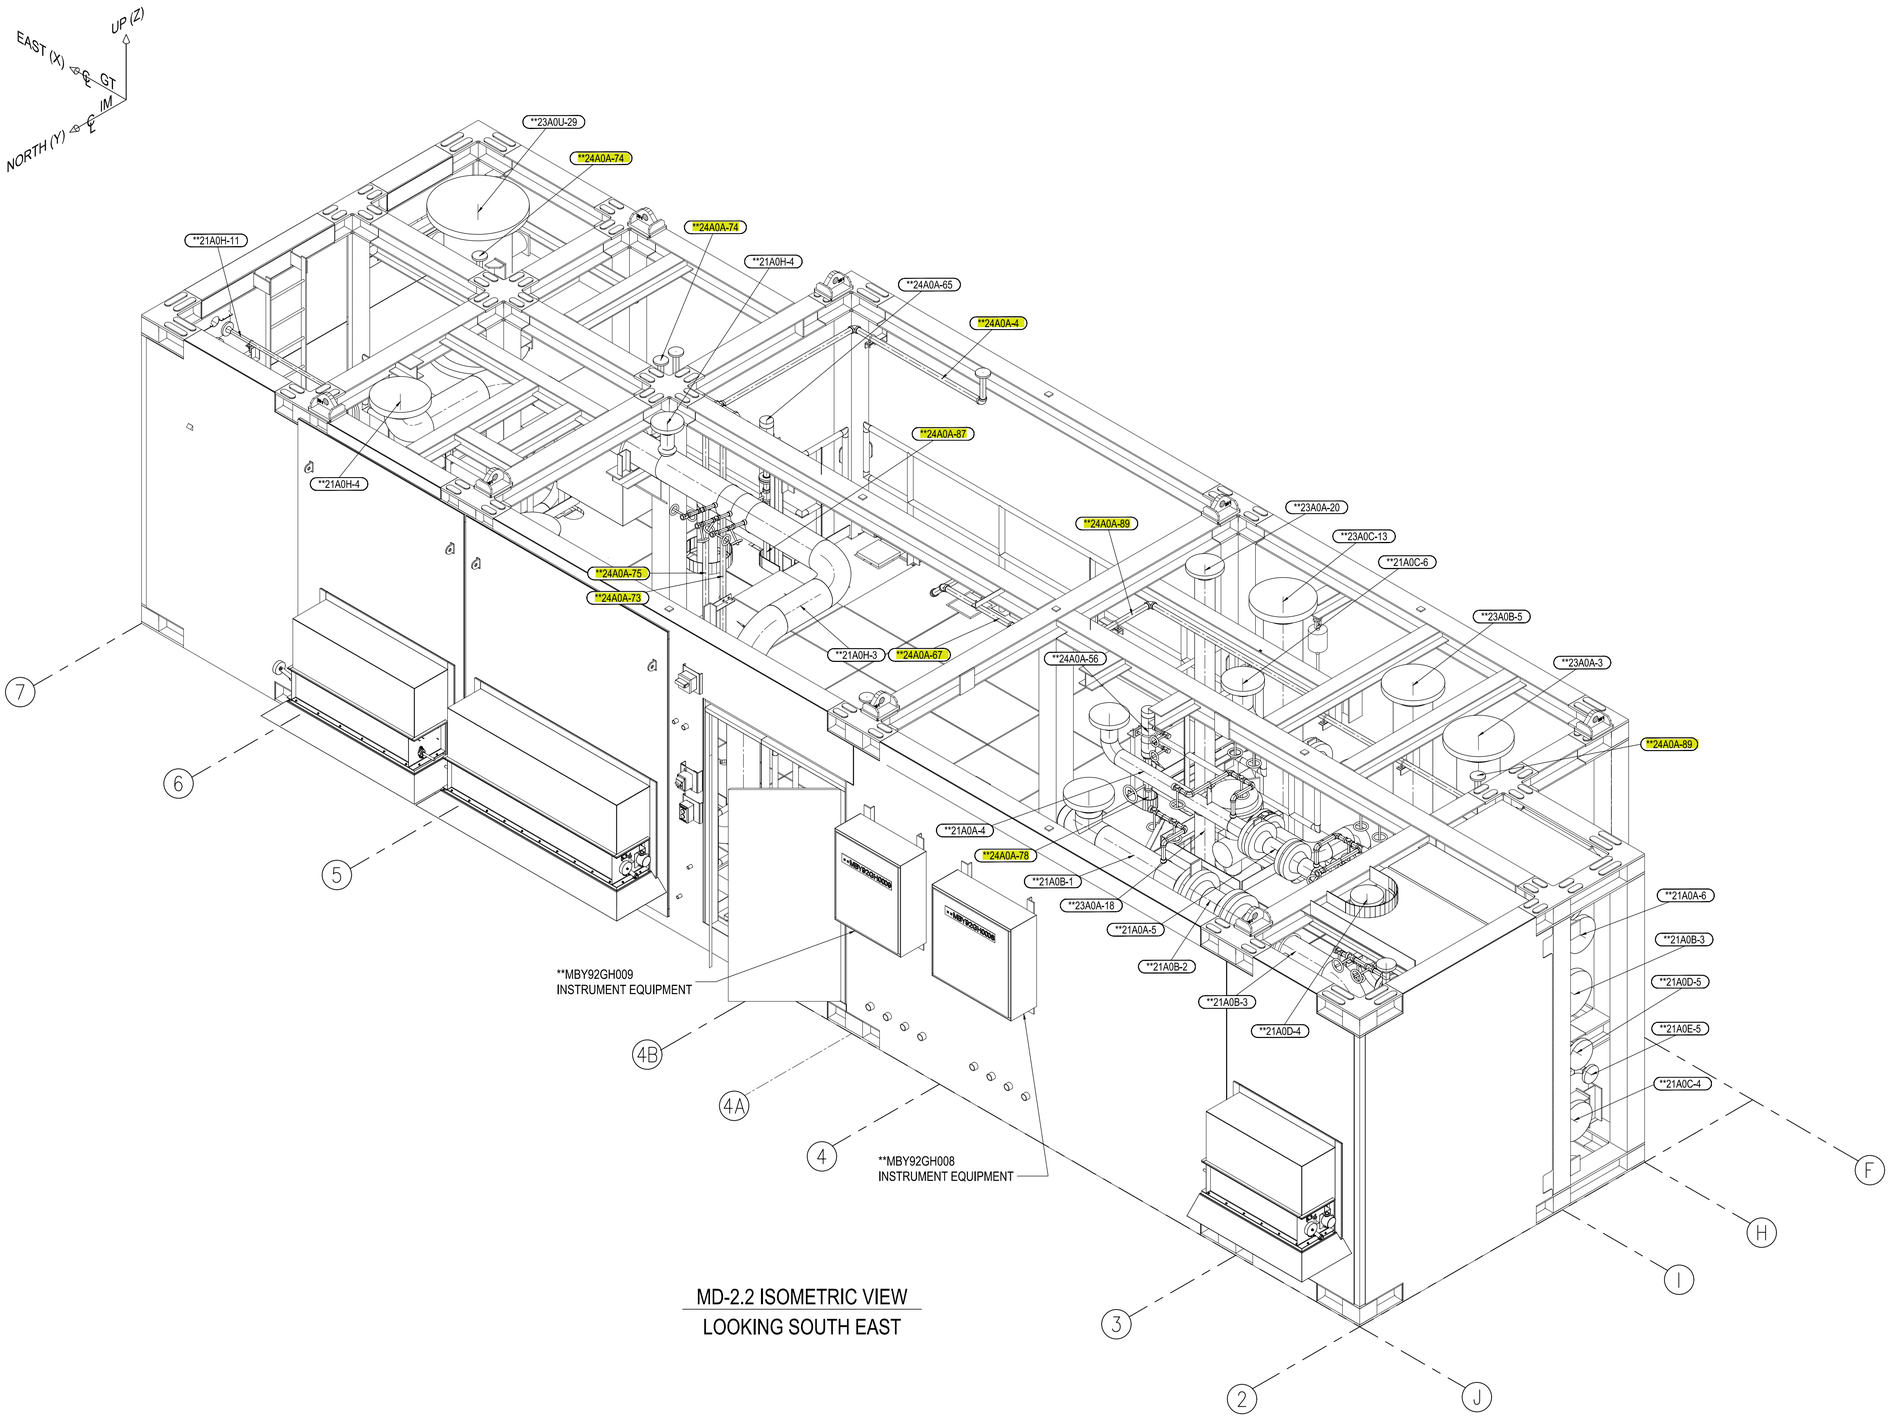

MD-2.2 ISOMETRIC VIEW
LOOKING SOUTH EAST

REFERENCES

MDL ITEM #	MPWA MDL DESCRIPTION	DETAILS FOR
1	FOUNDATION PLAN AND SUMMARY LOADING DATA FOR MODULE GT ENCLOSURE	GENERAL LOCATION
20	GA DRAWING FOR MODULARIZED JAC GT ENCLOSURE	GENERAL LOCATION

NOTES

1. DIMENSIONS : MM [INCHES]
2. LABELING
   - ××XXXXXX ——PIPE LINE
   - (××XXX-X) ——SPOOL NO
3. SOME STRUCTURAL MEMBERS AND GRATINGS ARE HIDDEN FOR A MORE CLEAR VIEW WHERE IT IS CONSIDERED NECESSARY
4. WP : WORKING POINT FOR SLOPE LINE

REV.	DESCRIPTION	DATE	BY	CHECK	APPROVAL
0	ISSUED FOR CONSTRUCTION	01.MAY.2024	S.H.	M.F.	N.K.

This drawing is the property of Cimtas and all rights reserved

REVISIONS

CUSTOMER

PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2024 , Mitsubishi Power Americas, Inc.

MITSUBISHI POWER

CUSTOMER JOB NO: –

ITEM NO: MDL-150

DWG NAME: MD-2.2 PIPING SUPPORT & SPOOLS GENERAL ARRANGEMENTS DRAWINGS **(GA FOR SPOOLS)**


REF.DWG.NO.: –

PREPARED BY: cimtas


JOB NO	SHEET	SCALE	SIZE
2E00140	1/1	1/25	A1

DRAWING NO: 2E00140-PI-094-001-MD-2.2

REV.: 0

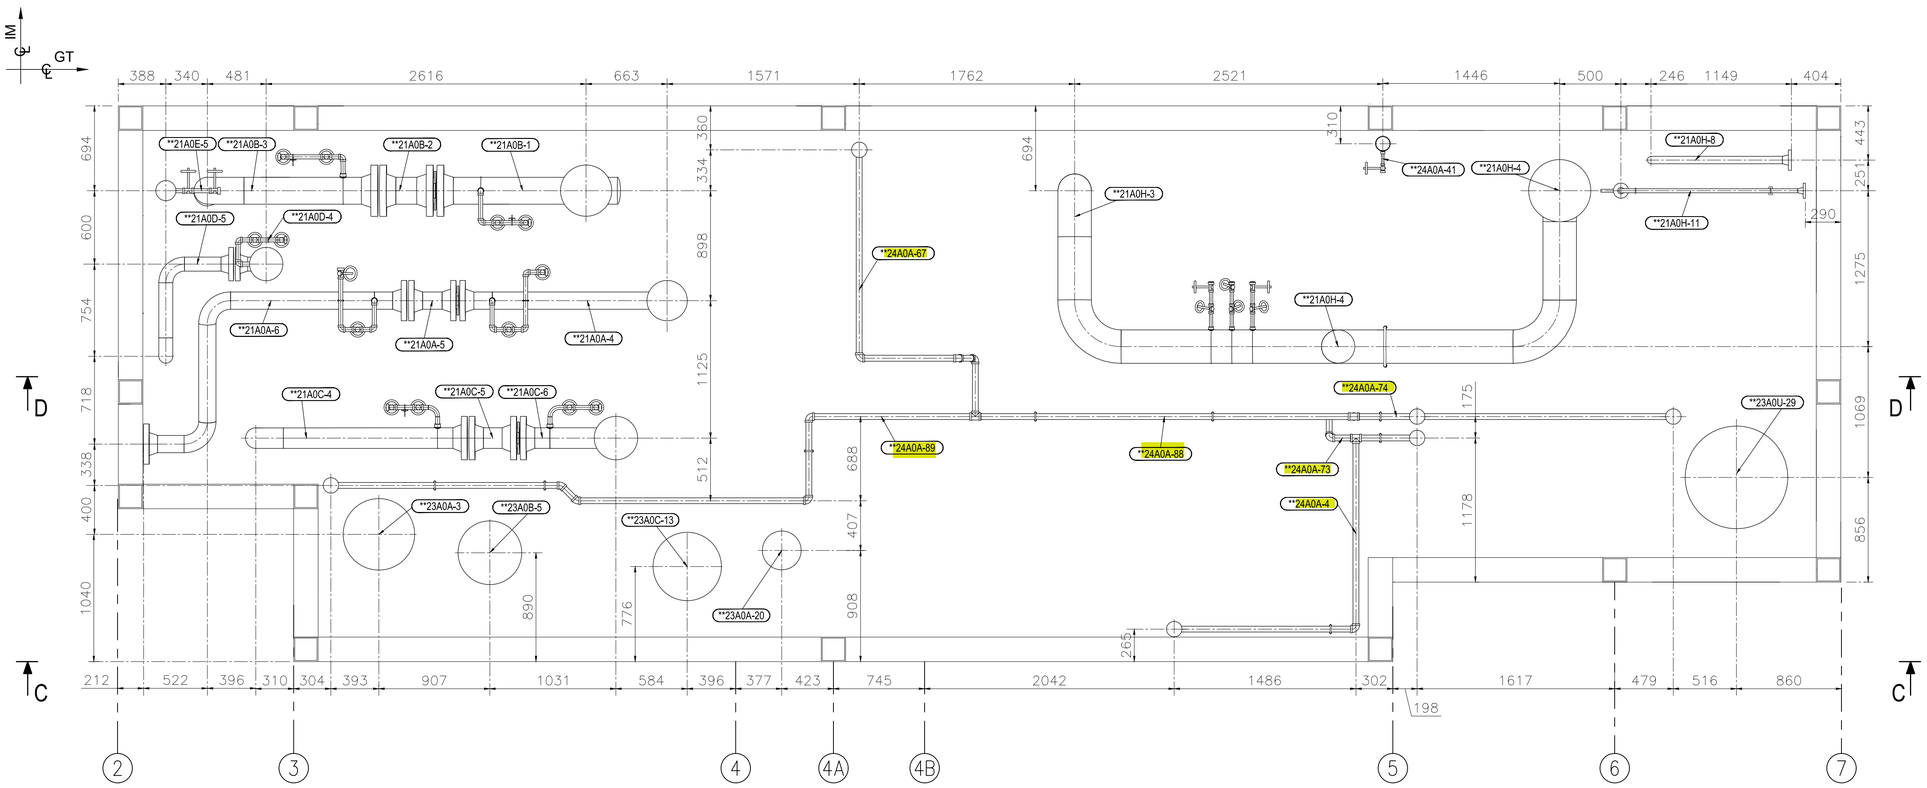

MD-2.2 PLAN VIEW
SECTION 'A-A'

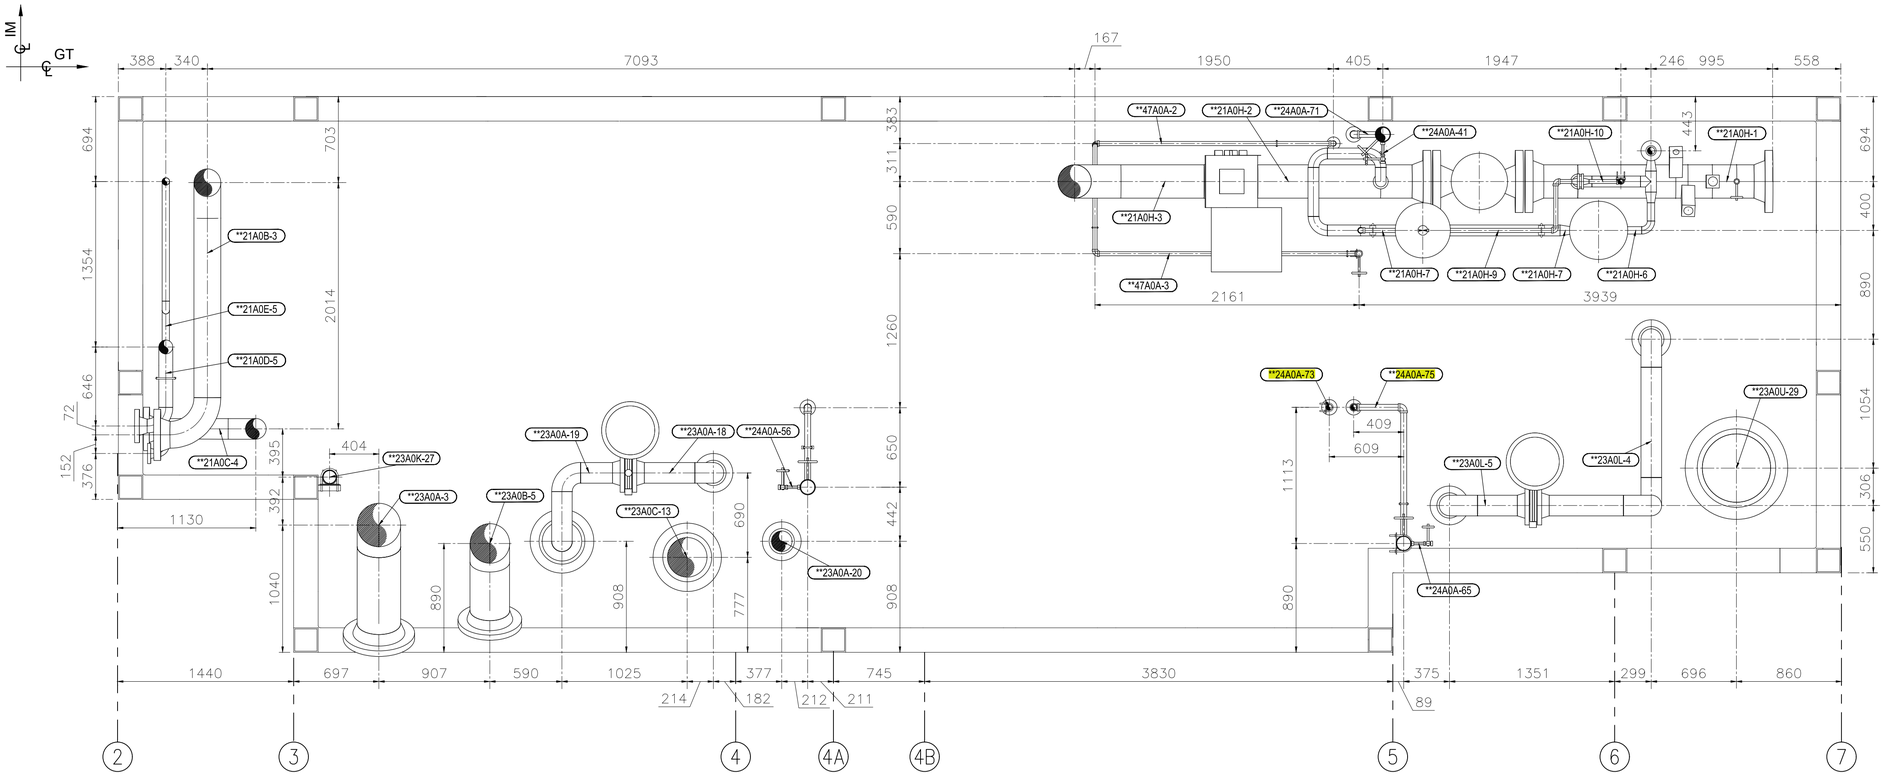

MD-2.2 PLAN VIEW
SECTION 'B-B'

REFERENCES

MDL ITEM #	MPWA MDL DESCRIPTION	DETAILS FOR
1	FOUNDATION PLAN AND SUMMARY LOADING DATA FOR MODULE GT ENCLOSURE	GENERAL LOCATION
20	GA DRAWING FOR MODULARIZED JAC GT ENCLOSURE	GENERAL LOCATION

NOTES

1. DIMENSIONS : MM [INCHES]
2. LABELING
   - ××XXXXXX —— PIPE LINE
   - (××XXX-X) —— SPOOL NO
3. SOME STRUCTURAL MEMBERS AND GRATINGS ARE HIDDEN FOR A MORE CLEAR VIEW WHERE IT IS CONSIDERED NECESSARY
4. WP : WORKING POINT FOR SLOPE LINE

REV.	DESCRIPTION	DATE	BY	CHECK	APPROVAL
0	ISSUED FOR CONSTRUCTION	01.MAY.2024	S.H.	M.F.	N.K.

This drawing is the property of Cimtas and all rights reserved

REVISIONS

CUSTOMER

PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2024 Mitsubishi Power Americas, Inc.

MITSUBISHI POWER

CUSTOMER JOB NO: –

ITEM NO: MDL–150

DWG NAME: MD–2.2 PIPING SUPPORT & SPOOLS GENERAL ARRANGEMENTS DRAWINGS **(GA FOR SPOOLS)**


REF.DWG.NO.: –

PREPARED BY: cimtas


JOB NO	SHEET	SCALE	SIZE
2E00140	1/1	1/25	A1

DRAWING NO: 2E00140–PI–094–001–MD–2.2


REV. 0

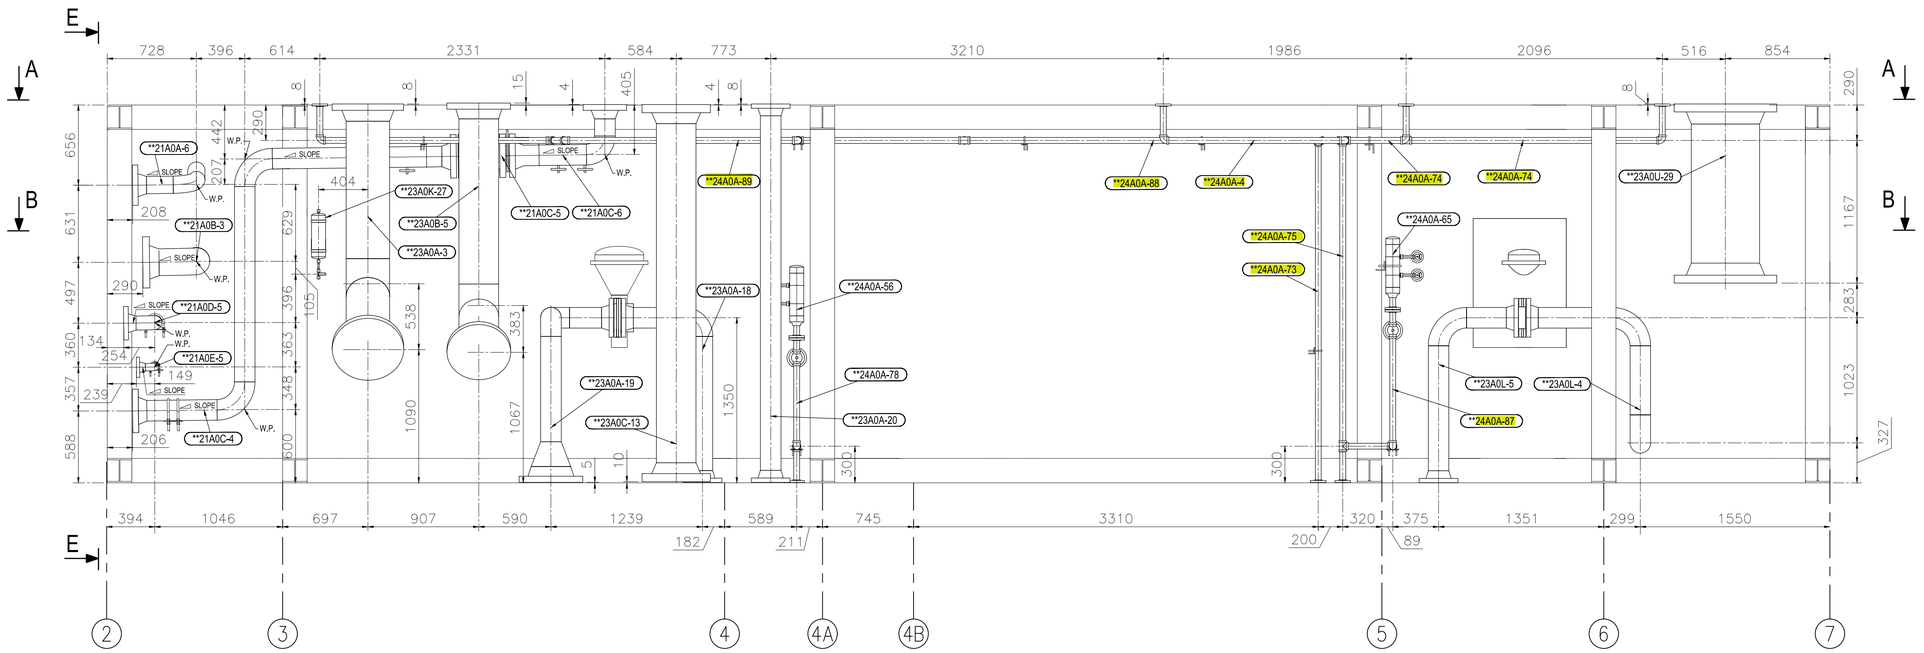

MD-2.2 ELEVATION VIEW
SECTION 'C-C'

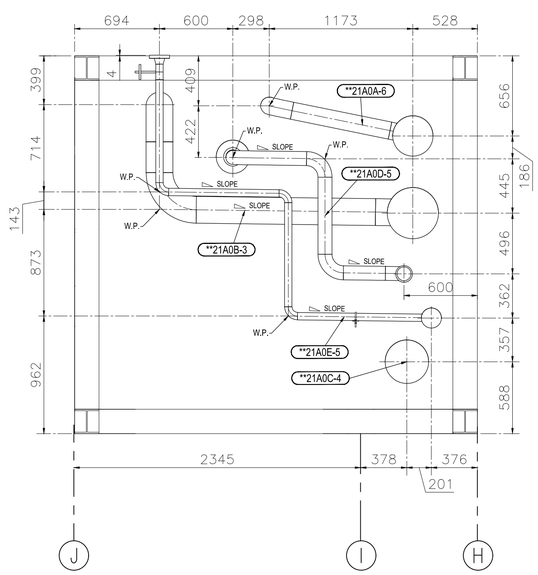

MD-2.2 SECTION 'E-E'
(LOOKING EAST)

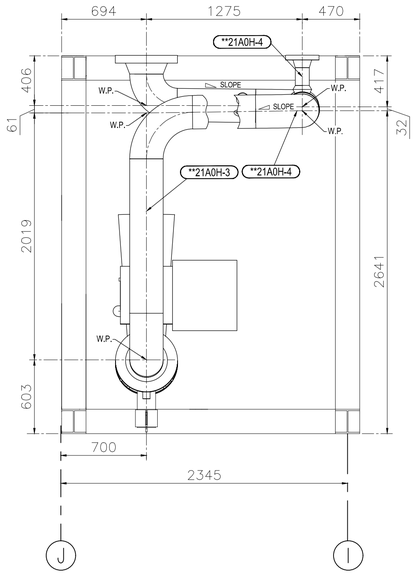

MD-2.2 SECTION 'F-F'
(LOOKING EAST)

REFERENCES

MDL ITEM #	MPWA MDL DESCRIPTION	DETAILS FOR
1	FOUNDATION PLAN AND SUMMARY LOADING DATA FOR MODULE GT ENCLOSURE	GENERAL LOCATION
20	GA DRAWING FOR MODULARIZED JAC GT ENCLOSURE	GENERAL LOCATION

NOTES

1. DIMENSIONS : MM [INCHES]
2. LABELING
   - ××XXXXXX —— PIPE LINE
   - (××XXX-X) —— SPOOL NO
3. SOME STRUCTURAL MEMBERS AND GRATINGS ARE HIDDEN FOR A MORE CLEAR VIEW WHERE IT IS CONSIDERED NECESSARY
4. WP : WORKING POINT FOR SLOPE LINE

REV.	DESCRIPTION	DATE	BY	CHECK	APPROVAL
0	ISSUED FOR CONSTRUCTION	01.MAY.2024	S.H.	M.F.	N.K.

This drawing is the property of Cimtas and all rights reserved

REVISIONS

CUSTOMER

PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2024 Mitsubishi Power Americas, Inc.

MITSUBISHI POWER

CUSTOMER JOB NO: –

ITEM NO: MDL-150

DWG NAME: MD-2.2 PIPING SUPPORT & SPOOLS GENERAL ARRANGEMENTS DRAWINGS **(GA FOR SPOOLS)**


REF.DWG.NO.: –

PREPARED BY: cimtas

JOB NO	SHEET	SCALE	SIZE
2E00140	1/1	1/25	A1

DRAWING NO: 2E00140-PI-094-001-MD-2.2

REV.: 0

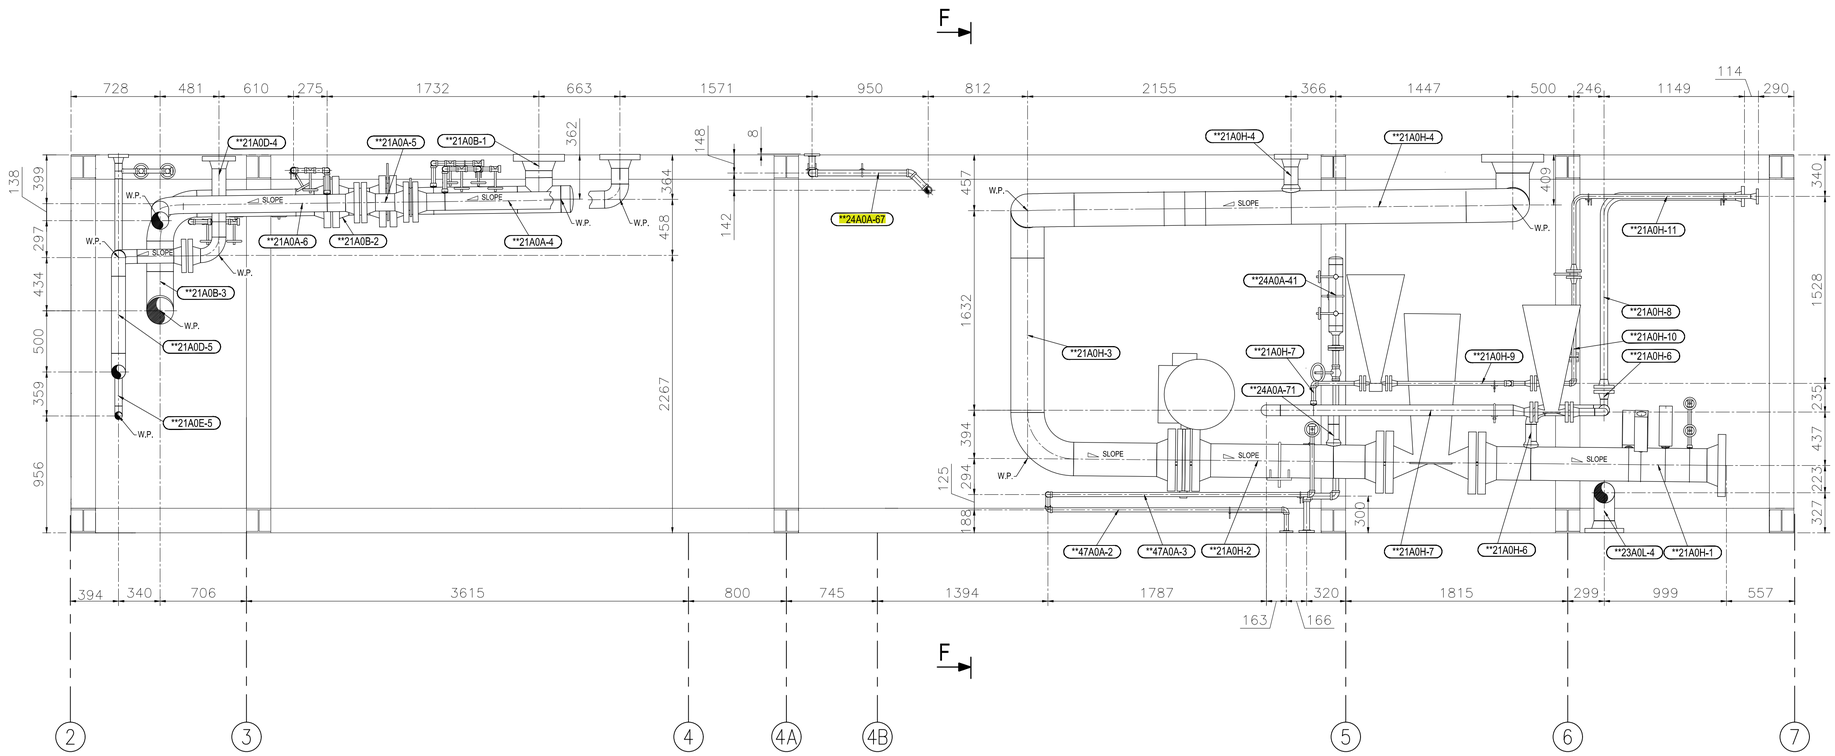

MD-2.2 ELEVATION VIEW
SECTION 'D-D'

REFERENCES

MDL ITEM #	MPWA MDL DESCRIPTION	DETAILS FOR
1	FOUNDATION PLAN AND SUMMARY LOADING DATA FOR MODULE GT ENCLOSURE	GENERAL LOCATION
20	GA DRAWING FOR MODULARIZED JAC GT ENCLOSURE	GENERAL LOCATION

NOTES

1. DIMENSIONS : MM [INCHES]
2. LABELING
   - ××XXXXXX ——PIPE LINE
   - (××XXX-X) ——SPOOL NO
3. SOME STRUCTURAL MEMBERS AND GRATINGS ARE HIDDEN FOR A MORE CLEAR VIEW WHERE IT IS CONSIDERED NECESSARY
4. WP : WORKING POINT FOR SLOPE LINE

REV.	DESCRIPTION	DATE	BY	CHECK	APPROVAL
0	ISSUED FOR CONSTRUCTION	01.MAY.2024	S.H.	M.F.	N.K.

This drawing is the property of Cimtas and all rights reserved

REVISIONS

CUSTOMER

PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2024 , Mitsubishi Power Americas, Inc.

MITSUBISHI POWER

CUSTOMER JOB NO
–

ITEM NO
MDL-150

DWG NAME
MD-2.2 PIPING SUPPORT & SPOOLS GENERAL ARRANGEMENTS DRAWINGS **(GA FOR SPOOLS)**

REF.DWG.NO.
–


PREPARED BY
cimtas

JOB NO	SHEET	SCALE	SIZE
2E00140	1/1	1/25	A1

DRAWING NO
2E00140-PI-094-001-MD-2.2

REV.
0

REVISION RECORD

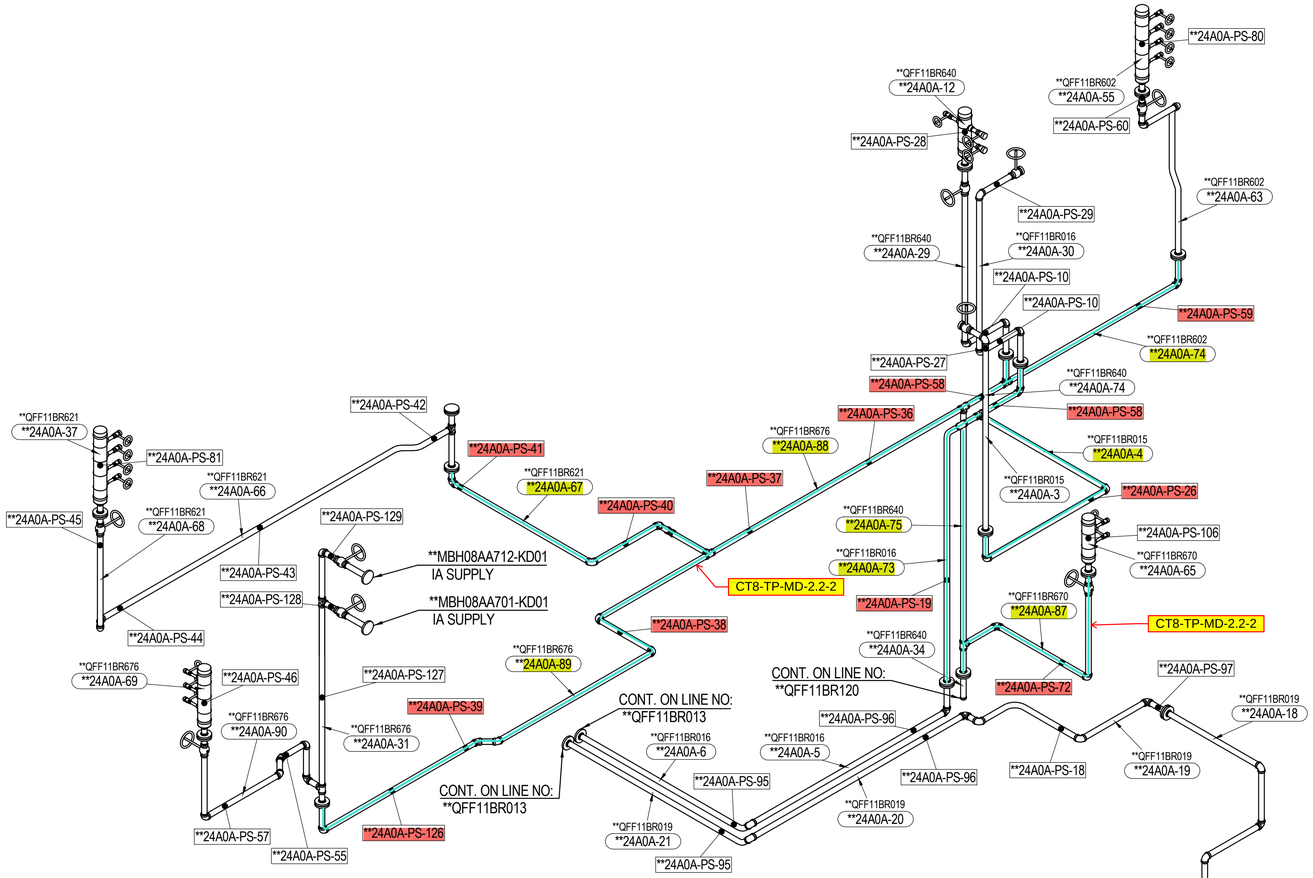

LEGEND:

PIPELINE / SPOOL	INDICATES PIPELINE ON THE TOP AND SPOOL ON THE BOTTOM.
SUPPORT	INDICATES SUPPORT.
TERMINAL POINT	INDICATES TERMINAL POINT.
– – – – – – –	INDICATES TRACING.

ORIGIN:	MITSUBISHI POWER-LAKE MARY	DATE:	MITSUBISHI POWER DRAWING NUMBER:	REV. NO.:	SYSTEM CODE:
PREPARED BY:	D. DURAPAU	10/22/2025	**N05-003580**	**0**	**24A0A**
REVIEWED BY:	D.MAZQUIARAN / N.JAMSHIDI	10/28/2025	**INSTRUMENT AIR PIPING**		
APPROVED BY:	U. KASINATHAN	10/31/2025	**INTERNAL TO GT PACKAGE**		
			FOR FABRICATION & ERECTION		
			N05-ISO-QFF-BR-AA		
			P&ID DRAWING NUMBER: N01-PID-QFF-00-02		
			M501JAC GAS TURBINE		
PROJECT CODE:	-	P&ID:	-		
PIPELINE:	-	PAGE NUMBER:	5 OF 8		

PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2025 , Mitsubishi Power Americas, Inc.

EXPORT CONTROL DIVERSION WARNING
This document contains data which if exported from the United States must be exported in accordance with the export administration regulations, diversion contrary to U.S. law is prohibited.

MITSUBISHI POWER

ECCN: EAR99 No License Req'd

SL2


MITSUBISHI POWER ENGINEERING

PLANT ENGINEERING

DEPARTMENT:

SECTION:

DRAWING DISTRIBUTION LIST

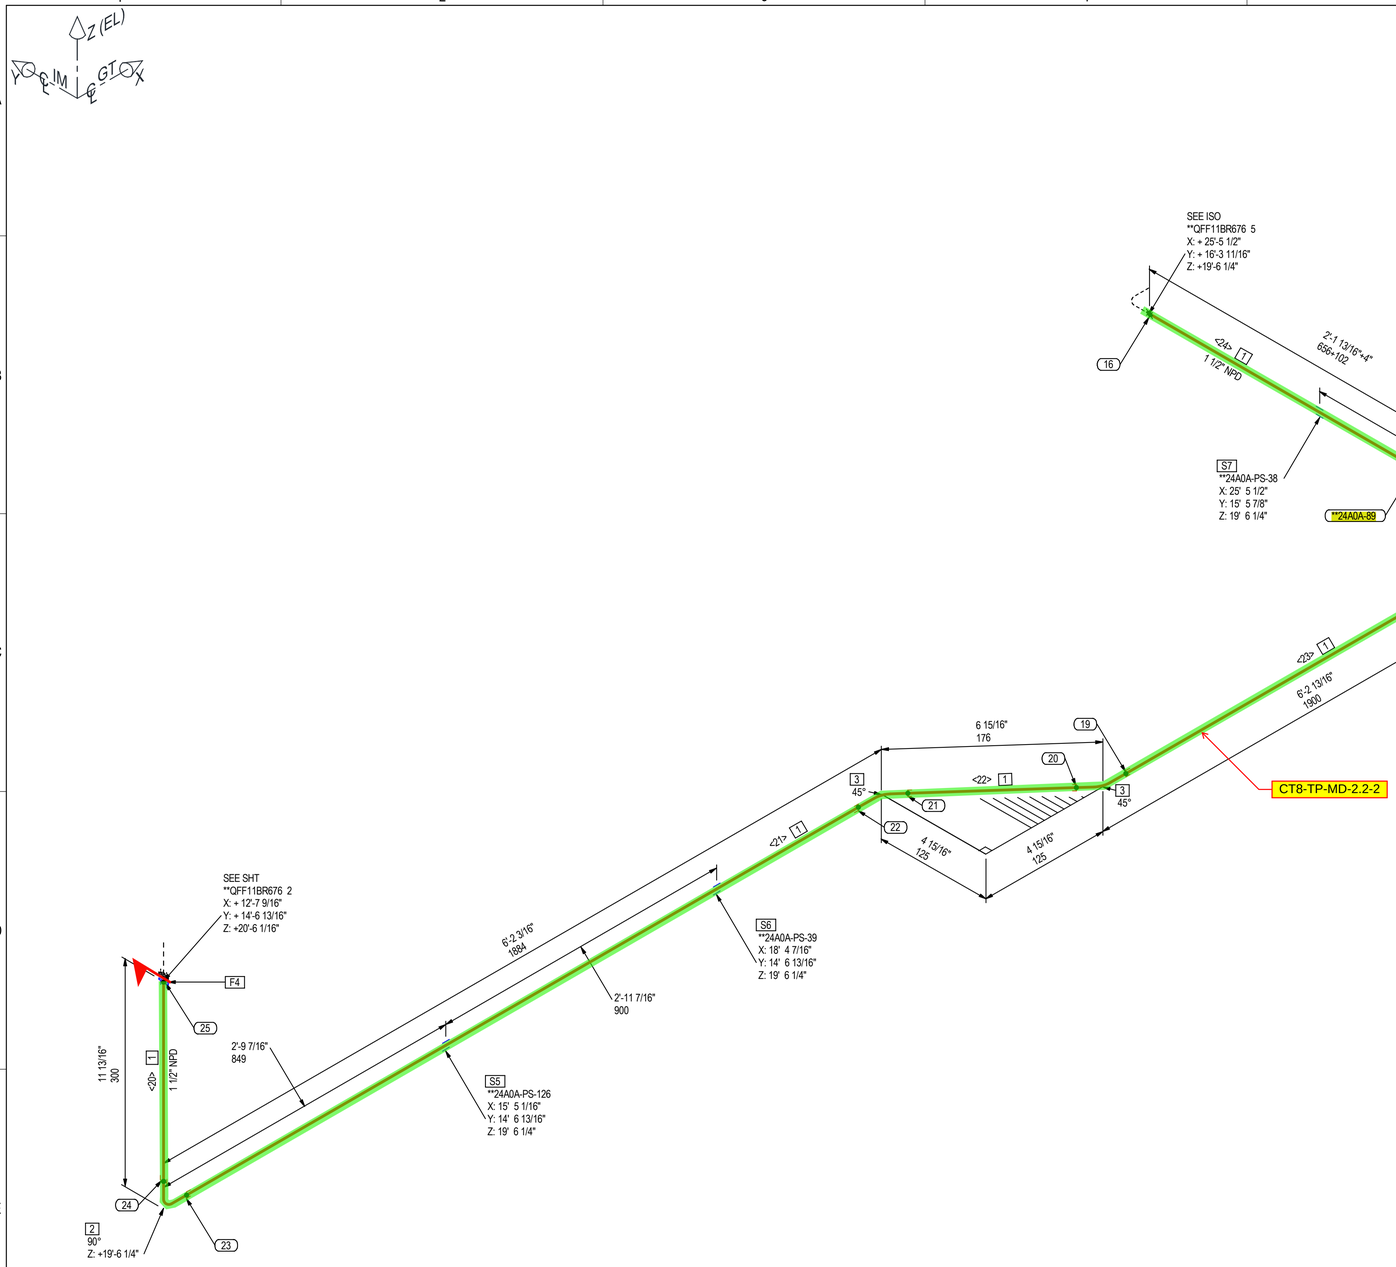

SHOP MATERIALS - FABRICATION ONLY

PT NO	DESCRIPTION	NPD (IN)	CMDTY CODE	QTY
1	PIPE, S-40S, PE, ASME B36.19M, ASTM A312-TP304, SEAMLESS	1 1/2	MPAAZZBPZZABBANI	15.8'
2	90 DEG ELBOW, CL3000, SWE, ASME B16.11, ASTM A182-F304	1 1/2	MMCKAWBVZZAAGALO	2
3	45 DEG ELBOW, CL3000, SWE, ASME B16.11, ASTM A182-F304	1 1/2	MMBWAWBVZZAAGALO	2
4	FLANGE SW, CL150, RFFE, ASME B16.5, ASTM A182-F304	1 1/2	MFABAHABZZAADALO	1

OTHER THAN SHOP MATERIALS - ERECTION ONLY

PT NO	DESCRIPTION	NPD (IN)	CMDTY CODE	QTY
	PIPE SUPPORTS			
5	PIPE SUPPORT	1 1/2	**24A0A-PS-126	1
6	PIPE SUPPORT	1 1/2	**24A0A-PS-39	1
7	PIPE SUPPORT	1 1/2	**24A0A-PS-38	1
	SPOOLS			
	**24A0A-89			

CUT PIPE LENGTH

PIECE NO	LENGTH (FT-INS)	NPD (IN)	REMARKS	END ONE	END TWO	ITEM CODE
<20>	10 3/16"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<21>	6'0"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<22>	5 3/16"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<23>	6'0 5/8"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<24>	2'4 1/2"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI

ACTUAL QUANTITY OF WASHERS SHALL BE CONSIDERED AS HALF OF THE QUANTITY SHOWN ON ISOMETRICS

NOTES:
1. THE X AND Y COORDINATES ARE WITH RESPECT TO THE INTERSECTION OF THE CENTERLINE OF THE GAS TURBINE (GT) AND THE INLET MANIFOLD (IM). THE Z (EL) COORDINATE IS WITH RESPECT TO THE TOP OF CONCRETE, WHICH IS 15'-9" [4800 mm] BELOW THE CENTERLINE OF THE GT AND IS 0'-0".
2. ALL PIPE SUPPORT COORDINATES ARE WITH RESPECT TO THE CENTERLINE OF THE INSTALLED SUPPORTED PIPE.
3. THE MARK 'FFW' (FIELD FIT WELD) IN THE DRAWING INDICATES EXCESS LENGTH OF APPROX. 4 INCHES IDENTIFIED AS LOOSE IN THE DRAWING TO BE CUT AND ADJUSTED AT THE FIELD.
4. ALL WELDING TO BE DONE AND INSPECTED PER LATEST APPLICABLE EDITION OF ASME B31.1 AND SECTION IX AVAILABLE ON THE PROJECT AWARD DATE.
5. PIPING SHALL BE INSTALLED PER THE INDICATED SLOPE.
6. FOR ANY FURTHER INFORMATION REQUIRED DURING INSTALLATION, CONSULT MITSUBISHI POWER TFA (TECHNICAL FIELD ADVISOR) AT SITE.
7. ⟨XXX## ###⟩ INDICATES PIPING TERMINAL POINT.

ADDITIONAL NOTES:
WELDING AT PIPES MARKED WITH ✱ SHALL BE ADJUSTED AT SHOP TO FIT DURING ASSEMBLY.
THE MARK ✱ ON THE DRAWING INDICATES AN EXCESS LENGTH OF 4" (100mm) ADDED TO THE PIPE FOR ADJUSTED DURING ASSEMBLY.

WELD NO	WELD TYPE	WELD CAT	NPD	QTY
25	SW	S	1 1/2"	1
24	SW	S	1 1/2"	1
23	SW	S	1 1/2"	1
22	SW	S	1 1/2"	1
21	SW	S	1 1/2"	1
20	SW	S	1 1/2"	1
19	SW	S	1 1/2"	1
18	SW	S	1 1/2"	1
17	SW	S	1 1/2"	1
16	SW	S	1 1/2"	1

PIPING SPEC:	SAC
FLUID CODE:	IA, INSTRUMENT AIR
MAX. PRESS.:	150.00 psig / 1.03 MPag
TEST PRESS.:	225.00 psig / 1.55 MPag
MAX. TEMP:	140 F / 60 C
INSULATION SPEC:	NOT INSULATED

PAINTING SPEC: PER PROJECT SPECIFICATION
INTERIOR SURFACE TREATMENT SPEC: LU-00129

REVISION RECORD					
REV. #	DESCRIPTION	BY	CHK	APP	DATE

WELD TYPE IDENTIFIER:
BW - BUTT WELD
SW - SOCKET WELD
SOF - SLIP-ON FLANGE
SOB - SET-ON BRANCH
LET - OLET, LATROLET OR HALF COUPLING
TW - TACK WELD
MW - MITER WELD

WELD CATEGORY IDENTIFICATION:
● S - SHOP
✖ FW - FIELD WELD
✖ FFW - FIELD FIT WELD

SYMBOLOGY:
WELD NUMBER
PART NUMBER (PT NO)
< > CUT LIST PIECE NUMBER

SYMBOL IDENTIFIER:
F - FLANGE
G - GASKET
B - BOLT
N - NUT
W - WASHER
O - O-RING
L - LOCK WIRE


ORIGIN:	MITSUBISHI POWER-LAKE MARY	DATE:	MITSUBISHI POWER DRAWING NUMBER:	REV. NO.:	SYSTEM CODE:
PREPARED BY:	D. DURAPAU	10/22/2025	N05-003580	0	24A0A
REVIEWED BY:	D.MAZQUIARAN / N.JAMSHIDI	10/28/2025	INSTRUMENT AIR PIPING		
APPROVED BY:	U. KASINATHAN	10/31/2025	INTERNAL TO GT PACKAGE		
			FOR FABRICATION & ERECTION		
			N05-ISO-QFF-BR-AA		
			P&ID DRAWING NUMBER: N01-PID-QFF-00-02		
			M501JAC GAS TURBINE		
			PROJECT CODE: -	P&ID: -	
			PIPELINE:	PAGE NUMBER:	
			**QFF11BR676	4 OF 5	

PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2025 , Mitsubishi Power Americas, Inc.

MITSUBISHI POWER

EXPORT CONTROL DIVERSION WARNING
This document contains data which if exported from the United States must be exported in accordance with the export administration regulations, diversion contrary to U.S. law is prohibited.

ECCN: EAR99 No License Req'd
SL2
MITSUBISHI POWER ENGINEERING
PLANT ENGINEERING
DEPARTMENT:
SECTION:
DRAWING DISTRIBUTION LIST

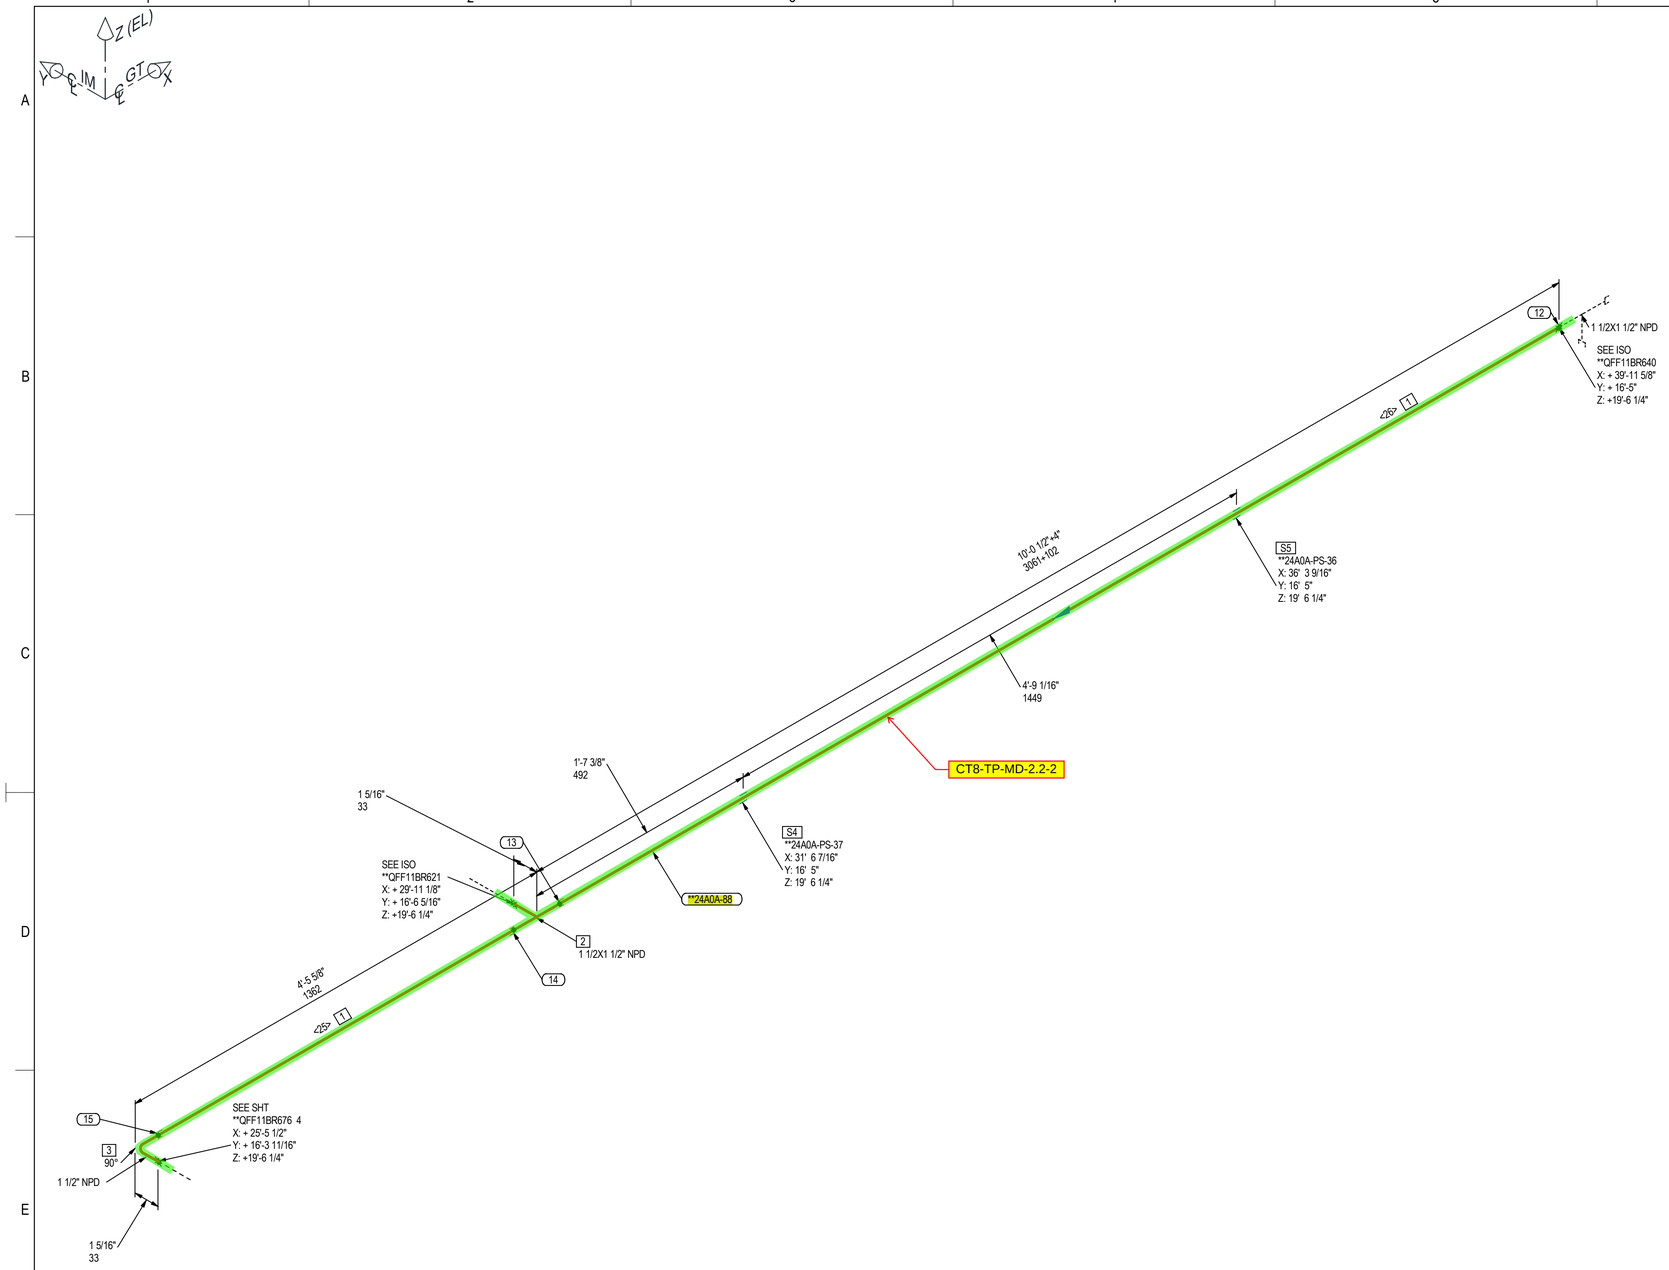

SHOP MATERIALS - FABRICATION ONLY

PT NO	DESCRIPTION	NPD (IN)	CMDTY CODE	QTY
1	PIPE, S-40S, PE, ASME B36.19M, ASTM A312-TP304, SEAMLESS	1 1/2	MPAAZZBPZZABBANI	14.6'
2	TEE, CL3000, SWE, ASME B16.11, ASTM A182-F304	1 1/2X1 1/2	MMDJAWBVZZAAGALO	1
3	90 DEG ELBOW, CL3000, SWE, ASME B16.11, ASTM A182-F304	1 1/2	MMCKAWBVZZAAGALO	1

OTHER THAN SHOP MATERIALS - ERECTION ONLY

PT NO	DESCRIPTION	NPD (IN)	CMDTY CODE	QTY
	PIPE SUPPORTS			
4	PIPE SUPPORT	1 1/2	**24A0A-PS-37	1
5	PIPE SUPPORT	1 1/2	**24A0A-PS-36	1
	SPOOLS			
	**24A0A-88			

CUT PIPE LENGTH

PIECE NO	LENGTH (FT-INS)	NPD (IN)	REMARKS	END ONE	END TWO	ITEM CODE
<25>	4'3"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<26>	10'3 3/16"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI

ACTUAL QUANTITY OF WASHERS SHALL BE CONSIDERED AS HALF OF THE QUANTITY SHOWN ON ISOMETRICS

NOTES:
1. THE X AND Y COORDINATES ARE WITH RESPECT TO THE INTERSECTION OF THE CENTERLINE OF THE GAS TURBINE (GT) AND THE INLET MANIFOLD (IM). THE Z (EL) COORDINATE IS WITH RESPECT TO THE TOP OF CONCRETE, WHICH IS 15'-9" [4800 mm] BELOW THE CENTERLINE OF THE GT AND IS 0'-0".
2. ALL PIPE SUPPORT COORDINATES ARE WITH RESPECT TO THE CENTERLINE OF THE INSTALLED SUPPORTED PIPE.
3. THE MARK 'FFW' (FIELD FIT WELD) IN THE DRAWING INDICATES EXCESS LENGTH OF APPROX. 4 INCHES IDENTIFIED AS LOOSE IN THE DRAWING TO BE CUT AND ADJUSTED AT THE FIELD.
4. ALL WELDING TO BE DONE AND INSPECTED PER LATEST APPLICABLE EDITION OF ASME B31.1 AND SECTION IX AVAILABLE ON THE PROJECT AWARD DATE.
5. PIPING SHALL BE INSTALLED PER THE INDICATED SLOPE.
6. FOR ANY FURTHER INFORMATION REQUIRED DURING INSTALLATION, CONSULT MITSUBISHI POWER TFA (TECHNICAL FIELD ADVISOR) AT SITE.
7. ⟨XXX## ###⟩ INDICATES PIPING TERMINAL POINT.

WELD NO	WELD TYPE	WELD CAT	NPD	QTY
15	SW	S	1 1/2"	1
14	SW	S	1 1/2"	1
13	SW	S	1 1/2"	1
12	SW	S	1 1/2"	1

PIPING SPEC:	SAC
FLUID CODE:	IA, INSTRUMENT AIR
MAX. PRESS.:	150.00 psig / 1.03 MPag
TEST PRESS.:	225.00 psig / 1.55 MPag
MAX. TEMP:	140 F / 60 C
INSULATION SPEC:	NOT INSULATED

PAINTING SPEC: PER PROJECT SPECIFICATION

INTERIOR SURFACE TREATMENT SPEC: LU-00129

REVISION RECORD

REV. #	DESCRIPTION	BY	CHK	APP	DATE

WELD TYPE IDENTIFIER:
BW - BUTT WELD
SW - SOCKET WELD
SOF - SLIP-ON FLANGE
SOB - SET-ON BRANCH
LET - OLET, LATROLET OR HALF COUPLING
TW - TACK WELD
MW - MITER WELD

WELD CATEGORY IDENTIFICATION:
● S - SHOP
✖ FW - FIELD WELD
✖ FFW - FIELD FIT WELD

SYMBOLOGY:
WELD NUMBER
PART NUMBER (PT NO)
< > CUT LIST PIECE NUMBER

SYMBOL IDENTIFIER:
F - FLANGE
G - GASKET
B - BOLT
N - NUT
W - WASHER
O - O-RING
L - LOCK WIRE

PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2025 , Mitsubishi Power Americas, Inc.

MITSUBISHI POWER

ORIGIN:	MITSUBISHI POWER-LAKE MARY	DATE:	MITSUBISHI POWER DRAWING NUMBER:
PREPARED BY:	D. DURAPAU	10/22/2025	N05-003580
REVIEWED BY:	D.MAZQUIARAN / N.JAMSHIDI	10/28/2025	INSTRUMENT AIR PIPING
APPROVED BY:	U. KASINATHAN	10/31/2025	INTERNAL TO GT PACKAGE

REV. NO.:	SYSTEM CODE:
0	24A0A

FOR FABRICATION & ERECTION

N05-ISO-QFF-BR-AA

P&ID DRAWING NUMBER: N01-PID-QFF-00-02

M501JAC GAS TURBINE

PROJECT CODE:	-	P&ID:	-
PIPELINE:		PAGE NUMBER:	
**QFF11BR676		5 OF 5	

EXPORT CONTROL DIVERSION WARNING
This document contains data which if exported from the United States must be exported in accordance with the export administration regulations, diversion contrary to U.S. law is prohibited.


ECCN: EAR99 No License Req'd

SL2

MITSUBISHI POWER ENGINEERING
PLANT ENGINEERING

DEPARTMENT:
SECTION:

DRAWING DISTRIBUTION LIST

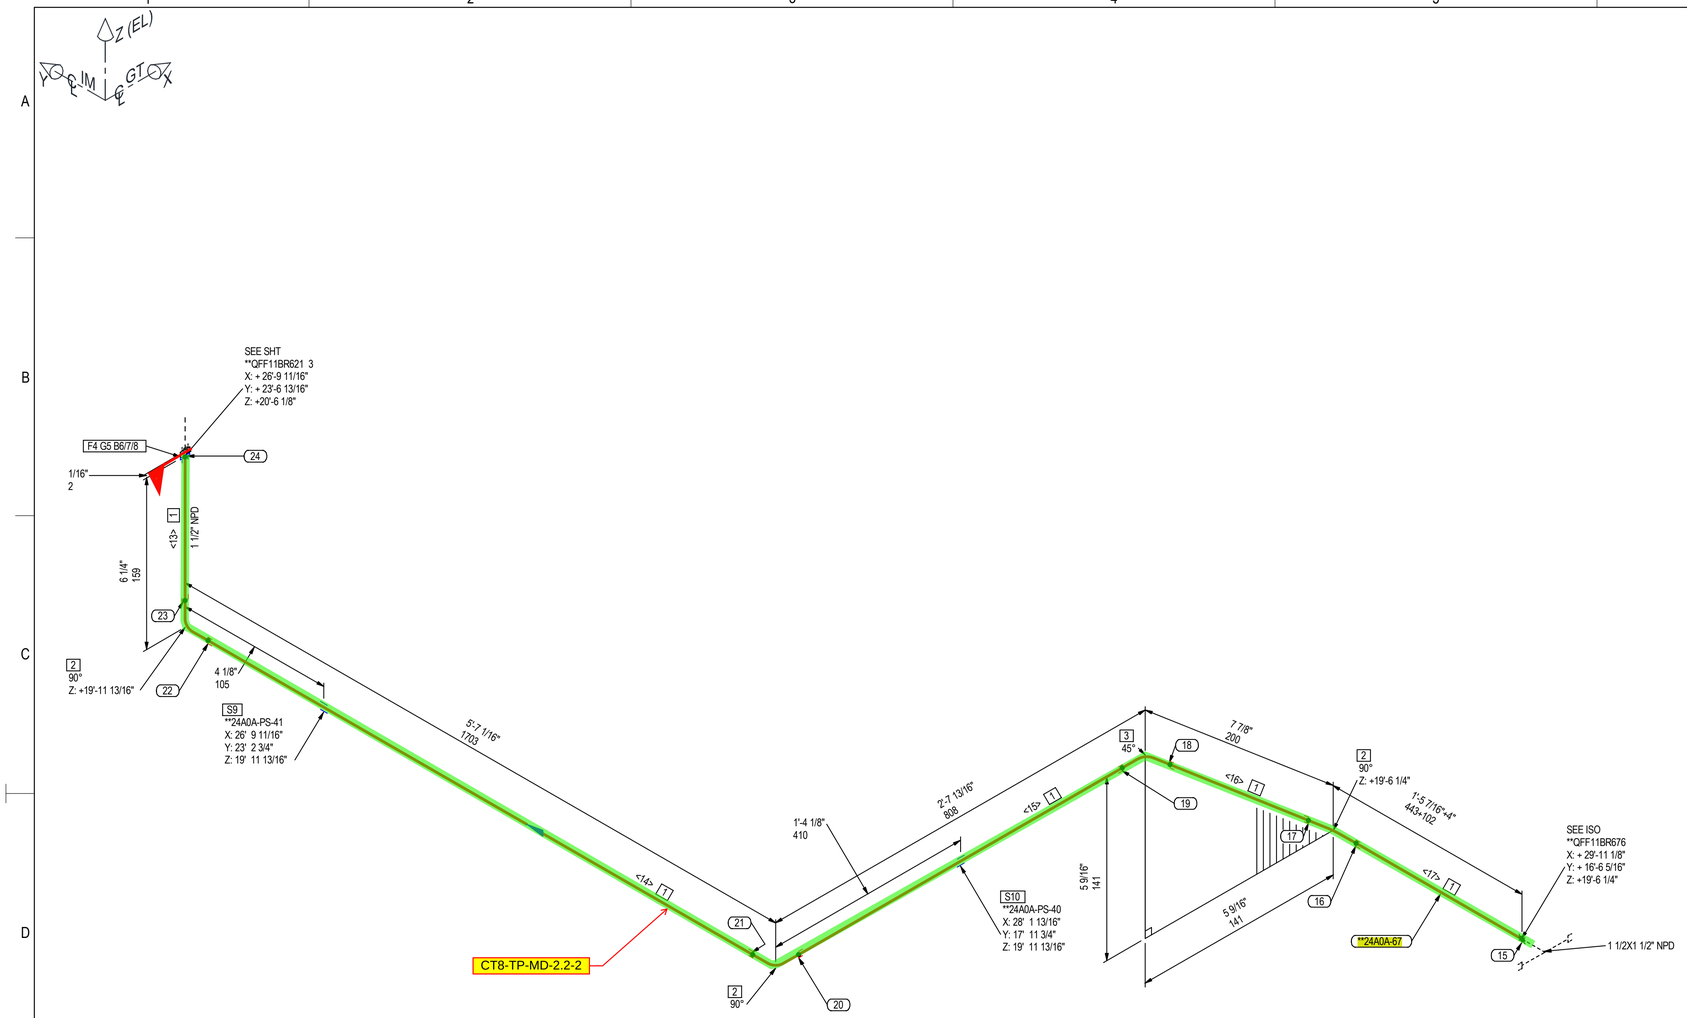

SHOP MATERIALS - FABRICATION ONLY

PT NO	DESCRIPTION	NPD (IN)	CMDTY CODE	QTY
1	PIPE, S-40S, PE, ASME B36.19M, ASTM A312-TP304, SEAMLESS	1 1/2	MPAAZZBPZZABBANI	10.4'
2	90 DEG ELBOW, CL3000, SWE, ASME B16.11, ASTM A182-F304	1 1/2	MMCKAWBVZZAAGALO	3
3	45 DEG ELBOW, CL3000, SWE, ASME B16.11, ASTM A182-F304	1 1/2	MMBWAWBVZZAAGALO	1
4	FLANGE SW, CL150, RFFE, ASME B16.5, ASTM A182-F304	1 1/2	MFABAHABZZAADALO	1

OTHER THAN SHOP MATERIALS - ERECTION ONLY

PT NO	DESCRIPTION	NPD (IN)	CMDTY CODE	QTY
5	GASKET, FLAT RING, CL150, 0.0625" THK, ASME B16.21, COMPRESSED NON ASBESTOS FIBER	1 1/2	MITAHAAAALBMNUS	1
6	STUD, CONTINUOUS THREAD, ASME B18.31.2, ASTM A193-B8 CL1, 13-UNC - 3.5 in. Length	1/2	MBAZZACZZIAGBLJZ	4
7	NUT, HEAVY HEX, ASME B18.2.2, ASTM A194-8, 13-UNC	1/2	MNOZZACAAZPCJAFU	8
8	WASHER, SPECIAL SHAPED LOCK, 1.5in NPD, 0.8mm THK, MHPSA G1-90942, ASTM A240-304	1/2	MWQZZZZBUIBBAMDP	8
	PIPE SUPPORTS			
9	PIPE SUPPORT	1 1/2	**24A0A-PS-41	1
10	PIPE SUPPORT	1 1/2	**24A0A-PS-40	1
	SPOOLS			
	**24A0A-67			

CUT PIPE LENGTH

PIECE NO	LENGTH (FT-INS)	NPD (IN)	REMARKS	END ONE	END TWO	ITEM CODE
<13>	4 5/8"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<14>	5'4 7/16"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<15>	2'5 5/8"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<16>	5 11/16"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<17>	1'8 1/8"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI

ACTUAL QUANTITY OF WASHERS SHALL BE CONSIDERED AS HALF OF THE QUANTITY SHOWN ON ISOMETRICS

NOTES:
1. THE X AND Y COORDINATES ARE WITH RESPECT TO THE INTERSECTION OF THE CENTERLINE OF THE GAS TURBINE (GT) AND THE INLET MANIFOLD (IM). THE Z (EL) COORDINATE IS WITH RESPECT TO THE TOP OF CONCRETE, WHICH IS 15'-9" [4800 mm] BELOW THE CENTERLINE OF THE GT AND IS 0'-0".
2. ALL PIPE SUPPORT COORDINATES ARE WITH RESPECT TO THE CENTERLINE OF THE INSTALLED SUPPORTED PIPE.
3. THE MARK 'FFW' (FIELD FIT WELD) IN THE DRAWING INDICATES EXCESS LENGTH OF APPROX. 4 INCHES IDENTIFIED AS LOOSE IN THE DRAWING TO BE CUT AND ADJUSTED AT THE FIELD.
4. ALL WELDING TO BE DONE AND INSPECTED PER LATEST APPLICABLE EDITION OF ASME B31.1 AND SECTION IX AVAILABLE ON THE PROJECT AWARD DATE.
5. PIPING SHALL BE INSTALLED PER THE INDICATED SLOPE.
6. FOR ANY FURTHER INFORMATION REQUIRED DURING INSTALLATION, CONSULT MITSUBISHI POWER TFA (TECHNICAL FIELD ADVISOR) AT SITE.
7. ⟨XXX## ###⟩ INDICATES PIPING TERMINAL POINT.

WELD NO	WELD TYPE	WELD CAT	NPD	QTY
24	SW	S	1 1/2"	1
23	SW	S	1 1/2"	1
22	SW	S	1 1/2"	1
21	SW	S	1 1/2"	1
20	SW	S	1 1/2"	1
19	SW	S	1 1/2"	1
18	SW	S	1 1/2"	1
17	SW	S	1 1/2"	1
16	SW	S	1 1/2"	1
15	SW	S	1 1/2"	1

ADDITIONAL NOTES:
WELDING AT PIPES MARKED WITH ✱ SHALL BE ADJUSTED AT SHOP TO FIT DURING ASSEMBLY.
THE MARK ✱ ON THE DRAWING INDICATES AN EXCESS LENGTH OF 4" (100mm) ADDED TO THE PIPE FOR ADJUSTED DURING ASSEMBLY.

PIPING SPEC:	SAC	PAINTING SPEC: PER PROJECT SPECIFICATION	REVISION RECORD					
FLUID CODE:	IA, INSTRUMENT AIR	INTERIOR SURFACE TREATMENT SPEC: LU-00129	REV. #	DESCRIPTION	BY	CHK	APP	DATE
MAX. PRESS.:	150.00 psig / 1.03 MPag							
TEST PRESS.:	225.00 psig / 1.55 MPag							
MAX. TEMP:	140 F / 60 C							
INSULATION SPEC:	NOT INSULATED							

WELD TYPE IDENTIFIER:
BW - BUTT WELD
SW - SOCKET WELD
SOF - SLIP-ON FLANGE
SOB - SET-ON BRANCH
LET - OLET, LATROLET OR HALF COUPLING
TW - TACK WELD
MW - MITER WELD

WELD CATEGORY IDENTIFICATION:
● S - SHOP
⊗ FW - FIELD WELD
⊗ FFW - FIELD FIT WELD

SYMBOLOGY:
WELD NUMBER
PART NUMBER (PT NO)
< > CUT LIST PIECE NUMBER

SYMBOL IDENTIFIER:
F - FLANGE
G - GASKET
B - BOLT
N - NUT
W - WASHER
O - O-RING
L - LOCK WIRE


PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2025 , Mitsubishi Power Americas, Inc.


MITSUBISHI POWER

ORIGIN:	MITSUBISHI POWER-LAKE MARY	DATE:	MITSUBISHI POWER DRAWING NUMBER: / REV. NO.: / SYSTEM CODE:
PREPARED BY:	D. DURAPAU	10/22/2025	N05-003580 / 0 / 24A0A
REVIEWED BY:	D.MAZQUIARAN / N.JAMSHIDI	10/28/2025	INSTRUMENT AIR PIPING
APPROVED BY:	U. KASINATHAN	10/31/2025	INTERNAL TO GT PACKAGE
			FOR FABRICATION & ERECTION
			N05-ISO-QFF-BR-AA
			P&ID DRAWING NUMBER: N01-PID-QFF-00-02
			M501JAC GAS TURBINE
PROJECT CODE:	-	P&ID:	-
PIPELINE:		PAGE NUMBER:	
**QFF11BR621		5 OF 5	

EXPORT CONTROL DIVERSION WARNING
This document contains data which if exported from the United States must be exported in accordance with the export administration regulations, diversion contrary to U.S. law is prohibited.

ECCN: EAR99 No License Req'd
SL2
MITSUBISHI POWER ENGINEERING / PLANT ENGINEERING
DEPARTMENT: / SECTION:
DRAWING DISTRIBUTION LIST



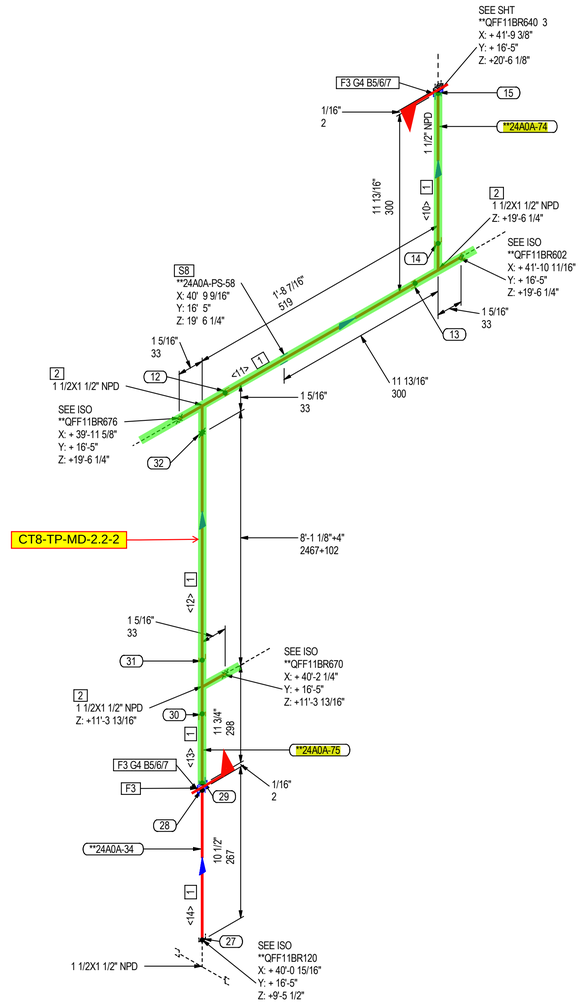

SHOP MATERIALS - FABRICATION ONLY

PT NO	DESCRIPTION	NPD (IN)	CMDTY CODE	QTY
1	PIPE, S-40S, PE, ASME B36.19M, ASTM A312-TP304, SEAMLESS	1 1/2	MPAAZZBPZZABBANI	12.4'
2	TEE, CL3000, SWE, ASME B16.11, ASTM A182-F304	1 1/2X1 1/2	MMDJAWBVZZAAGALO	3
3	FLANGE SW, CL150, RFFE, ASME B16.5, ASTM A182-F304	1 1/2	MFABAHABZZAADALO	3

OTHER THAN SHOP MATERIALS - ERECTION ONLY

PT NO	DESCRIPTION	NPD (IN)	CMDTY CODE	QTY
4	GASKET, FLAT RING, CL150, 0.0625" THK, ASME B16.21, COMPRESSED NON ASBESTOS FIBER	1 1/2	MITAHAAAALBMNUS	2
5	STUD, CONTINUOUS THREAD, ASME B18.31.2, ASTM A193-B8 CL1, 13-UNC - 3.5 in. Length	1/2	MBAZZACZZIAGBLJZ	8
6	NUT, HEAVY HEX, ASME B18.2.2, ASTM A194-8, 13-UNC	1/2	MNOZZACAAZPCJAFU	16
7	WASHER, SPECIAL SHAPED LOCK, 1.5in NPD, 0.8mm THK, MHPSA G1-90942, ASTM A240-304	1/2	MWQZZZZBUIBBAMDP	16
	PIPE SUPPORTS			
8	PIPE SUPPORT	1 1/2	**24A0A-PS-58	1
	SPOOLS			
	**24A0A-34, **24A0A-74, **24A0A-75			

CUT PIPE LENGTH

PIECE NO	LENGTH (FT-INS)	NPD (IN)	REMARKS	END ONE	END TWO	ITEM CODE
<10>	10 3/16"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<11>	1'5 13/16"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<12>	8'3 13/16"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<13>	10 1/8"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<14>	10 3/16"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI

ACTUAL QUANTITY OF WASHERS SHALL BE CONSIDERED AS HALF OF THE QUANTITY SHOWN ON ISOMETRICS

NOTES:
1. THE X AND Y COORDINATES ARE WITH RESPECT TO THE INTERSECTION OF THE CENTERLINE OF THE GAS TURBINE (GT) AND THE INLET MANIFOLD (IM). THE Z (EL) COORDINATE IS WITH RESPECT TO THE TOP OF CONCRETE, WHICH IS 15'-9" [4800 mm] BELOW THE CENTERLINE OF THE GT AND IS 0'-0".
2. ALL PIPE SUPPORT COORDINATES ARE WITH RESPECT TO THE CENTERLINE OF THE INSTALLED SUPPORTED PIPE.
3. THE MARK 'FFW' (FIELD FIT WELD) IN THE DRAWING INDICATES EXCESS LENGTH OF APPROX. 4 INCHES IDENTIFIED AS LOOSE IN THE DRAWING TO BE CUT AND ADJUSTED AT THE FIELD.
4. ALL WELDING TO BE DONE AND INSPECTED PER LATEST APPLICABLE EDITION OF ASME B31.1 AND SECTION IX AVAILABLE ON THE PROJECT AWARD DATE.
5. PIPING SHALL BE INSTALLED PER THE INDICATED SLOPE.
6. FOR ANY FURTHER INFORMATION REQUIRED DURING INSTALLATION, CONSULT MITSUBISHI POWER TFA (TECHNICAL FIELD ADVISOR) AT SITE.
7. ⟨XXX## ###⟩ INDICATES PIPING TERMINAL POINT.

ADDITIONAL NOTES:
WELDING AT PIPES MARKED WITH ✱ SHALL BE ADJUSTED AT SHOP TO FIT DURING ASSEMBLY.
THE MARK ✱ ON THE DRAWING INDICATES AN EXCESS LENGTH OF 4" (100mm) ADDED TO THE PIPE FOR ADJUSTED DURING ASSEMBLY.

WELD NO	WELD TYPE	WELD CAT	NPD	QTY
15	SW	S	1 1/2"	1
14	SW	S	1 1/2"	1
13	SW	S	1 1/2"	1
12	SW	S	1 1/2"	1
32	SW	S	1 1/2"	1
31	SW	S	1 1/2"	1
30	SW	S	1 1/2"	1
29	SW	S	1 1/2"	1
28	SW	S	1 1/2"	1
27	SW	S	1 1/2"	1

PIPING SPEC:	SAC	PAINTING SPEC: PER PROJECT SPECIFICATION	REVISION RECORD					
FLUID CODE:	IA, INSTRUMENT AIR	INTERIOR SURFACE TREATMENT SPEC: LU-00129	REV. #	DESCRIPTION	BY	CHK	APP	DATE
MAX. PRESS.:	150.00 psig / 1.03 MPag							
TEST PRESS.:	225.00 psig / 1.55 MPag							
MAX. TEMP:	140 F / 60 C							
INSULATION SPEC:	NOT INSULATED							

WELD TYPE IDENTIFIER:
BW - BUTT WELD
SW - SOCKET WELD
SOF - SLIP-ON FLANGE
SOB - SET-ON BRANCH
LET - OLET, LATROLET OR HALF COUPLING
TW - TACK WELD
MW - MITER WELD

WELD CATEGORY IDENTIFICATION:
● S - SHOP
⊗ FW - FIELD WELD
⊗ FFW - FIELD FIT WELD

SYMBOLOGY:
WELD NUMBER
PART NUMBER (PT NO)
< > CUT LIST PIECE NUMBER

SYMBOL IDENTIFIER:
F - FLANGE
G - GASKET
B - BOLT
N - NUT
W - WASHER
O - O-RING
L - LOCK WIRE


ORIGIN:	MITSUBISHI POWER-LAKE MARY	DATE:	MITSUBISHI POWER DRAWING NUMBER:	REV. NO.:	SYSTEM CODE:
PREPARED BY:	D. DURAPAU	10/22/2025	N05-003580	0	24A0A
REVIEWED BY:	D.MAZQUIARAN / N.JAMSHIDI	10/28/2025	INSTRUMENT AIR PIPING		
APPROVED BY:	U. KASINATHAN	10/31/2025	INTERNAL TO GT PACKAGE		
			FOR FABRICATION & ERECTION		
			N05-ISO-QFF-BR-AA		
			P&ID DRAWING NUMBER: N01-PID-QFF-00-02		
			M501JAC GAS TURBINE		
			PROJECT CODE: -	P&ID: -	
			PIPELINE: **QFF11BR640	PAGE NUMBER: 4 OF 4	

PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2025 , Mitsubishi Power Americas, Inc.

MITSUBISHI POWER

EXPORT CONTROL DIVERSION WARNING
This document contains data which if exported from the United States must be exported in accordance with the export administration regulations, diversion contrary to U.S. law is prohibited.

ECCN: EAR99 No License Req'd
SIL2
MITSUBISHI POWER ENGINEERING
PLANT ENGINEERING
DEPARTMENT:
SECTION:
DRAWING DISTRIBUTION LIST

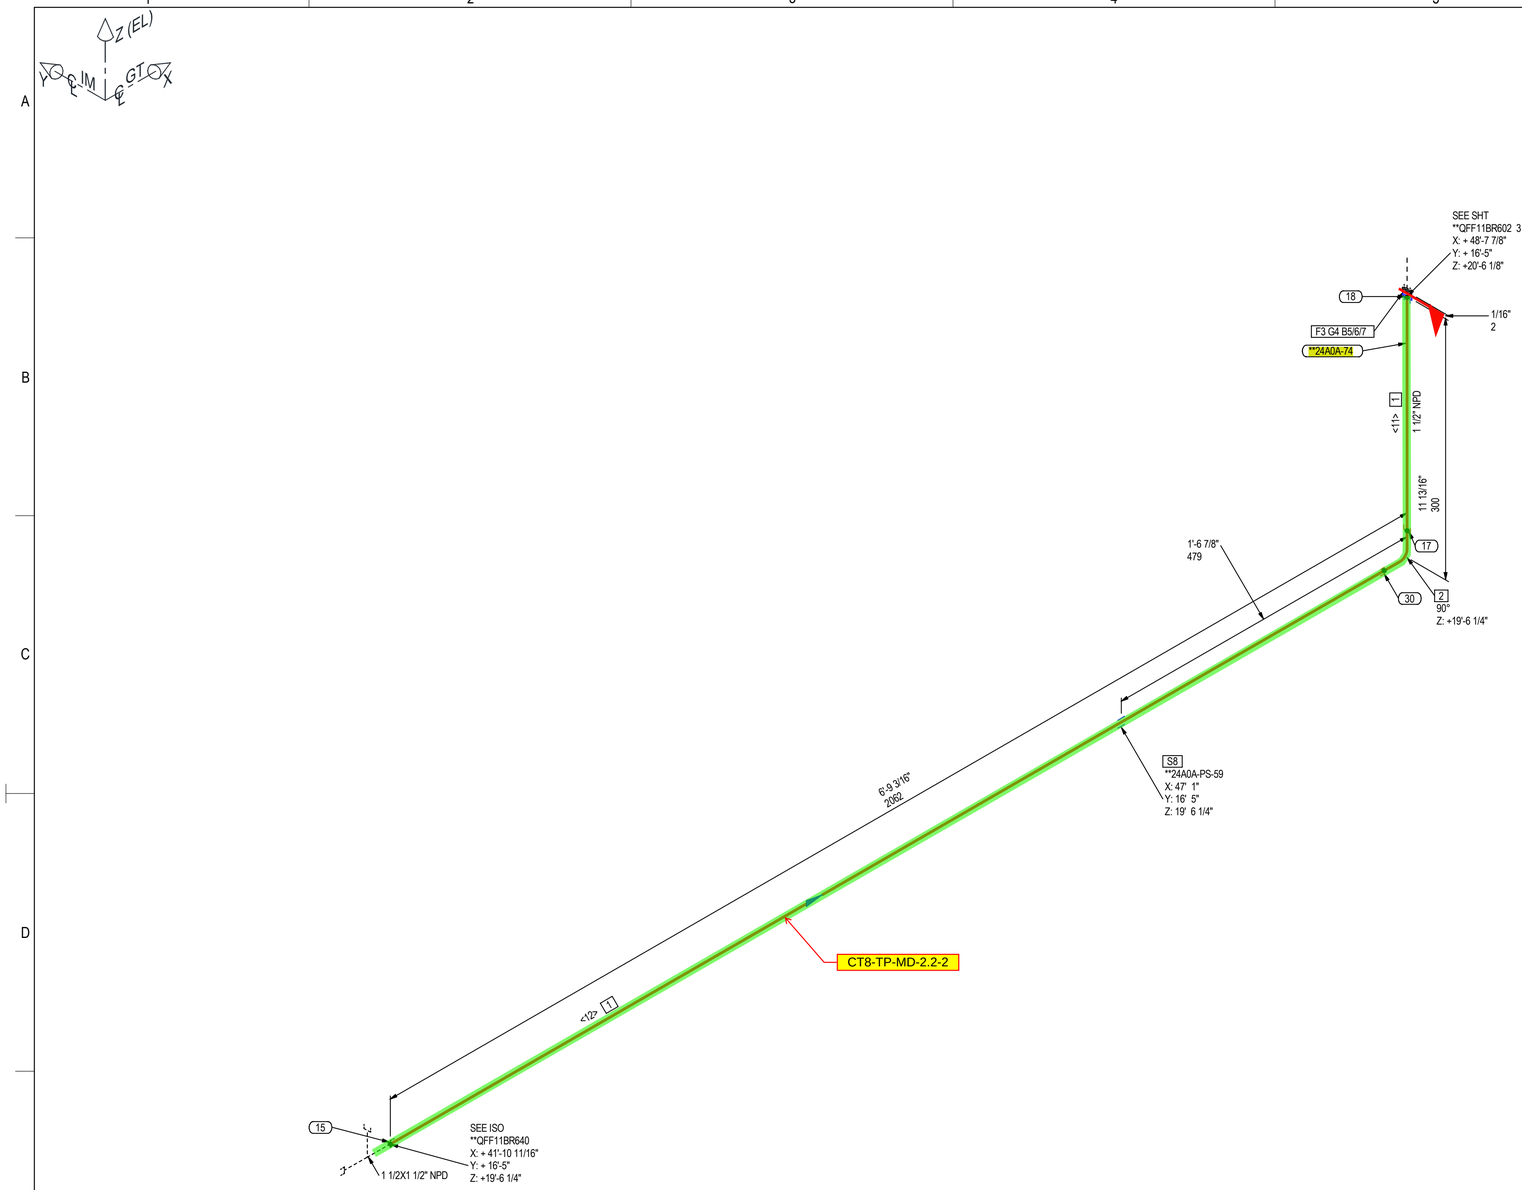

SHOP MATERIALS - FABRICATION ONLY

PT NO	DESCRIPTION	NPD (IN)	CMDTY CODE	QTY
1	PIPE, S-40S, PE, ASME B36.19M, ASTM A312-TP304, SEAMLESS	1 1/2	MPAAZZBPZZABBANI	7.6'
2	90 DEG ELBOW, CL3000, SWE, ASME B16.11, ASTM A182-F304	1 1/2	MMCKAWBVZZAAGALO	1
3	FLANGE SW, CL150, RFFE, ASME B16.5, ASTM A182-F304	1 1/2	MFABAHABZZAADALO	1

OTHER THAN SHOP MATERIALS - ERECTION ONLY

PT NO	DESCRIPTION	NPD (IN)	CMDTY CODE	QTY
4	GASKET, FLAT RING, CL150, 0.0625" THK, ASME B16.21, COMPRESSED NON ASBESTOS FIBER	1 1/2	MITAHAAAALBMNUS	1
5	STUD, CONTINUOUS THREAD, ASME B18.31.2, ASTM A193-B8 CL1, 13-UNC - 3.5 in. Length	1/2	MBAZZACZZIAGBLJZ	4
6	NUT, HEAVY HEX, ASME B18.2.2, ASTM A194-8, 13-UNC	1/2	MNOZZACAAZPCJAFU	8
7	WASHER, SPECIAL SHAPED LOCK, 1.5in NPD, 0.8mm THK, MHPSA G1-90942, ASTM A240-304	1/2	MWQZZZZBUIBBAMDP	8
	PIPE SUPPORTS			
8	PIPE SUPPORT	1 1/2	**24A0A-PS-59	1
	SPOOLS			
	**24A0A-74			

CUT PIPE LENGTH

PIECE NO	LENGTH (FT-INS)	NPD (IN)	REMARKS	END ONE	END TWO	ITEM CODE
<11>	10 3/16"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<12>	6'7 7/8"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI

ACTUAL QUANTITY OF WASHERS SHALL BE CONSIDERED AS HALF OF THE QUANTITY SHOWN ON ISOMETRICS

NOTES:
1. THE X AND Y COORDINATES ARE WITH RESPECT TO THE INTERSECTION OF THE CENTERLINE OF THE GAS TURBINE (GT) AND THE INLET MANIFOLD (IM). THE Z (EL) COORDINATE IS WITH RESPECT TO THE TOP OF CONCRETE, WHICH IS 15'-9" [4800 mm] BELOW THE CENTERLINE OF THE GT AND IS 0'-0".
2. ALL PIPE SUPPORT COORDINATES ARE WITH RESPECT TO THE CENTERLINE OF THE INSTALLED SUPPORTED PIPE.
3. THE MARK 'FFW' (FIELD FIT WELD) IN THE DRAWING INDICATES EXCESS LENGTH OF APPROX. 4 INCHES IDENTIFIED AS LOOSE IN THE DRAWING TO BE CUT AND ADJUSTED AT THE FIELD.
4. ALL WELDING TO BE DONE AND INSPECTED PER LATEST APPLICABLE EDITION OF ASME B31.1 AND SECTION IX AVAILABLE ON THE PROJECT AWARD DATE.
5. PIPING SHALL BE INSTALLED PER THE INDICATED SLOPE.
6. FOR ANY FURTHER INFORMATION REQUIRED DURING INSTALLATION, CONSULT MITSUBISHI POWER TFA (TECHNICAL FIELD ADVISOR) AT SITE.
7. XXX## ### INDICATES PIPING TERMINAL POINT.

WELD NO	WELD TYPE	WELD CAT	NPD	QTY
18	SW	S	1 1/2"	1
17	SW	S	1 1/2"	1
30	SW	S	1 1/2"	1
15	SW	S	1 1/2"	1

PIPING SPEC:	SAC	PAINTING SPEC: PER PROJECT SPECIFICATION	REVISION RECORD				
FLUID CODE:	IA, INSTRUMENT AIR	INTERIOR SURFACE TREATMENT SPEC: LU-00129	REV. #	DESCRIPTION	BY	CHK	APP	DATE
MAX. PRESS.:	150.00 psig / 1.03 MPag							
TEST PRESS.:	225.00 psig / 1.55 MPag							
MAX. TEMP:	140 F / 60 C							
INSULATION SPEC:	NOT INSULATED							

WELD TYPE IDENTIFIER:
BW - BUTT WELD
SW - SOCKET WELD
SOF - SLIP-ON FLANGE
SOB - SET-ON BRANCH
LET - OLET, LATROLET OR HALF COUPLING
TW - TACK WELD
MW - MITER WELD

WELD CATEGORY IDENTIFICATION:
S - SHOP
FW - FIELD WELD
FFW - FIELD FIT WELD

SYMBOLOGY:
WELD NUMBER
PART NUMBER (PT NO)
< > CUT LIST PIECE NUMBER

SYMBOL IDENTIFIER:
F - FLANGE
G - GASKET
B - BOLT
N - NUT
W - WASHER
O - O-RING
L - LOCK WIRE

ORIGIN:	MITSUBISHI POWER-LAKE MARY	DATE:	MITSUBISHI POWER DRAWING NUMBER:	REV. NO.:	SYSTEM CODE:
PREPARED BY:	D. DURAPAU	10/22/2025	**N05-003580**	**0**	**24A0A**
REVIEWED BY:	D.MAZQUIARAN / N.JAMSHIDI	10/28/2025	**INSTRUMENT AIR PIPING**		
APPROVED BY:	U. KASINATHAN	10/31/2025	**INTERNAL TO GT PACKAGE**		
			FOR FABRICATION & ERECTION		
			N05-ISO-QFF-BR-AA		
			P&ID DRAWING NUMBER: N01-PID-QFF-00-02		
			M501JAC GAS TURBINE		
			PROJECT CODE: -	P&ID: -	
			PIPELINE:	PAGE NUMBER:	
			**QFF11BR602	4 OF 4	

PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2025 , Mitsubishi Power Americas, Inc.

MITSUBISHI POWER


EXPORT CONTROL DIVERSION WARNING
This document contains data which if exported from the United States must be exported in accordance with the export administration regulations, diversion contrary to U.S. law is prohibited.

ECCN: EAR99 No License Req'd

SL2

DEPARTMENT: MITSUBISHI POWER ENGINEERING
SECTION: PLANT ENGINEERING

DRAWING DISTRIBUTION LIST

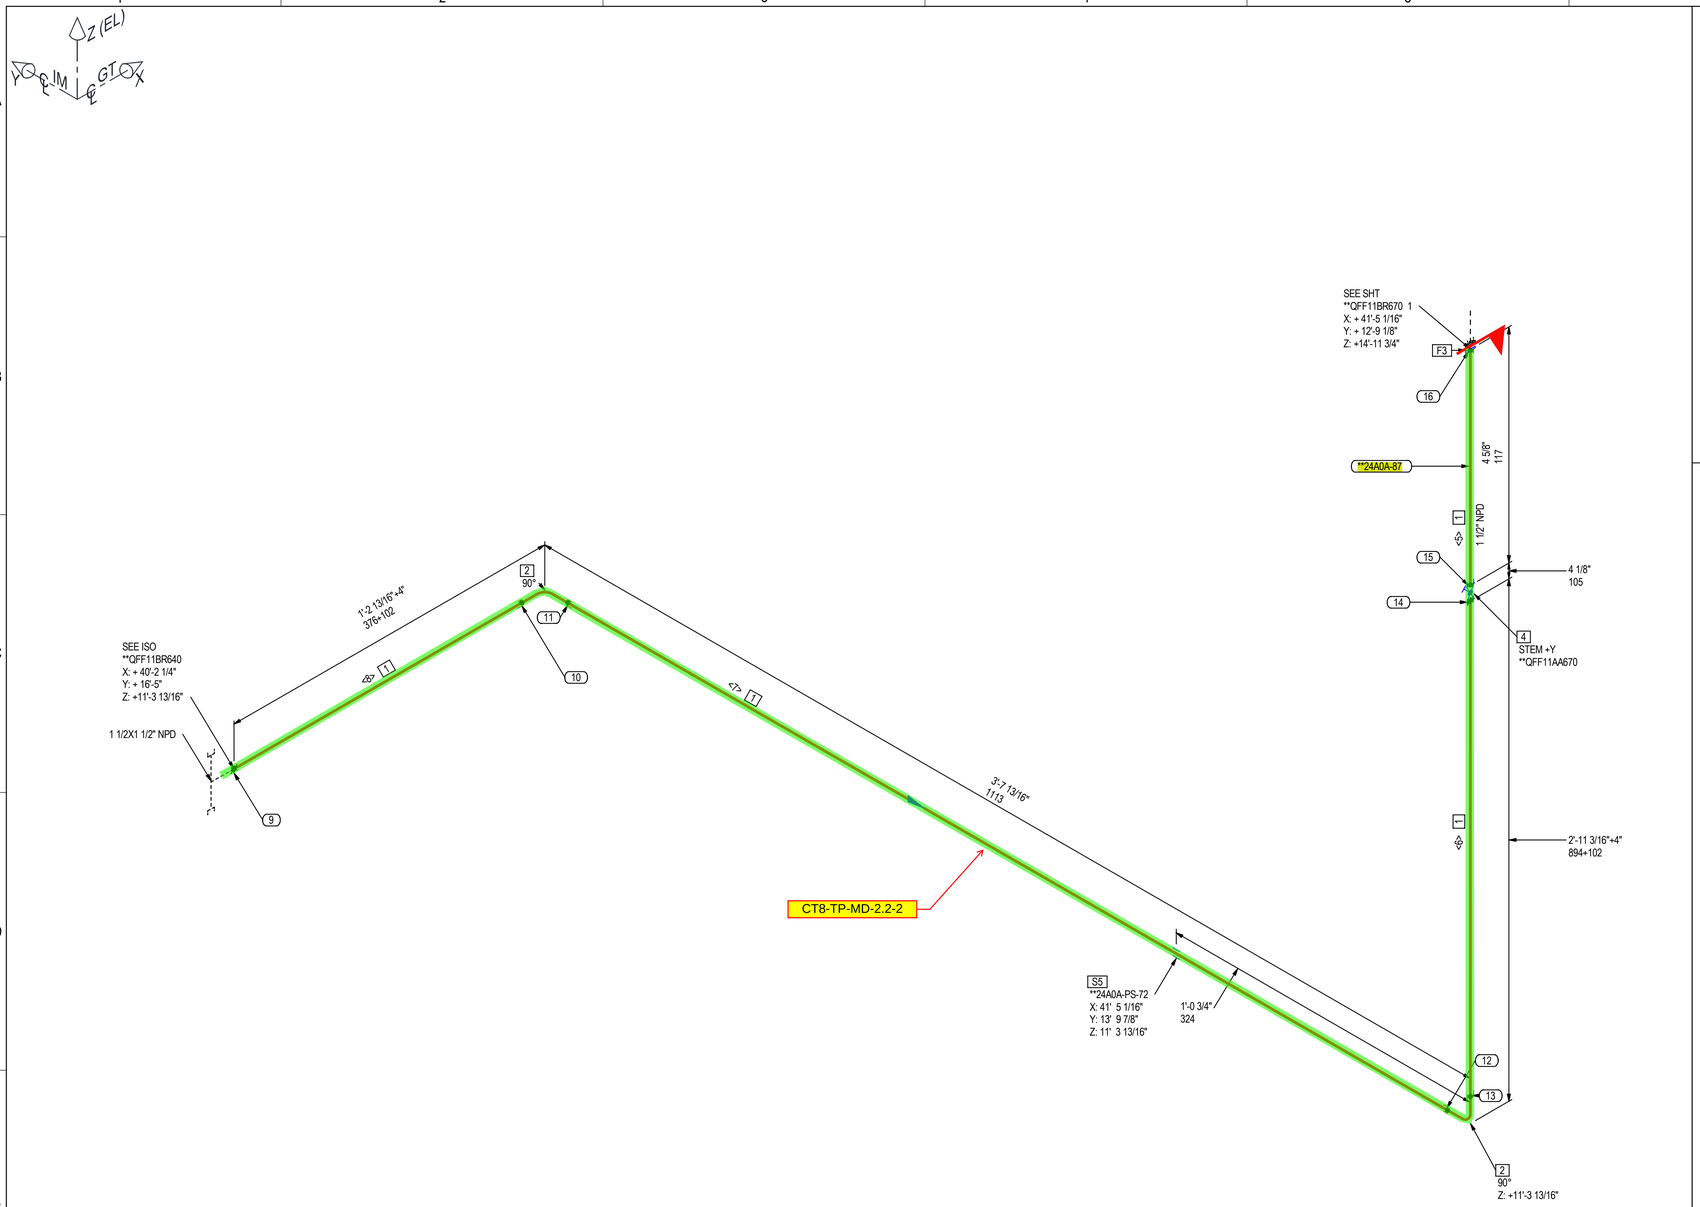

SHOP MATERIALS - FABRICATION ONLY

PT NO	DESCRIPTION	NPD (IN)	CMDTY CODE	QTY
1	PIPE, S-40S, PE, ASME B36.19M, ASTM A312-TP304, SEAMLESS	1 1/2	MPAAZZBPZZABBANI	8.5'
2	90 DEG ELBOW, CL3000, SWE, ASME B16.11, ASTM A182-F304	1 1/2	MMCKAWBVZZAAGALO	2
3	FLANGE SW, CL150, RFFE, ASME B16.5, ASTM A182-F304	1 1/2	MFABAHABZZAADALO	1

OTHER THAN SHOP MATERIALS - ERECTION ONLY

PT NO	DESCRIPTION	NPD (IN)	CMDTY CODE	QTY
4	GLOBE VALVE, CL800, SWE, ASME B16.34, ASTM A182-F316	1 1/2	MVALAQBVZZAATALS	1
	PIPE SUPPORTS			
5	PIPE SUPPORT	1 1/2	**24A0A-PS-72	1
	SPOOLS			
	**24A0A-87			

CUT PIPE LENGTH

PIECE NO	LENGTH (FT-INS)	NPD (IN)	REMARKS	END ONE	END TWO	ITEM CODE
<5>	4 5/16"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<6>	3'1 7/8"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<7>	3'5 3/16"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<8>	1'5 1/2"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI

ACTUAL QUANTITY OF WASHERS SHALL BE CONSIDERED AS HALF OF THE QUANTITY SHOWN ON ISOMETRICS

NOTES:
1. THE X AND Y COORDINATES ARE WITH RESPECT TO THE INTERSECTION OF THE CENTERLINE OF THE GAS TURBINE (GT) AND THE INLET MANIFOLD (IM). THE Z (EL) COORDINATE IS WITH RESPECT TO THE TOP OF CONCRETE, WHICH IS 15'-9" [4800 mm] BELOW THE CENTERLINE OF THE GT AND IS 0'-0".
2. ALL PIPE SUPPORT COORDINATES ARE WITH RESPECT TO THE CENTERLINE OF THE INSTALLED SUPPORTED PIPE.
3. THE MARK 'FFW' (FIELD FIT WELD) IN THE DRAWING INDICATES EXCESS LENGTH OF APPROX. 4 INCHES IDENTIFIED AS LOOSE IN THE DRAWING TO BE CUT AND ADJUSTED AT THE FIELD.
4. ALL WELDING TO BE DONE AND INSPECTED PER LATEST APPLICABLE EDITION OF ASME B31.1 AND SECTION IX AVAILABLE ON THE PROJECT AWARD DATE.
5. PIPING SHALL BE INSTALLED PER THE INDICATED SLOPE.
6. FOR ANY FURTHER INFORMATION REQUIRED DURING INSTALLATION, CONSULT MITSUBISHI POWER TFA (TECHNICAL FIELD ADVISOR) AT SITE.
7. ⟨XXX## ###⟩ INDICATES PIPING TERMINAL POINT.

ADDITIONAL NOTES:
WELDING AT PIPES MARKED WITH ✎ SHALL BE ADJUSTED AT SHOP TO FIT DURING ASSEMBLY.
THE MARK ✎ ON THE DRAWING INDICATES AN EXCESS LENGTH OF 4" (100mm) ADDED TO THE PIPE FOR ADJUSTED DURING ASSEMBLY.

WELD NO	WELD TYPE	WELD CAT	NPD	QTY
16	SW	S	1 1/2"	1
15	SW	S	1 1/2"	1
14	SW	S	1 1/2"	1
13	SW	S	1 1/2"	1
12	SW	S	1 1/2"	1
11	SW	S	1 1/2"	1
10	SW	S	1 1/2"	1
9	SW	S	1 1/2"	1

PIPING SPEC:	SAC
FLUID CODE:	IA, INSTRUMENT AIR
MAX. PRESS.:	150.00 psig / 1.03 MPag
TEST PRESS.:	225.00 psig / 1.55 MPag
MAX. TEMP:	140 F / 60 C
INSULATION SPEC:	NOT INSULATED

PAINTING SPEC: PER PROJECT SPECIFICATION
INTERIOR SURFACE TREATMENT SPEC: LU-00129

REVISION RECORD					
REV. #	DESCRIPTION	BY	CHK	APP	DATE

WELD TYPE IDENTIFIER:
BW - BUTT WELD
SW - SOCKET WELD
SOF - SLIP-ON FLANGE
SOB - SET-ON BRANCH
LET - OLET, LATROLET OR HALF COUPLING
TW - TACK WELD
MW - MITER WELD

WELD CATEGORY IDENTIFICATION:
● S - SHOP
⊗ FW - FIELD WELD
⊗ FFW - FIELD FIT WELD

SYMBOLOGY:
WELD NUMBER
PART NUMBER (PT NO)
< > CUT LIST PIECE NUMBER

SYMBOL IDENTIFIER:
F - FLANGE
G - GASKET
B - BOLT
N - NUT
W - WASHER
O - O-RING
L - LOCK WIRE


PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2025 , Mitsubishi Power Americas, Inc.

MITSUBISHI POWER

ORIGIN:	MITSUBISHI POWER-LAKE MARY	DATE:	MITSUBISHI POWER DRAWING NUMBER: / REV. NO.: / SYSTEM CODE:
PREPARED BY:	D. DURAPAU	10/22/2025	N05-003580 / 0 / 24A0A
REVIEWED BY:	D.MAZQUIARAN / N.JAMSHIDI	10/28/2025	INSTRUMENT AIR PIPING
APPROVED BY:	U. KASINATHAN	10/31/2025	INTERNAL TO GT PACKAGE
			FOR FABRICATION & ERECTION
			N05-ISO-QFF-BR-AA
			P&ID DRAWING NUMBER: N01-PID-QFF-00-02
			M501JAC GAS TURBINE
PROJECT CODE:	-	P&ID:	-
PIPELINE:		PAGE NUMBER:	
**QFF11BR670		2 OF 2	

EXPORT CONTROL DIVERSION WARNING
This document contains data which if exported from the United States must be exported in accordance with the export administration regulations, diversion contrary to U.S. law is prohibited.

ECCN: EAR99 No License Req'd
SL2
MITSUBISHI POWER ENGINEERING / PLANT ENGINEERING
DEPARTMENT: / SECTION:
DRAWING DISTRIBUTION LIST

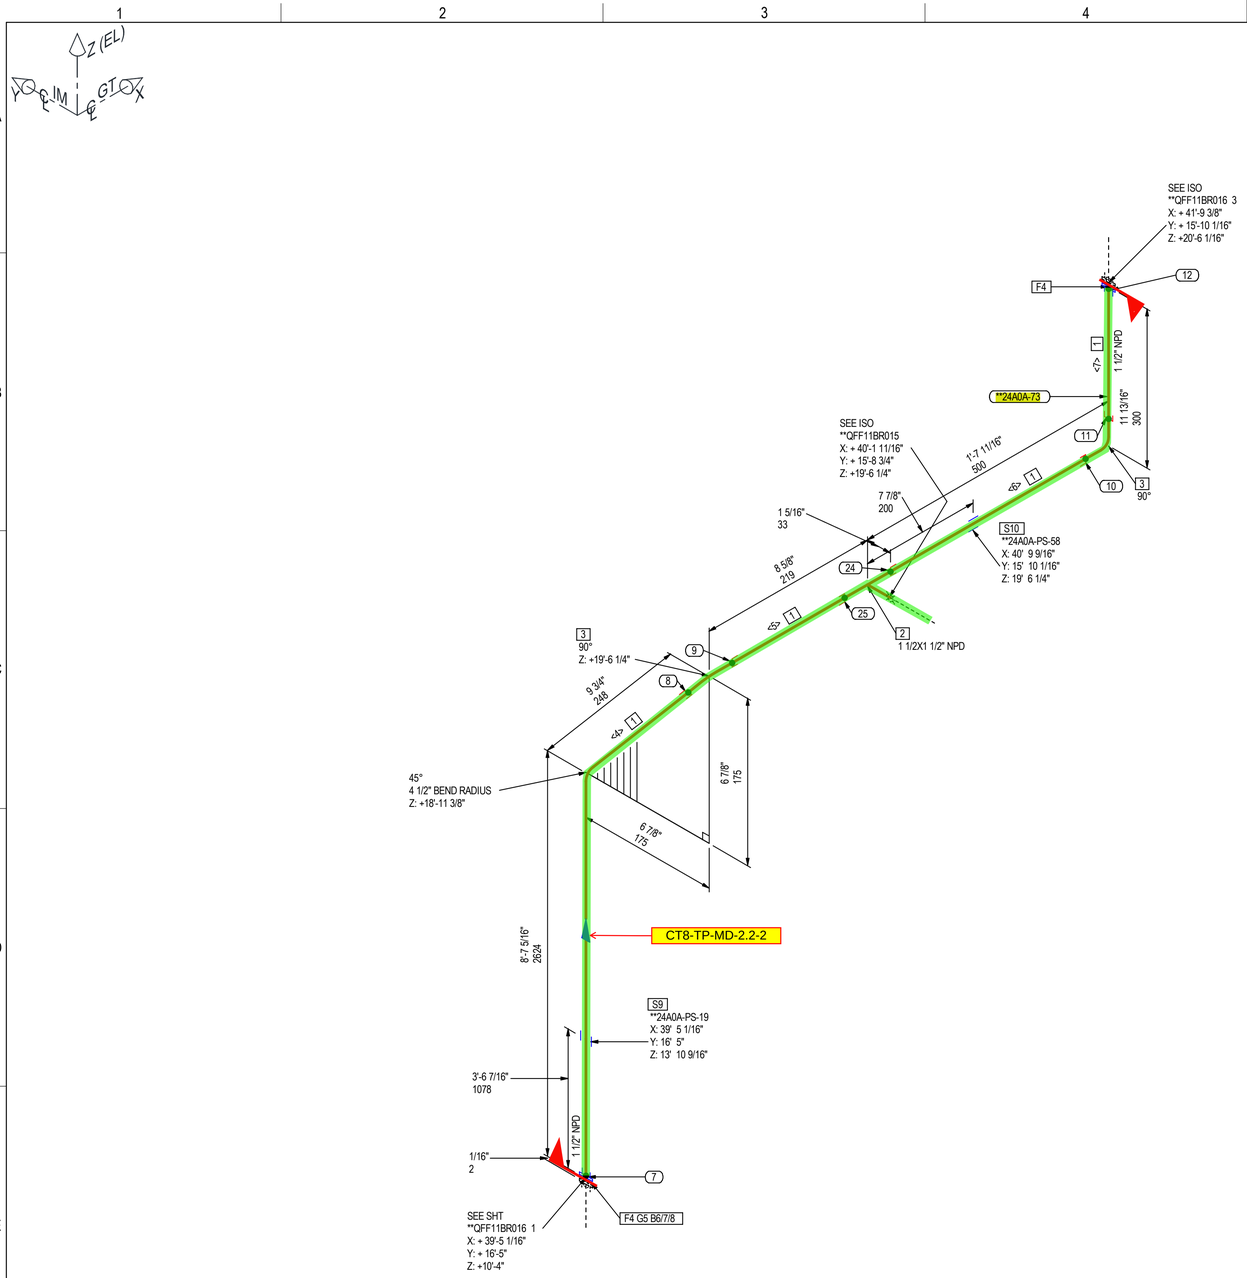

SHOP MATERIALS - FABRICATION ONLY

PT NO	DESCRIPTION	NPD (IN)	CMDTY CODE	QTY
1	PIPE, S-40S, PE, ASME B36.19M, ASTM A312-TP304, SEAMLESS	1 1/2	MPAAZZBPZZABBANI	12.1'
2	TEE, CL3000, SWE, ASME B16.11, ASTM A182-F304	1 1/2X1 1/2	MMDJAWBVZZAAGALO	1
3	90 DEG ELBOW, CL3000, SWE, ASME B16.11, ASTM A182-F304	1 1/2	MMCKAWBVZZAAGALO	2
4	FLANGE SW, CL150, RFFE, ASME B16.5, ASTM A182-F304	1 1/2	MFABAHABZZAADALO	2

OTHER THAN SHOP MATERIALS - ERECTION ONLY

PT NO	DESCRIPTION	NPD (IN)	CMDTY CODE	QTY
5	GASKET, FLAT RING, CL150, 0.0625" THK, ASME B16.21, COMPRESSED NON ASBESTOS FIBER	1 1/2	MITAHAAAALBMNUS	1
6	STUD, CONTINUOUS THREAD, ASME B18.31.2, ASTM A193-B8 CL1, 13-UNC - 3.5 in. Length	1/2	MBAZZACZZIAGBLJZ	4
7	NUT, HEAVY HEX, ASME B18.2.2, ASTM A194-8, 13-UNC	1/2	MNOZZACAAZPCJAFU	8
8	WASHER, SPECIAL SHAPED LOCK, 1.5in NPD, 0.8mm THK, MHPSA G1-90942, ASTM A240-304	1/2	MWQZZZZBUIBBAMDP	8
	PIPE SUPPORTS			
9	PIPE SUPPORT	1 1/2	**24A0A-PS-19	1
10	PIPE SUPPORT	1 1/2	**24A0A-PS-58	1
	SPOOLS			
	**24A0A-73			

CUT PIPE LENGTH

PIECE NO	LENGTH (FT-INS)	NPD (IN)	REMARKS	END ONE	END TWO	ITEM CODE
<4>	9'3 3/16"	1 1/2	PLD BEND(1)	SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<5>	6"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<6>	1'5 1/16"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<7>	10 3/16"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI

ACTUAL QUANTITY OF WASHERS SHALL BE CONSIDERED AS HALF OF THE QUANTITY SHOWN ON ISOMETRICS

NOTES:
1. THE X AND Y COORDINATES ARE WITH RESPECT TO THE INTERSECTION OF THE CENTERLINE OF THE GAS TURBINE (GT) AND THE INLET MANIFOLD (IM). THE Z (EL) COORDINATE IS WITH RESPECT TO THE TOP OF CONCRETE, WHICH IS 15'-9" [4800 mm] BELOW THE CENTERLINE OF THE GT AND IS 0'-0".
2. ALL PIPE SUPPORT COORDINATES ARE WITH RESPECT TO THE CENTERLINE OF THE INSTALLED SUPPORTED PIPE.
3. THE MARK 'FFW' (FIELD FIT WELD) IN THE DRAWING INDICATES EXCESS LENGTH OF APPROX. 4 INCHES IDENTIFIED AS LOOSE IN THE DRAWING TO BE CUT AND ADJUSTED AT THE FIELD.
4. ALL WELDING TO BE DONE AND INSPECTED PER LATEST APPLICABLE EDITION OF ASME B31.1 AND SECTION IX AVAILABLE ON THE PROJECT AWARD DATE.
5. PIPING SHALL BE INSTALLED PER THE INDICATED SLOPE.
6. FOR ANY FURTHER INFORMATION REQUIRED DURING INSTALLATION, CONSULT MITSUBISHI POWER TFA (TECHNICAL FIELD ADVISOR) AT SITE.
7. <XXX##-###> INDICATES PIPING TERMINAL POINT.

WELD NO	WELD TYPE	WELD CAT	NPD	QTY
7	SW	S	1 1/2"	1
8	SW	S	1 1/2"	1
9	SW	S	1 1/2"	1
25	SW	S	1 1/2"	1
24	SW	S	1 1/2"	1
10	SW	S	1 1/2"	1
11	SW	S	1 1/2"	1
12	SW	S	1 1/2"	1

PIPING SPEC:	SAC	PAINTING SPEC: PER PROJECT SPECIFICATION	REVISION RECORD				
FLUID CODE:	IA, INSTRUMENT AIR	INTERIOR SURFACE TREATMENT SPEC: LU-00129	REV. #	DESCRIPTION	BY	CHK	APP	DATE
MAX. PRESS.:	150.00 psig / 1.03 MPag							
TEST PRESS.:	225.00 psig / 1.55 MPag							
MAX. TEMP:	140 F / 60 C							
INSULATION SPEC:	NOT INSULATED							

WELD TYPE IDENTIFIER:
BW - BUTT WELD
SW - SOCKET WELD
SOF - SLIP-ON FLANGE
SOB - SET-ON BRANCH
LET - OLET, LATROLET OR HALF COUPLING
TW - TACK WELD
MW - MITER WELD

WELD CATEGORY IDENTIFICATION:
S - SHOP
FW - FIELD WELD
FFW - FIELD FIT WELD

SYMBOLOGY:
WELD NUMBER
PART NUMBER (PT NO)
< > CUT LIST PIECE NUMBER

SYMBOL IDENTIFIER:
F - FLANGE
G - GASKET
B - BOLT
N - NUT
W - WASHER
O - O-RING
L - LOCK WIRE

PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2025 , Mitsubishi Power Americas, Inc.

MITSUBISHI POWER

ORIGIN:	MITSUBISHI POWER-LAKE MARY	DATE:
PREPARED BY:	D. DURAPAU	10/22/2025
REVIEWED BY:	D.MAZQUIARAN / N.JAMSHIDI	10/28/2025
APPROVED BY:	U. KASINATHAN	10/31/2025


MITSUBISHI POWER DRAWING NUMBER: N05-003580 | REV. NO.: 0 | SYSTEM CODE: 24A0A


INSTRUMENT AIR PIPING
INTERNAL TO GT PACKAGE
FOR FABRICATION & ERECTION
N05-ISO-QFF-BR-AA
P&ID DRAWING NUMBER: N01-PID-QFF-00-02
M501JAC GAS TURBINE

PROJECT CODE: - P&ID: -
PIPELINE: **QFF11BR016
PAGE NUMBER: 2 OF 3

EXPORT CONTROL DIVERSION WARNING
This document contains data which if exported from the United States must be exported in accordance with the export administration regulations, diversion contrary to U.S. law is prohibited.

ECCN: EAR99 No License Req'd
SL2
MITSUBISHI POWER ENGINEERING
PLANT ENGINEERING
DEPARTMENT:
SECTION:
DRAWING DISTRIBUTION LIST



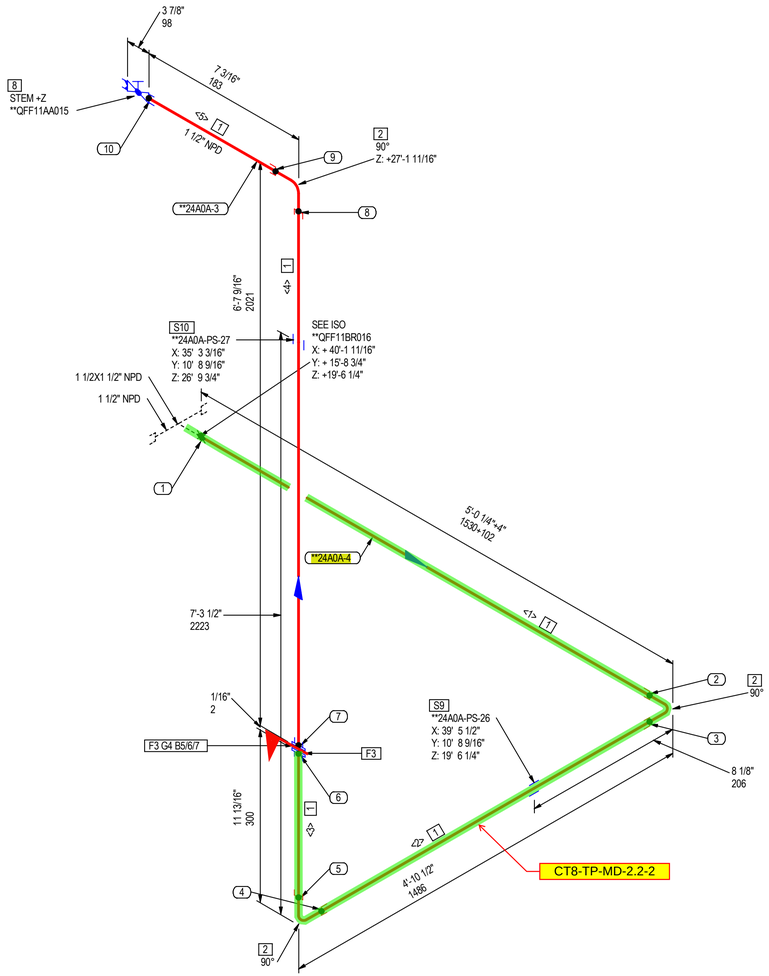

SHOP MATERIALS - FABRICATION ONLY

PT NO	DESCRIPTION	NPD (IN)	CMDTY CODE	QTY
1	PIPE, S-40S, PE, ASME B36.19M, ASTM A312-TP304, SEAMLESS	1 1/2	MPAAZZBPZZABBANI	17.8'
2	90 DEG ELBOW, CL3000, SWE, ASME B16.11, ASTM A182-F304	1 1/2	MMCKAWBVZZAAGALO	3
3	FLANGE SW, CL150, RFFE, ASME B16.5, ASTM A182-F304	1 1/2	MFABAHABZZAADALO	2

OTHER THAN SHOP MATERIALS - ERECTION ONLY

PT NO	DESCRIPTION	NPD (IN)	CMDTY CODE	QTY
4	GASKET, FLAT RING, CL150, 0.0625" THK, ASME B16.21, COMPRESSED NON ASBESTOS FIBER	1 1/2	MITAHAAAALBMNUS	1
5	STUD, CONTINUOUS THREAD, ASME B18.31.2, ASTM A193-B8 CL1, 13-UNC - 3.5 in. Length	1/2	MBAZZACZZIAGBLJZ	4
6	NUT, HEAVY HEX, ASME B18.2.2, ASTM A194-8, 13-UNC	1/2	MNOZZACAAZPCJAFU	8
7	WASHER, SPECIAL SHAPED LOCK, 1.5in NPD, 0.8mm THK, MHPSA G1-90942, ASTM A240-304	1/2	MWQZZZZBUIBBAMDP	8
8	GLOBE VALVE, CL800, SWE x FTE, ASME B16.34, ASTM A182-F316	1 1/2	MVALAQDHZZAATALS	1
	PIPE SUPPORTS			
9	PIPE SUPPORT	1 1/2	**24A0A-PS-26	1
10	PIPE SUPPORT	1 1/2	**24A0A-PS-27	1

SPOOLS

**24A0A-3, **24A0A-4

CUT PIPE LENGTH

PIECE NO	LENGTH (FT-INS)	NPD (IN)	REMARKS	END ONE	END TWO	ITEM CODE
<1>	5'2 15/16"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<2>	4'7 7/8"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<3>	10 3/16"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<4>	6'5 15/16"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI
<5>	5 7/8"	1 1/2		SQ.CUT	SQ.CUT	MPAAZZBPZZABBANI

ACTUAL QUANTITY OF WASHERS SHALL BE CONSIDERED AS HALF OF THE QUANTITY SHOWN ON ISOMETRICS

NOTES:
1. THE X AND Y COORDINATES ARE WITH RESPECT TO THE INTERSECTION OF THE CENTERLINE OF THE GAS TURBINE (GT) AND THE INLET MANIFOLD (IM). THE Z (EL) COORDINATE IS WITH RESPECT TO THE TOP OF CONCRETE, WHICH IS 15'-9" [4800 mm] BELOW THE CENTERLINE OF THE GT AND IS 0'-0".
2. ALL PIPE SUPPORT COORDINATES ARE WITH RESPECT TO THE CENTERLINE OF THE INSTALLED SUPPORTED PIPE.
3. THE MARK 'FFW' (FIELD FIT WELD) IN THE DRAWING INDICATES EXCESS LENGTH OF APPROX. 4 INCHES IDENTIFIED AS LOOSE IN THE DRAWING TO BE CUT AND ADJUSTED AT THE FIELD.
4. ALL WELDING TO BE DONE AND INSPECTED PER LATEST APPLICABLE EDITION OF ASME B31.1 AND SECTION IX AVAILABLE ON THE PROJECT AWARD DATE.
5. PIPING SHALL BE INSTALLED PER THE INDICATED SLOPE.
6. FOR ANY FURTHER INFORMATION REQUIRED DURING INSTALLATION, CONSULT MITSUBISHI POWER TFA (TECHNICAL FIELD ADVISOR) AT SITE.
7. 〈XXX## ###〉 INDICATES PIPING TERMINAL POINT.

WELD NO	WELD TYPE	WELD CAT	NPD	QTY
1	SW	S	1 1/2"	1
2	SW	S	1 1/2"	1
3	SW	S	1 1/2"	1
4	SW	S	1 1/2"	1
5	SW	S	1 1/2"	1
6	SW	S	1 1/2"	1
7	SW	S	1 1/2"	1
8	SW	S	1 1/2"	1
9	SW	S	1 1/2"	1
10	SW	S	1 1/2"	1

PIPING SPEC:	SAC	PAINTING SPEC: PER PROJECT SPECIFICATION	REVISION RECORD				
FLUID CODE:	IA, INSTRUMENT AIR	INTERIOR SURFACE TREATMENT SPEC: LU-00129	REV. #	DESCRIPTION	BY	CHK	APP	DATE
MAX. PRESS.:	150.00 psig / 1.03 MPag							
TEST PRESS.:	225.00 psig / 1.55 MPag							
MAX. TEMP:	140 F / 60 C							
INSULATION SPEC:	NOT INSULATED							

WELD TYPE IDENTIFIER:
BW - BUTT WELD
SW - SOCKET WELD
SOF - SLIP-ON FLANGE
SOB - SET-ON BRANCH
LET - OLET, LATROLET OR HALF COUPLING
TW - TACK WELD
MW - MITER WELD

WELD CATEGORY IDENTIFICATION:
S - SHOP
FW - FIELD WELD
FFW - FIELD FIT WELD

SYMBOLOGY:
WELD NUMBER
PART NUMBER (PT NO)
< > CUT LIST PIECE NUMBER

SYMBOL IDENTIFIER:
F - FLANGE
G - GASKET
B - BOLT
N - NUT
W - WASHER
O - O-RING
L - LOCK WIRE

PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2025 , Mitsubishi Power Americas, Inc.

MITSUBISHI POWER

ORIGIN:	MITSUBISHI POWER-LAKE MARY	DATE:	MITSUBISHI POWER DRAWING NUMBER:	REV. NO.:	SYSTEM CODE:
PREPARED BY:	D. DURAPAU	10/22/2025	**N05-003580**	**0**	**24A0A**
REVIEWED BY:	D.MAZQUIARAN / N.JAMSHIDI	10/28/2025	**INSTRUMENT AIR PIPING**		
APPROVED BY:	U. KASINATHAN	10/31/2025	**INTERNAL TO GT PACKAGE**		
			FOR FABRICATION & ERECTION		
			N05-ISO-QFF-BR-AA		
			P&ID DRAWING NUMBER: N01-PID-QFF-00-02		
			M501JAC GAS TURBINE		
			PROJECT CODE: -	P&ID: -	
			PIPELINE:	PAGE NUMBER:	
			**QFF11BR015	1 OF 1	

EXPORT CONTROL DIVERSION WARNING
This document contains data which if exported from the United States must be exported in accordance with the export administration regulations, diversion contrary to U.S. law is prohibited.

ECCN: EAR99 No License Req'd

SL2


MITSUBISHI POWER ENGINEERING
PLANT ENGINEERING

DEPARTMENT:
SECTION:

DRAWING DISTRIBUTION LIST

REFERENCES

MDL ITEM #	MHPSA MDL DESCRIPTION	DETAILS FOR
N/A	FUEL GAS MAIN A PIPING (21A0A)	PIPE SUPPORT DRAWINGS
N/A	FUEL GAS MAIN B PIPING (21A0B)	"
N/A	FUEL GAS TOPHAT PIPING (21A0C)	"
N/A	FUEL GAS PILOT A PIPING (21A0D)	"
N/A	FUEL GAS PILOT B PIPING (21A0E)	"
N/A	FUEL GAS PIPING (21A0H)	"
N/A	LOW PRESSURE BLEED AIR PIPING (23A0A)	"
N/A	MIDDLE PRESSURE BLEED AIR PIPING (23A0B)	"
N/A	HIGH PRESSURE BLEED AIR PIPING (23A0C)	"
N/A	EXHAUST CYLINDER SEAL AIR PIPING (23A0I)	"
N/A	AIR INLET PRESSURE INSTRUMENT PIPING (23A0K)	"
N/A	TURBINE BYPASS PIPING (23A0U)	"
N/A	4S COOLING RETURN PIPING (23A0L)	"
N/A	INSTRUMENT AIR PIPING (24A0A)	"
N/A	N2 GAS PIPING (INTERNAL) (47A0A)	"
38	GT ENCLOSURE MODULE 2-2 DETAIL DRAWINGS	STRUCTURE

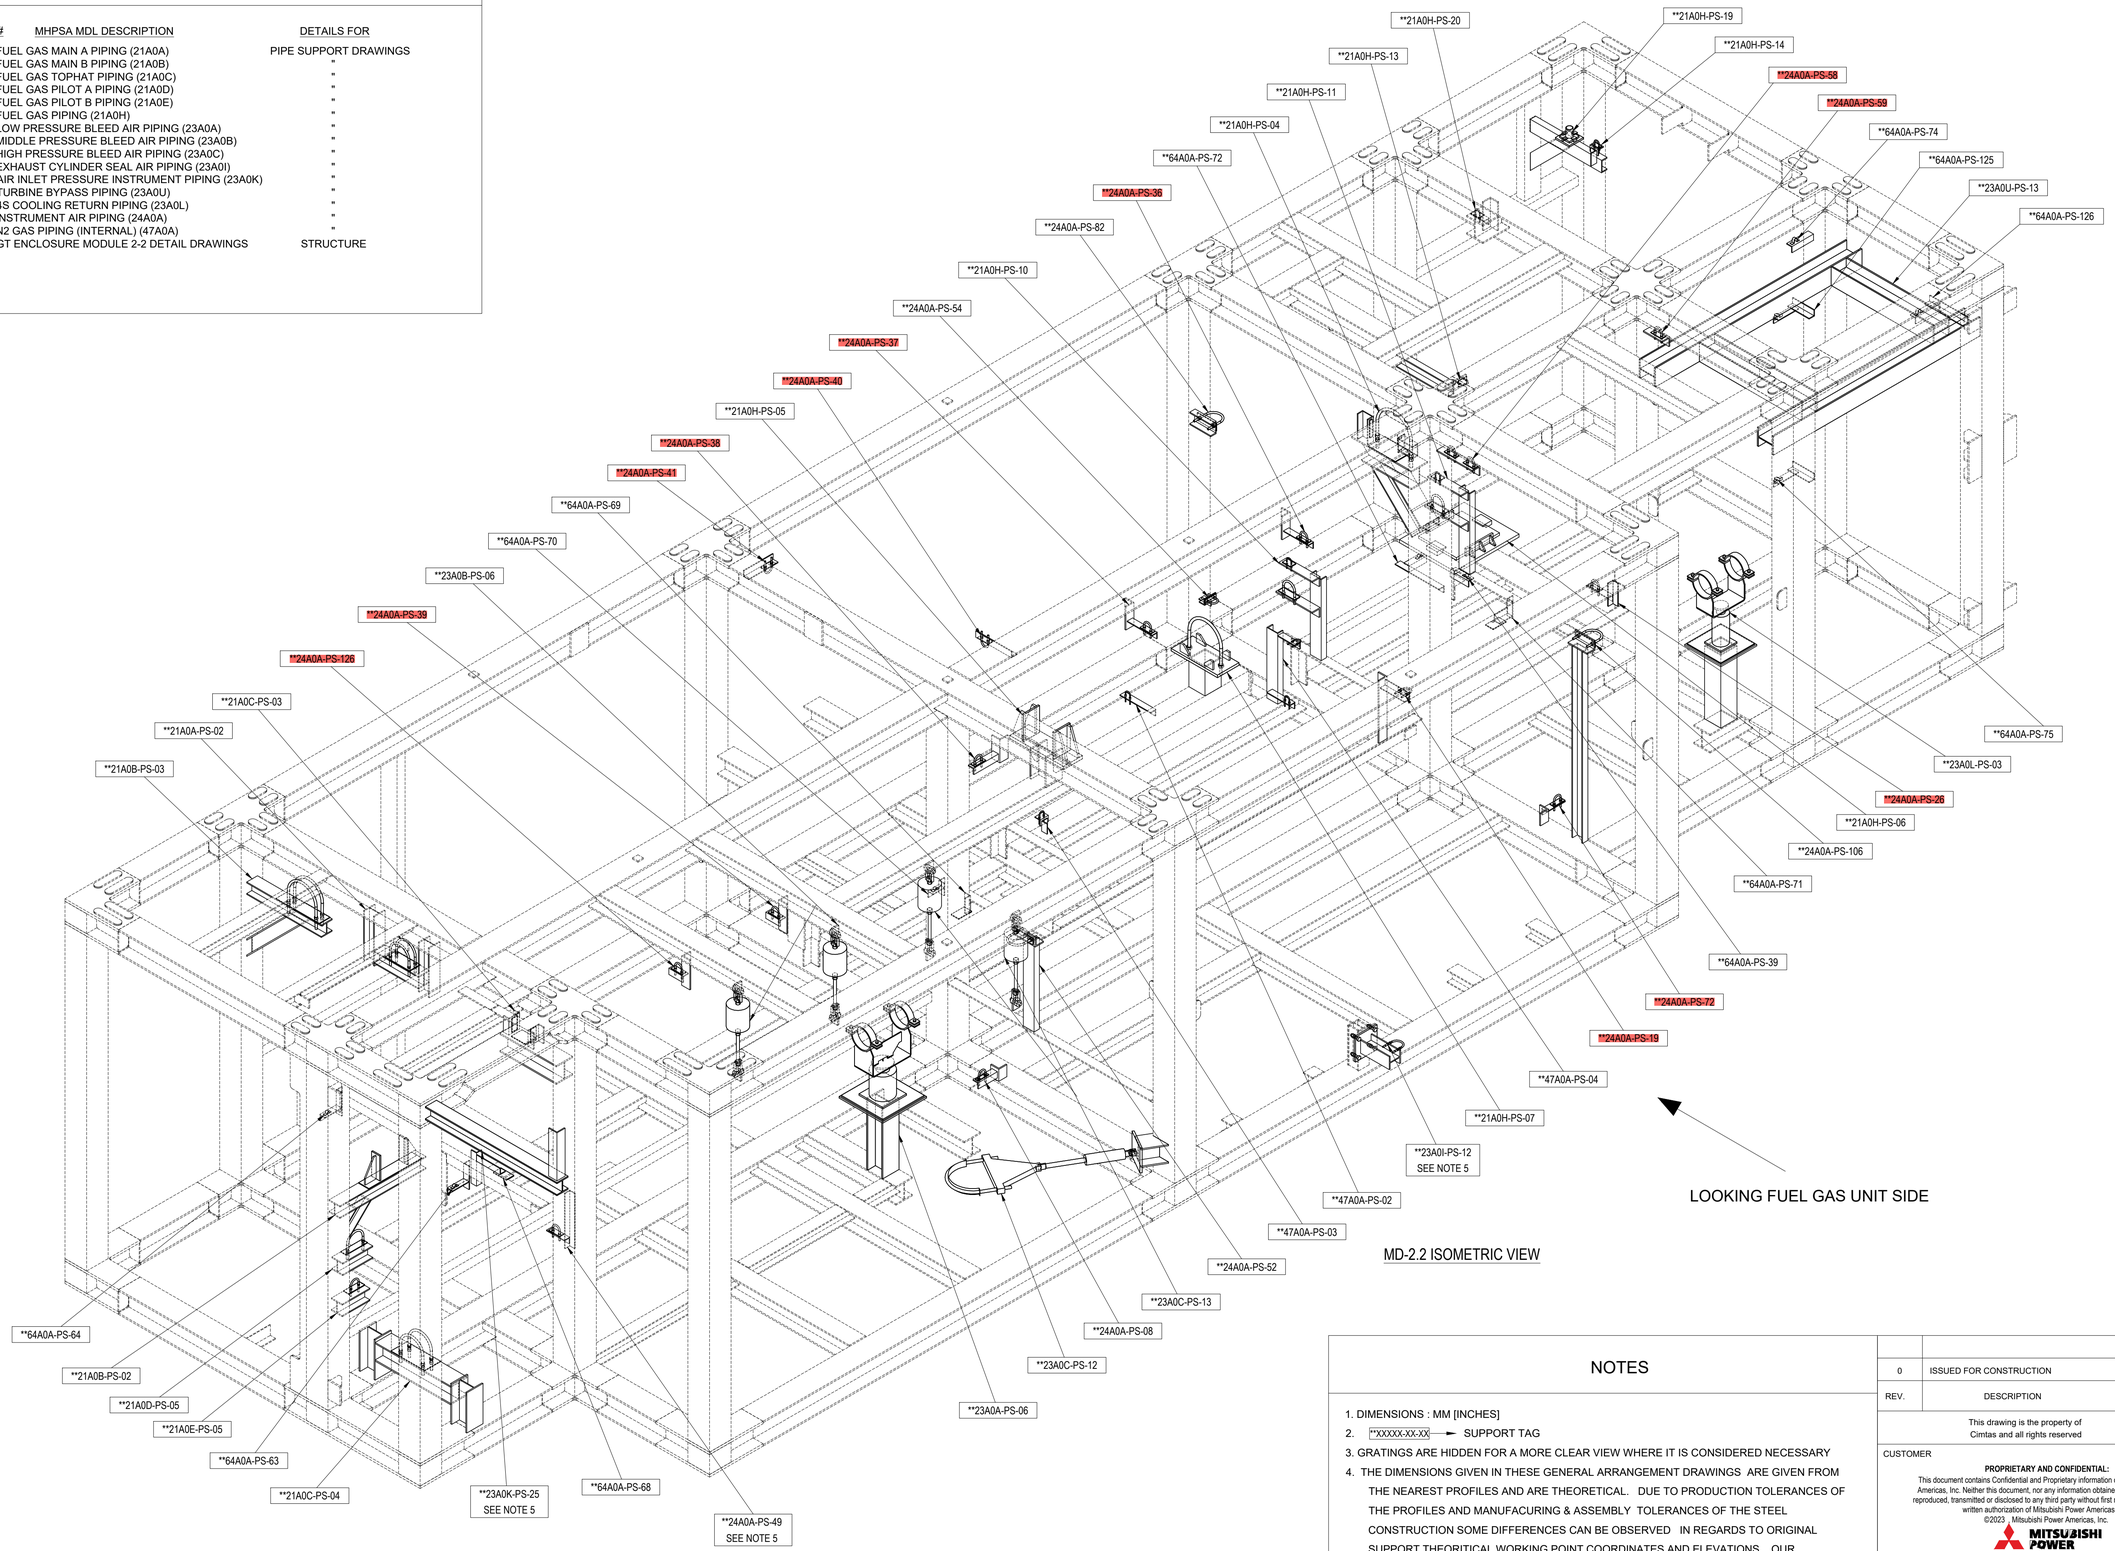

LOOKING FUEL GAS UNIT SIDE

MD-2.2 ISOMETRIC VIEW

NO	SUPPORT TAG	SPOOL NO	REMARK
1	**21A0A-PS-02	**21A0A-6	
2	**21A0B-PS-02	**21A0B-3	
3	**21A0B-PS-03	**21A0B-3	
4	**21A0C-PS-03	**21A0C-4	
5	**21A0C-PS-04	**21A0C-4	
6	**21A0D-PS-05	**21A0D-5	
7	**21A0E-PS-05	**21A0E-5	
8	**21A0H-PS-04	**21A0H-4	
9	**21A0H-PS-05	**21A0H-3	
10	**21A0H-PS-06	**21A0H-1	
11	**21A0H-PS-07	**21A0H-2	
12	**21A0H-PS-10	**21A0H-7	
		**21A0H-7	
13	**21A0H-PS-11	**21A0H-7	
		**21A0H-9	
14	**21A0H-PS-13	**21A0H-10	
15	**21A0H-PS-14	**21A0H-11	
16	**21A0H-PS-19	**21A0H-8	
17	**21A0H-PS-20	**21A0H-11	
18	**23A0A-PS-06	**23A0A-18	
19	**23A0B-PS-06	**23A0B-5	
20	**23A0C-PS-12	**23A0C-13	
21	**23A0C-PS-13	**23A0C-13	
22	**23A0I-PS-12	**23A0I-21	SEE NOTE 5
23	**23A0K-PS-25	**23A0K-20	SEE NOTE 5
		**23A0K-3	
24	**23A0L-PS-03	**23A0L-4	
25	**23A0U-PS-13	**23A0U-29	
26	**24A0A-PS-08	**24A0A-78	
27	**24A0A-PS-106	**24A0A-65	
28	**24A0A-PS-126	**24A0A-89	
29	**24A0A-PS-19	**24A0A-73	
30	**24A0A-PS-26	**24A0A-4	
31	**24A0A-PS-36	**24A0A-88	
32	**24A0A-PS-37	**24A0A-88	
33	**24A0A-PS-38	**24A0A-89	
34	**24A0A-PS-39	**24A0A-89	
35	**24A0A-PS-40	**24A0A-67	
36	**24A0A-PS-41	**24A0A-67	
37	**24A0A-PS-49	**24A0A-42	SEE NOTE 5
38	**24A0A-PS-52	**24A0A-56	
39	**24A0A-PS-54	**24A0A-71	
40	**24A0A-PS-58	**24A0A-73	
		**24A0A-74	
41	**24A0A-PS-59	**24A0A-74	
42	**24A0A-PS-72	**24A0A-87	
43	**24A0A-PS-82	**24A0A-41	
44	**47A0A-PS-02	**47A0A-2	
45	**47A0A-PS-03	**47A0A-2	
46	**47A0A-PS-04	**47A0A-3	
47	**64A0A-PS-125	FFS	
48	**64A0A-PS-126	FFS	
49	**64A0A-PS-39	FFS	
50	**64A0A-PS-63	FFS	
51	**64A0A-PS-64	FFS	
52	**64A0A-PS-68	FFS	
53	**64A0A-PS-69	FFS	
54	**64A0A-PS-70	FFS	
55	**64A0A-PS-71	FFS	
56	**64A0A-PS-72	FFS	
57	**64A0A-PS-74	FFS	
58	**64A0A-PS-75	FFS	

NOTES

1. DIMENSIONS : MM [INCHES]
2. **XXXXX-XX-XX** → SUPPORT TAG
3. GRATINGS ARE HIDDEN FOR A MORE CLEAR VIEW WHERE IT IS CONSIDERED NECESSARY
4. THE DIMENSIONS GIVEN IN THESE GENERAL ARRANGEMENT DRAWINGS ARE GIVEN FROM THE NEAREST PROFILES AND ARE THEORETICAL. DUE TO PRODUCTION TOLERANCES OF THE PROFILES AND MANUFACURING & ASSEMBLY TOLERANCES OF THE STEEL CONSTRUCTION SOME DIFFERENCES CAN BE OBSERVED IN REGARDS TO ORIGINAL SUPPORT THEORITICAL WORKING POINT COORDINATES AND ELEVATIONS. OUR SUGGESTION IS IN SUCH INCONVENIENT CASES, A CHECK SHALL BE MADE ACCORDING TO THE ELEVATION AND COORDINATES IN THE ORIGINAL SUPPORT DRAWINGS.
5. OFF MODULE SUPPORTS ARE GOING TO BE SITE MANUFACTURED AND ASSEMBLED.

REV.	DESCRIPTION	DATE	BY	CHECK	APPROVAL
0	ISSUED FOR CONSTRUCTION	26.07.2024	S.C.K.	S.S.	S.O.

This drawing is the property of Cimtas and all rights reserved

REVISIONS

CUSTOMER

PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2023 , Mitsubishi Power Americas, Inc.

MITSUBISHI POWER

CUSTOMER JOB NO: -

ITEM NO: MDL-153

DWG NAME: MD-2.2 SUPPORTS GENERAL ARRANGEMENT DRAWING

REF.DWG.NO.: -

PREPARED BY: cimtas


JOB NO	SHEET	SCALE	SIZE
2E00140	1/7	1/20	A1

DRAWING NO: 2E00140-CI-026-150

REV.: 0

REFERENCES

MDL ITEM #	MHPSA MDL DESCRIPTION	DETAILS FOR
N/A	FUEL GAS MAIN A PIPING (21A0A)	PIPE SUPPORT DRAWINGS
N/A	FUEL GAS MAIN B PIPING (21A0B)	"
N/A	FUEL GAS TOPHAT PIPING (21A0C)	"
N/A	FUEL GAS PILOT A PIPING (21A0D)	"
N/A	FUEL GAS PILOT B PIPING (21A0E)	"
N/A	FUEL GAS PIPING (21A0H)	"
N/A	LOW PRESSURE BLEED AIR PIPING (23A0A)	"
N/A	MIDDLE PRESSURE BLEED AIR PIPING (23A0B)	"
N/A	HIGH PRESSURE BLEED AIR PIPING (23A0C)	"
N/A	EXHAUST CYLINDER SEAL AIR PIPING (23A0I)	"
N/A	AIR INLET PRESSURE INSTRUMENT PIPING (23A0K)	"
N/A	TURBINE BYPASS PIPING (23A0U)	"
N/A	4S COOLING RETURN PIPING (23A0L)	"
N/A	INSTRUMENT AIR PIPING (24A0A)	"
N/A	N2 GAS PIPING (INTERNAL) (47A0A)	"
38	GT ENCLOSURE MODULE 2-2 DETAIL DRAWINGS	STRUCTURE

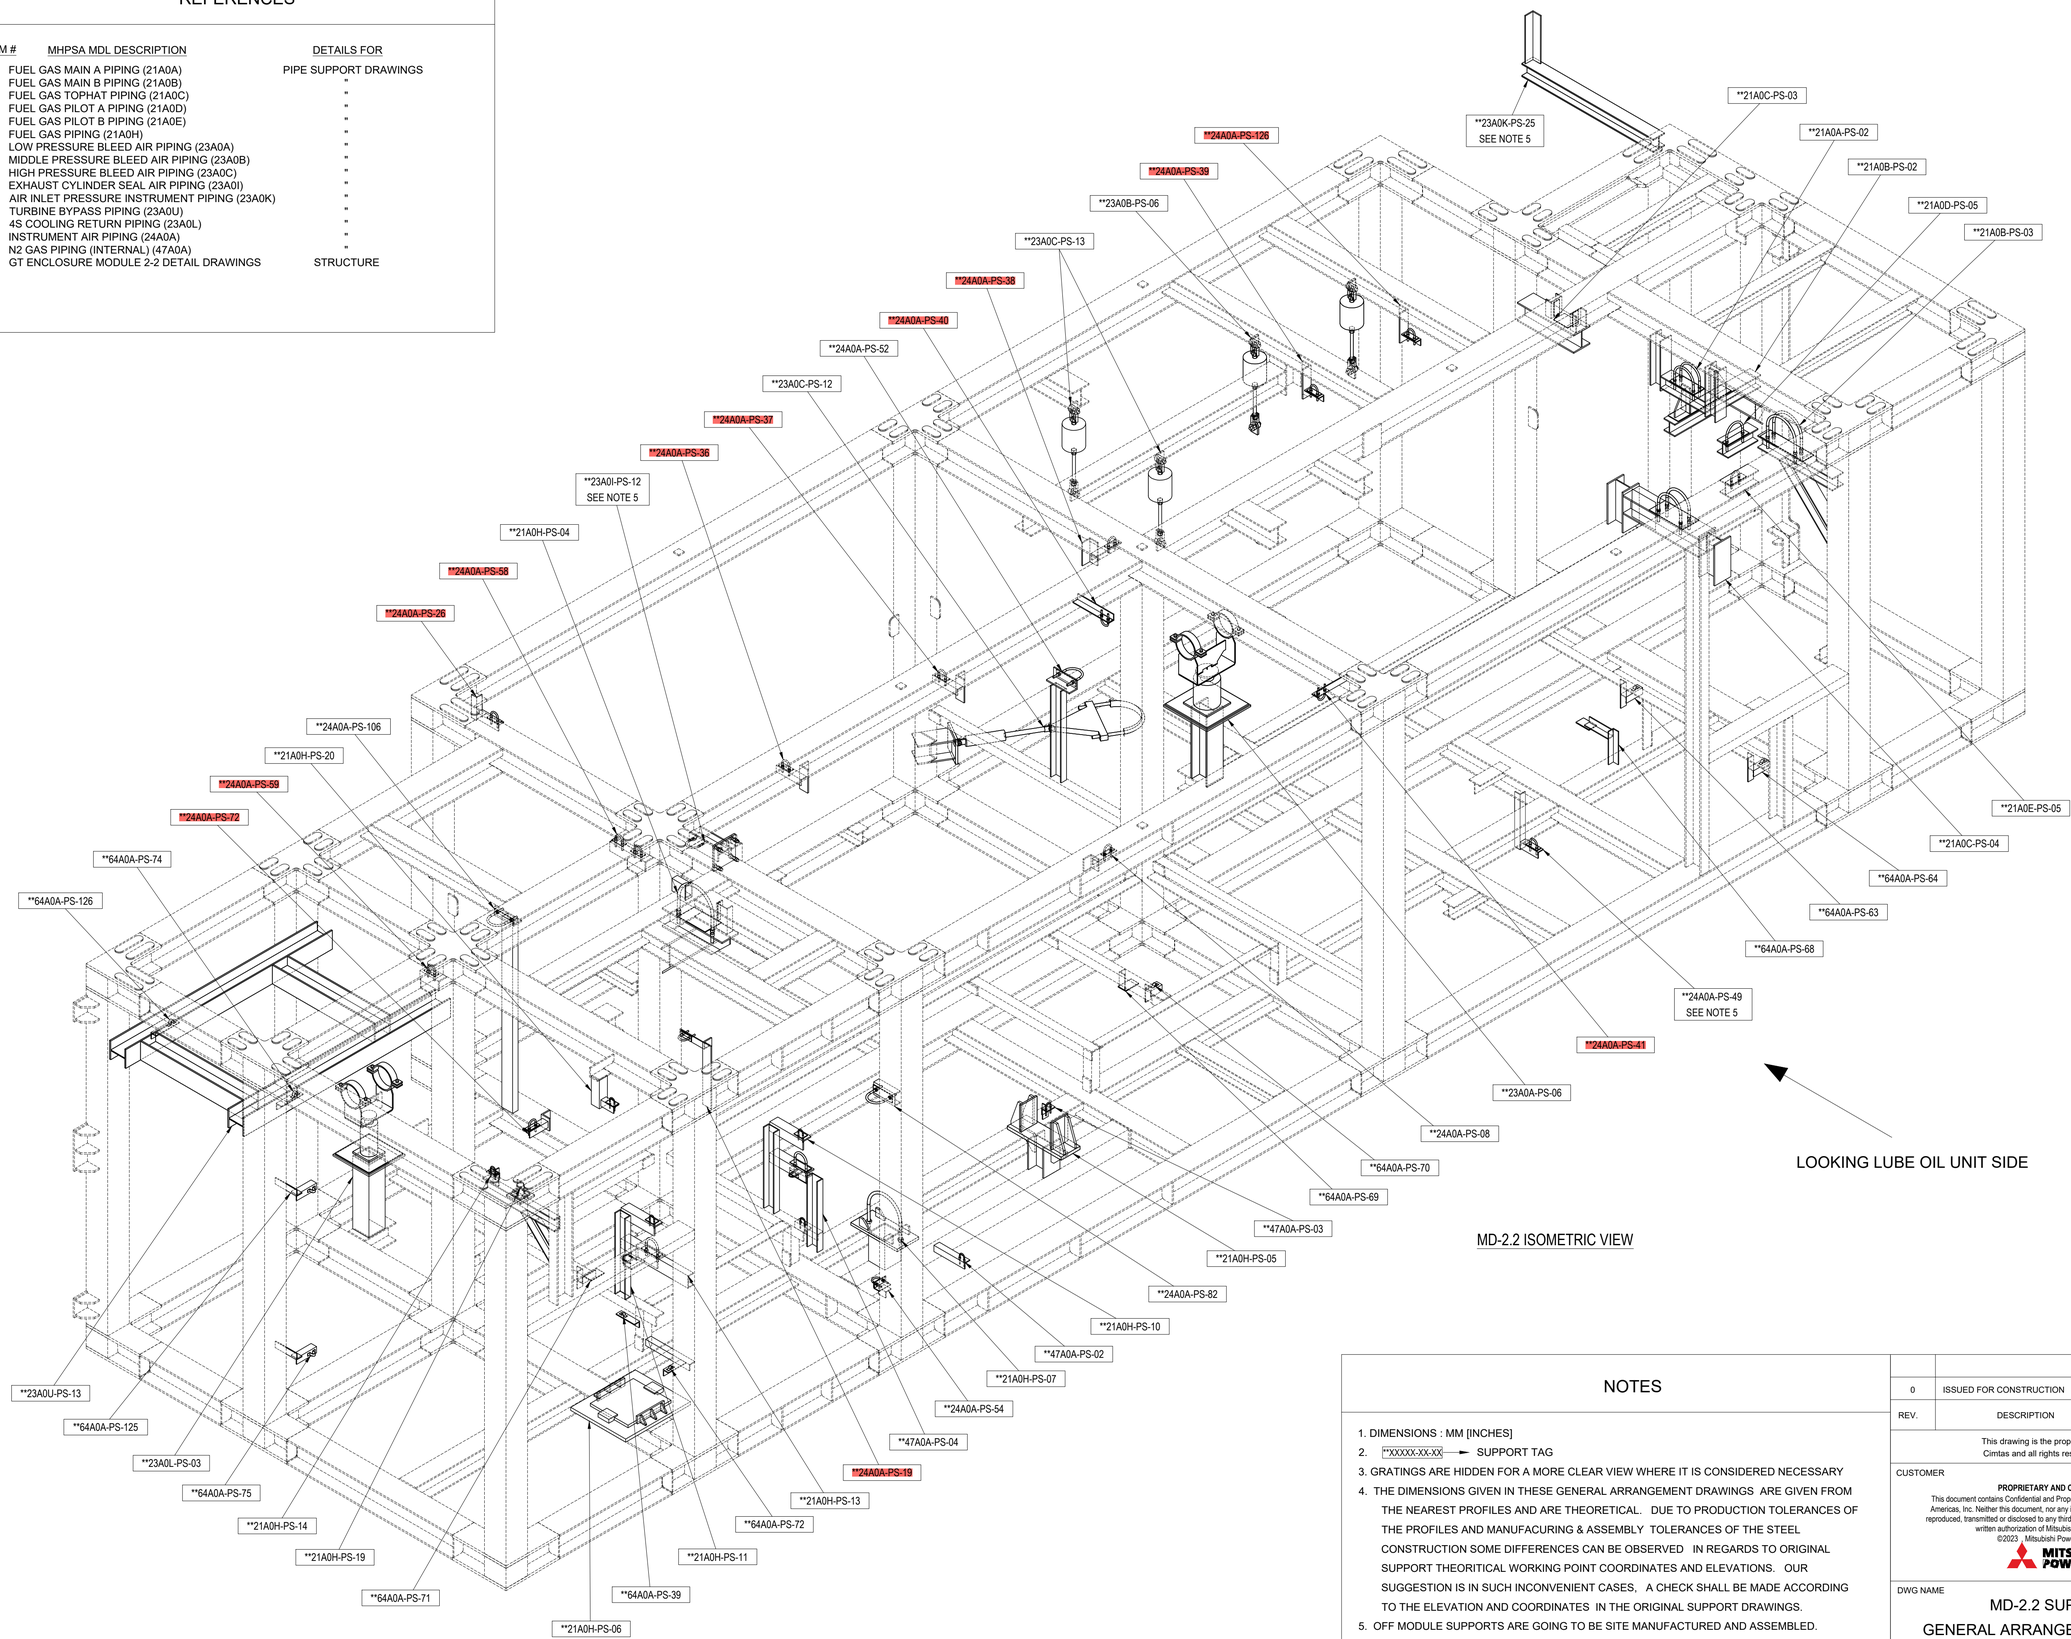

LOOKING LUBE OIL UNIT SIDE

MD-2.2 ISOMETRIC VIEW

NO	SUPPORT TAG	SPOOL NO	REMARK
1	**21A0A-PS-02	**21A0A-6	
2	**21A0B-PS-02	**21A0B-3	
3	**21A0B-PS-03	**21A0B-3	
4	**21A0C-PS-03	**21A0C-4	
5	**21A0C-PS-04	**21A0C-4	
6	**21A0D-PS-05	**21A0D-5	
7	**21A0E-PS-05	**21A0E-5	
8	**21A0H-PS-04	**21A0H-4	
9	**21A0H-PS-05	**21A0H-3	
10	**21A0H-PS-06	**21A0H-1	
11	**21A0H-PS-07	**21A0H-2	
12	**21A0H-PS-10	**21A0H-7	
		**21A0H-7	
13	**21A0H-PS-11	**21A0H-7	
		**21A0H-9	
14	**21A0H-PS-13	**21A0H-10	
15	**21A0H-PS-14	**21A0H-11	
16	**21A0H-PS-19	**21A0H-8	
17	**21A0H-PS-20	**21A0H-11	
18	**23A0A-PS-06	**23A0A-18	
19	**23A0B-PS-06	**23A0B-5	
20	**23A0C-PS-12	**23A0C-13	
21	**23A0C-PS-13	**23A0C-13	
22	**23A0I-PS-12	**23A0I-21	SEE NOTE 5
23	**23A0K-PS-25	**23A0K-20	SEE NOTE 5
		**23A0K-3	
24	**23A0L-PS-03	**23A0L-4	
25	**23A0U-PS-13	**23A0U-29	
26	**24A0A-PS-08	**24A0A-78	
27	**24A0A-PS-106	**24A0A-65	
28	**24A0A-PS-126	**24A0A-89	
29	**24A0A-PS-19	**24A0A-73	
30	**24A0A-PS-26	**24A0A-4	
31	**24A0A-PS-36	**24A0A-88	
32	**24A0A-PS-37	**24A0A-88	
33	**24A0A-PS-38	**24A0A-89	
34	**24A0A-PS-39	**24A0A-89	
35	**24A0A-PS-40	**24A0A-67	
36	**24A0A-PS-41	**24A0A-67	
37	**24A0A-PS-49	**24A0A-42	SEE NOTE 5
38	**24A0A-PS-52	**24A0A-56	
39	**24A0A-PS-54	**24A0A-71	
40	**24A0A-PS-58	**24A0A-73	
		**24A0A-74	
41	**24A0A-PS-59	**24A0A-74	
42	**24A0A-PS-72	**24A0A-87	
43	**24A0A-PS-82	**24A0A-41	
44	**47A0A-PS-02	**47A0A-2	
45	**47A0A-PS-03	**47A0A-2	
46	**47A0A-PS-04	**47A0A-3	
47	**64A0A-PS-125	FFS	
48	**64A0A-PS-126	FFS	
49	**64A0A-PS-39	FFS	
50	**64A0A-PS-63	FFS	
51	**64A0A-PS-64	FFS	
52	**64A0A-PS-68	FFS	
53	**64A0A-PS-69	FFS	
54	**64A0A-PS-70	FFS	
55	**64A0A-PS-71	FFS	
56	**64A0A-PS-72	FFS	
57	**64A0A-PS-74	FFS	
58	**64A0A-PS-75	FFS	

NOTES

1. DIMENSIONS : MM [INCHES]
2. **XXXXX-XX-XX → SUPPORT TAG
3. GRATINGS ARE HIDDEN FOR A MORE CLEAR VIEW WHERE IT IS CONSIDERED NECESSARY
4. THE DIMENSIONS GIVEN IN THESE GENERAL ARRANGEMENT DRAWINGS ARE GIVEN FROM THE NEAREST PROFILES AND ARE THEORETICAL. DUE TO PRODUCTION TOLERANCES OF THE PROFILES AND MANUFACURING & ASSEMBLY TOLERANCES OF THE STEEL CONSTRUCTION SOME DIFFERENCES CAN BE OBSERVED IN REGARDS TO ORIGINAL SUPPORT THEORITICAL WORKING POINT COORDINATES AND ELEVATIONS. OUR SUGGESTION IS IN SUCH INCONVENIENT CASES, A CHECK SHALL BE MADE ACCORDING TO THE ELEVATION AND COORDINATES IN THE ORIGINAL SUPPORT DRAWINGS.
5. OFF MODULE SUPPORTS ARE GOING TO BE SITE MANUFACTURED AND ASSEMBLED.

REV.	DESCRIPTION	DATE	BY	CHECK	APPROVAL
0	ISSUED FOR CONSTRUCTION	26.07.2024	S.C.K.	S.S.	S.O.

This drawing is the property of Cimtas and all rights reserved

REVISIONS

CUSTOMER

PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2023 Mitsubishi Power Americas, Inc.

MITSUBISHI POWER

CUSTOMER JOB NO: -

ITEM NO: MDL-153

DWG NAME: MD-2.2 SUPPORTS GENERAL ARRANGEMENT DRAWING


REF.DWG.NO.: -

PREPARED BY: cimtas

JOB NO	SHEET	SCALE	SIZE
2E00140	2/7	1/20	A1

DRAWING NO: 2E00140-CI-026-150

REV.: 0

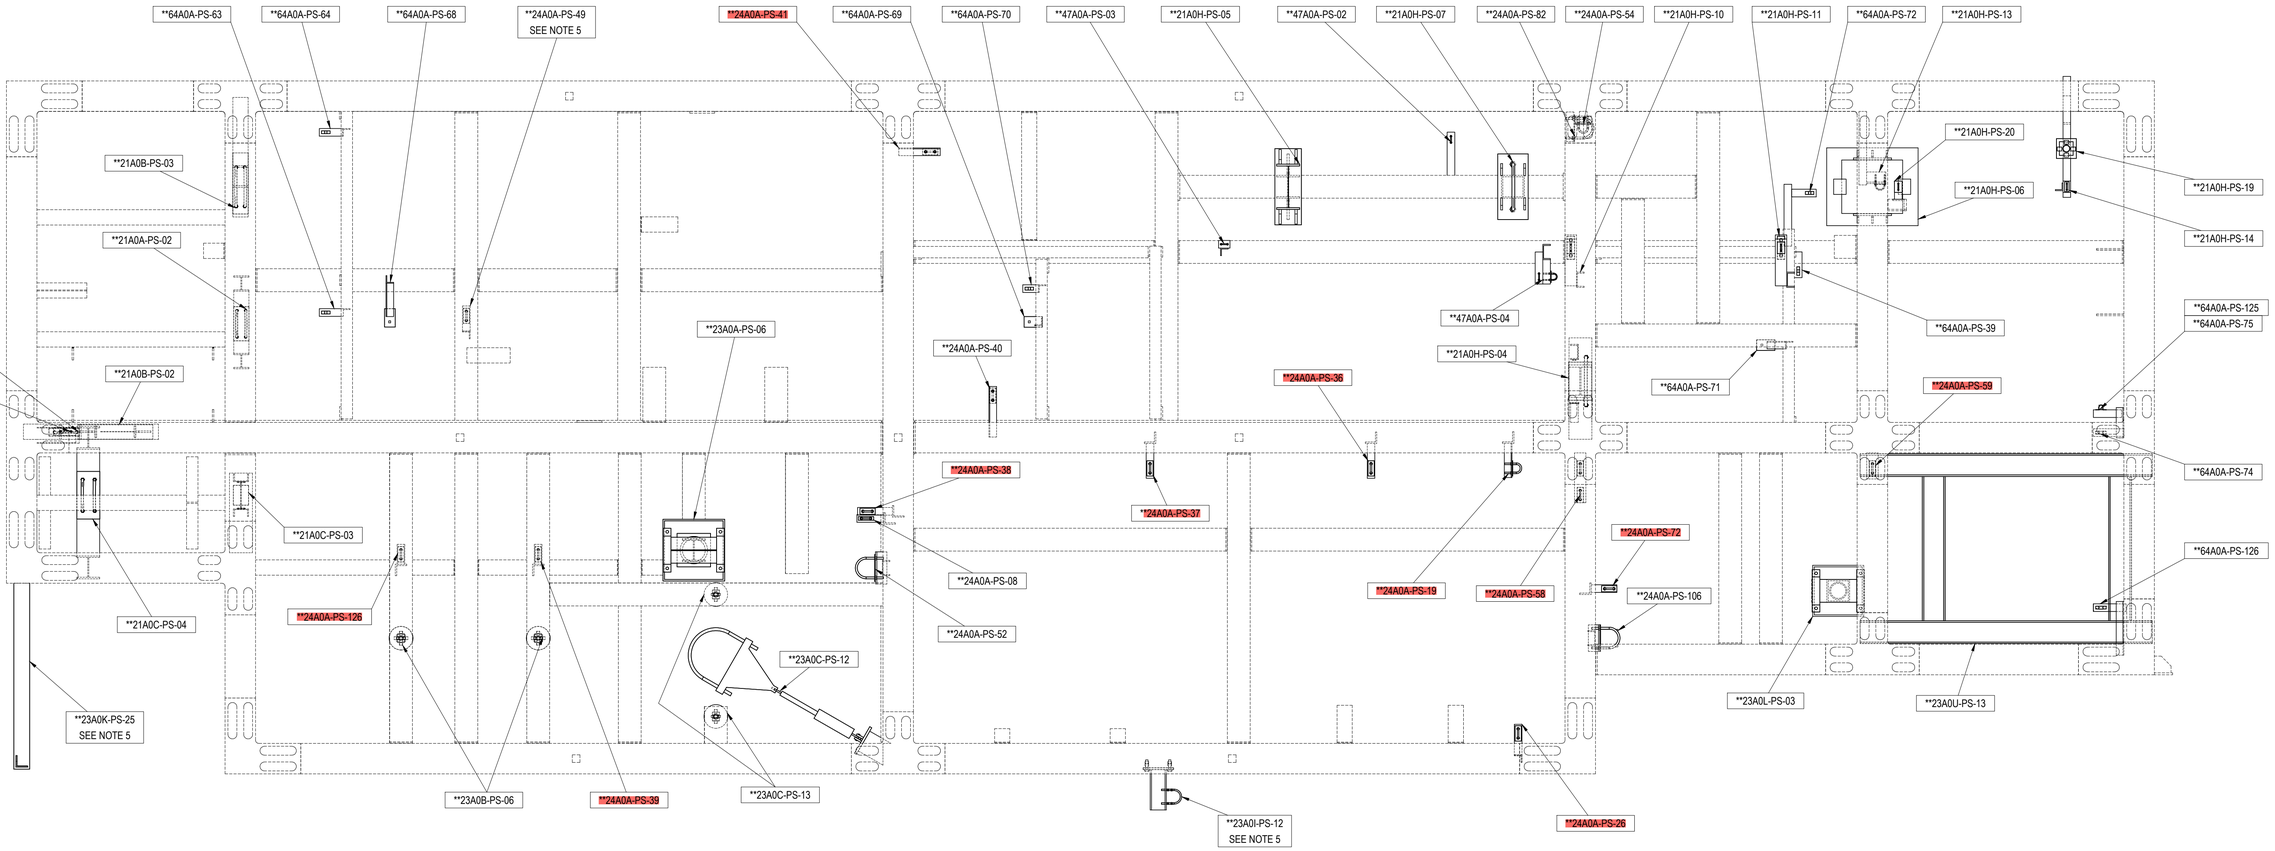

MD-2.2 PLAN VIEW

REFERENCES

MDL ITEM #	MHPSA MDL DESCRIPTION	DETAILS FOR
N/A	FUEL GAS MAIN A PIPING (21A0A)	PIPE SUPPORT DRAWINGS
N/A	FUEL GAS MAIN B PIPING (21A0B)	"
N/A	FUEL GAS TOPHAT PIPING (21A0C)	"
N/A	FUEL GAS PILOT A PIPING (21A0D)	"
N/A	FUEL GAS PILOT B PIPING (21A0E)	"
N/A	FUEL GAS PIPING (21A0H)	"
N/A	LOW PRESSURE BLEED AIR PIPING (23A0A)	"
N/A	MIDDLE PRESSURE BLEED AIR PIPING (23A0B)	"
N/A	HIGH PRESSURE BLEED AIR PIPING (23A0C)	"
N/A	EXHAUST CYLINDER SEAL AIR PIPING (23A0I)	"
N/A	AIR INLET PRESSURE INSTRUMENT PIPING (23A0K)	"
N/A	TURBINE BYPASS PIPING (23A0U)	"
N/A	4S COOLING RETURN PIPING (23A0L)	"
N/A	INSTRUMENT AIR PIPING (24A0A)	"
N/A	N2 GAS PIPING (INTERNAL) (47A0A)	"
38	GT ENCLOSURE MODULE 2-2 DETAIL DRAWINGS	STRUCTURE

NOTES

1. DIMENSIONS : MM [INCHES]
2. **XXXXX-XX-XX → SUPPORT TAG
3. GRATINGS ARE HIDDEN FOR A MORE CLEAR VIEW WHERE IT IS CONSIDERED NECESSARY
4. THE DIMENSIONS GIVEN IN THESE GENERAL ARRANGEMENT DRAWINGS ARE GIVEN FROM THE NEAREST PROFILES AND ARE THEORETICAL. DUE TO PRODUCTION TOLERANCES OF THE PROFILES AND MANUFACURING & ASSEMBLY TOLERANCES OF THE STEEL CONSTRUCTION SOME DIFFERENCES CAN BE OBSERVED IN REGARDS TO ORIGINAL SUPPORT THEORITICAL WORKING POINT COORDINATES AND ELEVATIONS. OUR SUGGESTION IS IN SUCH INCONVENIENT CASES, A CHECK SHALL BE MADE ACCORDING TO THE ELEVATION AND COORDINATES IN THE ORIGINAL SUPPORT DRAWINGS.
5. OFF MODULE SUPPORTS ARE GOING TO BE SITE MANUFACTURED AND ASSEMBLED.

REV.	DESCRIPTION	DATE	BY	CHECK	APPROVAL
0	ISSUED FOR CONSTRUCTION	26.07.2024	S.C.K.	S.S.	S.O.

This drawing is the property of Cimtas and all rights reserved

REVISIONS

CUSTOMER

PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2023 Mitsubishi Power Americas, Inc.

MITSUBISHI POWER

CUSTOMER JOB NO: -

ITEM NO: MDL-153

DWG NAME: MD-2.2 SUPPORTS GENERAL ARRANGEMENT DRAWING


REF.DWG.NO.: -

PREPARED BY: cimtas

JOB NO	SHEET	SCALE	SIZE
2E00140	3/7	1/20	A1

DRAWING NO: 2E00140-CI-026-150

REV.: 0

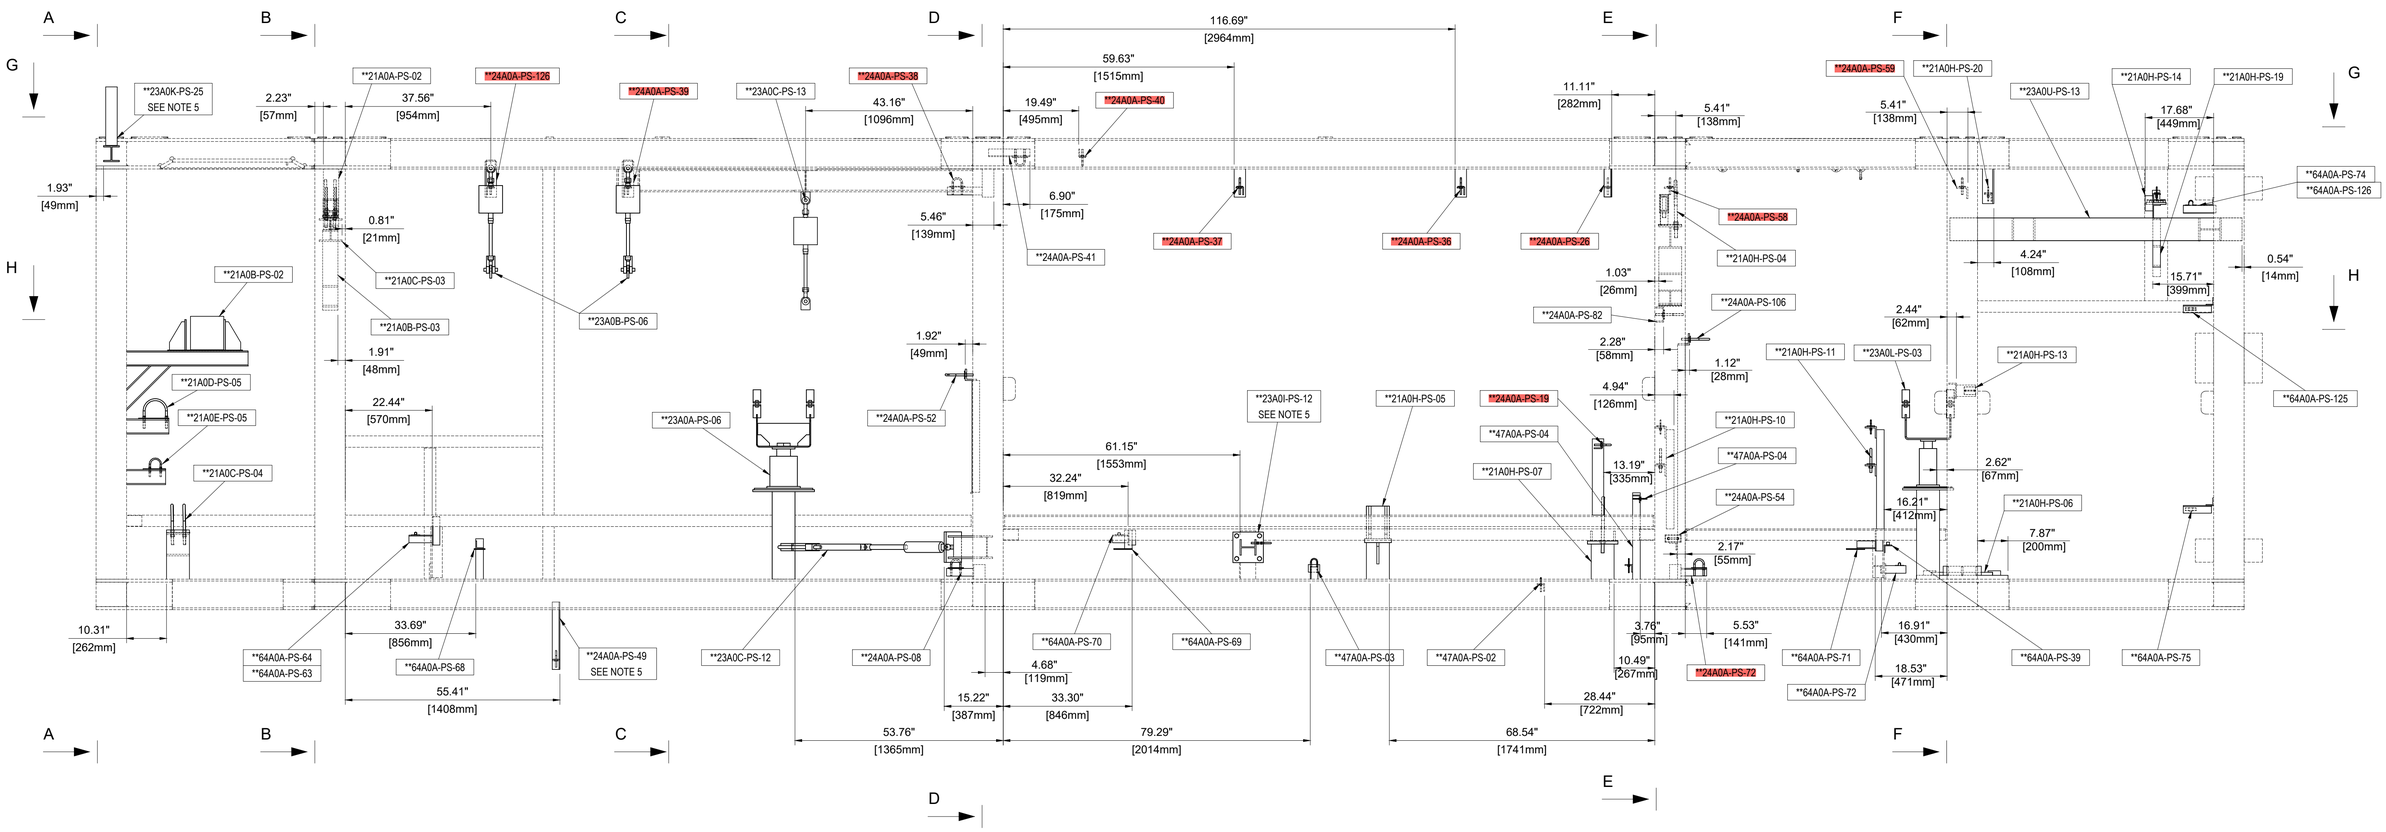

MD-2.2 LOOKING FUEL GAS UNIT SIDE

REFERENCES

MDL ITEM #	MHPSA MDL DESCRIPTION	DETAILS FOR
N/A	FUEL GAS MAIN A PIPING (21A0A)	PIPE SUPPORT DRAWINGS
N/A	FUEL GAS MAIN B PIPING (21A0B)	"
N/A	FUEL GAS TOPHAT PIPING (21A0C)	"
N/A	FUEL GAS PILOT A PIPING (21A0D)	"
N/A	FUEL GAS PILOT B PIPING (21A0E)	"
N/A	FUEL GAS PIPING (21A0H)	"
N/A	LOW PRESSURE BLEED AIR PIPING (23A0A)	"
N/A	MIDDLE PRESSURE BLEED AIR PIPING (23A0B)	"
N/A	HIGH PRESSURE BLEED AIR PIPING (23A0C)	"
N/A	EXHAUST CYLINDER SEAL AIR PIPING (23A0I)	"
N/A	AIR INLET PRESSURE INSTRUMENT PIPING (23A0K)	"
N/A	TURBINE BYPASS PIPING (23A0U)	"
N/A	4S COOLING RETURN PIPING (23A0L)	"
N/A	INSTRUMENT AIR PIPING (24A0A)	"
N/A	N2 GAS PIPING (INTERNAL) (47A0A)	"
38	GT ENCLOSURE MODULE 2-2 DETAIL DRAWINGS	STRUCTURE

NOTES

1. DIMENSIONS : MM [INCHES]
2. **XXXXX-XX-XX → SUPPORT TAG
3. GRATINGS ARE HIDDEN FOR A MORE CLEAR VIEW WHERE IT IS CONSIDERED NECESSARY
4. THE DIMENSIONS GIVEN IN THESE GENERAL ARRANGEMENT DRAWINGS ARE GIVEN FROM THE NEAREST PROFILES AND ARE THEORETICAL. DUE TO PRODUCTION TOLERANCES OF THE PROFILES AND MANUFACURING & ASSEMBLY TOLERANCES OF THE STEEL CONSTRUCTION SOME DIFFERENCES CAN BE OBSERVED IN REGARDS TO ORIGINAL SUPPORT THEORITICAL WORKING POINT COORDINATES AND ELEVATIONS. OUR SUGGESTION IS IN SUCH INCONVENIENT CASES, A CHECK SHALL BE MADE ACCORDING TO THE ELEVATION AND COORDINATES IN THE ORIGINAL SUPPORT DRAWINGS.
5. OFF MODULE SUPPORTS ARE GOING TO BE SITE MANUFACTURED AND ASSEMBLED.

REV.	DESCRIPTION	DATE	BY	CHECK	APPROVAL
0	ISSUED FOR CONSTRUCTION	26.07.2024	S.C.K.	S.S.	S.O.

This drawing is the property of Cimtas and all rights reserved

REVISIONS

CUSTOMER

PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2023 , Mitsubishi Power Americas, Inc.

MITSUBISHI POWER

CUSTOMER JOB NO: -

ITEM NO: MDL-153

DWG NAME: MD-2.2 SUPPORTS GENERAL ARRANGEMENT DRAWING


REF.DWG.NO.: -

PREPARED BY: cimtas


JOB NO	SHEET	SCALE	SIZE
2E00140	4/7	1/20	A1

DRAWING NO: 2E00140-CI-026-150


REV.: 0

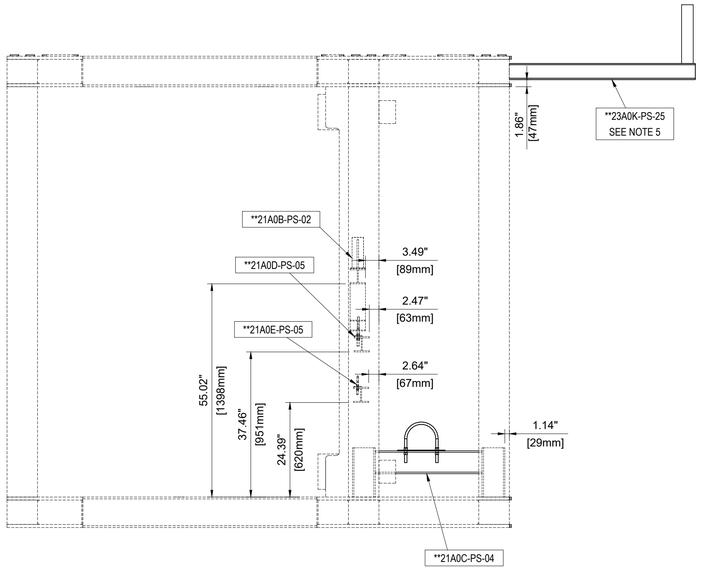


MD-2.2 SECTION A-A

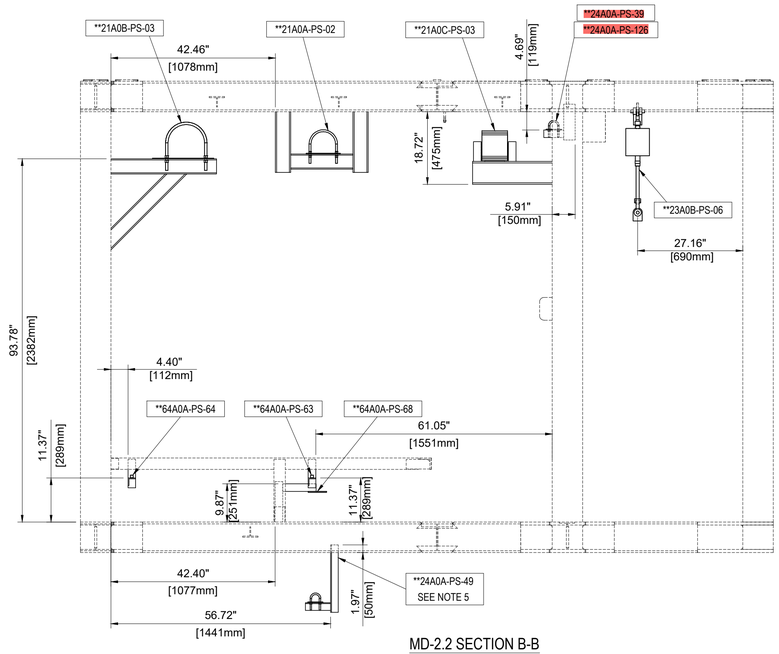


MD-2.2 SECTION B-B

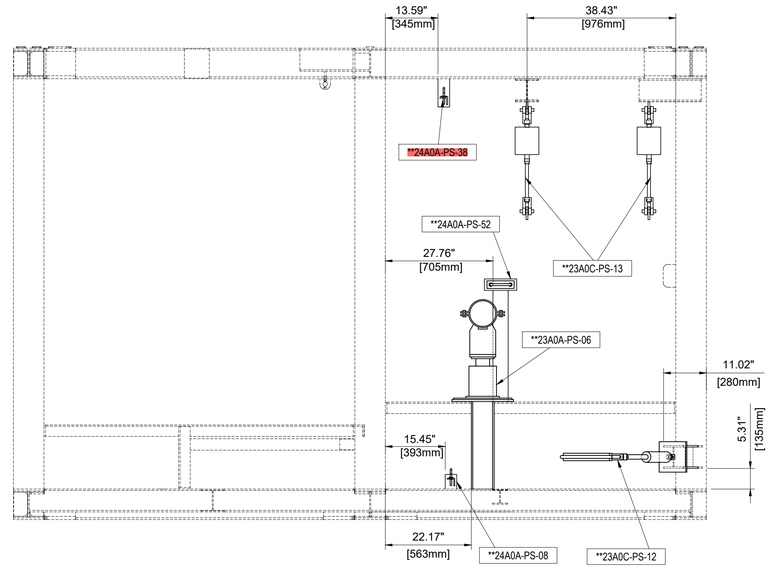


MD-2.2 SECTION C-C

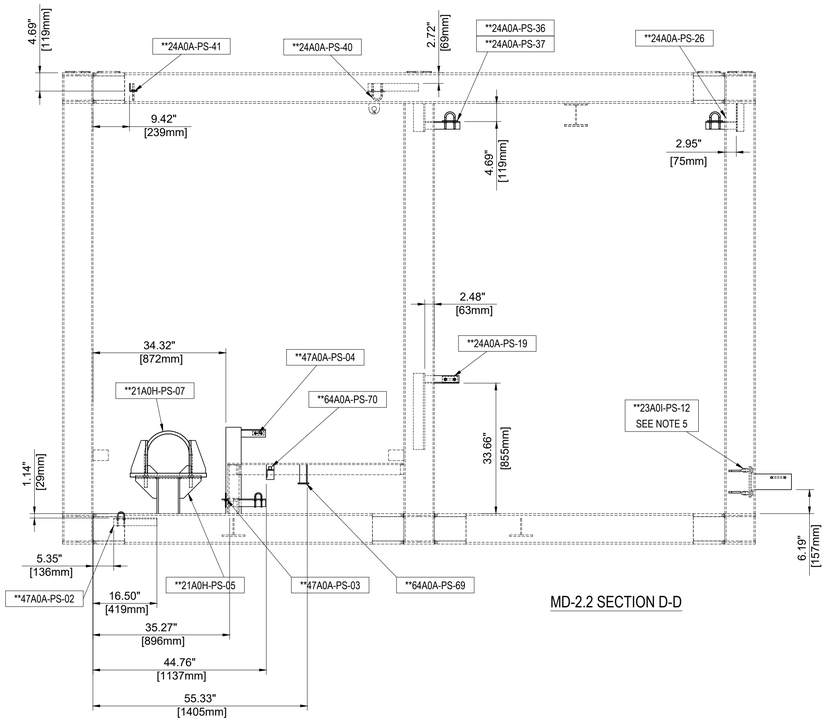

MD-2.2 SECTION D-D

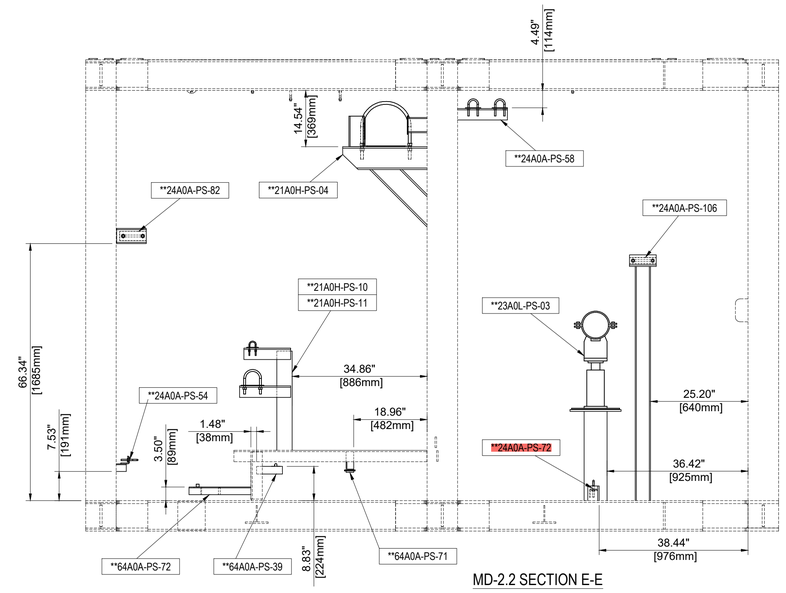

MD-2.2 SECTION E-E

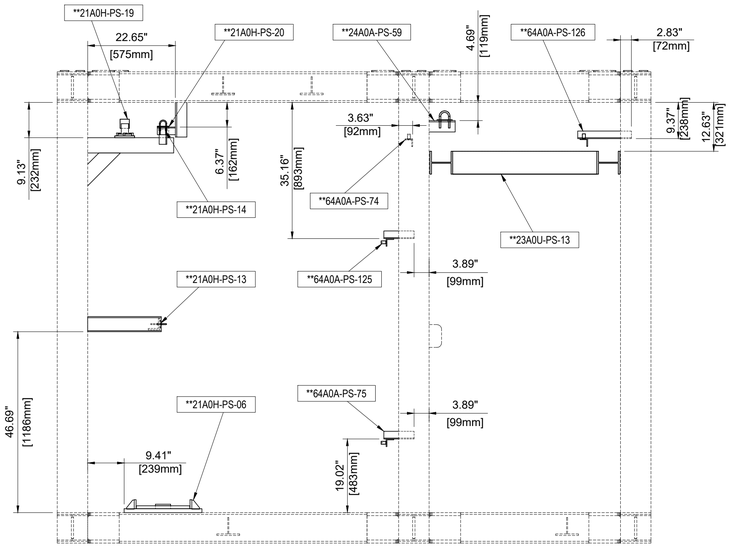

MD-2.2 SECTION F-F

REFERENCES

MDL ITEM #	MHPSA MDL DESCRIPTION	DETAILS FOR
N/A	FUEL GAS MAIN A PIPING (21A0A)	PIPE SUPPORT DRAWINGS
N/A	FUEL GAS MAIN B PIPING (21A0B)	"
N/A	FUEL GAS TOPHAT PIPING (21A0C)	"
N/A	FUEL GAS PILOT A PIPING (21A0D)	"
N/A	FUEL GAS PILOT B PIPING (21A0E)	"
N/A	FUEL GAS PIPING (21A0H)	"
N/A	LOW PRESSURE BLEED AIR PIPING (23A0A)	"
N/A	MIDDLE PRESSURE BLEED AIR PIPING (23A0B)	"
N/A	HIGH PRESSURE BLEED AIR PIPING (23A0C)	"
N/A	EXHAUST CYLINDER SEAL AIR PIPING (23A0I)	"
N/A	AIR INLET PRESSURE INSTRUMENT PIPING (23A0K)	"
N/A	TURBINE BYPASS PIPING (23A0U)	"
N/A	4S COOLING RETURN PIPING (23A0L)	"
N/A	INSTRUMENT AIR PIPING (24A0A)	"
N/A	N2 GAS PIPING (INTERNAL) (47A0A)	"
38	GT ENCLOSURE MODULE 2-2 DETAIL DRAWINGS	STRUCTURE

NOTES

1. DIMENSIONS : MM [INCHES]
2. **XXXXX-XX-XX → SUPPORT TAG
3. GRATINGS ARE HIDDEN FOR A MORE CLEAR VIEW WHERE IT IS CONSIDERED NECESSARY
4. THE DIMENSIONS GIVEN IN THESE GENERAL ARRANGEMENT DRAWINGS ARE GIVEN FROM THE NEAREST PROFILES AND ARE THEORETICAL. DUE TO PRODUCTION TOLERANCES OF THE PROFILES AND MANUFACURING & ASSEMBLY TOLERANCES OF THE STEEL CONSTRUCTION SOME DIFFERENCES CAN BE OBSERVED IN REGARDS TO ORIGINAL SUPPORT THEORITICAL WORKING POINT COORDINATES AND ELEVATIONS. OUR SUGGESTION IS IN SUCH INCONVENIENT CASES, A CHECK SHALL BE MADE ACCORDING TO THE ELEVATION AND COORDINATES IN THE ORIGINAL SUPPORT DRAWINGS.
5. OFF MODULE SUPPORTS ARE GOING TO BE SITE MANUFACTURED AND ASSEMBLED.

REV.	DESCRIPTION	DATE	BY	CHECK	APPROVAL
0	ISSUED FOR CONSTRUCTION	26.07.2024	S.C.K.	S.S.	S.O.

This drawing is the property of Cimtas and all rights reserved

REVISIONS

CUSTOMER

PROPRIETARY AND CONFIDENTIAL:

This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2023 . Mitsubishi Power Americas, Inc.

MITSUBISHI POWER

CUSTOMER JOB NO: -

ITEM NO: MDL-153

DWG NAME: MD-2.2 SUPPORTS GENERAL ARRANGEMENT DRAWING


REF.DWG.NO.: -

PREPARED BY: cimtas

JOB NO	SHEET	SCALE	SIZE
2E00140	5/7	1/20	A1

DRAWING NO: 2E00140-CI-026-150

REV.: 0

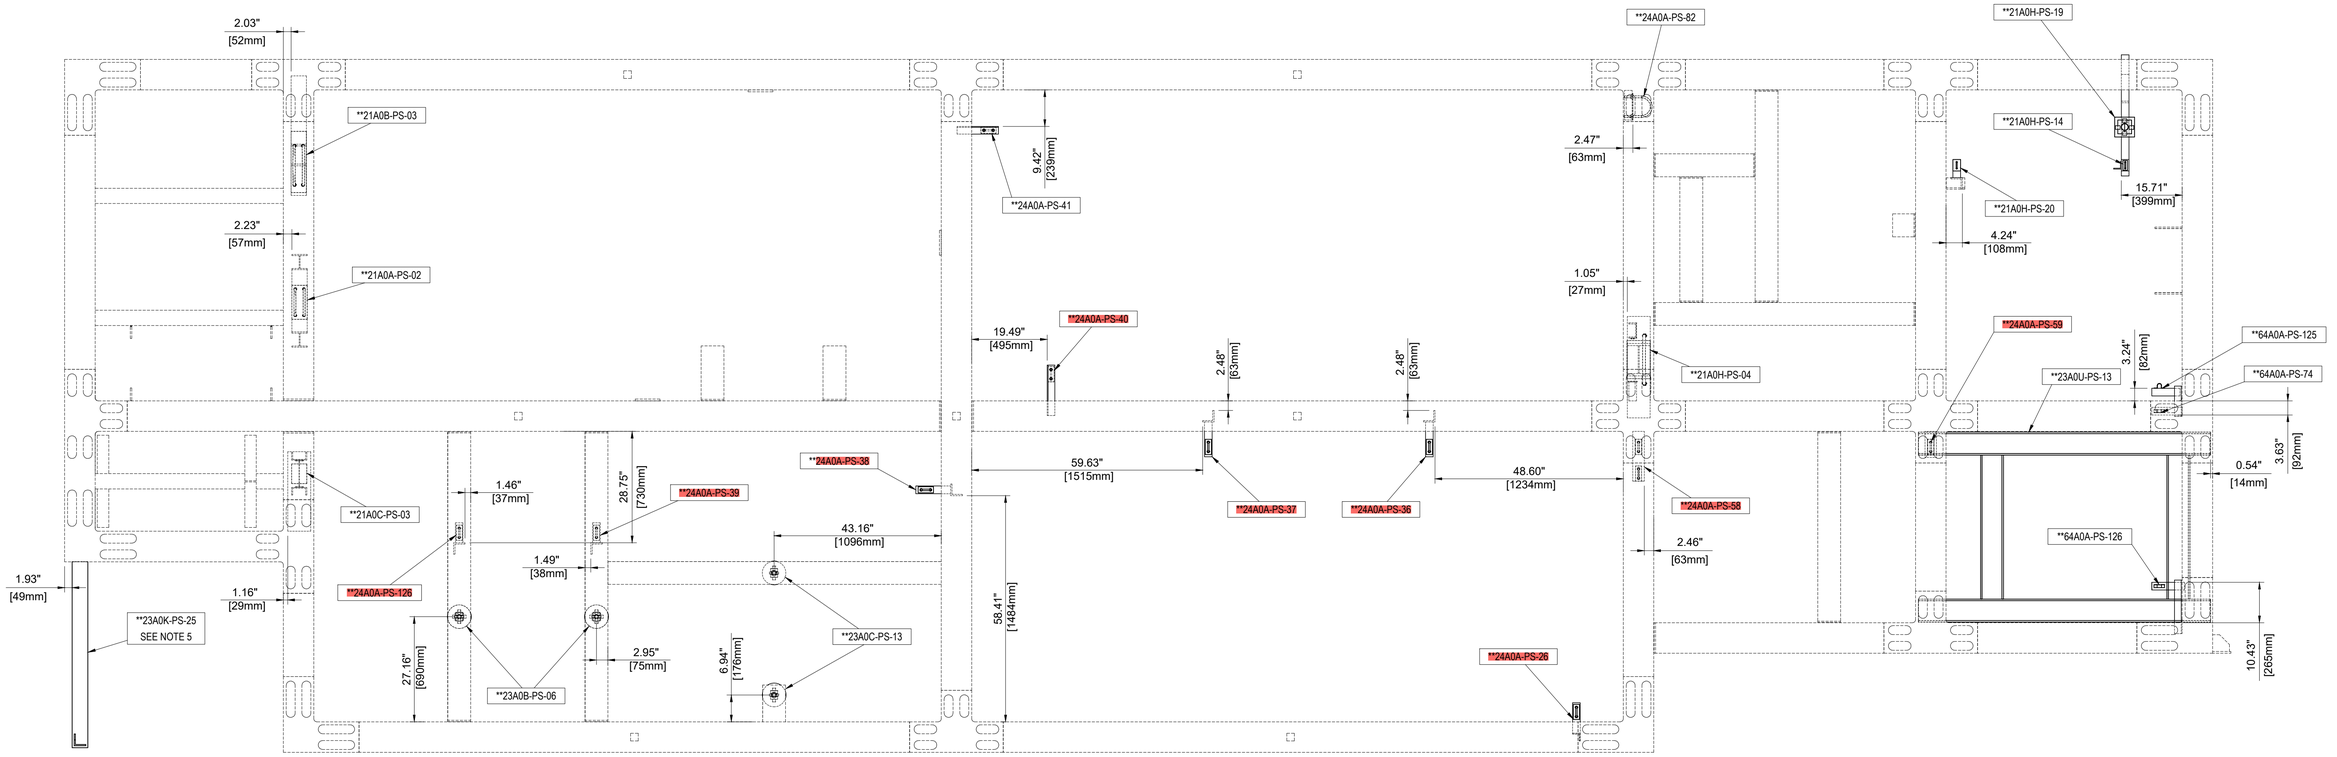

MD-2.2 SECTION G-G

REFERENCES

MDL ITEM #	MHPSA MDL DESCRIPTION	DETAILS FOR
N/A	FUEL GAS MAIN A PIPING (21A0A)	PIPE SUPPORT DRAWINGS
N/A	FUEL GAS MAIN B PIPING (21A0B)	"
N/A	FUEL GAS TOPHAT PIPING (21A0C)	"
N/A	FUEL GAS PILOT A PIPING (21A0D)	"
N/A	FUEL GAS PILOT B PIPING (21A0E)	"
N/A	FUEL GAS PIPING (21A0H)	"
N/A	LOW PRESSURE BLEED AIR PIPING (23A0A)	"
N/A	MIDDLE PRESSURE BLEED AIR PIPING (23A0B)	"
N/A	HIGH PRESSURE BLEED AIR PIPING (23A0C)	"
N/A	EXHAUST CYLINDER SEAL AIR PIPING (23A0I)	"
N/A	AIR INLET PRESSURE INSTRUMENT PIPING (23A0K)	"
N/A	TURBINE BYPASS PIPING (23A0U)	"
N/A	4S COOLING RETURN PIPING (23A0L)	"
N/A	INSTRUMENT AIR PIPING (24A0A)	"
N/A	N2 GAS PIPING (INTERNAL) (47A0A)	"
38	GT ENCLOSURE MODULE 2-2 DETAIL DRAWINGS	STRUCTURE

NOTES

1. DIMENSIONS : MM [INCHES]
2. **XXXX-XX-XX → SUPPORT TAG
3. GRATINGS ARE HIDDEN FOR A MORE CLEAR VIEW WHERE IT IS CONSIDERED NECESSARY
4. THE DIMENSIONS GIVEN IN THESE GENERAL ARRANGEMENT DRAWINGS ARE GIVEN FROM THE NEAREST PROFILES AND ARE THEORETICAL. DUE TO PRODUCTION TOLERANCES OF THE PROFILES AND MANUFACURING & ASSEMBLY TOLERANCES OF THE STEEL CONSTRUCTION SOME DIFFERENCES CAN BE OBSERVED IN REGARDS TO ORIGINAL SUPPORT THEORITICAL WORKING POINT COORDINATES AND ELEVATIONS. OUR SUGGESTION IS IN SUCH INCONVENIENT CASES, A CHECK SHALL BE MADE ACCORDING TO THE ELEVATION AND COORDINATES IN THE ORIGINAL SUPPORT DRAWINGS.
5. OFF MODULE SUPPORTS ARE GOING TO BE SITE MANUFACTURED AND ASSEMBLED.

REV.	DESCRIPTION	DATE	BY	CHECK	APPROVAL
0	ISSUED FOR CONSTRUCTION	26.07.2024	S.C.K.	S.S.	S.O.

This drawing is the property of Cimtas and all rights reserved

REVISIONS

CUSTOMER

PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2023 . Mitsubishi Power Americas, Inc.

MITSUBISHI POWER

CUSTOMER JOB NO: -

ITEM NO: MDL-153

DWG NAME: MD-2.2 SUPPORTS GENERAL ARRANGEMENT DRAWING


REF.DWG.NO.: -

PREPARED BY: cimtas

JOB NO	SHEET	SCALE	SIZE
2E00140	6/7	1/20	A1

DRAWING NO: 2E00140-CI-026-150

REV.: 0

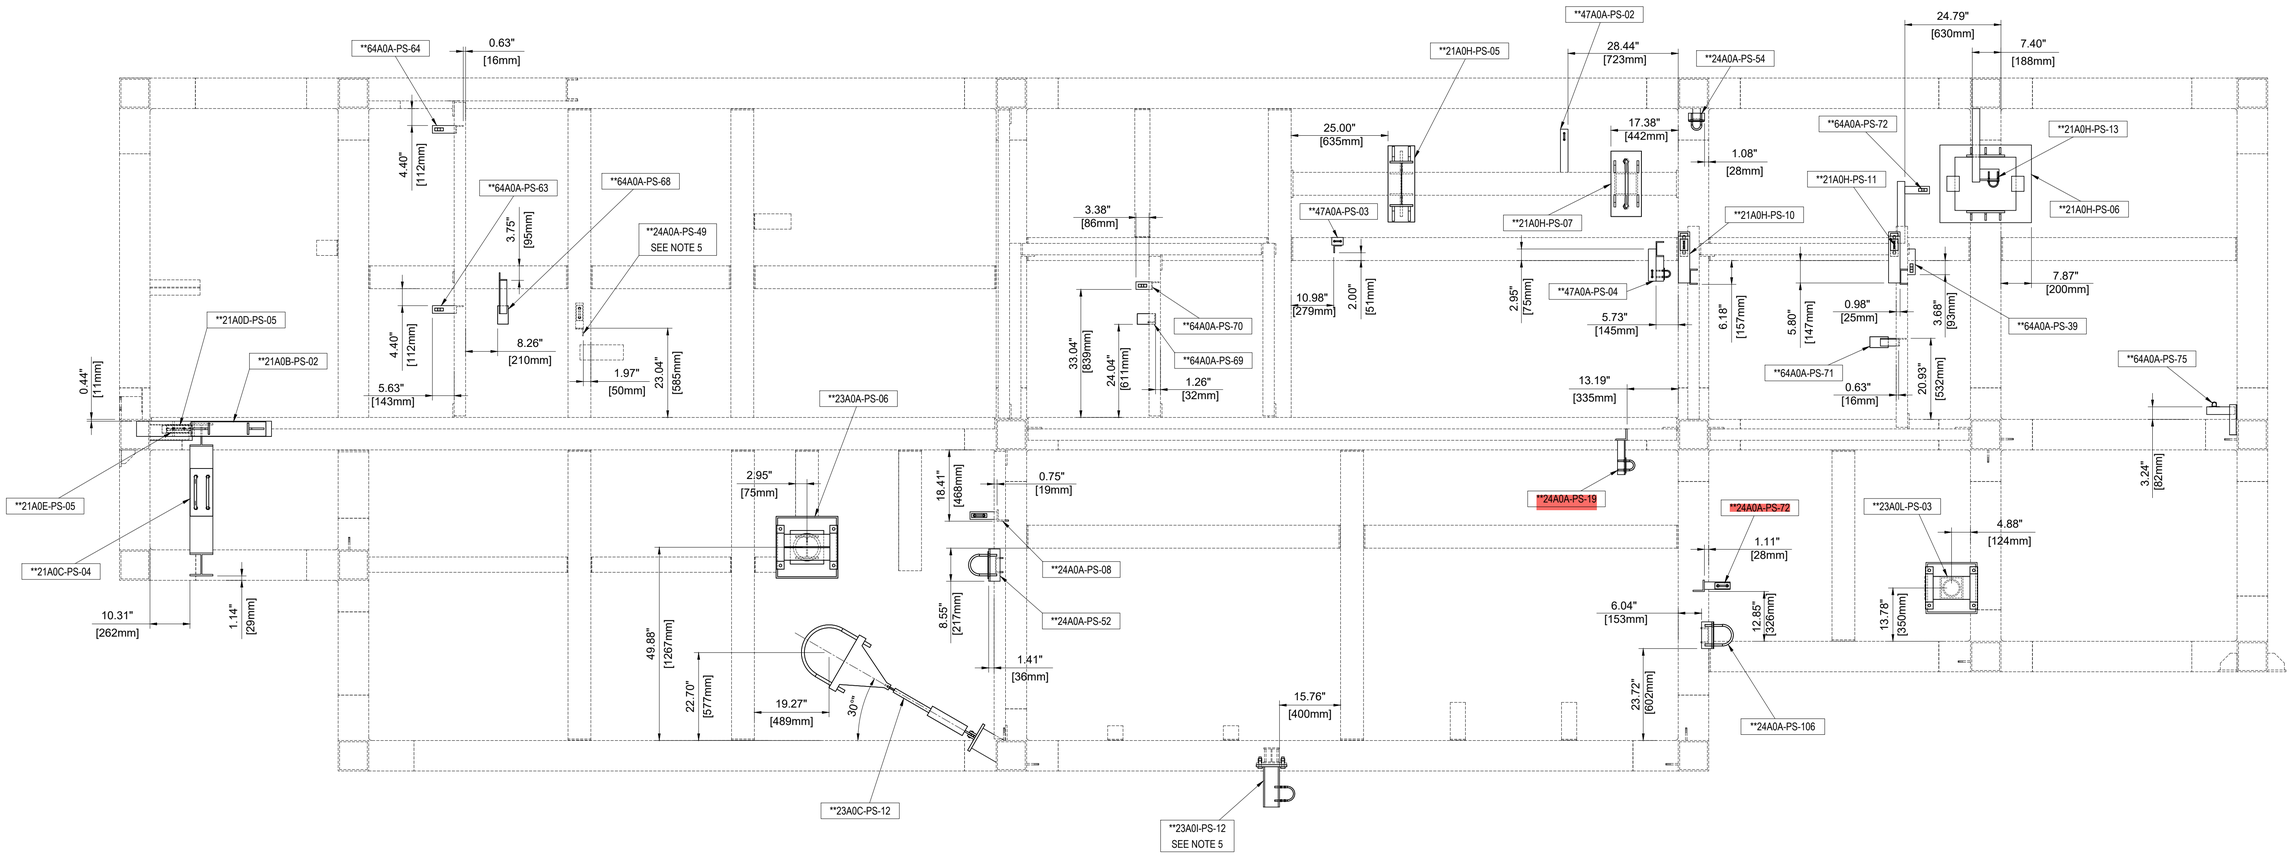

MD-2.2 SECTION H-H

REFERENCES

MDL ITEM #	MHPSA MDL DESCRIPTION	DETAILS FOR
N/A	FUEL GAS MAIN A PIPING (21A0A)	PIPE SUPPORT DRAWINGS
N/A	FUEL GAS MAIN B PIPING (21A0B)	"
N/A	FUEL GAS TOPHAT PIPING (21A0C)	"
N/A	FUEL GAS PILOT A PIPING (21A0D)	"
N/A	FUEL GAS PILOT B PIPING (21A0E)	"
N/A	FUEL GAS PIPING (21A0H)	"
N/A	LOW PRESSURE BLEED AIR PIPING (23A0A)	"
N/A	MIDDLE PRESSURE BLEED AIR PIPING (23A0B)	"
N/A	HIGH PRESSURE BLEED AIR PIPING (23A0C)	"
N/A	EXHAUST CYLINDER SEAL AIR PIPING (23A0I)	"
N/A	AIR INLET PRESSURE INSTRUMENT PIPING (23A0K)	"
N/A	TURBINE BYPASS PIPING (23A0U)	"
N/A	4S COOLING RETURN PIPING (23A0L)	"
N/A	INSTRUMENT AIR PIPING (24A0A)	"
N/A	N2 GAS PIPING (INTERNAL) (47A0A)	"
38	GT ENCLOSURE MODULE 2-2 DETAIL DRAWINGS	STRUCTURE

NOTES

1. DIMENSIONS : MM [INCHES]
2. **XXXX-XX-XX → SUPPORT TAG
3. GRATINGS ARE HIDDEN FOR A MORE CLEAR VIEW WHERE IT IS CONSIDERED NECESSARY
4. THE DIMENSIONS GIVEN IN THESE GENERAL ARRANGEMENT DRAWINGS ARE GIVEN FROM THE NEAREST PROFILES AND ARE THEORETICAL. DUE TO PRODUCTION TOLERANCES OF THE PROFILES AND MANUFACURING & ASSEMBLY TOLERANCES OF THE STEEL CONSTRUCTION SOME DIFFERENCES CAN BE OBSERVED IN REGARDS TO ORIGINAL SUPPORT THEORITICAL WORKING POINT COORDINATES AND ELEVATIONS. OUR SUGGESTION IS IN SUCH INCONVENIENT CASES, A CHECK SHALL BE MADE ACCORDING TO THE ELEVATION AND COORDINATES IN THE ORIGINAL SUPPORT DRAWINGS.
5. OFF MODULE SUPPORTS ARE GOING TO BE SITE MANUFACTURED AND ASSEMBLED.

REV.	DESCRIPTION	DATE	BY	CHECK	APPROVAL
0	ISSUED FOR CONSTRUCTION	26.07.2024	S.C.K.	S.S.	S.O.

This drawing is the property of Cimtas and all rights reserved

REVISIONS

CUSTOMER

PROPRIETARY AND CONFIDENTIAL:
This document contains Confidential and Proprietary information of Mitsubishi Power Americas, Inc. Neither this document, nor any information obtained therefrom is to be reproduced, transmitted or disclosed to any third party without first receiving the express written authorization of Mitsubishi Power Americas, Inc.
©2023 Mitsubishi Power Americas, Inc.

MITSUBISHI POWER

CUSTOMER JOB NO: -

ITEM NO: MDL-153

DWG NAME: MD-2.2 SUPPORTS GENERAL ARRANGEMENT DRAWING

REF.DWG.NO.: -

PREPARED BY: cimtas

JOB NO	SHEET	SCALE	SIZE
2E00140	7/7	1/20	A1

DRAWING NO: 2E00140-CI-026-150

REV.: 0