



Figure 4. Synthetic digital-gut-twin benchmark supports the anchored calibration trade-off.


a Simulated individual response recovery

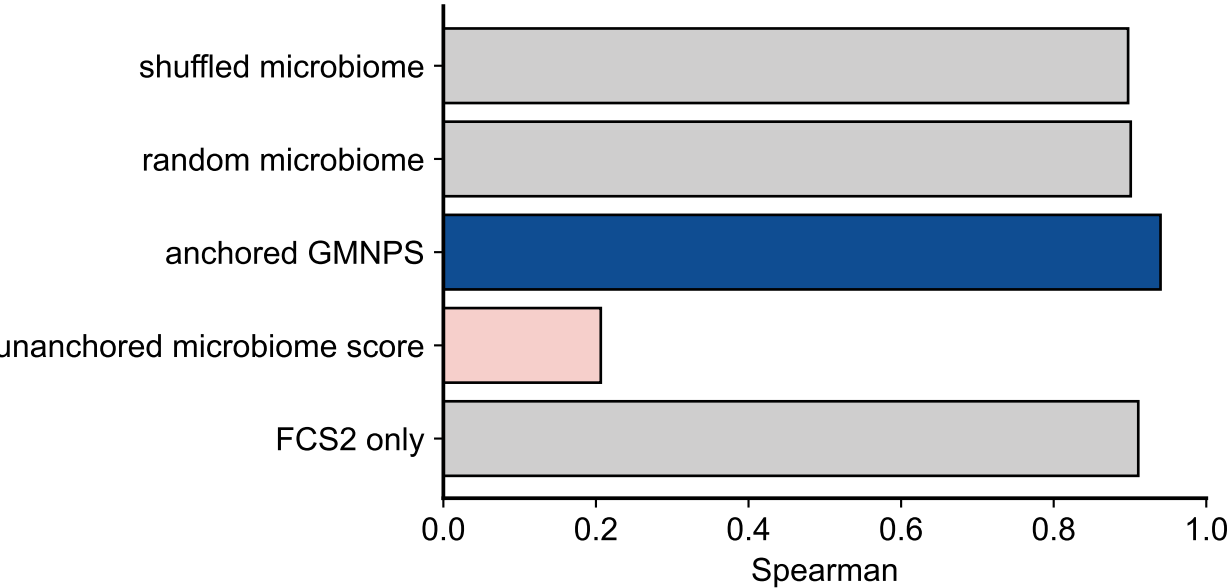

b Personalized residual recovery

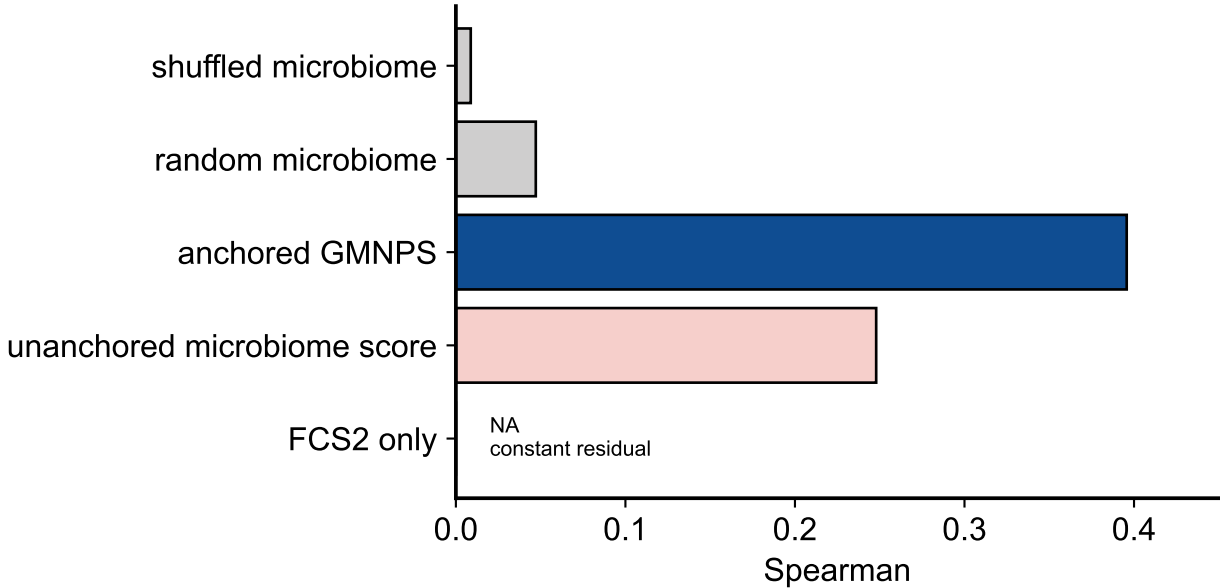

c Preservation-personalization trade-off

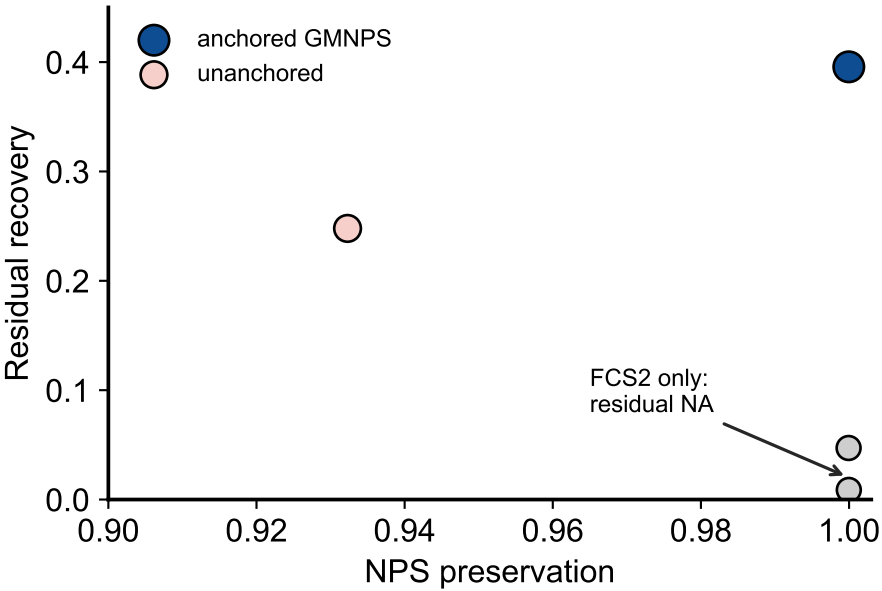

d Design ablation and negative controls

