Blue Trainer Bellows Drill

Protocol RT-TRAIN-014 · Revision 1 · Effective 1 June 2026 · Issued by the Lakeside Training Hospital Respiratory Education Committee (a fictional body).

1. Purpose

This invented protocol exists only to test Department Hub. It describes a classroom drill on the Blue Trainer bellows, a device that does not exist. Rates are counted in marks per minute (mk/min), a unit made up for this document.

2. Who may run the drill

Only a therapist who holds a current Blue Trainer card may run the drill. A student may run the drill only while a card holder is present in the room.

3. Drill order

A written drill order from the Simulation Lead is required before the drill is started. A verbal request is not a drill order.

4. Rates by age band

Age band	Starting rate	Highest rate	Recheck after
Adult (18 years and over)	12 mk/min	20 mk/min	10 minutes
Pediatric (under 18 years)	6 mk/min	10 mk/min	5 minutes

5. Adult drill

For an adult manikin, start the bellows at 12 mk/min. At each recheck, raise the rate by 2 mk/min while the green lamp stays lit. Never set an adult rate above 20 mk/min.

6. Pediatric drill

For a pediatric manikin, fit the small cuff and start the bellows at 6 mk/min. At each recheck, raise the rate by 1 mk/min while the green lamp stays lit. Never set a pediatric rate above 10 mk/min.

7. When the drill must not be started

Do not start the drill if the amber seal lamp on the manikin is lit, or if the bellows was serviced within the last 24 hours. This applies to adult and pediatric drills.

8. When to stop

Stop the drill at once if the red lamp lights or the gauge reads above 30 marks.

9. Who to call

After stopping, call the Simulation Lead. If the Simulation Lead does not answer within 5 minutes, call the Education Supervisor.
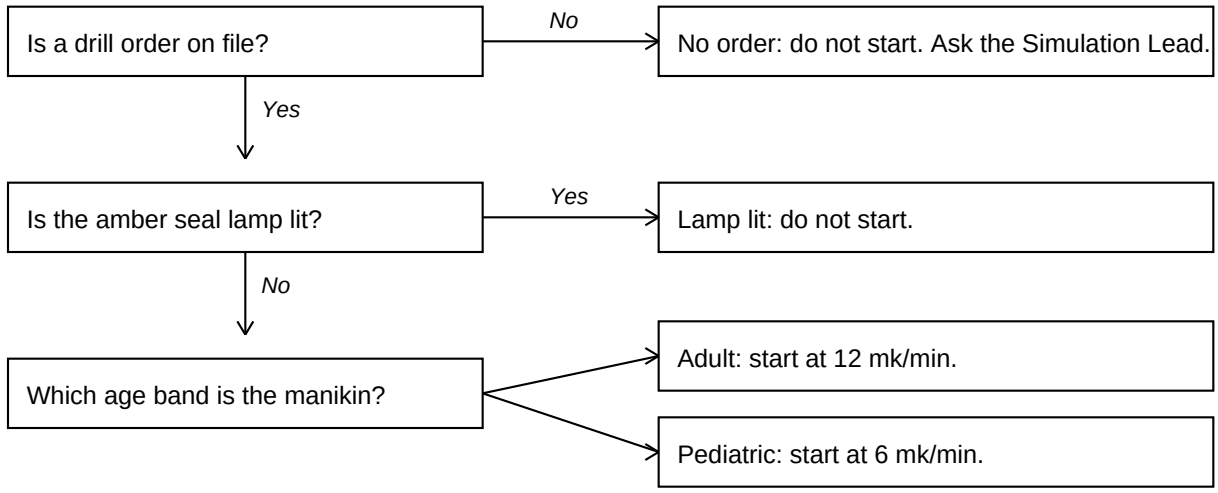
Figure 1. Start decision