WARNING: Deadly Voltage - Use Extreme Caution

CT CR8420-1000-G

GND

L1

L2

FUSE

FUSE

90-264V AC

GND

L1

L2

PILOT

J1772
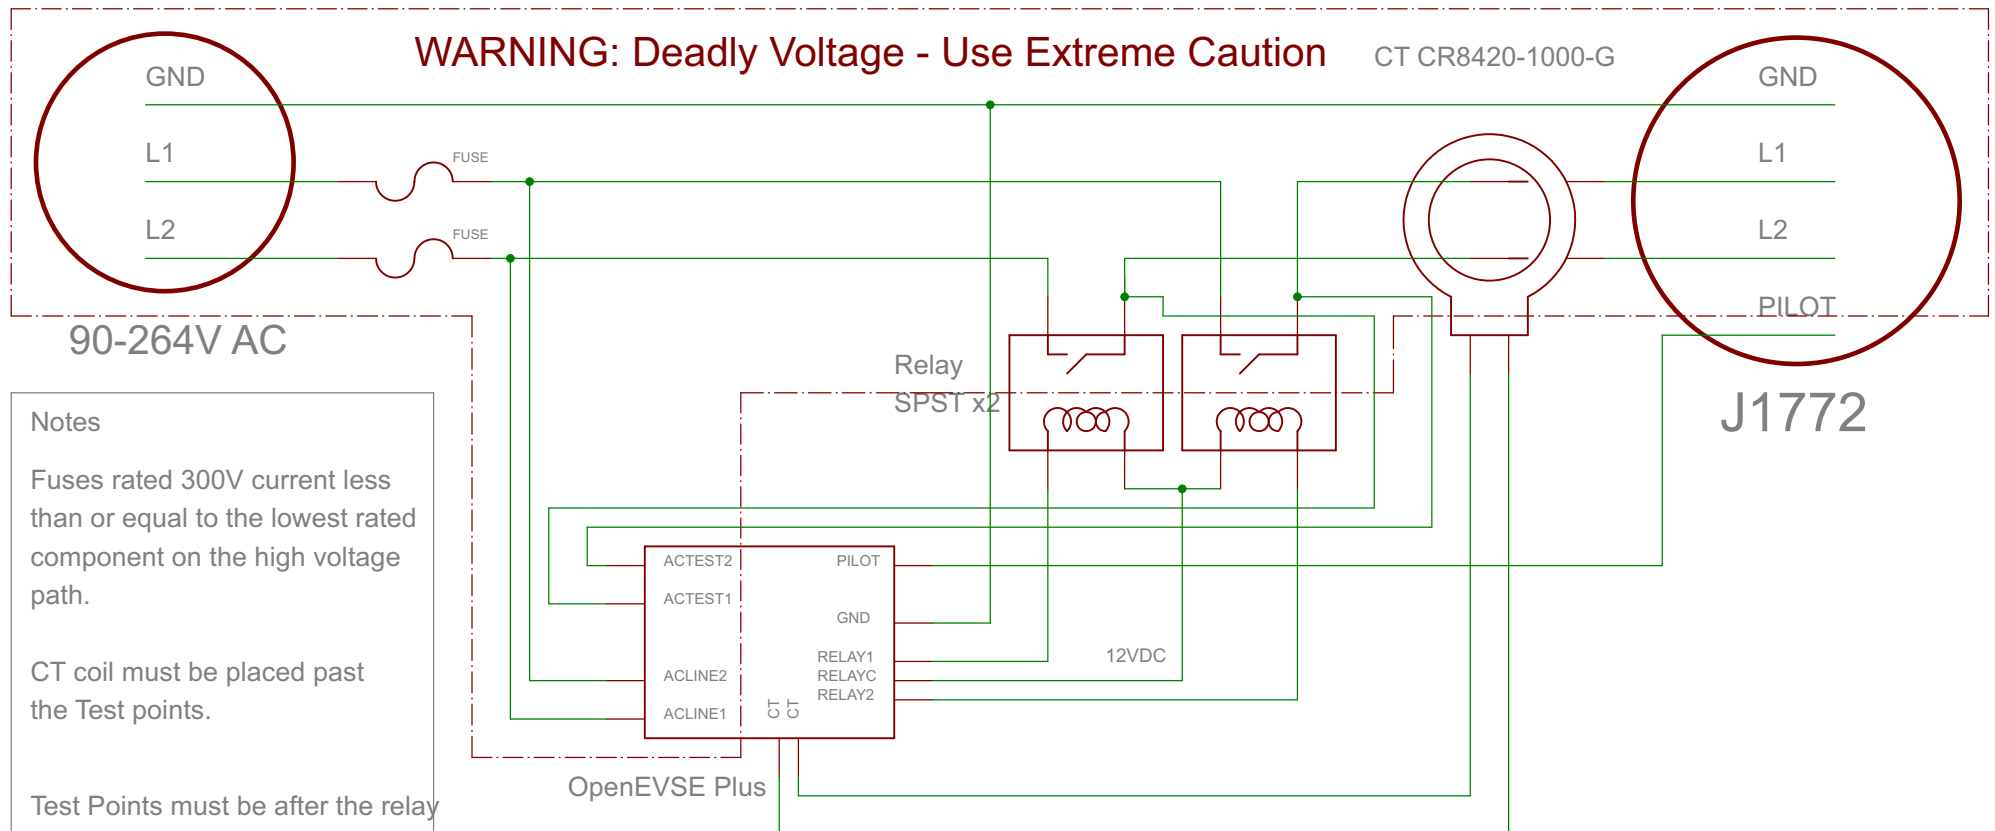
Relay
SPST x2

Notes

Fuses rated 300V current less than or equal to the lowest rated component on the high voltage path.

CT coil must be placed past the Test points.

Test Points must be after the relay but before the CT.

ACTEST2

ACTEST1

ACLINE2

ACLINE1

PILOT

GND

RELAY1
RELAYC
RELAY2

12VDC

CT
CT

OpenEVSE Plus

For More Information: http://code.google.com/p/open-evse/