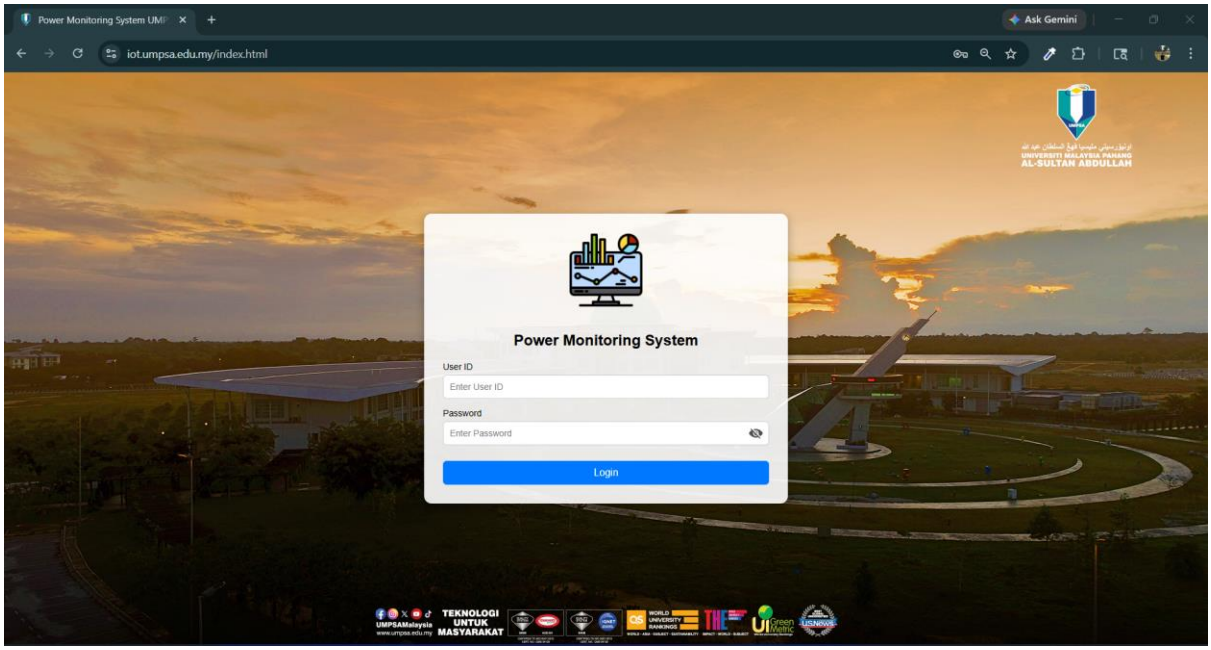
Power Monitoring System UMP
Ask Gemini
iot.umpsa.edu.my/index.html
UNIVERSITI MALAYSIA PAHANG
AL-SULTAN ABDULLAH
Power Monitoring System
User ID
Enter User ID
Password
Enter Password
Login
TEKNOLOGI
UNTUK
MASYARAKAT

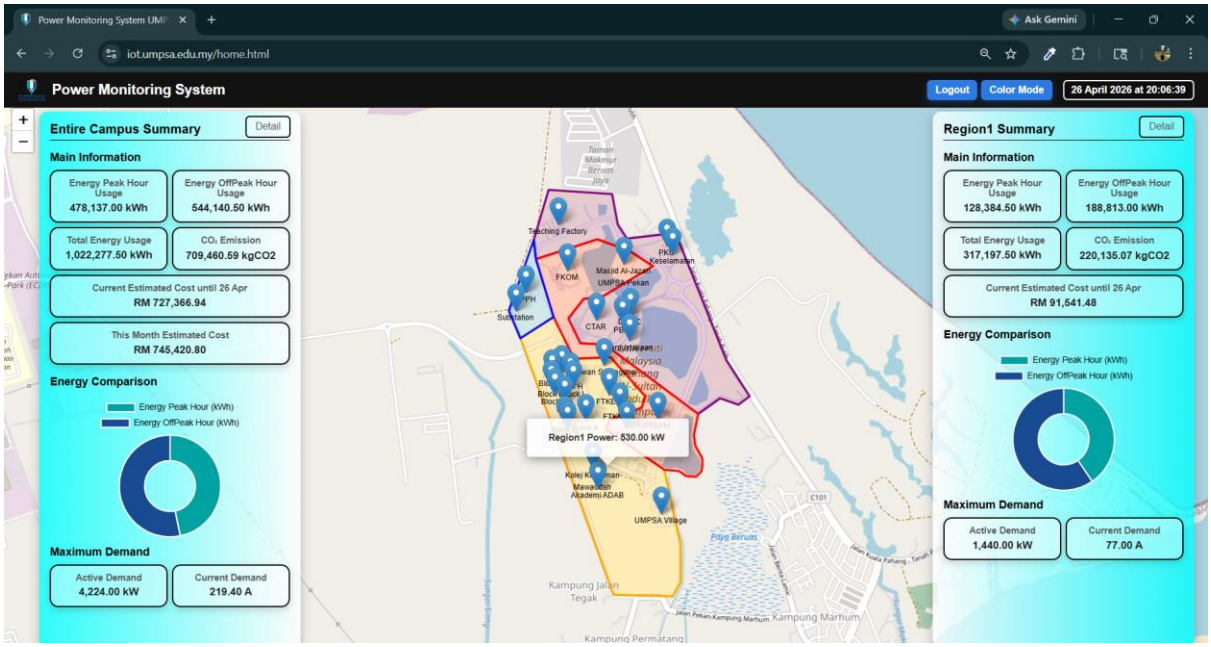
Power Monitoring System UMP
Ask Gemini
iot.umpsa.edu.my/home.html
Power Monitoring System
Logout
Color Mode
26 April 2026 at 20:06:39
Entire Campus Summary
Detail
Main Information
Energy Peak Hour Usage
478,137.00 kWh
Energy OffPeak Hour Usage
544,140.50 kWh
Total Energy Usage
1,022,277.50 kWh
CO₂ Emission
709,460.59 kgCO2
Current Estimated Cost until 26 Apr
RM 727,366.94
This Month Estimated Cost
RM 745,420.80
Energy Comparison
Energy Peak Hour (kWh)
Energy OffPeak Hour (kWh)
Maximum Demand
Active Demand
4,224.00 kW
Current Demand
219.40 A
Region1 Power: 530.00 kW
Teaching Factory
FKOM
Masjid Al-Jazari UMPSA Pekan
CTAR
UMPSA Village
Kampung Jalan Tegak
Kampung Marhum
Region1 Summary
Detail
Main Information
Energy Peak Hour Usage
128,384.50 kWh
Energy OffPeak Hour Usage
188,813.00 kWh
Total Energy Usage
317,197.50 kWh
CO₂ Emission
220,135.07 kgCO2
Current Estimated Cost until 26 Apr
RM 91,541.48
Energy Comparison
Energy Peak Hour (kWh)
Energy OffPeak Hour (kWh)
Maximum Demand
Active Demand
1,440.00 kW
Current Demand
77.00 A

Entire Campus Dashboard
Ask Gemini
iot.umpsa.edu.my/incomerTotal.html
Dashboard Entire Campus
View Incomer
Navigate Data
26 April 2026 at 20:08:11
Total Active Energy Entire Campus
Total Active Energy Peak Hour(kWh)
Total Active Energy OffPeak Hour(kWh)
1,200,000
1,000,000
800,000
600,000
400,000
200,000
0
Apr/20
Apr/21
Apr/22
Apr/23
Apr/24
Apr/25
Apr/26
Cost Energy Entire Campus
Cost Peak Energy (RM)
Cost OffPeak Energy (RM)
148,006.22
149,656.88
Current Estimated Cost Breakdown
Item | Value | Tariff | Amount
Cost Energy Peak | 478,137.00 kWh | RM 0.313/kWh | RM 149,656.88
Cost Energy OffPeak | 544,140.50 kWh | RM 0.272/kWh | RM 148,006.22
AFA* | - | - | RM 0.00
Cost Capacity | 4,224.00 kW | RM 30.19/kW | RM 127,522.56
Cost Network | 4,224.00 kW | RM 66.87/kW | RM 282,458.88
Retailing Charge | - | - | RM 200.00
Rebate | RM 707,844.54 | 10% | -RM 70,784.45
Load Connection Charge* | 2,900.00 kW | RM 8.50 | RM 24,650.00
Cost Total Usage | - | - | RM 661,710.09
Cost Renewable Energy | RM 637,060.09 | 1.6% | RM 10,192.96
Cost Utility | - | - | RM 671,903.05
Cost Solar* | 191,254.80 kWh | RM 0.29/kWh | RM 55,463.89
Current Estimated Cost | - | - | RM 727,366.94
TEKNOLOGI UNTUK MASYARAKAT

Entire Campus Dashboard
Ask Gemini
iot.umpsa.edu.my/incomerTotal.html
Daily Estimated Cost
Estimated Cost (RM)
780,000
760,000
740,000
720,000
700,000
680,000
660,000
640,000
RM 649531.17
RM 666672.02
RM 681675.02
RM 697131.45
RM 713385.82
RM 722944.49
RM 727366.94
Apr/20
Apr/21
Apr/22
Apr/23
Apr/24
Apr/25
Apr/26
Total Active Energy by Region
Energy Region1(kWh)
Energy Region2(kWh)
Energy Region3(kWh)
Energy Region5(kWh)
97,915.94
317,197.50
280,635.00
350,642.50
Cost Energy by Region
Cost Energy Region1 (RM)
Cost Energy Region2 (RM)
Cost Energy Region3 (RM)
Cost Energy Region5 (RM)
28,064.27
91,541.48
81,213.27
103,165.07
TEKNOLOGI UNTUK MASYARAKAT

Entire Campus Dashboard
Ask Gemini
iot.umpsa.edu.my/incomerTotal.html
Daily Power Demand Entire Campus
Total Active Demand(kW)
Power Demand Entire Campus
Total Maximum Demand(kW)
Total Active Power(kW)
Highest Demand This Month: 4224.00 kW @ 2026-04-15 15:46:31

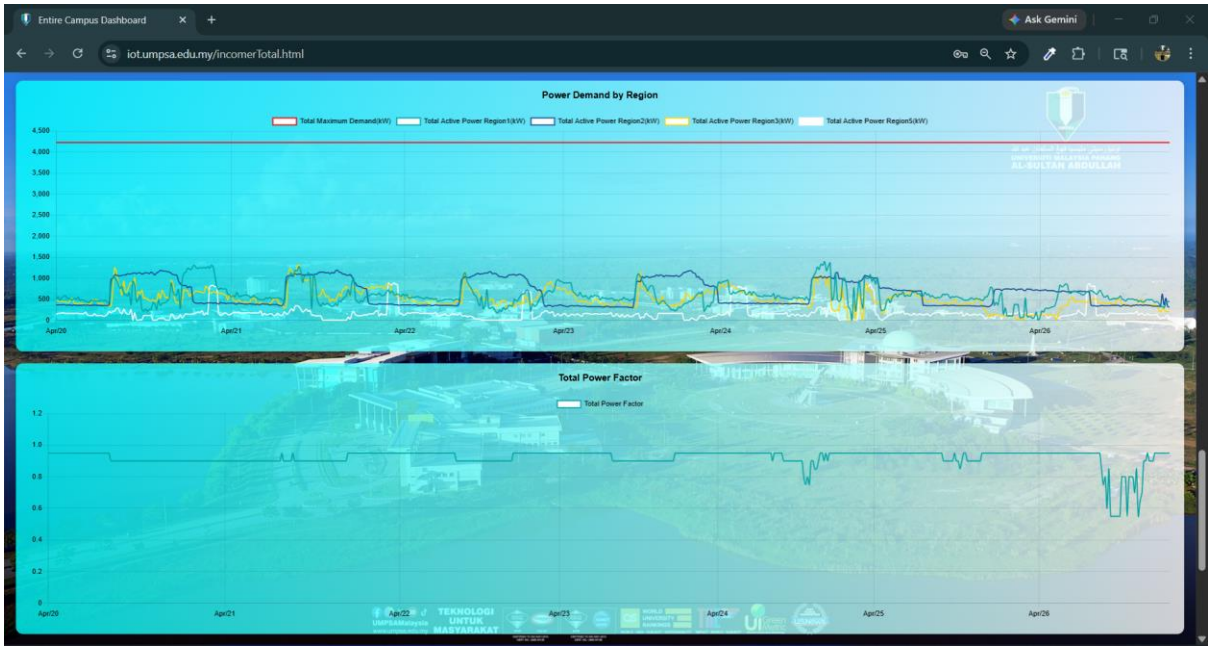
Entire Campus Dashboard
Ask Gemini
iot.umpsa.edu.my/incomerTotal.html
Power Demand by Region
Total Maximum Demand(kW)
Total Active Power Region1(kW)
Total Active Power Region2(kW)
Total Active Power Region3(kW)
Total Active Power Region5(kW)
Total Power Factor
Total Power Factor

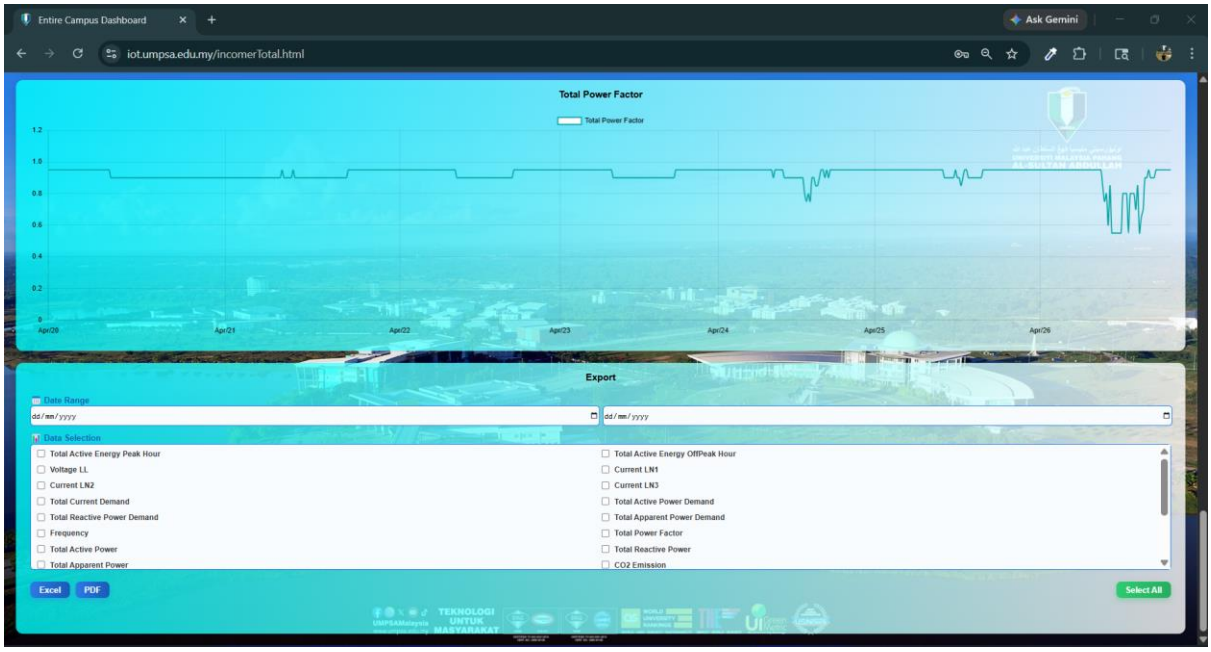
Entire Campus Dashboard
Ask Gemini
iot.umpsa.edu.my/incomerTotal.html
Total Power Factor
Total Power Factor
1.2
1.0
0.8
0.6
0.4
0.2
0
Apr/20
Apr/21
Apr/22
Apr/23
Apr/24
Apr/25
Apr/26
Export
Date Range
dd/mm/yyyy
dd/mm/yyyy
Data Selection
Total Active Energy Peak Hour
Voltage LL
Current LN2
Total Current Demand
Total Reactive Power Demand
Frequency
Total Active Power
Total Apparent Power
Total Active Energy OffPeak Hour
Current LN1
Current LN3
Total Active Power Demand
Total Apparent Power Demand
Total Power Factor
Total Reactive Power
CO2 Emission
Excel
PDF
Select All